

---

---

# COX

Research and Technology, Inc.

---

---

ELMWOOD MARINE SERVICE  
CONVENT, LA  
DUPLEX BLOWER  
CONTROL PANEL

Cox Research and Technology, Inc.  
14697 S. Harrells Ferry Road  
Baton Rouge, LA. 70816  
(225) 756-3271 Fax (225) 755-1030

CP-2038

VOLTAGE	<u>277/480V</u>	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	<u>3/60</u>	
NO. MOTORS	<u>2</u>	
HP	<u>1.5</u>	
FLA	<u>3.0</u>	
TYPE OF PUMP	<u>Blower</u>	(Self-Priming, Submersible)
MANUFACTURER	<u></u>	
CATALOG NUMBER	<u></u>	
CONTROL VOLTAGE	<u>120V</u>	(120V, Other)
ENCLOSURE	<u>NEMA 4X</u>	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	<u>Fiberglass</u>	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	<u></u>	(Floats, Bubbler, Other)
CAPACITORS	<u></u>	(Yes, No)
CAPACITOR WIRING FIGURE	<u></u>	
THERM. & SEAL FAIL WIRING FIGURE	<u></u>	

OPTIONS:


SEAL FAIL LIGHTS	<u></u>	(Submersible Only)
SEAL FAIL RELAYS	<u></u>	(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	<u></u>	(Submersible Only)
HT PUMP SHUTDOWN	<u></u>	(Self-Primer, Submersible)
ALARM HORN	<u></u>	
ALARM LIGHT	<u></u>	
LIGHT PANEL MTD	<u></u>	
LIGHT REMOTE MTD	<u></u>	
LIGHT FLASHER	<u></u>	
LIGHTNING ARRESTER	<u></u>	
ELAPSED TIME METER	<u></u>	
PHASE MONITOR	<u></u>	
NEMA RATED STARTERS	<u></u>	
GROUND FAULT RECPT.	<u></u>	
GREEN RUN LIGHTS VS. RED	<u></u>	
POLE, BOX, SEAL	<u></u>	
INTRINSICALLY SAFE RELAYS	<u></u>	
HIGH TEMP. LOCKOUT, MANUAL RESET	<u></u>	
ECONOMY VERSION	<u></u>	


SOLD TO: Delta Process, Ruston, LA

TAG : Elmwood Marine Service

Convent, LA

SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 4/20/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">   <b>COX</b>  Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX BLOWER CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2038
							SHEET NUMBER 1

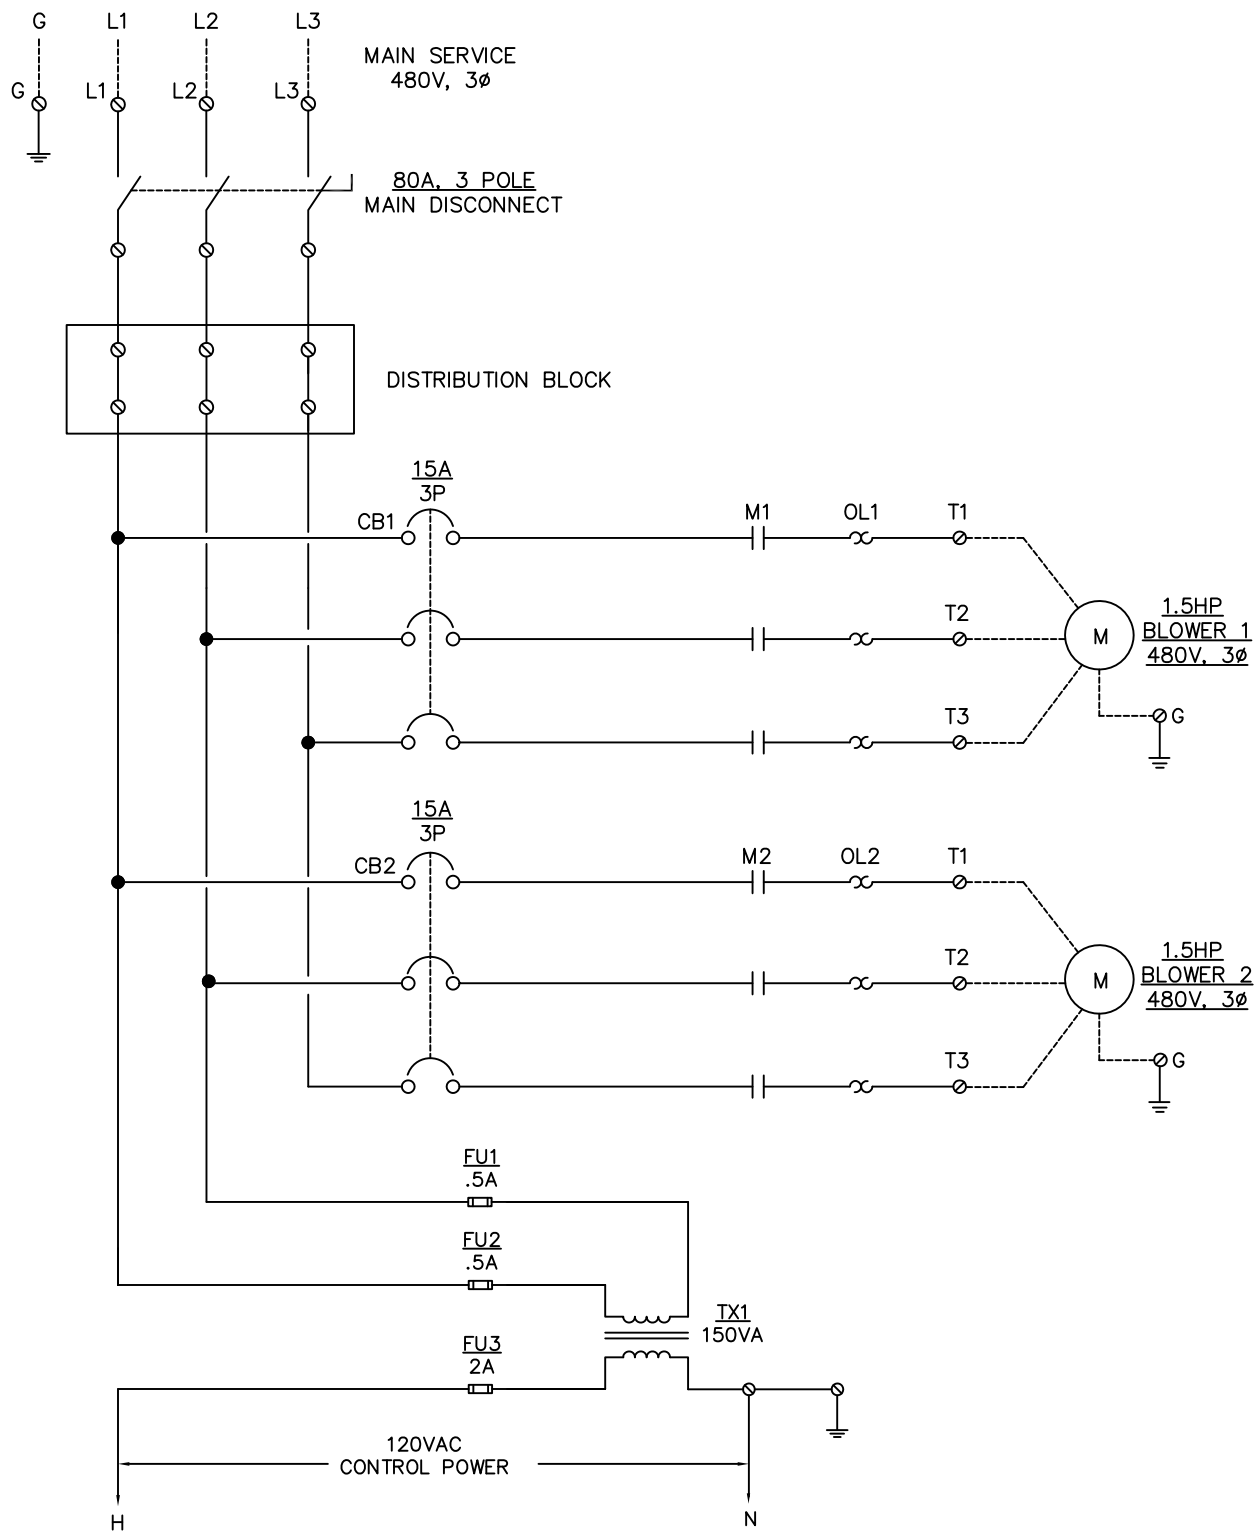


	Drawing Title								
	POWER DIAGRAM								
DATE		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
4/20/05		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL		APPROVED		
	Project Title							PURCHASE ORDER NUMBER	
	DUPLEX BLOWER CONTROL PANEL							DRAWING NUMBER CP-2038	
								SHEET NUMBER	2

**COX**

Research and Technology, Inc.

P.O. Box 77808  
Baton Rouge, LA  
70809

Ph. (225)756-3271  
Fax (225)755-1030

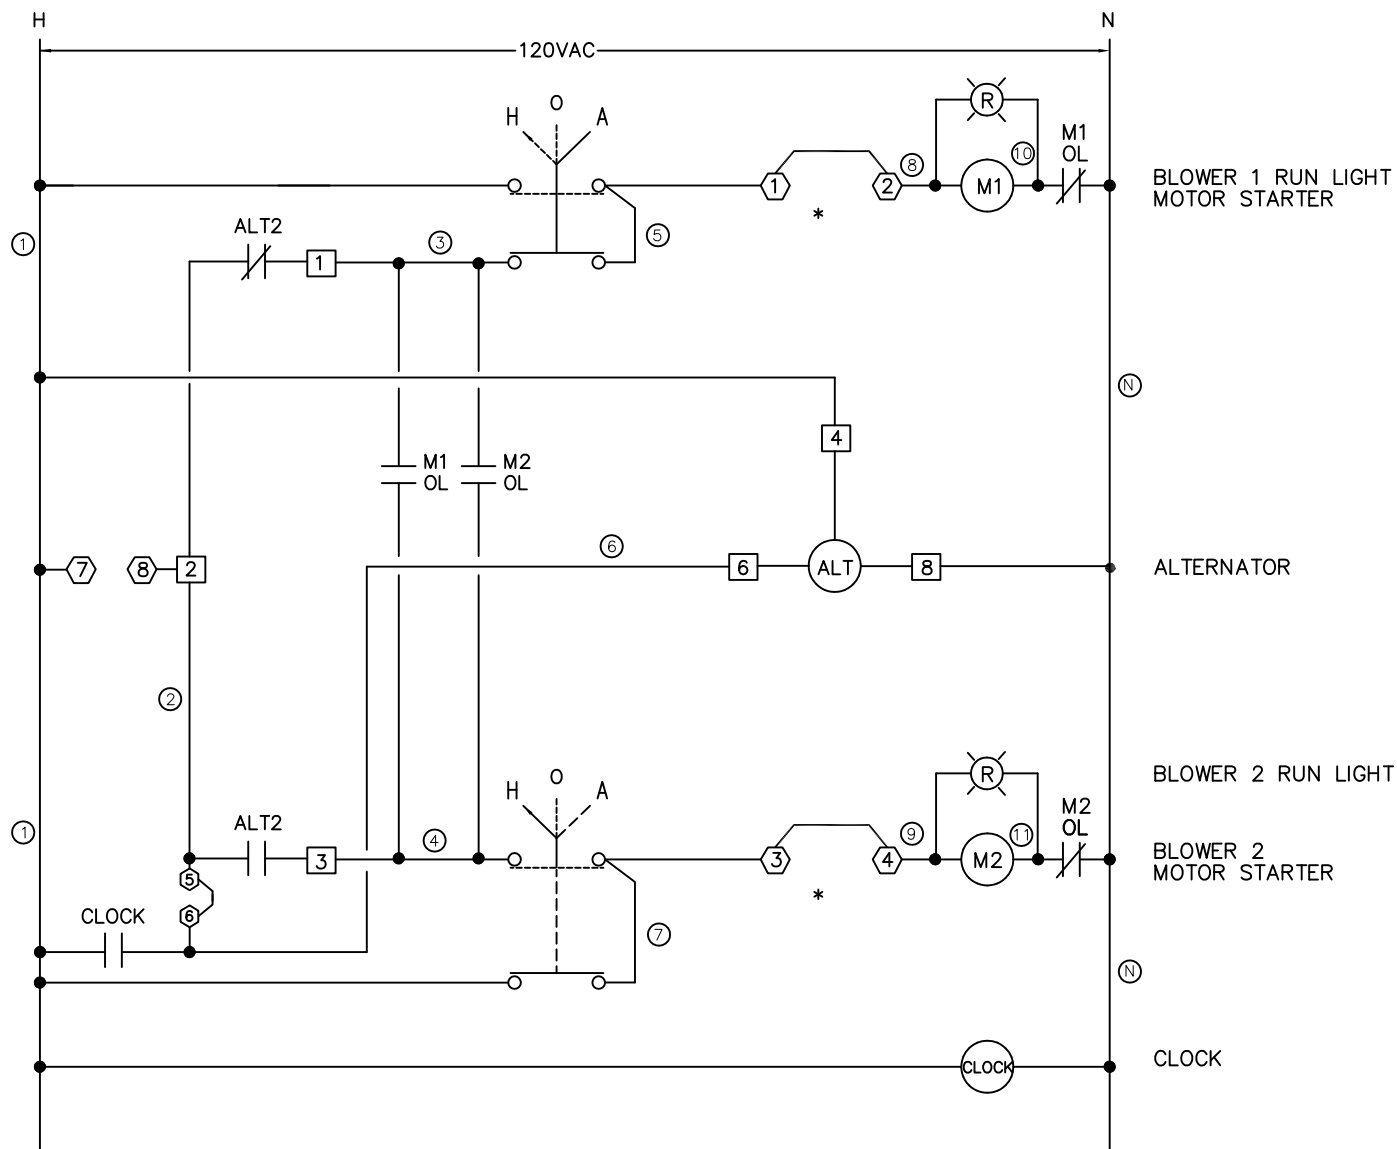


PANEL IS DESIGNED TO RUN AERATORS WITH A MINIMUM OF 15 MINUTES OF OFF TIME BETWEEN ALTERNATION. PINS PUSHED OUT ON CLOCK INDICATE RUN TIME. PINS PUSHED IN INDICATE OFF TIME. EACH PIN IS EQUAL TO 15 MINUTES.

IF NO OFF TIME IS REQUIRED BETWEEN ALTERNATION, REMOVE JUMPER FROM TERMINALS ⑤ AND ⑥ PLACE JUMPER ACROSS TERMINALS ⑦ AND ⑧ NOW AERATORS WILL RUN CONTINUOUSLY. SET 1 PIN IN AT THE TIME YOU WISH THE AERATORS TO ALTERNATE. ALL REMAINING PINS SHOULD BE PUSHED OUT.

REMOVE JUMPERS AND INSTALL LOCKOUT DEVICES IF REQUIRED

Drawing Title							
CONTROL DIAGRAM							
DATE 4/20/05	REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
	S/N		Sales Engineer C.C.		Application Engineer R.C.		DATE
Project Title		DRAWN		APPROVED		BY	
DUPLEX BLOWER CONTROL PANEL		BY C. RACHAL				DATE	
		P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER			
		Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-2038			
				SHEET NUMBER		3	



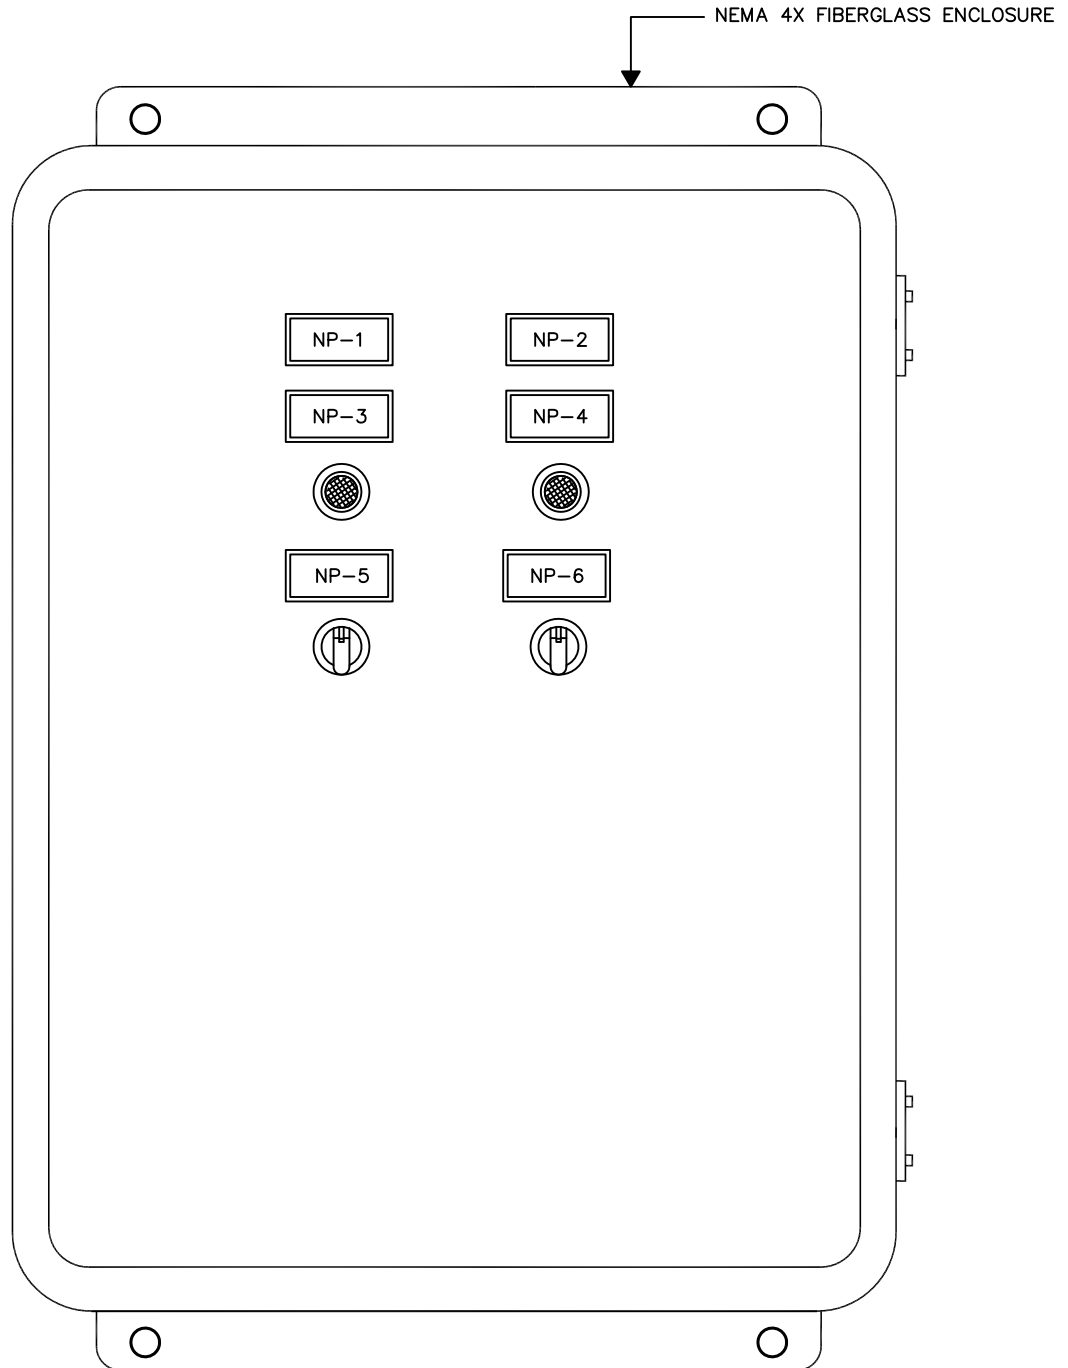

VIEW OF FRONT COVER

NAMEPLATE SCHEDULE

**NOTE:**  
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.  
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE  
PANEL TO PREVENT ENTRY OF GASSES.

NP-1	BLOWER 1
NP-2	BLOWER 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

DATE 4/20/05	Drawing Title							
	ENCLOSURE							
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
	Project Title	S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED	BY	DATE
	DUPLEX BLOWER CONTROL PANEL	<div> <div>COX</div> <div>Research and Technology, Inc.</div> </div>			P.O. Box 77808 Baton Rouge, LA 70809  Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER	
							DRAWING NUMBER CP-2038	
							SHEET NUMBER 5	

# BILL OF MATERIAL

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPL	ENCLOSURE
2	1	STAHLIN	BP1816AL	BACKPLATE
3	2	ABB	A16-30-10-84	STARTER
4	2	ABB	TA25DU4.0	O.L. (2.8-4.0A)
5	2	ABB	S1N015TL	CIRCUIT BREAKER 1,2
6	2	ACI	JR22P3M20B	H.O.A. SWITCH
7	1	TIMEMARK	261DT120	ALTERNATING RELAY
8	1	GRASSLIN	FM/1 STUZH-L	TIMER
9	2	ACI	JR22FR	RED PILOT LIGHT
10	1	ABB	T4150PSF1	TRANSFORMER
11	1	ABB	OT63E3	DISCONNECT SWITCH

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 4/20/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>		<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-2038</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER 6</p>		
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>			<p style="margin: 0; font-size: small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: small;">DRAWING NUMBER CP-2038</p> <hr/> <p style="margin: 0; font-size: small;">SHEET NUMBER 6</p>	
	DUPLEX BLOWER CONTROL PANEL							