


MAIN SERVICE
120/240V, 1Ø

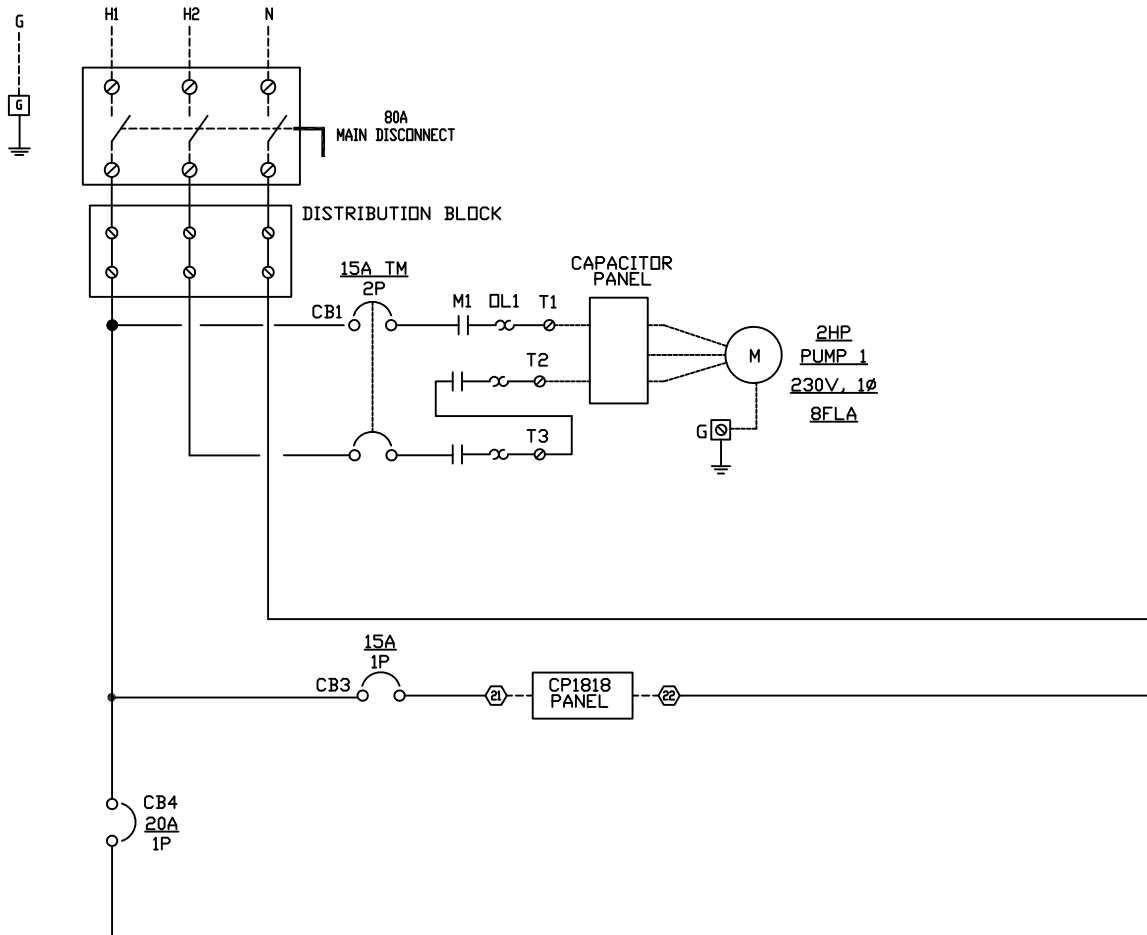

LEGEND

— WIRING BY VENDOR
- - - WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM
PULSE 6 FIELDS W/O
BACKWASH VALVE r1



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

Schematic Diagram Filter System


DWN BY:
C.RACHAL

DATE:
5/25/06

SCALE:
N.T.S.

DWG. NO.:
1 OF 6

JOB NO.:
CP-2392

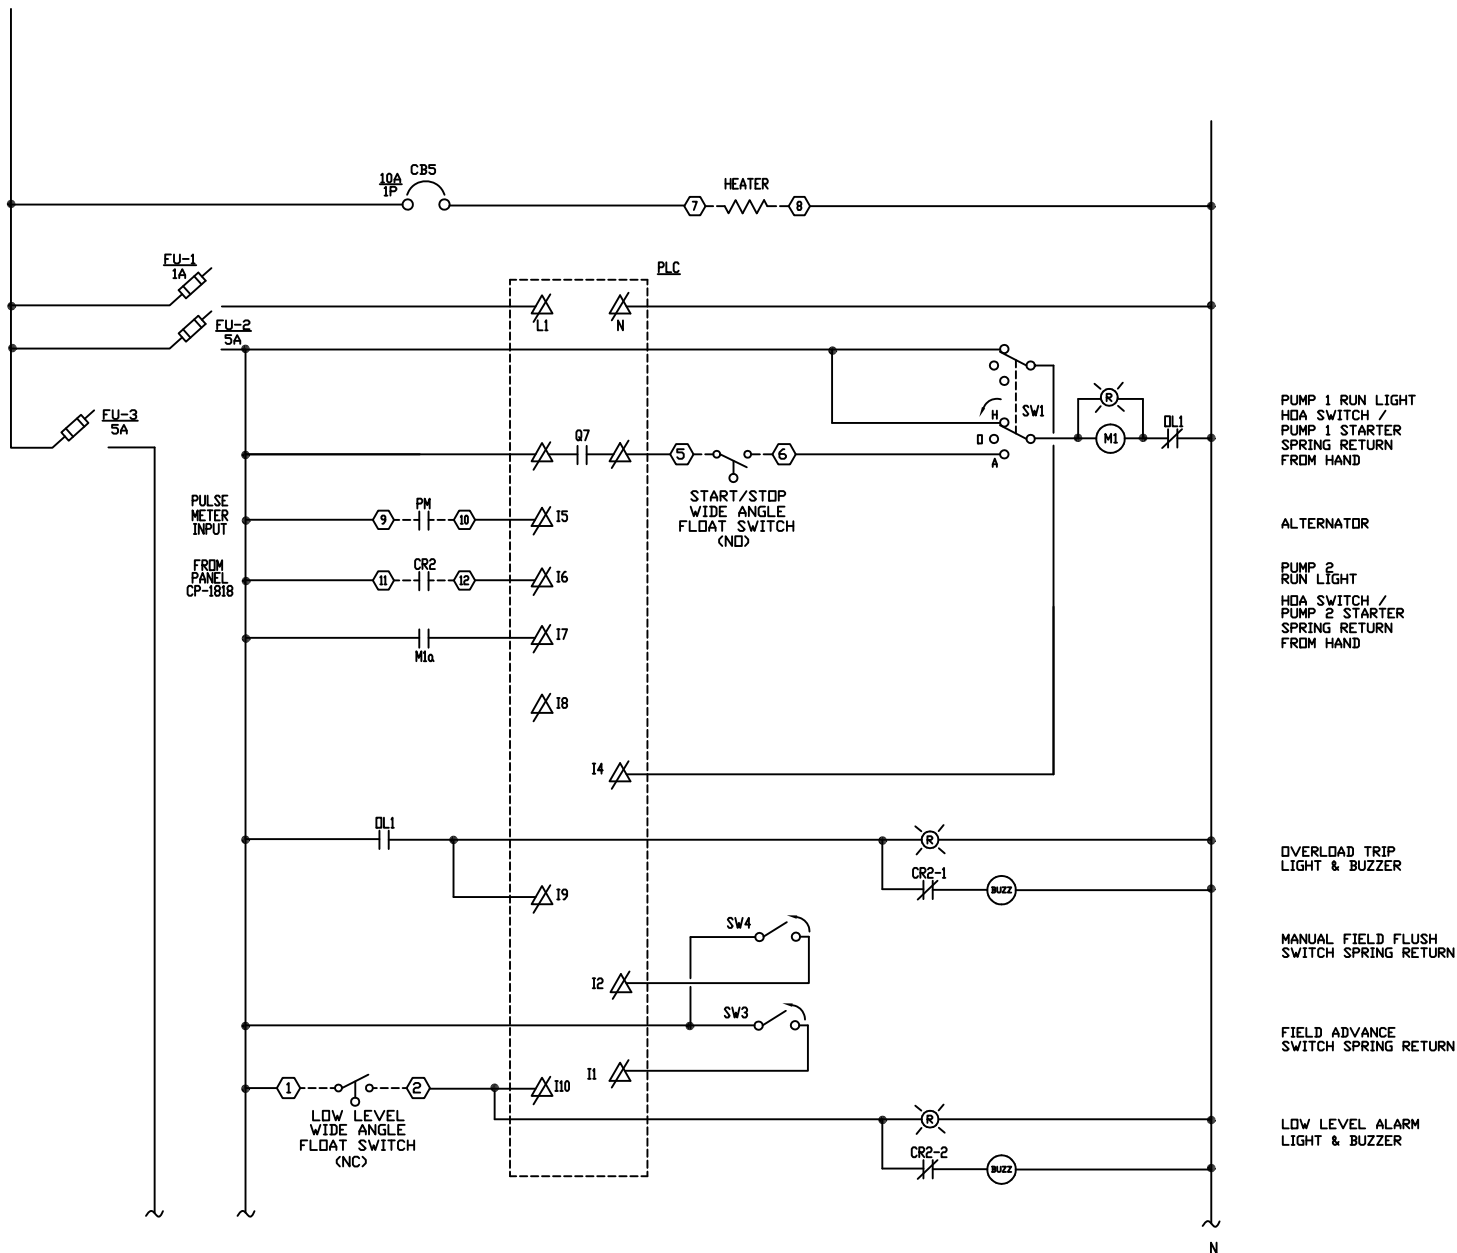


LEGEND

—	WIRING BY VENDOR
---	WIRING BY CUSTOMER

NOTE

1. INTERNAL PUMP THERMAL OVERLOAD IS RECOMMENDED.
2. PLC WILL INDICATE NUMBER OF HIGH LEVEL ALARMS AND NUMBER OF TIMES A PUMP IS TURNED TO HAND POSITION.

PROGRAM
PULSE 6 FIELDS W/D
BACKWASH VALVE P1



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL


DATE:
5/25/06

SCALE:
N.T.S.

DWG. NO.:
2 OF 6

JOB NO.:
CP-2392

Schematic Diagram Filter System

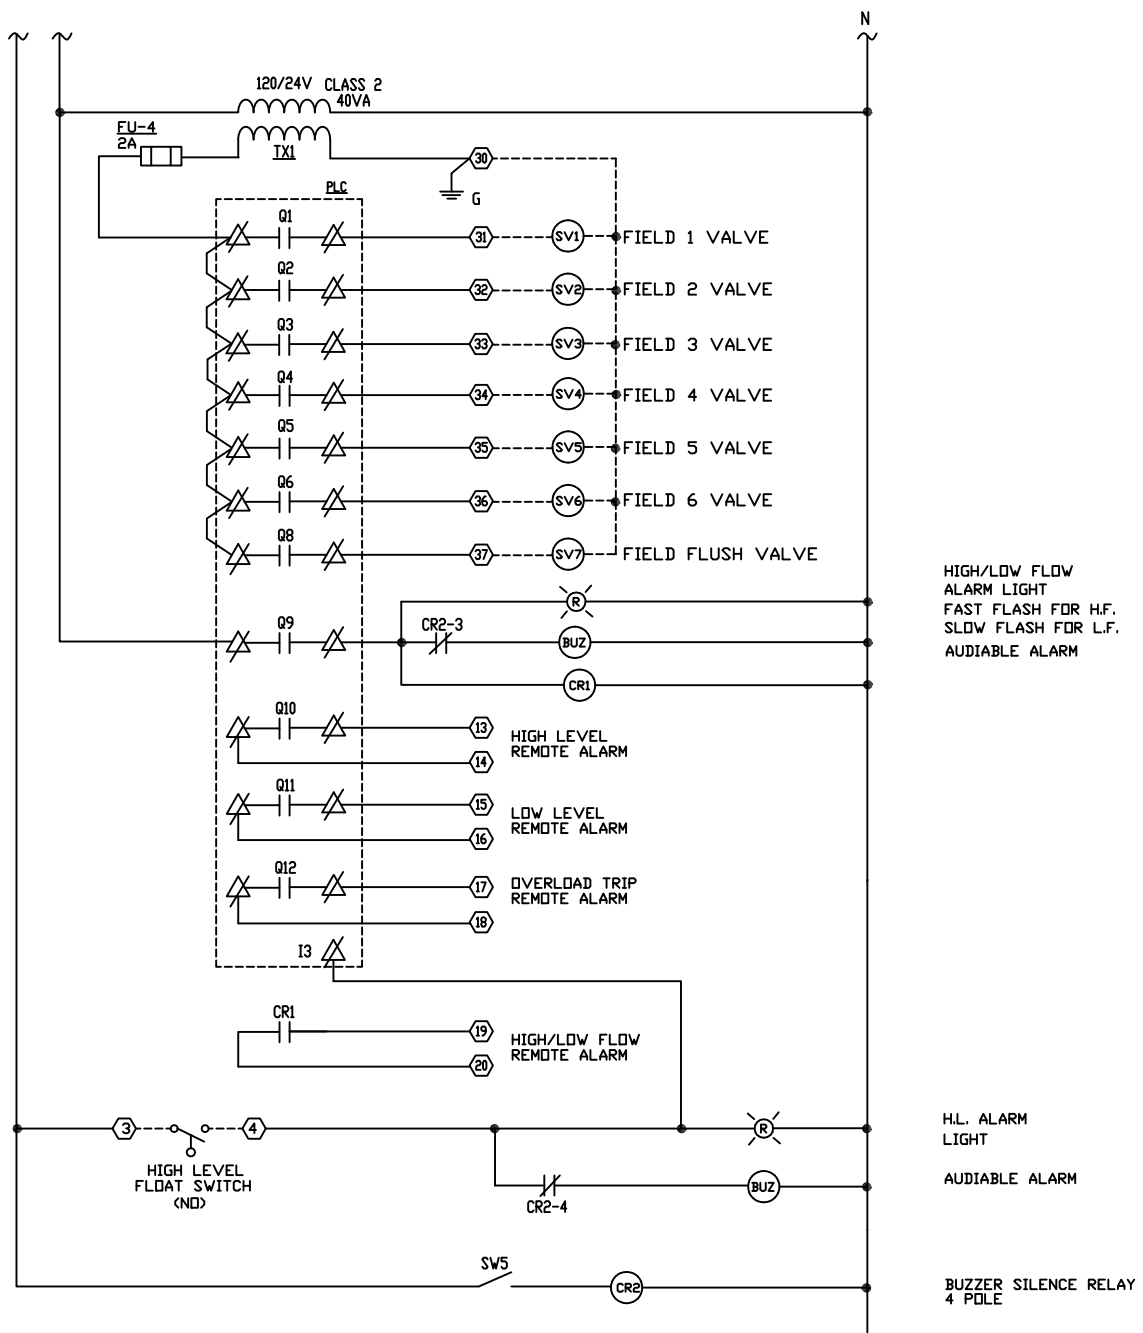

Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL




DATE:
5/25/06

SCALE:
N.T.S.


DWG. NO.:
3 OF 6

JOB NO.:
CP-2392


Schematic Diagram Filter System

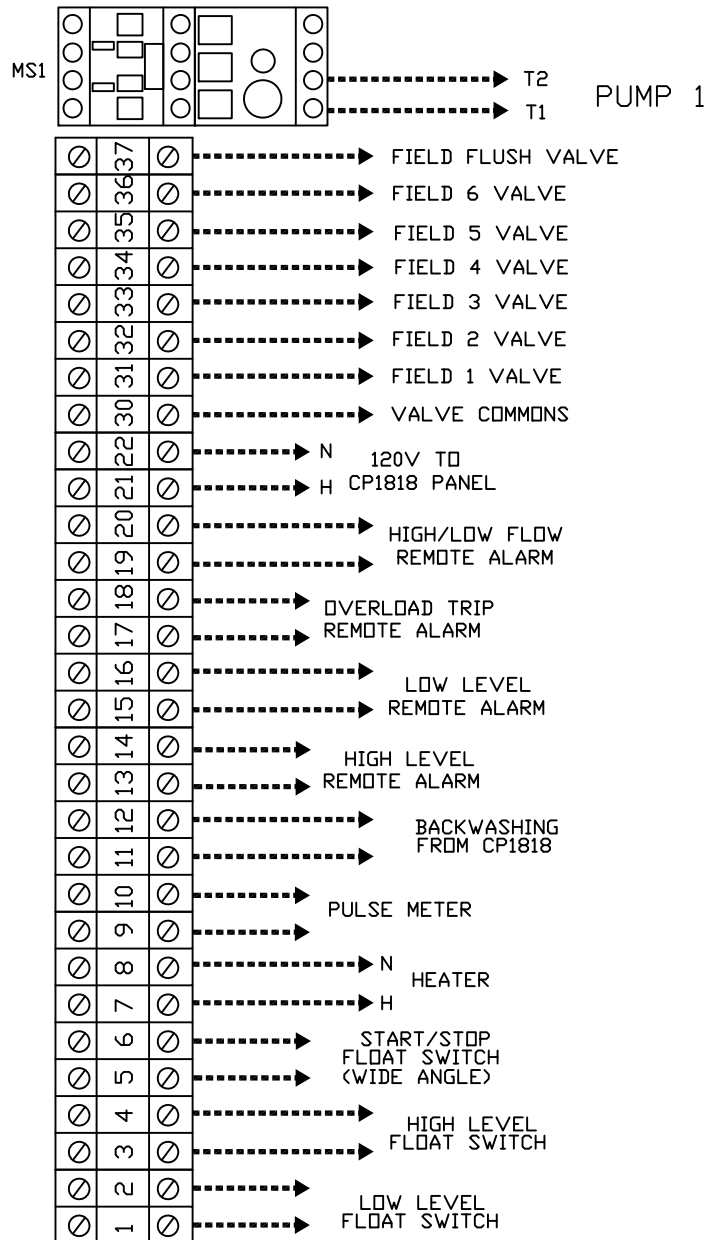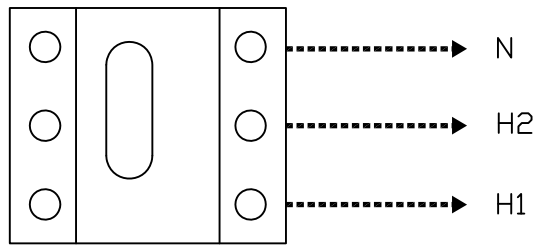

Schematic Diagram Filter System

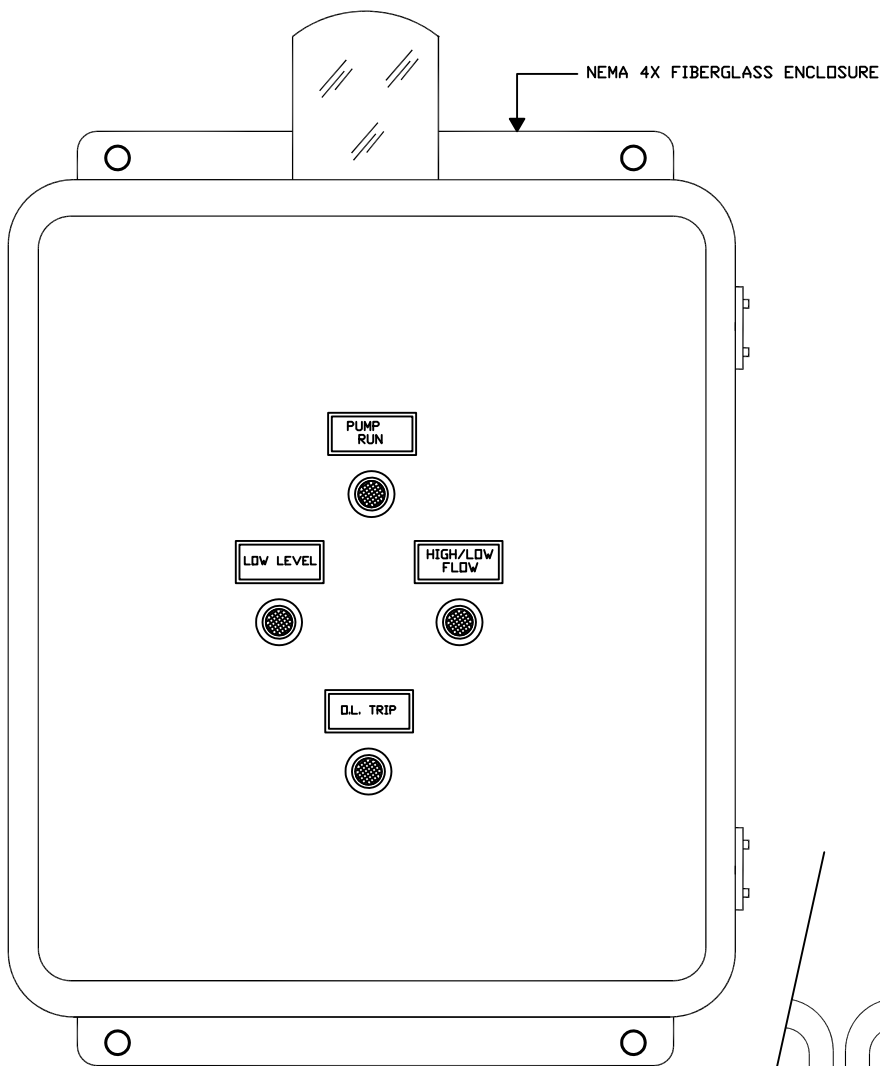

VIEW OF FRONT OF ENCLOSURE

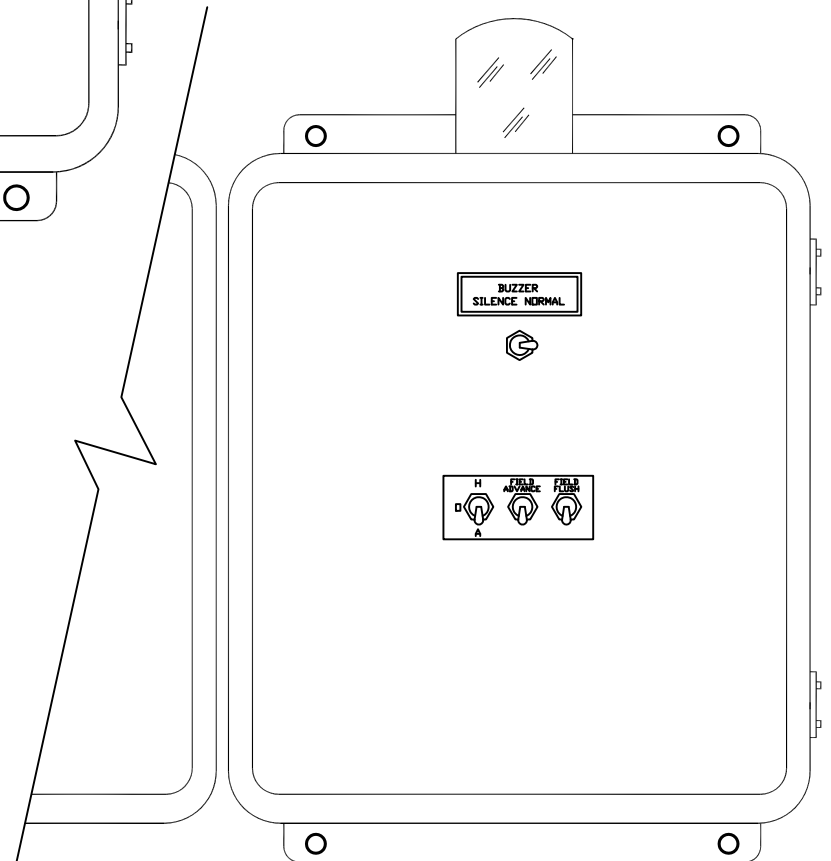

VIEW OF SWING PANEL



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL


DATE:
5/25/06

SCALE:
N.T.S.

DWG. NO.:
5 OF 6

JOB NO.:
CP-2392

ENCLOSURE Filter System

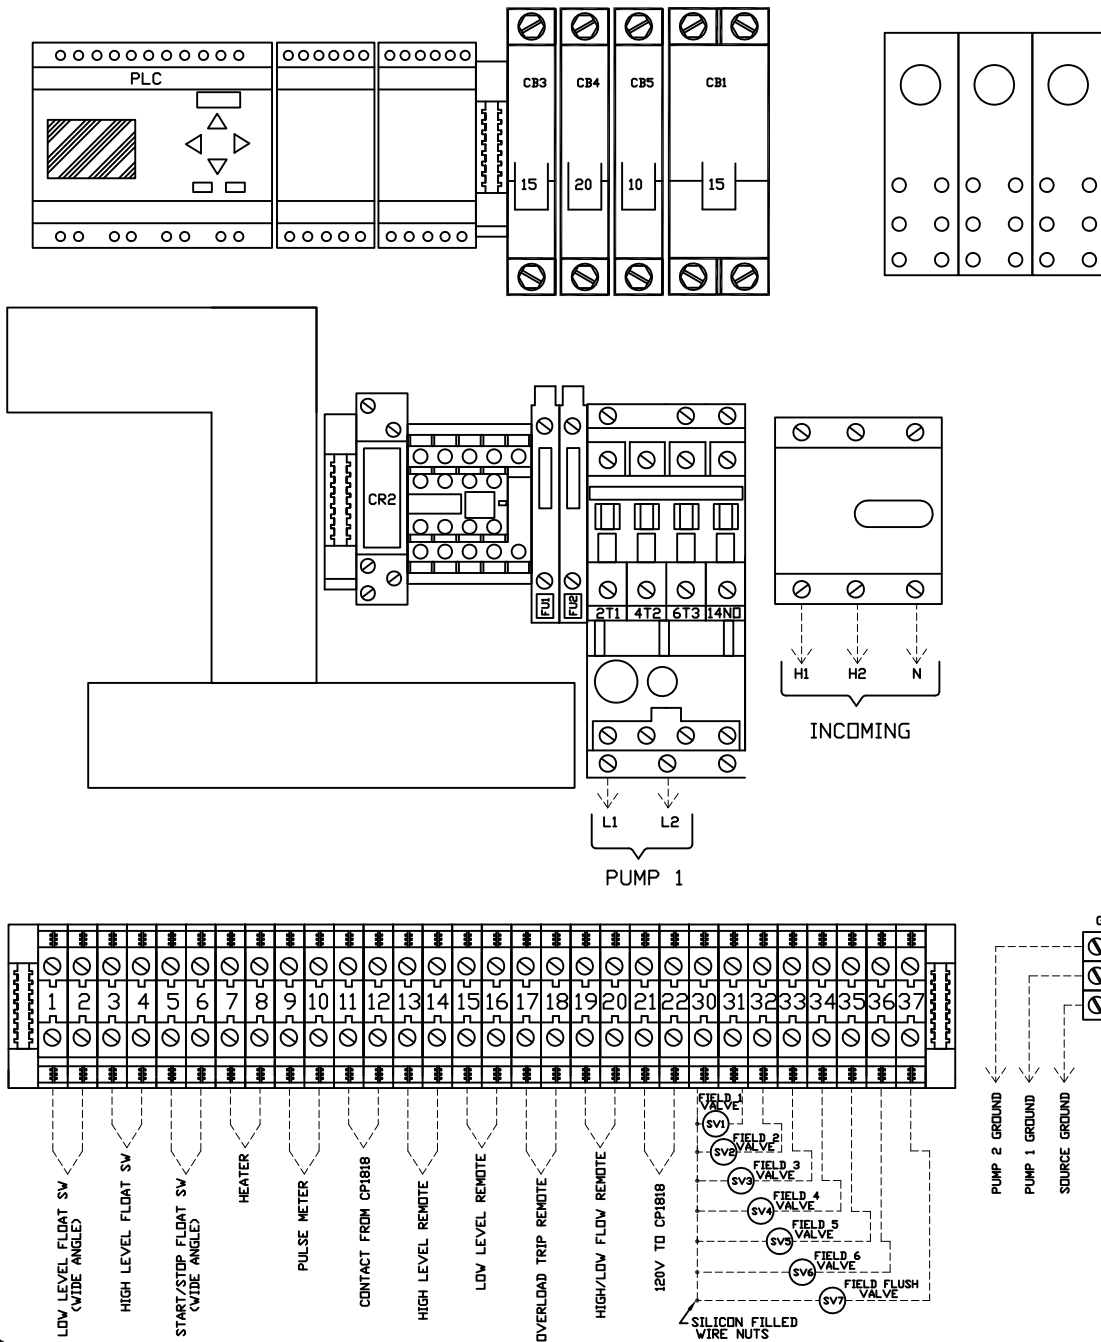

VIEW OF INNER LAYOUT



Delta Environmental Products, Inc.
P.O. Box 969 Denham Springs, LA 70727

DWN BY:
C.RACHAL

DATE:
5/25/06

SCALE:
N.T.S.

DWG. NO.:
6 OF 6

JOB NO.:
CP-2392

ENCLOSURE Filter System