
COX

Research and Technology, Inc.

PINECREST SUBDIVISION
GRAMBLING, LA
DUPLEX PUMP
CONTROL PANEL
3HP

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-2036

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	3	
FLA	28	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER	3SE-3024L	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE		
THERM. & SEAL FAIL WIRING FIGURE		

OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		


SOLD TO: Delta Process - Ruston, LA
TAG : Pinecrest Subdivision
Grambling, LA

SHIP TO: Delta Process - Ruston, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 4/20/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-2036 SHEET NUMBER 1
	DUPLEX PUMP CONTROL PANEL						



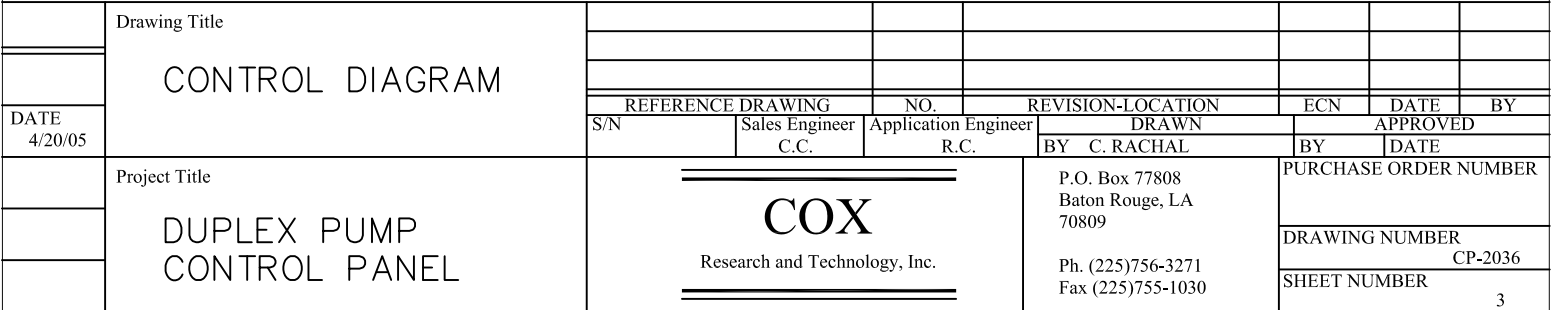

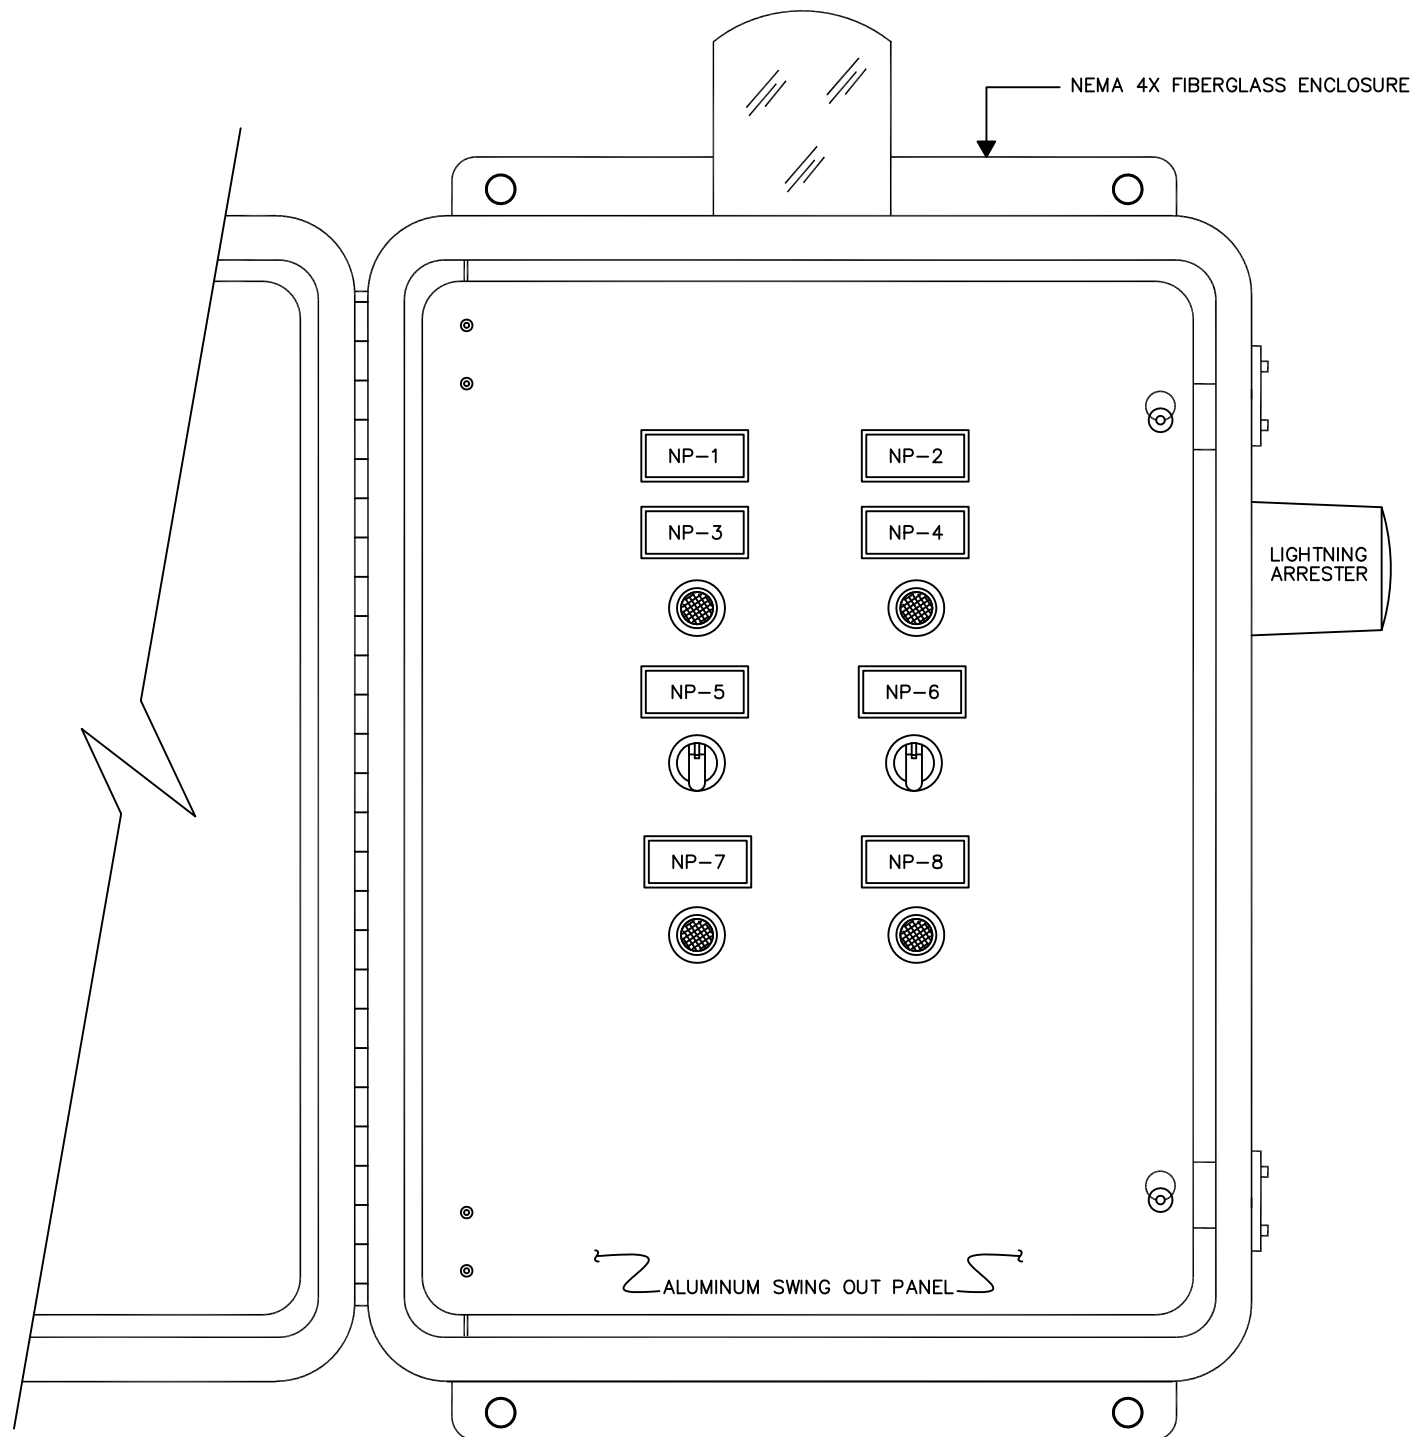

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:

SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title 	
--	---	--

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	MARATHON	1323580	DISTRIBUTION BLOCK
3	2	ABB	A26-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU32	O.L. RELAY (24-32A)
5	2	SQUARE D	QOU260	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10	1	DELTA	LA302	LIGHTNING ARRESTER
11	1	ABB	OT100E3	DISCONNECT SWITCH
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 4/20/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> </div> <p style="margin: 0;">Research and Technology, Inc.</p>		<p>P.O. Box 77808 Baton Rouge, LA 70809</p> <p>Ph. (225)756-3271 Fax (225)755-1030</p>		<p>PURCHASE ORDER NUMBER</p> <hr/> <p>DRAWING NUMBER CP-2036</p> <hr/> <p>SHEET NUMBER</p>		
	Project Title	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>			<p>5</p>			