



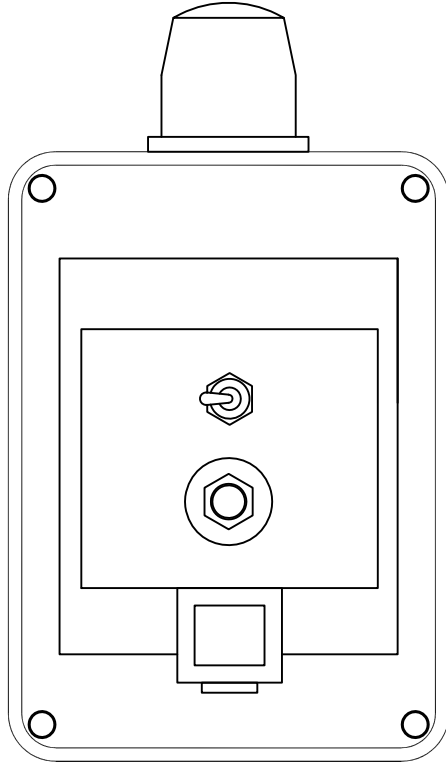


Delta Process Equipment, Inc.

HIGH LEVEL ALARM
CONTROL PANEL

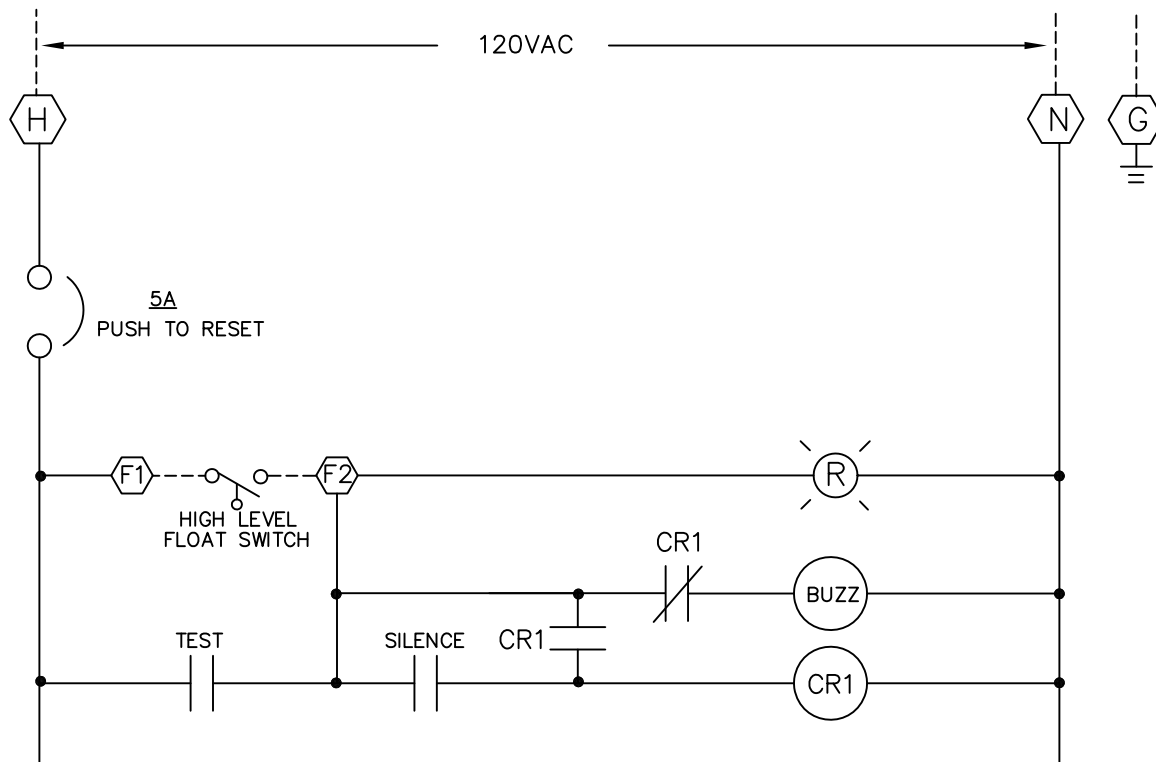


	Drawing Title							
	POWER DIAGRAM							
3/23/04 5/27/04		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY C. RACHAL	APPROVED BY	DATE	
	Project Title					PURCHASE ORDER NUMBER		
	HIGH LEVEL ALARM CONTROL PANEL	 Delta Process Equipment, Inc.				DRAWING NUMBER CP-1815		
						SHEET NUMBER 1		



NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.


	Drawing Title ENCLOSURE								
DATE 5/27/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY		
	Project Title HIGH LEVEL ALARM CONTROL PANEL	DRAWN BY CTR					APPROVED BY DATE		
		<div><div></div><div>Delta Process Equipment, Inc.</div></div>					PURCHASE ORDER NUMBER		
							DRAWING NUMBER CP-1815		
							SHEET NUMBER 2		

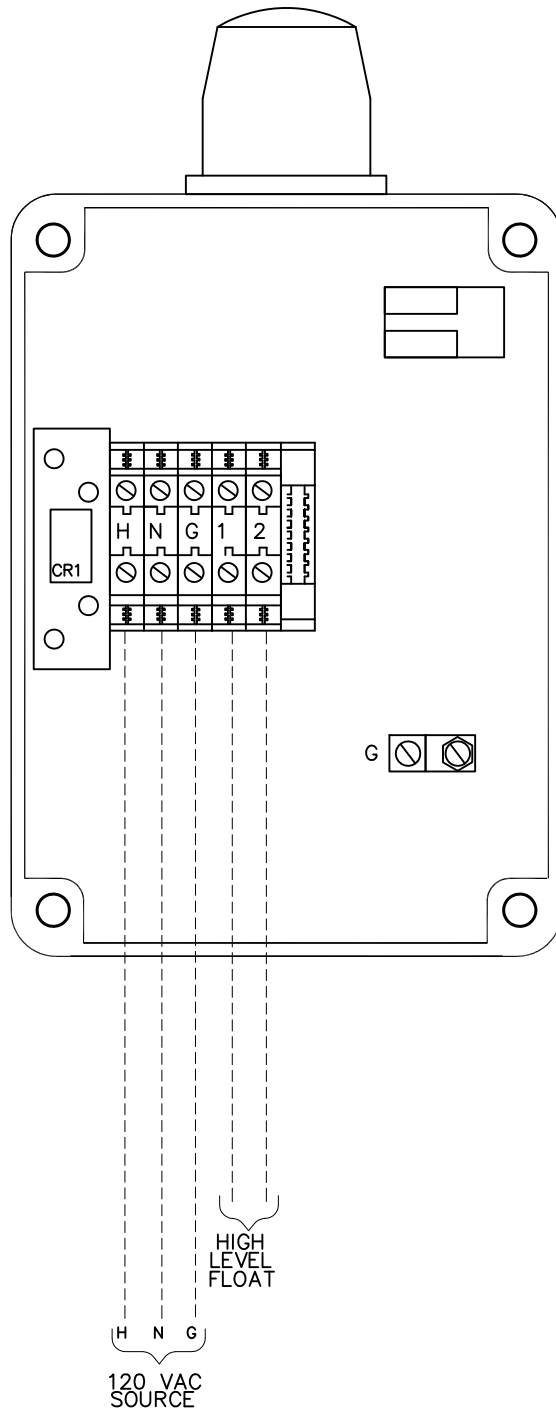

	Drawing Title							
	EXTERNAL CONNECTIONS							
DATE 5/27/04		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	BY C.RACHAL	ECN	DATE	BY
	Project Title	DRAWN APPROVED				BY	DATE	PURCHASE ORDER NUMBER
	HIGH LEVEL ALARM CONTROL PANEL	Delta Process Equipment, Inc.						DRAWING NUMBER CP-1815
								SHEET NUMBER 3

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	ABB	12644	ENCLOSURE
2	1	JOMEX	5A	CB1
3	1	U.S. CONTROLS		BUZZER
4	1	C.D.I.	R10-S-10	ALARM LIGHT
5	5	WEIDMULLER	WDU	TERMINAL BLOCKS
6	1	OMRON	G2R1SAC120	CONTROL RELAY
7				
8				
9				
10				

	Drawing Title							
	BILL OF MATERIALS							
DATE 5/2704		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY	
				DRAWN BY C. RACHAL	APPROVED BY	DATE		
	Project Title	 Delta Process Equipment, Inc.					PURCHASE ORDER NUMBER	
	HIGH LEVEL ALARM CONTROL PANEL						DRAWING NUMBER CP-1815	
							SHEET NUMBER 4	