
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
VINEYARDS
PHASE 1

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1458

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	1/60	
NO. MOTORS	2	
HP	2.7 HP	
FLA	11.9	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	GR	
CATALOG NUMBER	JSV 3B60-E 2.7	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	Yes	(Yes, No)
CAPACITOR WIRING FIGURE	G	
THERM. & SEAL FAIL WIRING FIGURE	5	


OPTIONS:


SEAL FAIL LIGHTS		(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN	X	(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER		
ELAPSED TIME METER		
PHASE MONITOR		
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO:	Delta Process - New Orleans, LA
TAG :	Vineyards Phase I


SHIP TO:	Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
DATE 7/29/02		S/N	Sales Engineer C.C.	Application Engineer R.C.	DRAWN BY CTR	APPROVED BY	DATE
	Project Title	COX Research and Technology, Inc.			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030	PURCHASE ORDER NUMBER	
	DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-1458	
						SHEET NUMBER 1	

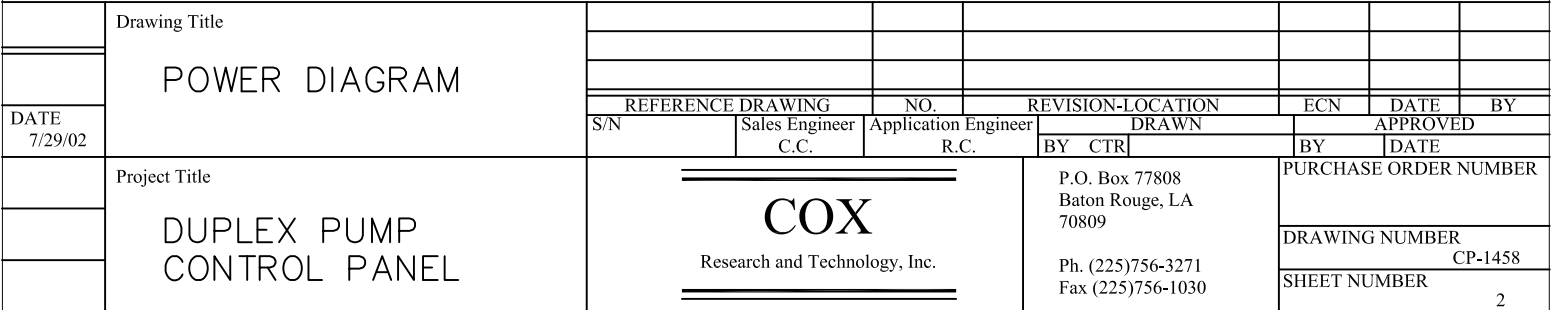

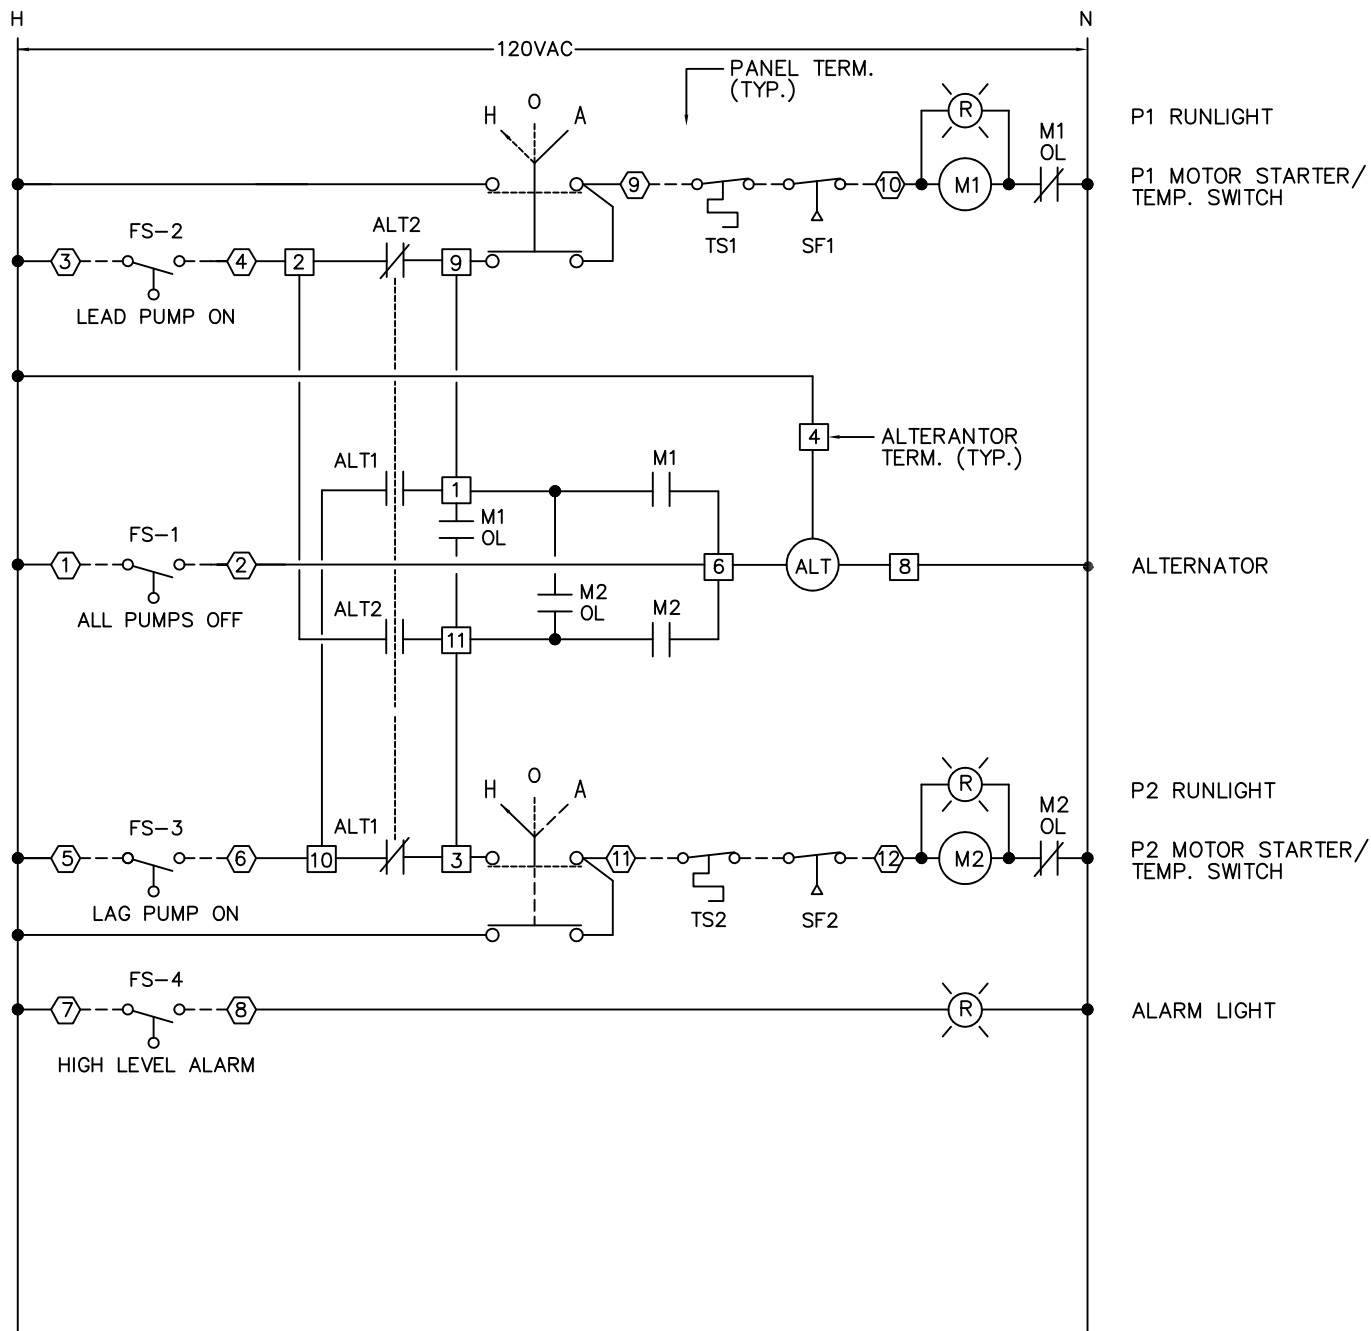

DATE 7/29/02	Drawing Title							
	CONTROL DIAGRAM							
	REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN	DATE
	S/N		Sales Engineer		Application Engineer		BY	
Project Title		C.C.		R.C.		BY		DATE
DUPLIX PUMP CONTROL PANEL								PURCHASE ORDER NUMBER
								DRAWING NUMBER
								CP-1458
								SHEET NUMBER
								3

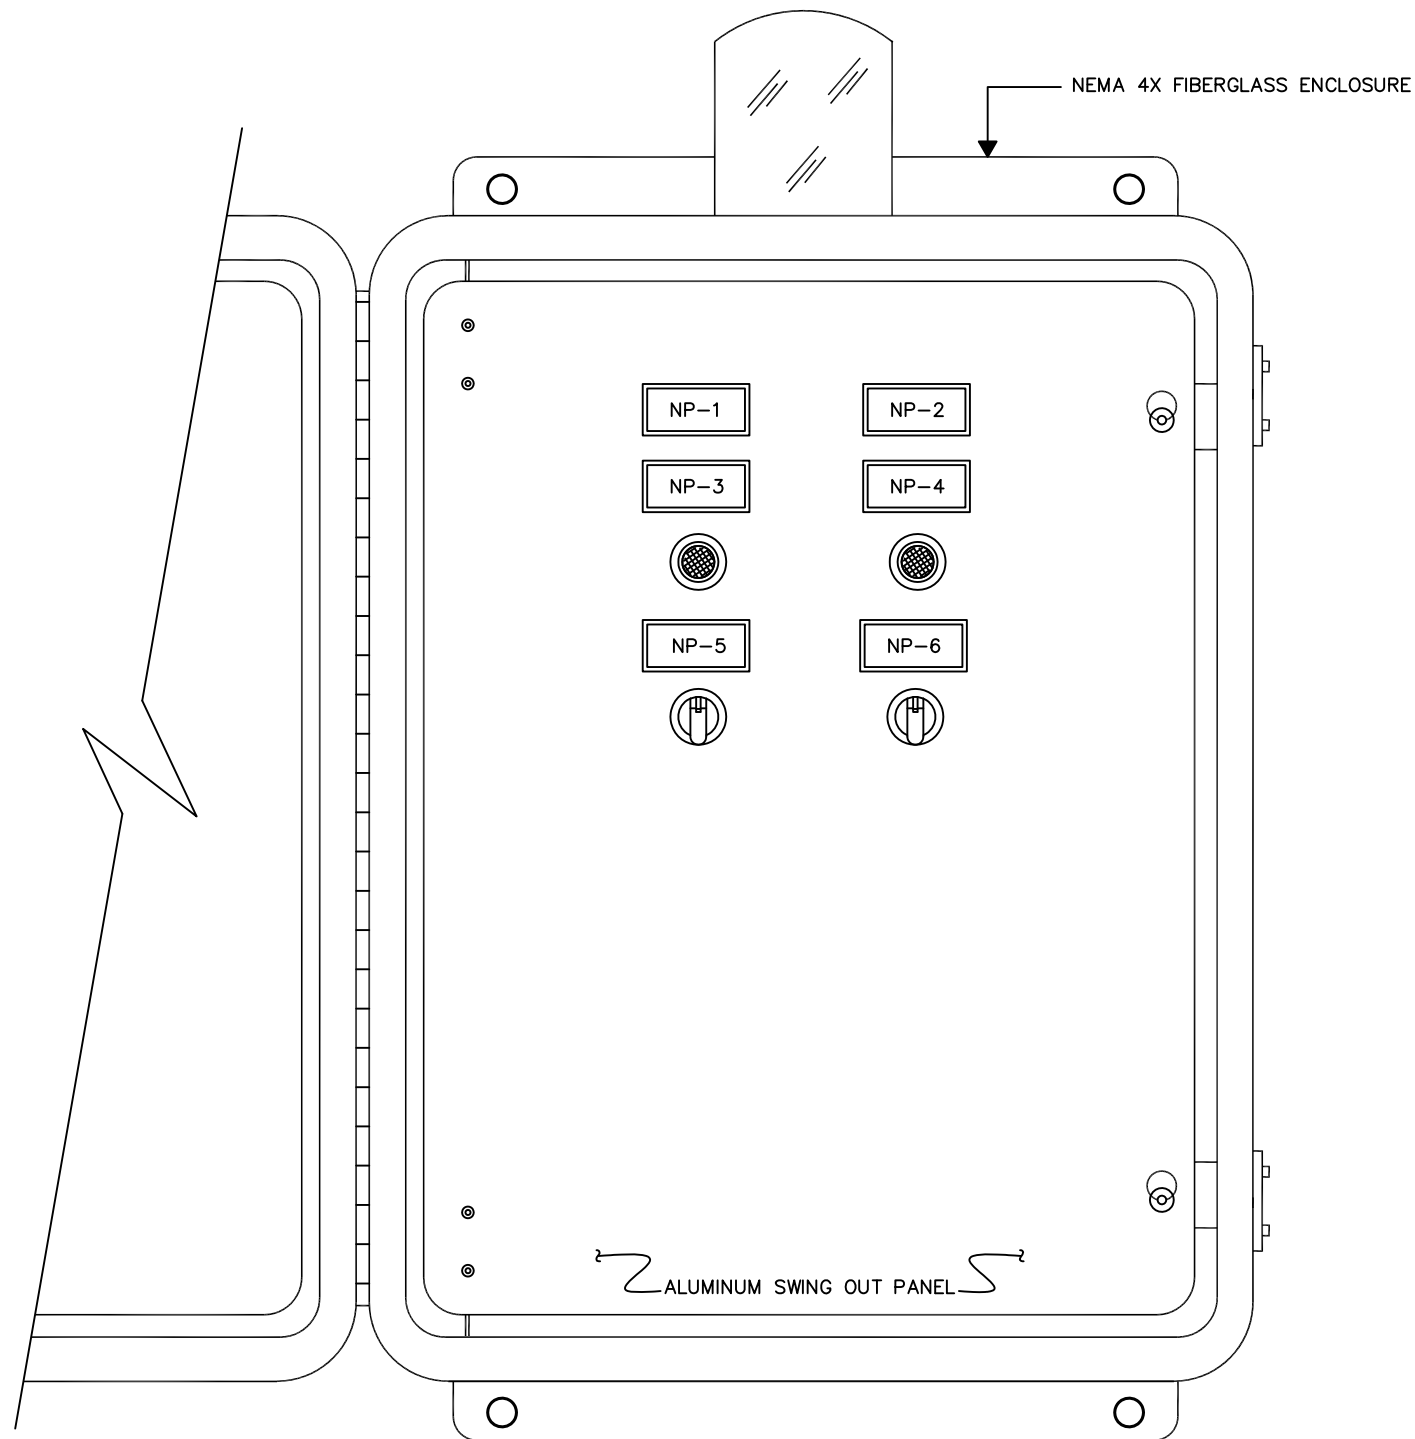

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA

DATE 7/29/02	Drawing Title							
	ENCLOSURE							
Project Title		REFERENCE DRAWING		NO.		REVISION-LOCATION		ECN
		S/N		Sales Engineer		Application Engineer		DATE
				C.C.		R.C.		BY
								DATE
								PURCHASE ORDER NUMBER
								DRAWING NUMBER
								CP-1458
								SHEET NUMBER
								4

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU14	O.L. RELAY (10-14A)
5	2	SQUARE D	QOU225	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	2	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title						
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>						
DATE 7/29/02		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	ECN	DATE	BY
	Project Title	<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 150px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0;">Research and Technology, Inc.</p> </div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)756-1030		PURCHASE ORDER NUMBER DRAWING NUMBER CP-1458 SHEET NUMBER <div style="text-align: right;">5</div>
	DUPLEX PUMP CONTROL PANEL						