





CP2315R1
CONTROL PANEL


Delta Treatment Systems
9125 Comar Drive
Walker, LA 70785
(225) 665-6162 Fax (800) 219-9183

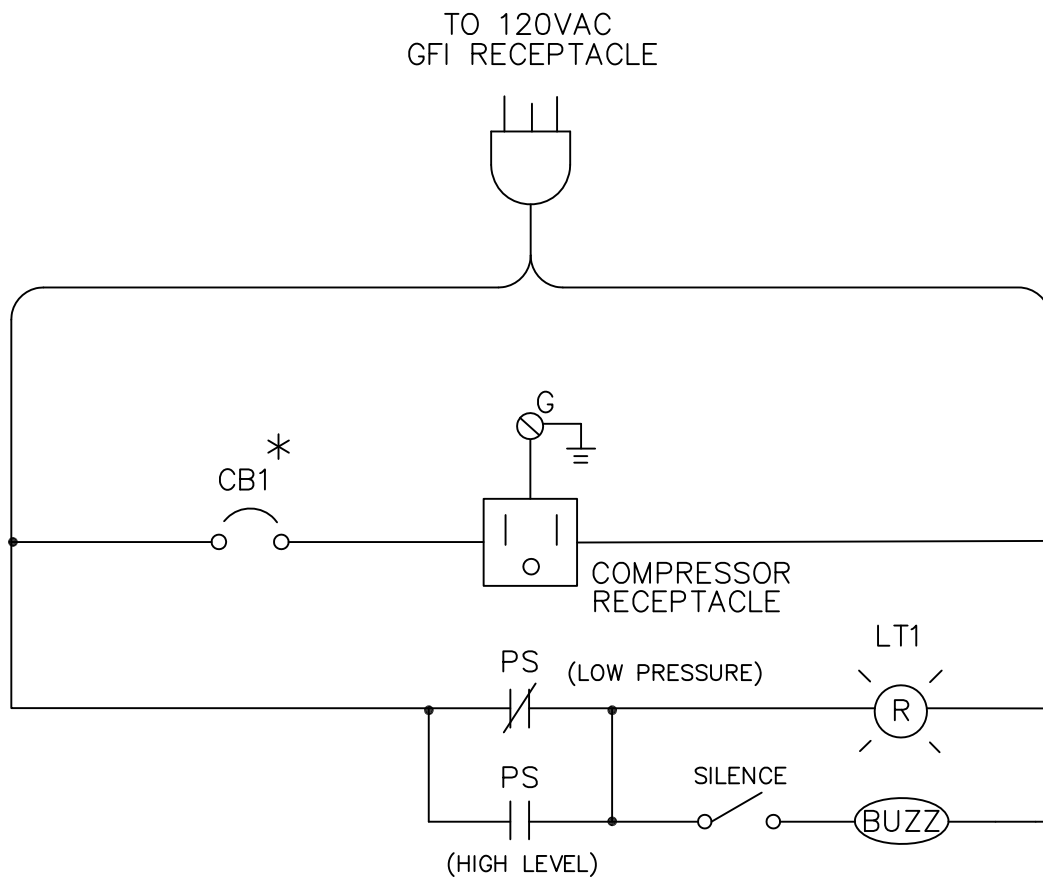


CP-2315R1

* SIZE VARIES WITH
COMPRESSOR SIZE PER
NATIONAL ELECTRICAL CODE

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	SCHEMATIC DIAGRAM				
-	-	-	-							
-	-	-	-							
REV.	DATE	REVISION	DESCRIPTION	BY						
<small>COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.</small>					PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP-2315R1	BMF	04/23/20	1 5	A

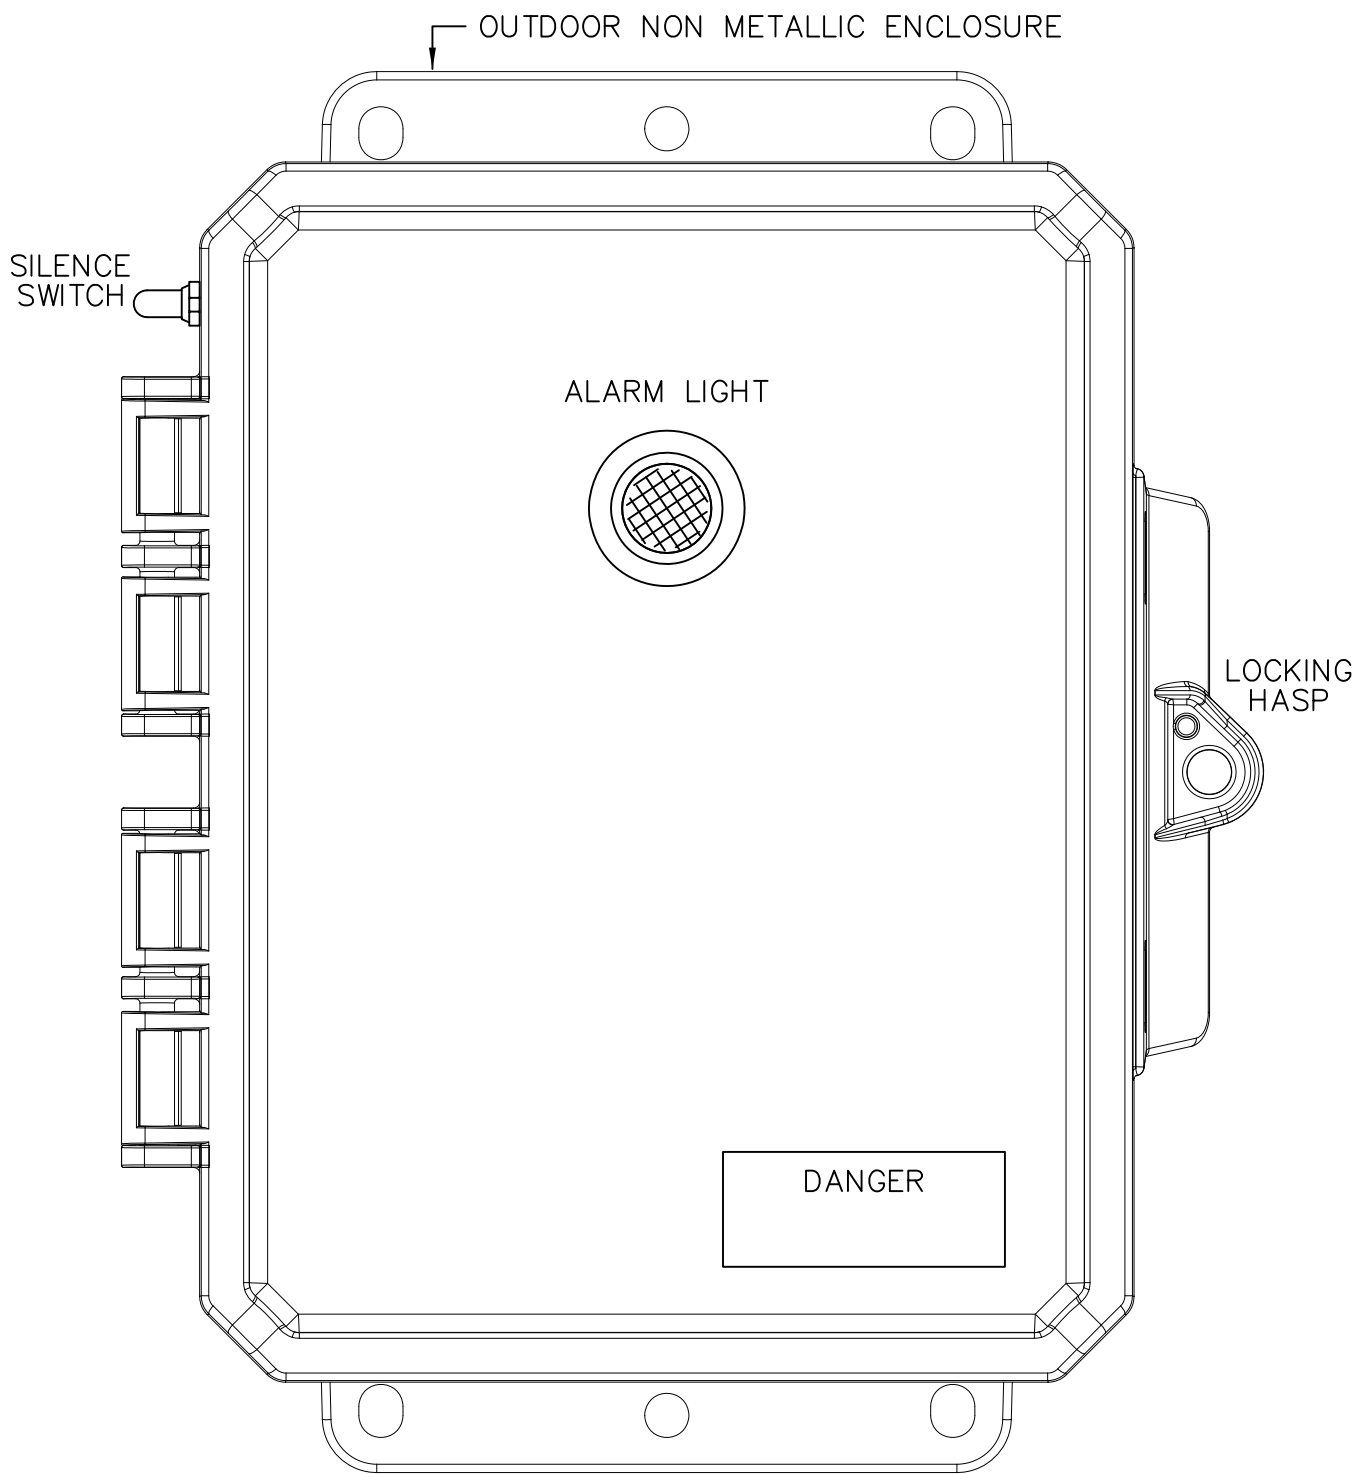


					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	ENCLOSURE				
-	-	-	-							
-	-	-	-							
REV.	DATE	REVISION	DESCRIPTION	BY						
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.					PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP-2315R1	BMF	04/23/20	2 5	A

Setting High Level Pressure Switch


Bring plant to operating water level with compressor on. Using properly sized screw driver, turn high level alarm adjustment screw clockwise until alarm occurs, then turn the screw counter-clockwise until alarm stops.


HIGH LEVEL ALARM
ADJUSTMENT SCREW

PRESSURE
SWITCH





AIR LINE
TO COMP.

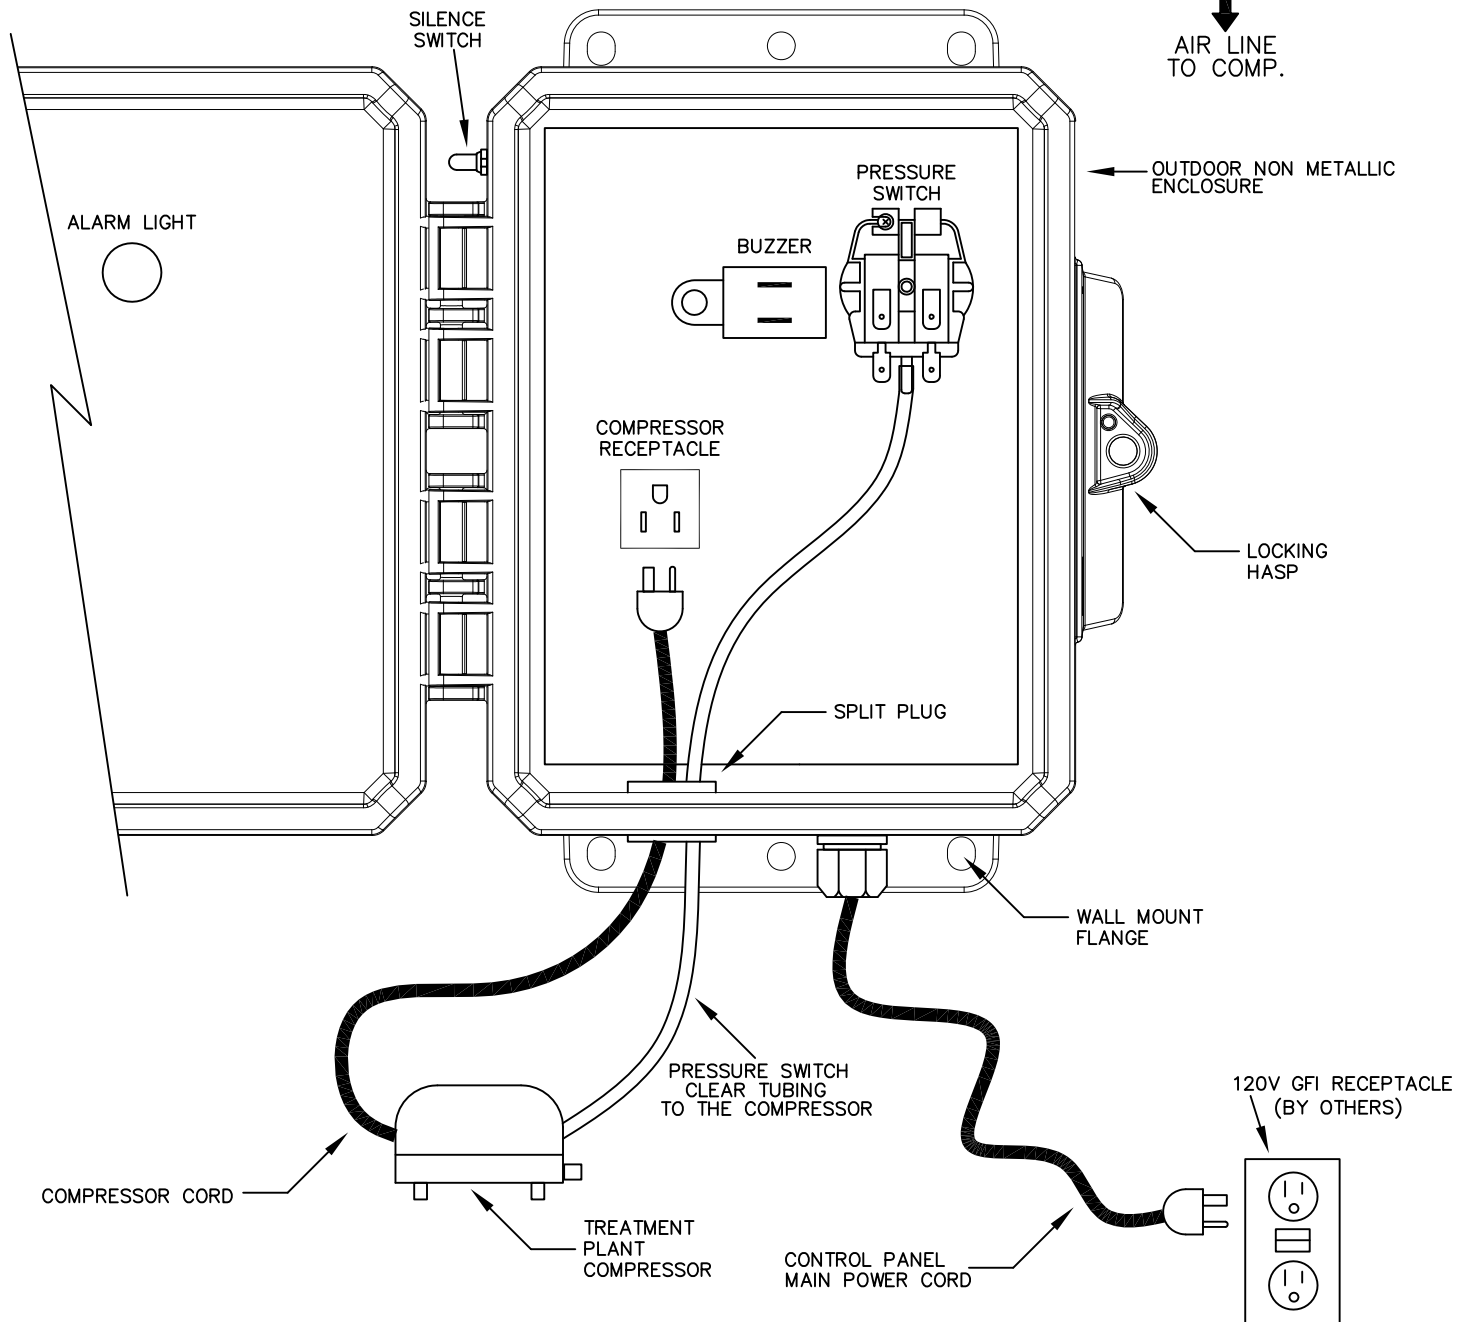

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	GENERAL ARRANGEMENT				
-	-	-	-							
-	-	-	-							
REV.	DATE	REVISION	DESCRIPTION							
COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.					PLOT SCALE	DRAWING NUMBER	DRAWN BY	DATE	SHEET OF	REV.
					NTS	CP-2315R1	BMF	04/23/20	3 5	A



Setting High Level Pressure Switch

Bring plant to operating water level with compressor on. Using properly sized screw driver, turn high level alarm adjustment screw clockwise until alarm occurs, then turn the screw counter-clockwise until alarm stops.

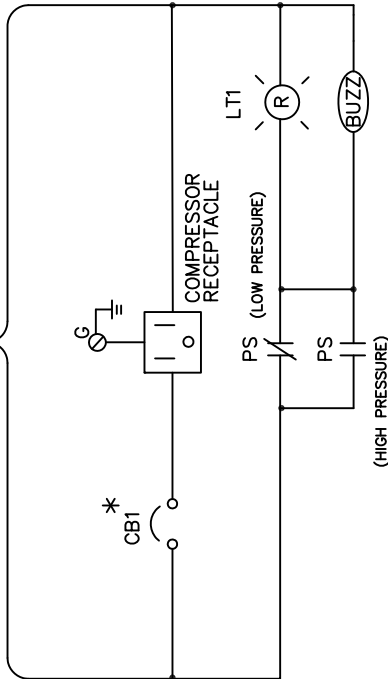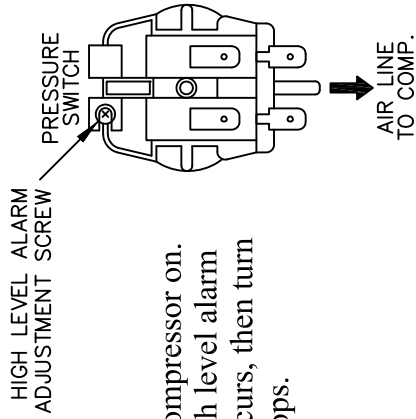

CP-2315R1

* SIZE VARIES WITH COMPRESSOR SIZE PER NATIONAL ELECTRICAL CODE

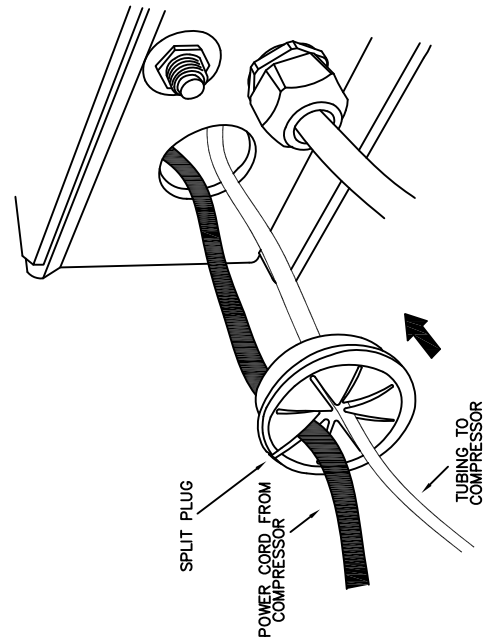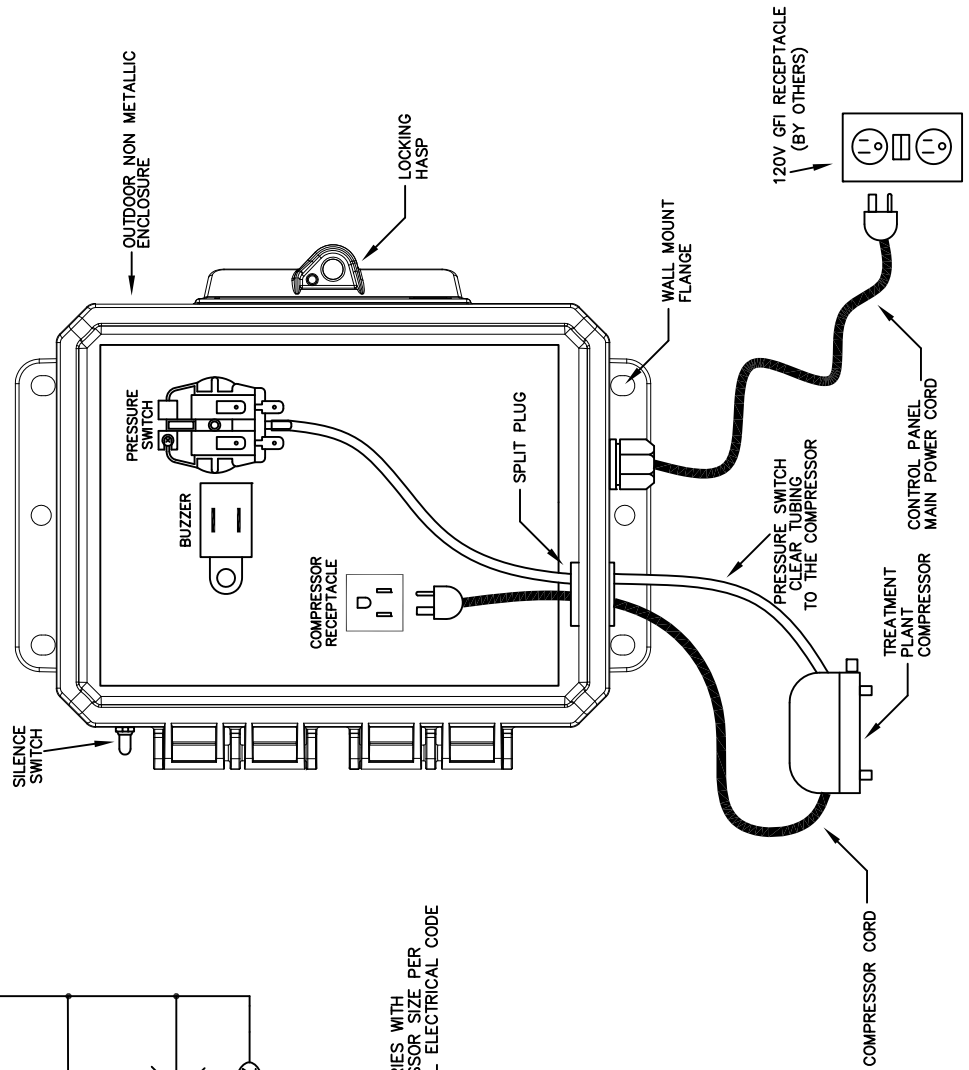



PLUG INSTALLATION

REV.	DATE	REVISION	DESCRIPTION	BY
-	-	-	-	-
-	-	-	-	-

		9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	SCHEMATIC/LAYOUT	
--	--	--	------------------	--

COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.				PLOT SCALE NTS	DRAWING NUMBER CP-2315R1	DRAWN BY BMF	DATE 04/23/20	SHEET OF 4 5	REV. A
--	--	--	--	-------------------	-----------------------------	-----------------	------------------	-----------------	-----------

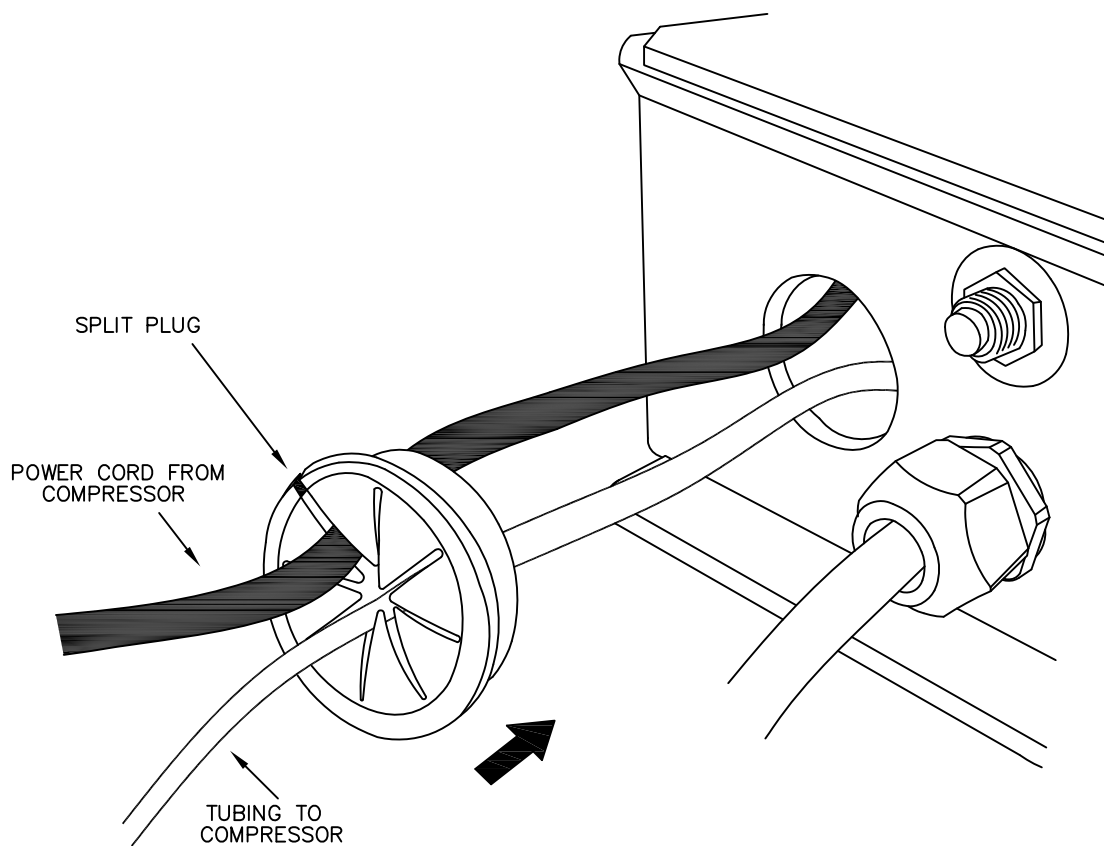

					9125 Comar Drive Walker, LA 70785 Ph. (225) 665-6162 Fax (800)219-9183	PLUG INSTALLATION			
-	-	-	-						
-	-	-	-						
REV.	DATE	REVISION	DESCRIPTION	BY					
<small>COMPANY CONFIDENTIAL: INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF PENTAIR PUMP GROUP, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF PENTAIR PUMP GROUP.</small>				PLOT SCALE NTS	DRAWING NUMBER CP-2315R1	DRAWN BY BMF	DATE 04/23/20	SHEET OF 5 5	REV. A