



Causal Transformer: operability, accuracy, and phase behaviour


(a) Operability window

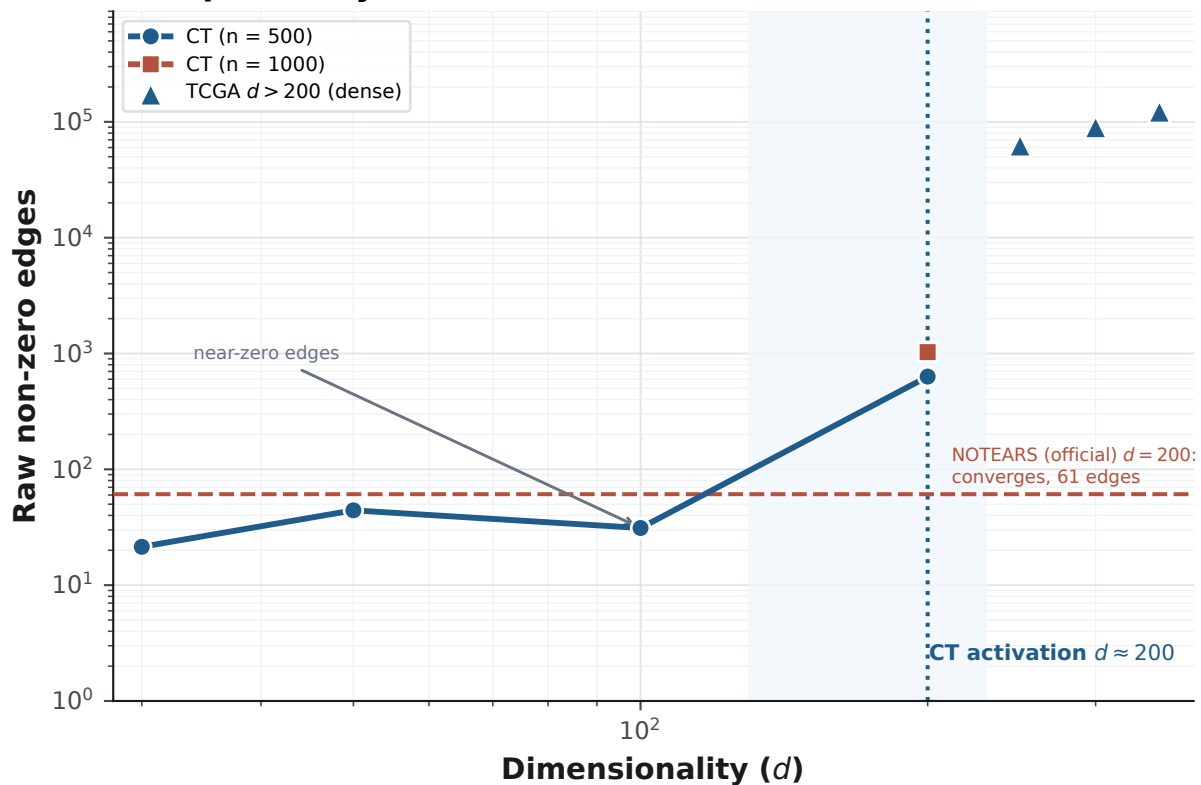

(b) Standard recovery: NOTEARS is stronger

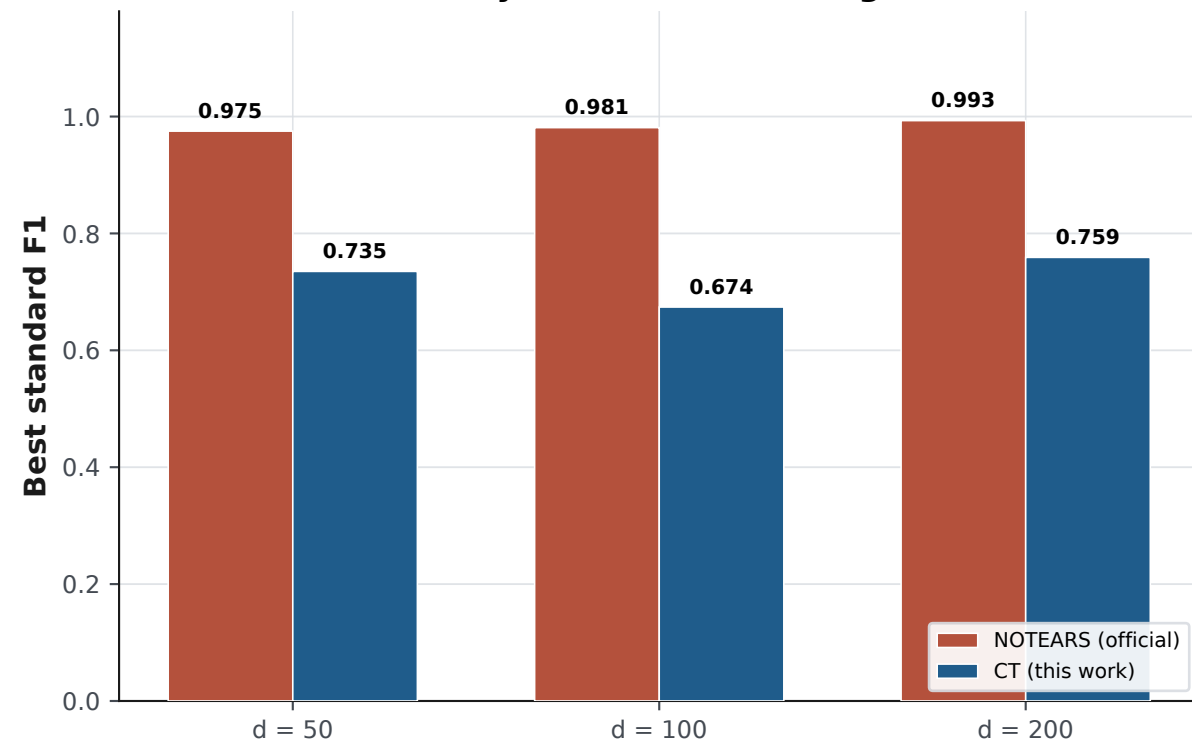

(c) Phase: max CT edges per (d, n)

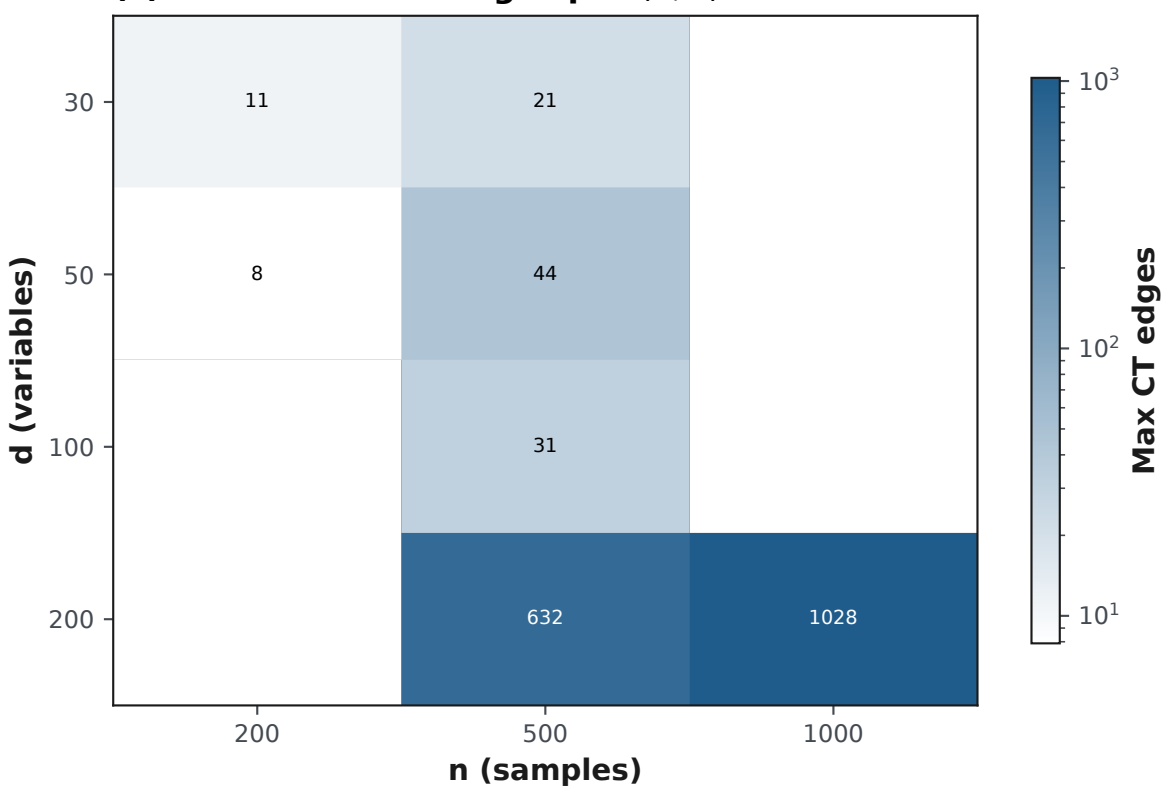

(d) Activation across d

