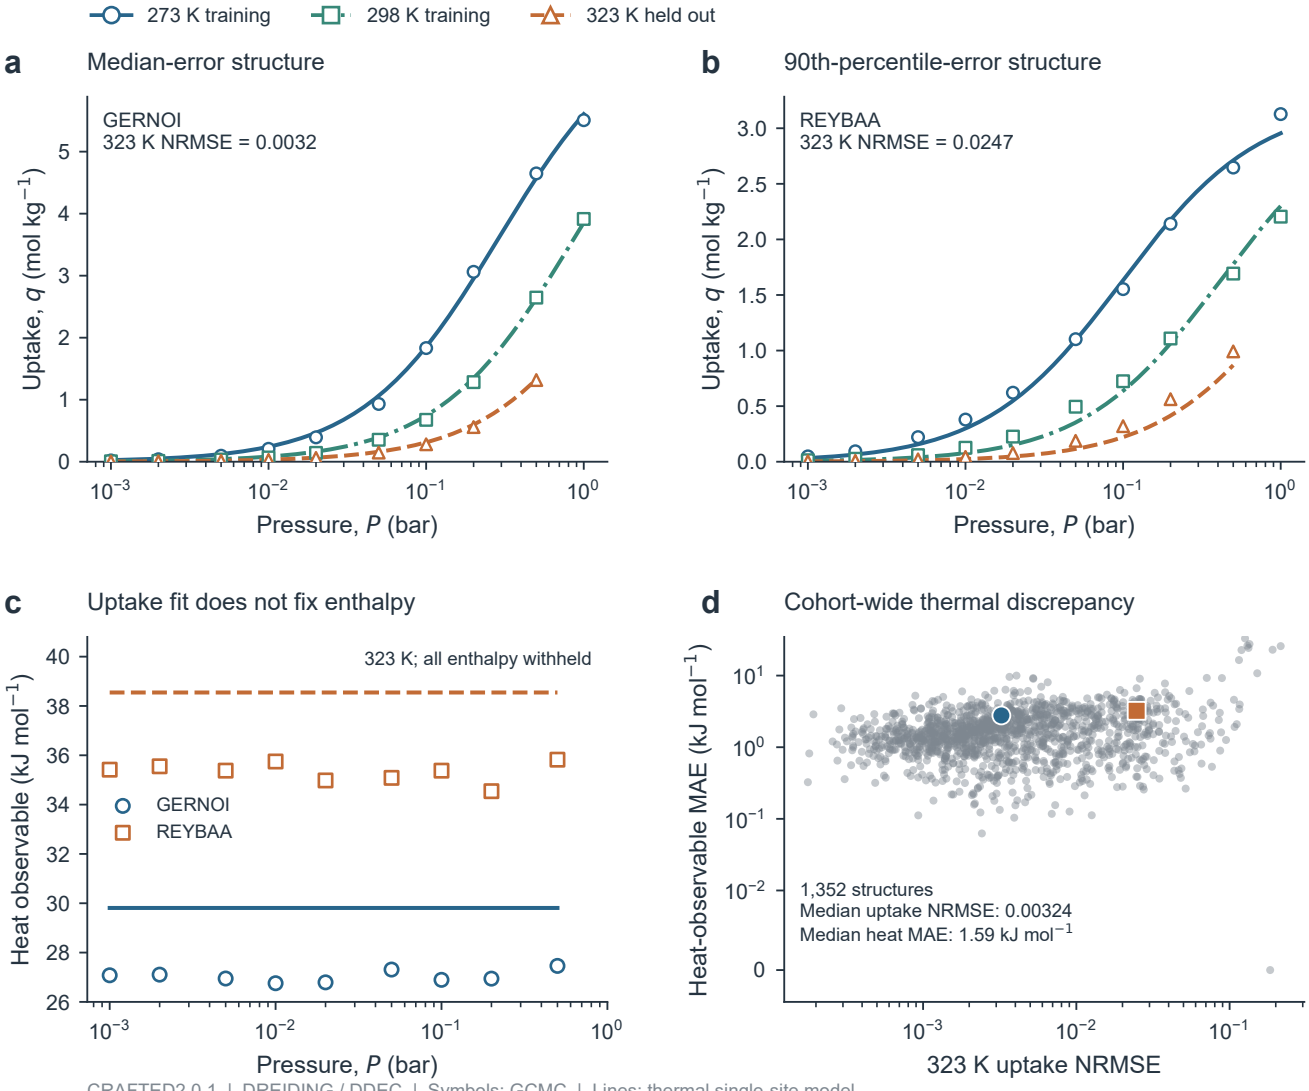

Public CO2 isotherms and withheld adsorption enthalpy
273 K training
298 K training
323 K held out
a
Median-error structure
GERNOI
323 K NRMSE = 0.0032
Uptake, q (mol kg−1)
Pressure, P (bar)
b
90th-percentile-error structure
REYBAA
323 K NRMSE = 0.0247
Uptake, q (mol kg−1)
Pressure, P (bar)
c
Uptake fit does not fix enthalpy
323 K; all enthalpy withheld
GERNOI
REYBAA
Heat observable (kJ mol−1)
Pressure, P (bar)
d
Cohort-wide thermal discrepancy
1,352 structures
Median uptake NRMSE: 0.00324
Median heat MAE: 1.59 kJ mol−1
Heat-observable MAE (kJ mol−1)
323 K uptake NRMSE
CRAFTED2.0.1 | DREIDING / DDEC | Symbols: GCMC | Lines: thermal single-site model