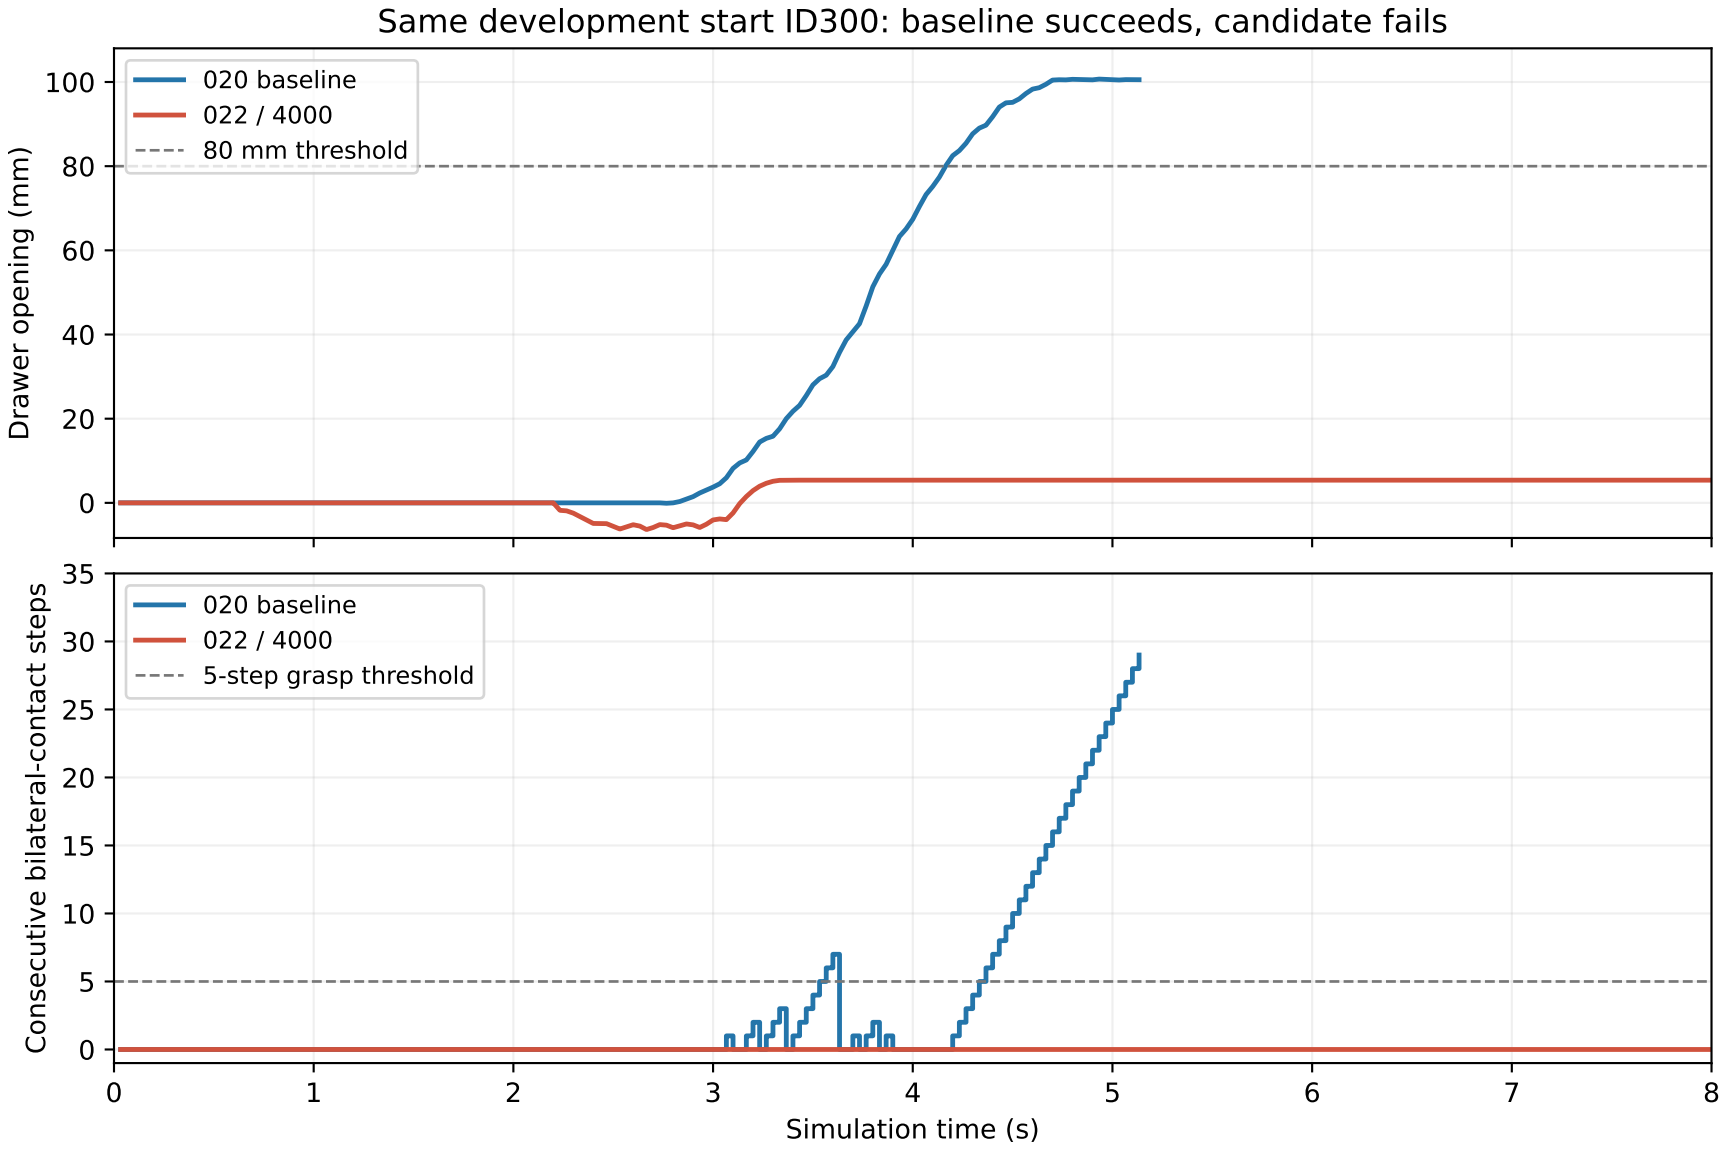
Same development start ID300: baseline succeeds, candidate fails
020 baseline
022 / 4000
80 mm threshold
Drawer opening (mm)
100
80
60
40
20
0
020 baseline
022 / 4000
5-step grasp threshold
Consecutive bilateral-contact steps
35
30
25
20
15
10
5
0
0
1
2
3
4
5
6
7
8
Simulation time (s)