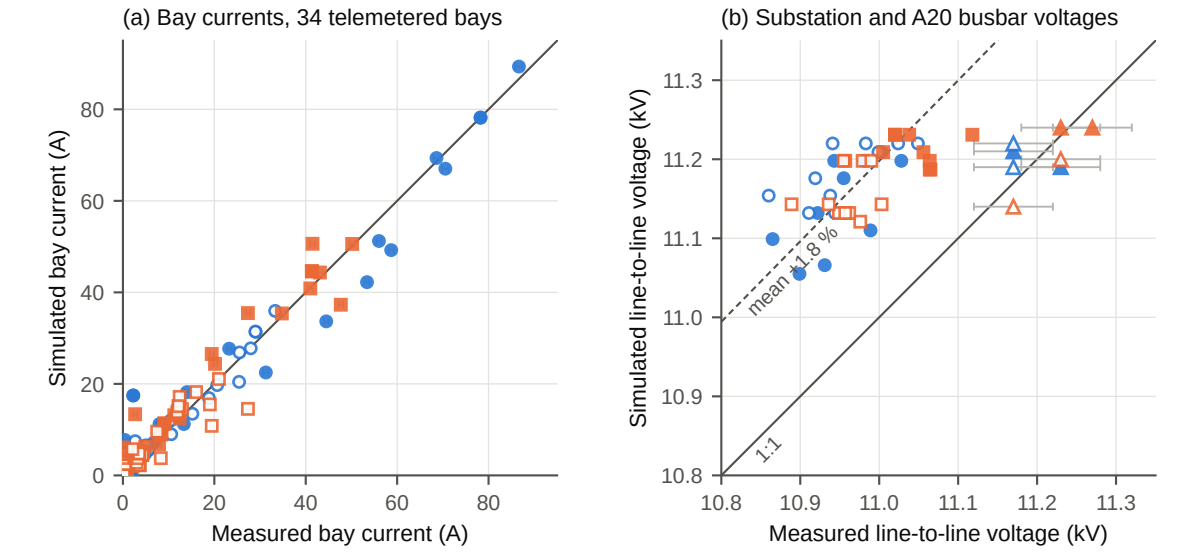
(a) Bay currents, 34 telemetered bays
Simulated bay current (A)
Measured bay current (A)
0
20
40
60
80
(b) Substation and A20 busbar voltages
Simulated line-to-line voltage (kV)
Measured line-to-line voltage (kV)
10.8
10.9
11.0
11.1
11.2
11.3
mean +1.8 %
1:1
winter peak
winter night
summer peak
summer night
A20 busbar (SCADA VT), by snapshot colour