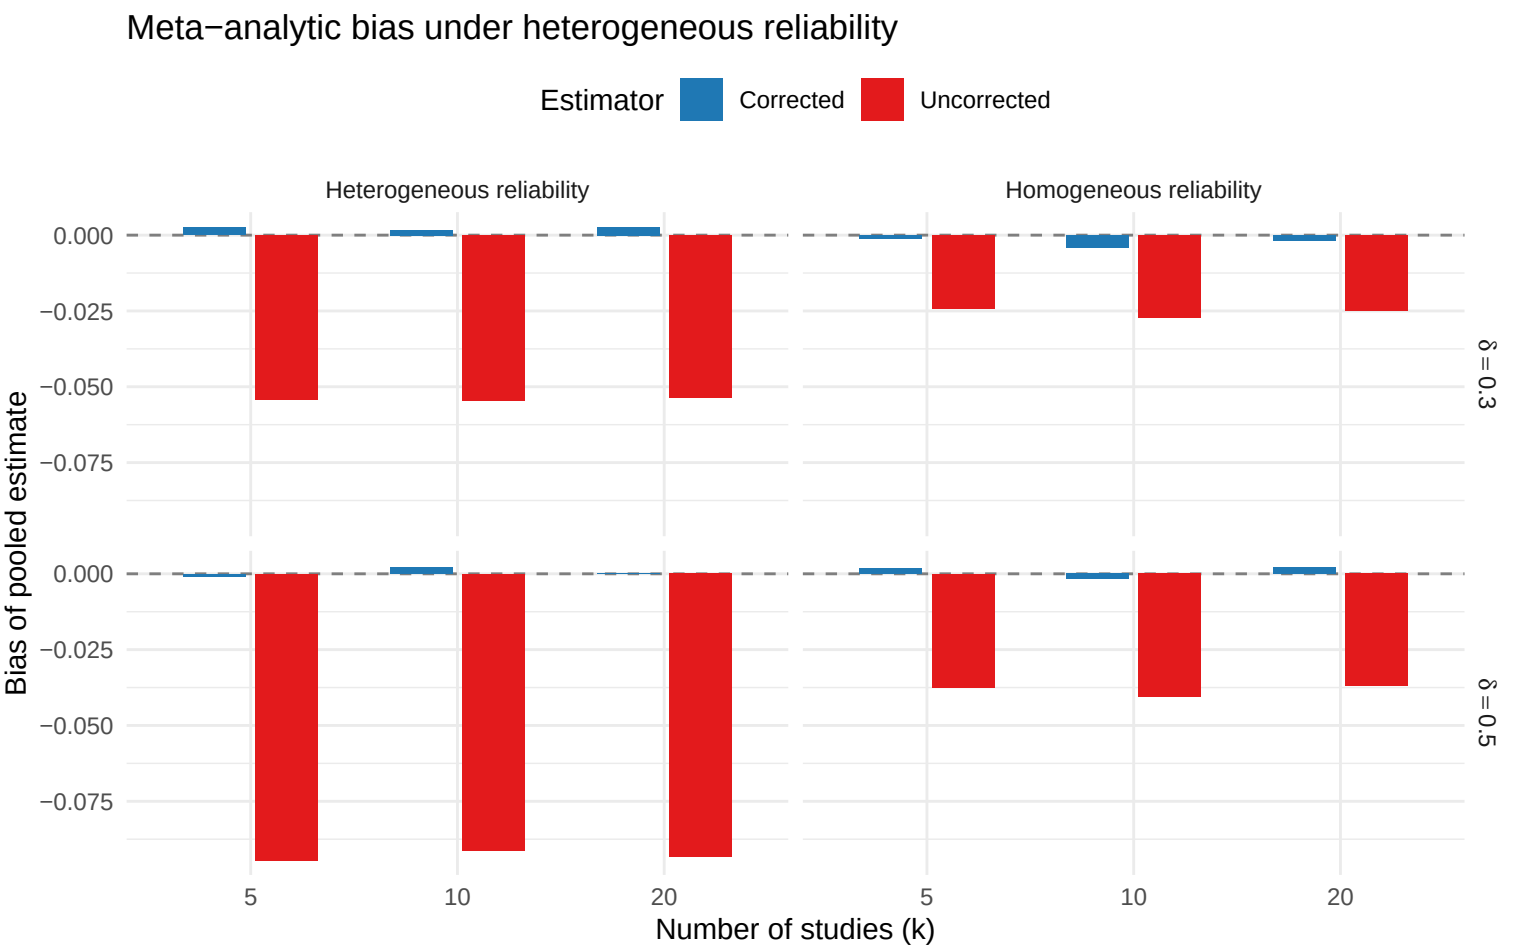
Meta−analytic bias under heterogeneous reliability
Estimator
Corrected
Uncorrected
Heterogeneous reliability
Homogeneous reliability
0.000
−0.025
−0.050
−0.075
δ = 0.3
δ = 0.5
Bias of pooled estimate
5
10
20
Number of studies (k)