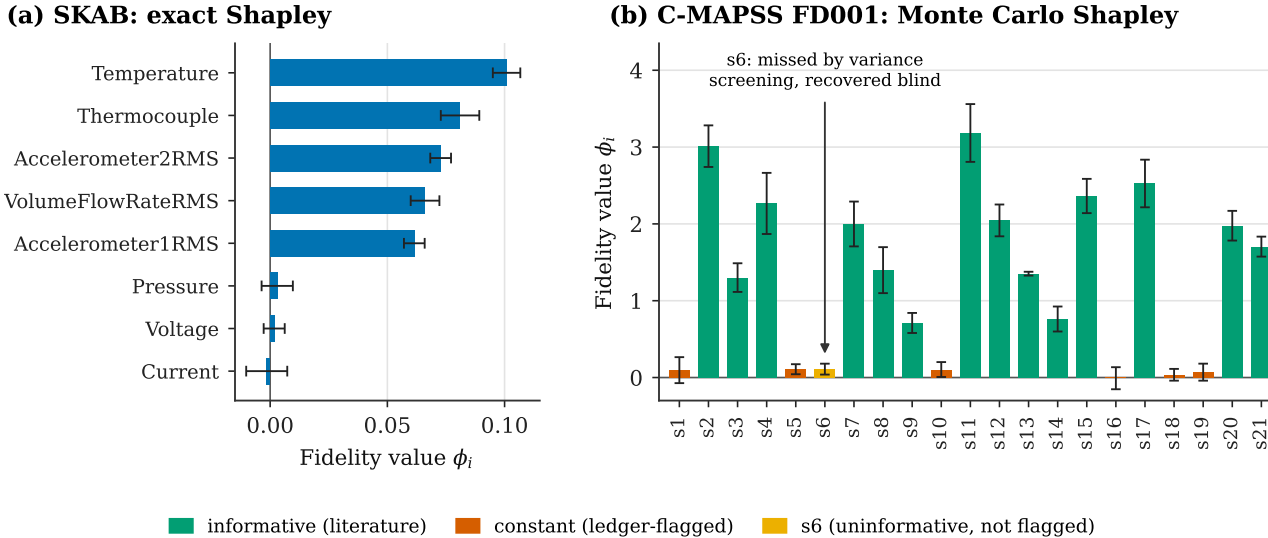
(a) SKAB: exact Shapley
Temperature
Thermocouple
Accelerometer2RMS
VolumeFlowRateRMS
Accelerometer1RMS
Pressure
Voltage
Current
0.00
0.05
0.10
Fidelity value ϕ_i
(b) C-MAPSS FD001: Monte Carlo Shapley
s6: missed by variance screening, recovered blind
Fidelity value ϕ_i
0
1
2
3
4
s1
s2
s3
s4
s5
s6
s7
s8
s9
s10
s11
s12
s13
s14
s15
s16
s17
s18
s19
s20
s21
informative (literature)
constant (ledger-flagged)
s6 (uninformative, not flagged)