



Panel 1 - Asset Health Overview

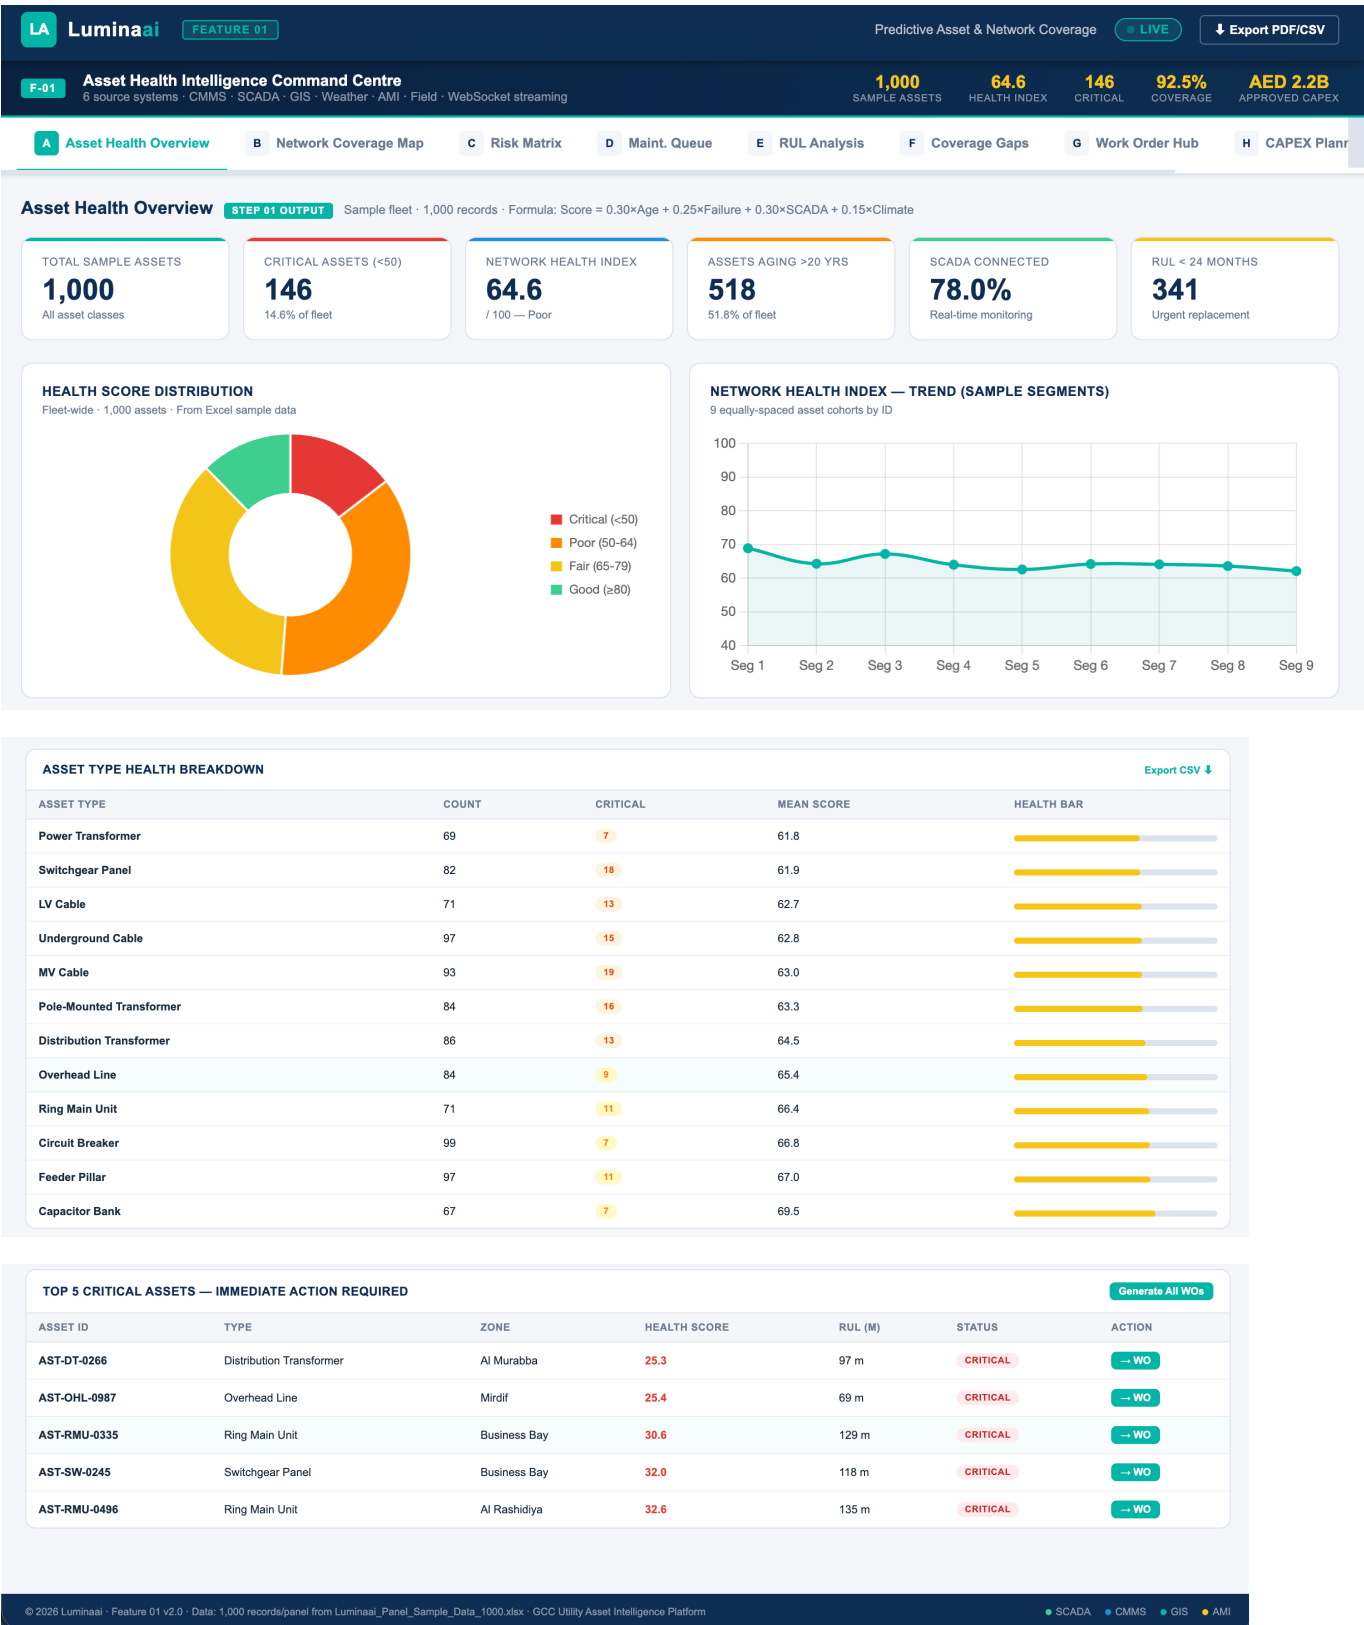

Panel 2 – Network Coverage Map

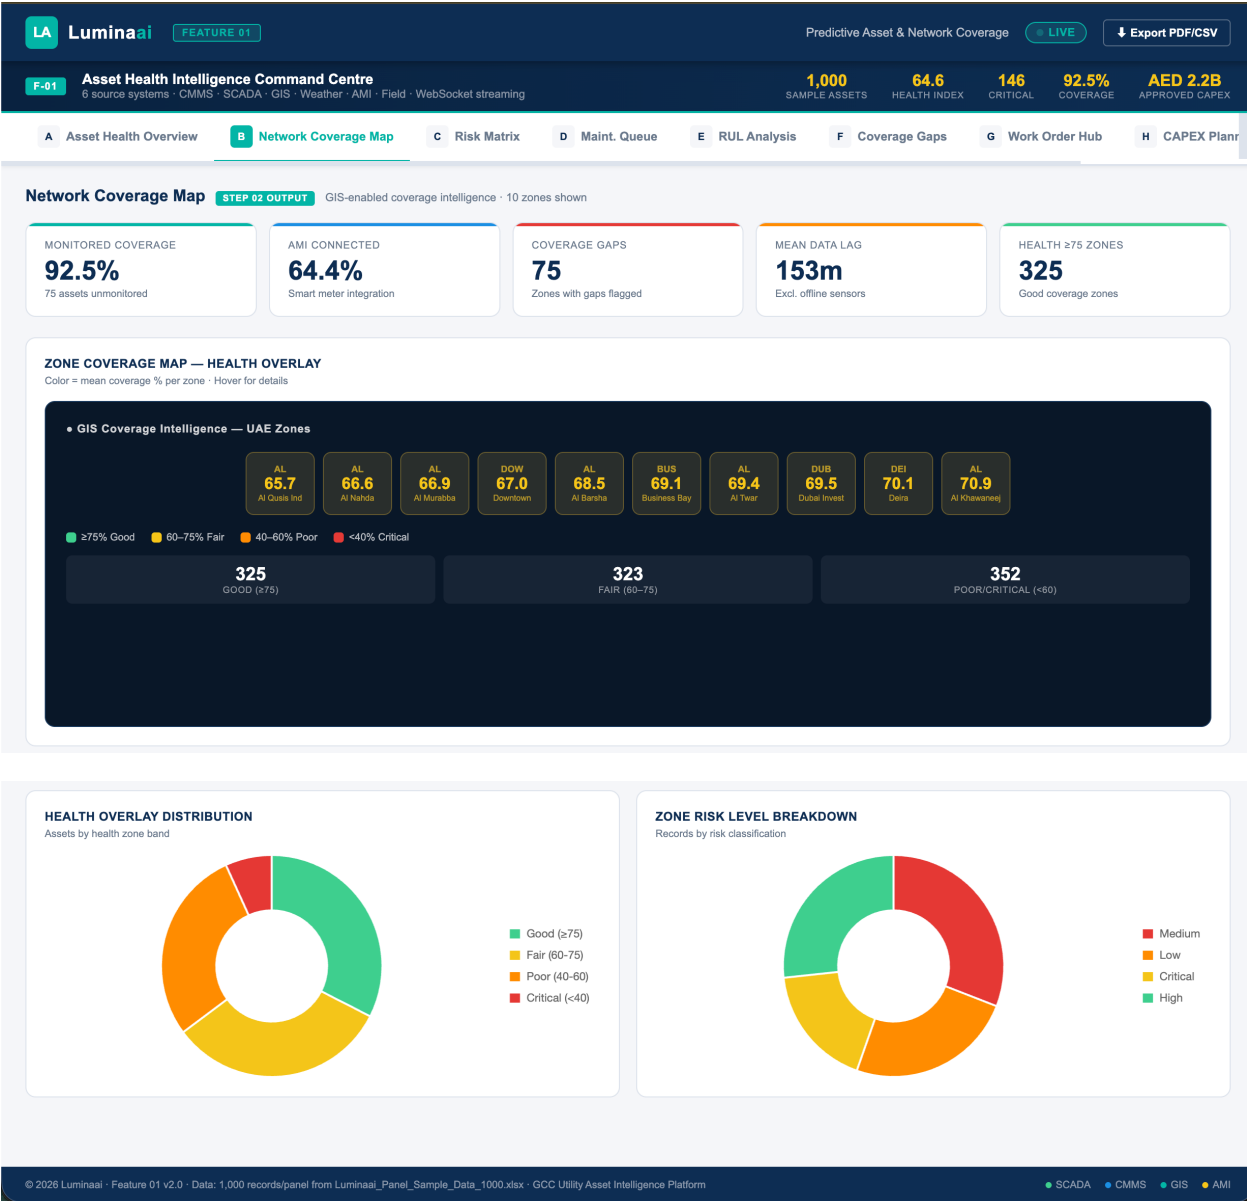

A

Asset Health Overview

B

Network Coverage Map

C

Risk Matrix

D

Maint. Queue

E

RUL Analysis

F

Coverage Gaps

G

Work Order Hub

H

CAPEX Plan

Network Coverage Map

STEP 02 OUTPUT

GIS-enabled coverage intelligence · 10 zones shown

MONITORED COVERAGE

92.5%

75 assets unmonitored

AMI CONNECTED

64.4%

Smart meter integration

COVERAGE GAPS

75

Zones with gaps flagged

MEAN DATA LAG

153m

Excl. offline sensors

HEALTH ≥75 ZONES

325

Good coverage zones

ZONE COVERAGE MAP — HEALTH OVERLAY

Color = mean coverage % per zone · Hover for details

• GIS Coverage Intelligence — UAE Zones

AL 65.7
Al Qusais Ind

AL 66.6
Al Fahra

AL 66.9
Al Munsabba

DOW 67.0
Downsview

AL 68.5
Al Baraha

BUS 69.1
Business Bay

AL 69.4
Al Thwar

DUB 69.5
Dubai Invest

DEI 70.1
Deira

AL 70.9
Al Khawaneej

≥75% Good

60–75% Fair

40–60% Poor

<40% Critical

325
GOOD (≥75)

323
FAIR (60–75)

352
POOR/CRITICAL (<60)

HEALTH OVERLAY DISTRIBUTION

Assets by health zone band

Good (≥75)

Fair (60-75)

Poor (40-60)

Critical (<40)

ZONE RISK LEVEL BREAKDOWN

Records by risk classification

Medium

Low

Critical

High

© 2026 Luminaai · Feature 01 v2.0 · Data: 1,000 records/panel from Luminaai_Panel_Sample_Data_1000.xlsx · GCC Utility Asset Intelligence Platform

SCADA

CMMS

GIS

AMI

Panel 3 – Risk Matrix

LA

Luminaai

FEATURE 01

Predictive Asset & Network Coverage

LIVE

Export PDF/CSV

F-01

Asset Health Intelligence Command Centre

6 source systems · CMMIS · SCADA · GIS · Weather · AMI · Field · WebSocket streaming

1,000

SAMPLE ASSETS

64.6

HEALTH INDEX

146

CRITICAL

92.5%

COVERAGE

AED 2.2B

APPROVED CAPEX

A

Asset Health Overview

B

Network Coverage Map

C

Risk Matrix

D

Maint. Queue

E

RUL Analysis

F

Coverage Gaps


G

Work Order Hub

H

CAPEX Plan


Risk Matrix STEP 03 OUTPUT Likelihood × Consequence scoring · Total annual risk exposure: AED 167.8M

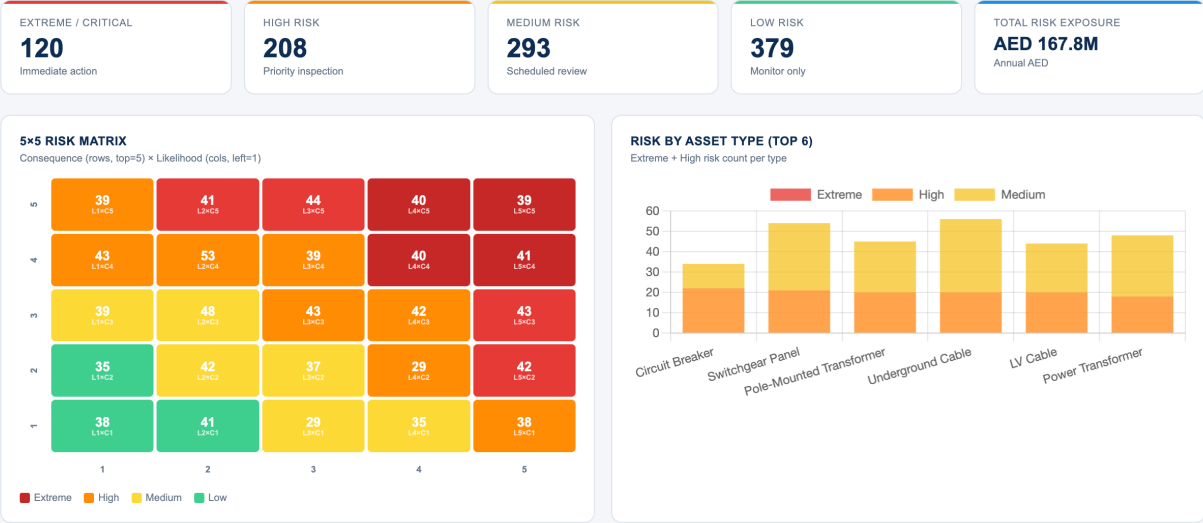

TOP 5 HIGHEST RISK ASSETS Export CSV

ASSET ID	TYPE	ZONE	RISK SCORE	CATEGORY	ANNUAL EXPOSURE
AST-UGC-0901	Underground Cable	Deira	25	CRITICAL	AED 99K
AST-CB-0992	Circuit Breaker	Al Warqa	25	CRITICAL	AED 163K
AST-FP-0391	Feeder Pillar	Al Barsha	25	CRITICAL	AED 88K
AST-SW-0131	Switchgear Panel	Al Ghusais	25	CRITICAL	AED 706K
AST-UGC-0602	Underground Cable	Al Qusais	25	CRITICAL	AED 93K

Panel 4 -Maintenance Queue

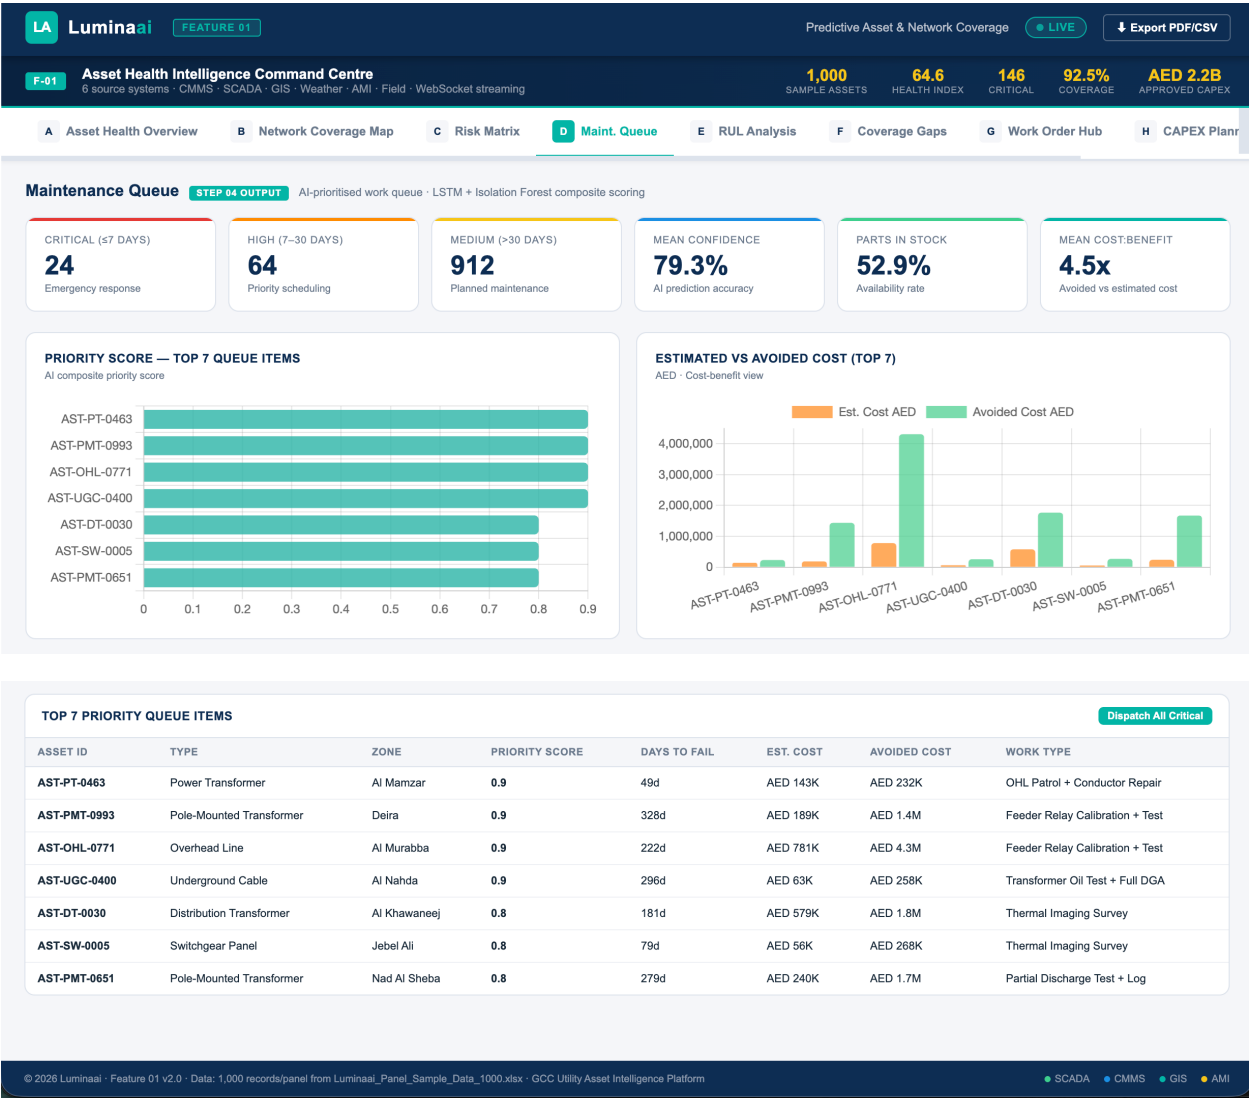

Maintenance Queue

STEP 04 OUTPUT

AI-prioritised work queue · LSTM + Isolation Forest composite scoring

CRITICAL (≤7 DAYS)

24

Emergency response

HIGH (7–30 DAYS)

64

Priority scheduling

MEDIUM (>30 DAYS)

912

Planned maintenance

MEAN CONFIDENCE

79.3%

AI prediction accuracy

PARTS IN STOCK

52.9%

Availability rate

MEAN COST:BENEFIT

4.5x

Avoided vs estimated cost

PRIORITY SCORE — TOP 7 QUEUE ITEMS

AI composite priority score

AST-PT-0463

AST-PMT-0993

AST-OHL-0771

AST-UGC-0400

AST-DT-0030

AST-SW-0005

AST-PMT-0651

0

0.1

0.2

0.3

0.4

0.5

0.6

0.7

0.8

0.9

ESTIMATED VS AVOIDED COST (TOP 7)

AED · Cost-benefit view

Est. Cost AED

Avoided Cost AED

4,000,000

3,000,000

2,000,000

1,000,000

0

AST-PT-0463

AST-PMT-0993

AST-OHL-0771

AST-UGC-0400

AST-DT-0030

AST-SW-0005

AST-PMT-0651

TOP 7 PRIORITY QUEUE ITEMS

Dispatch All Critical

ASSET ID	TYPE	ZONE	PRIORITY SCORE	DAYS TO FAIL	EST. COST	AVOIDED COST	WORK TYPE
AST-PT-0463	Power Transformer	Al Mamzar	0.9	49d	AED 143K	AED 232K	OHL Patrol + Conductor Repair
AST-PMT-0993	Pole-Mounted Transformer	Deira	0.9	328d	AED 189K	AED 1.4M	Feeder Relay Calibration + Test
AST-OHL-0771	Overhead Line	Al Murabba	0.9	222d	AED 781K	AED 4.3M	Feeder Relay Calibration + Test
AST-UGC-0400	Underground Cable	Al Nahda	0.9	296d	AED 63K	AED 258K	Transformer Oil Test + Full DGA
AST-DT-0030	Distribution Transformer	Al Khawaneej	0.8	181d	AED 579K	AED 1.8M	Thermal Imaging Survey
AST-SW-0005	Switchgear Panel	Jebel Ali	0.8	79d	AED 56K	AED 268K	Thermal Imaging Survey
AST-PMT-0651	Pole-Mounted Transformer	Nad Al Sheba	0.8	279d	AED 240K	AED 1.7M	Partial Discharge Test + Log

© 2026 Luminaai · Feature 01 v2.0 · Data: 1,000 records/panel from Luminaai_Panel_Sample_Data_1000.xlsx · GCC Utility Asset Intelligence Platform

SCADA

CMMS


GIS

AMI

Panel 5 – RUL analysis



Panel 6 -Coverage Gap

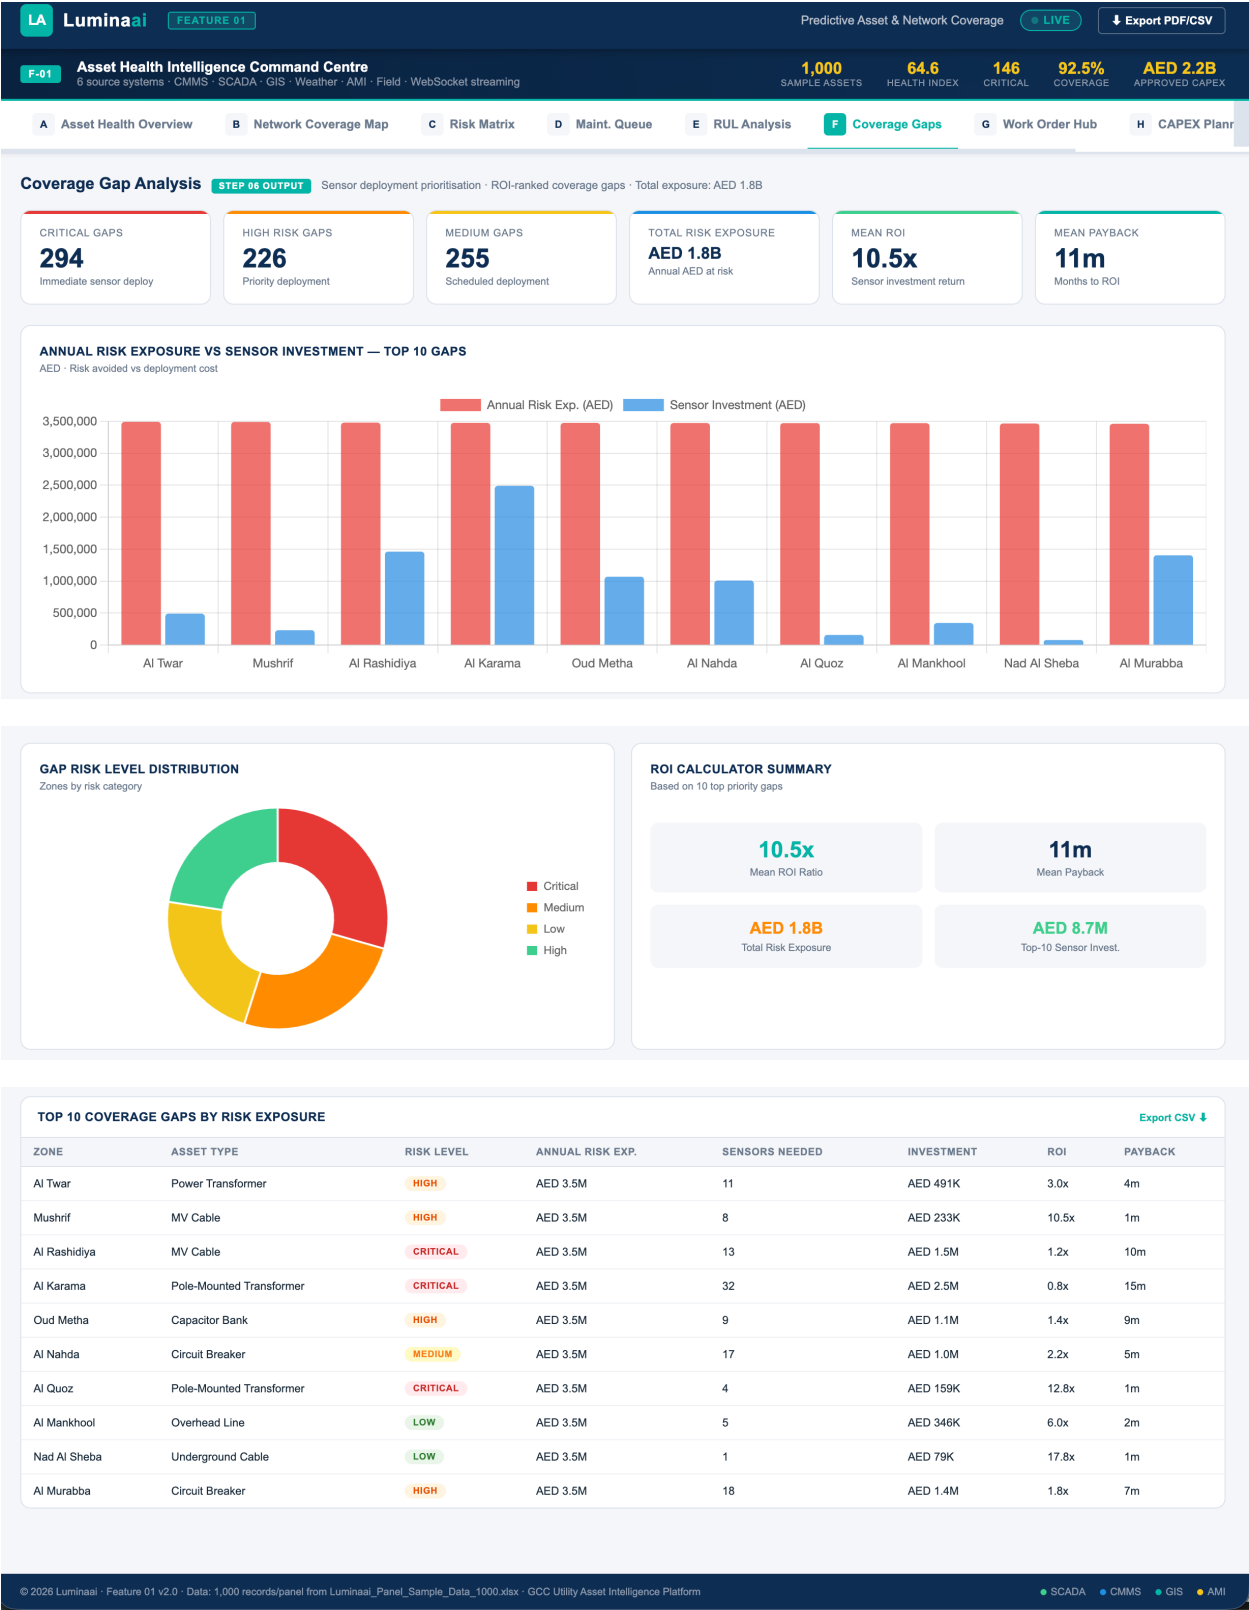

A

Asset Health Overview

B

Network Coverage Map

C

Risk Matrix

D

Maint. Queue

E

RUL Analysis

F

Coverage Gaps

G

Work Order Hub

H

CAPEX Plan

Coverage Gap Analysis

STEP 06 OUTPUT

Sensor deployment prioritisation · ROI-ranked coverage gaps · Total exposure: AED 1.8B

CRITICAL GAPS

294

Immediate sensor deploy

HIGH RISK GAPS

226

Priority deployment

MEDIUM GAPS

255

Scheduled deployment

TOTAL RISK EXPOSURE

AED 1.8B

Annual AED at risk

MEAN ROI

10.5x

Sensor investment return

MEAN PAYBACK

11m

Months to ROI

ANNUAL RISK EXPOSURE VS SENSOR INVESTMENT — TOP 10 GAPS

AED · Risk avoided vs deployment cost

Annual Risk Exp. (AED)

Sensor Investment (AED)

AI Twar	3,500,000	500,000
Mushrif	3,500,000	250,000
AI Rashidiya	3,500,000	1,500,000
AI Karama	3,500,000	2,500,000
Oud Metha	3,500,000	1,100,000
AI Nahda	3,500,000	1,000,000
AI Quoz	3,500,000	200,000
AI Mankhool	3,500,000	400,000
Nad Al Sheba	3,500,000	100,000
AI Murabba	3,500,000	1,400,000

GAP RISK LEVEL DISTRIBUTION

Zones by risk category

Critical

Medium

Low

High

ROI CALCULATOR SUMMARY

Based on 10 top priority gaps

10.5x

Mean ROI Ratio

11m

Mean Payback

AED 1.8B

Total Risk Exposure

AED 8.7M

Top-10 Sensor Invest.

TOP 10 COVERAGE GAPS BY RISK EXPOSURE

Export CSV

ZONE	ASSET TYPE	RISK LEVEL	ANNUAL RISK EXP.	SENSORS NEEDED	INVESTMENT	ROI	PAYBACK
AI Twar	Power Transformer	HIGH	AED 3.5M	11	AED 491K	3.0x	4m
Mushrif	MV Cable	HIGH	AED 3.5M	8	AED 233K	10.5x	1m
AI Rashidiya	MV Cable	CRITICAL	AED 3.5M	13	AED 1.5M	1.2x	10m
AI Karama	Pole-Mounted Transformer	CRITICAL	AED 3.5M	32	AED 2.5M	0.8x	15m
Oud Metha	Capacitor Bank	HIGH	AED 3.5M	9	AED 1.1M	1.4x	9m
AI Nahda	Circuit Breaker	MEDIUM	AED 3.5M	17	AED 1.0M	2.2x	5m
AI Quoz	Pole-Mounted Transformer	CRITICAL	AED 3.5M	4	AED 159K	12.8x	1m
AI Mankhool	Overhead Line	LOW	AED 3.5M	5	AED 346K	6.0x	2m
Nad Al Sheba	Underground Cable	LOW	AED 3.5M	1	AED 79K	17.8x	1m
AI Murabba	Circuit Breaker	HIGH	AED 3.5M	18	AED 1.4M	1.8x	7m

© 2026 Luminaai · Feature 01 v2.0 · Data: 1,000 records/panel from Luminaai_Panel_Sample_Data_1000.xlsx · GCC Utility Asset Intelligence Platform


SCADA

CMMS

GIS

AMI

Panel 7 – Work order Hub

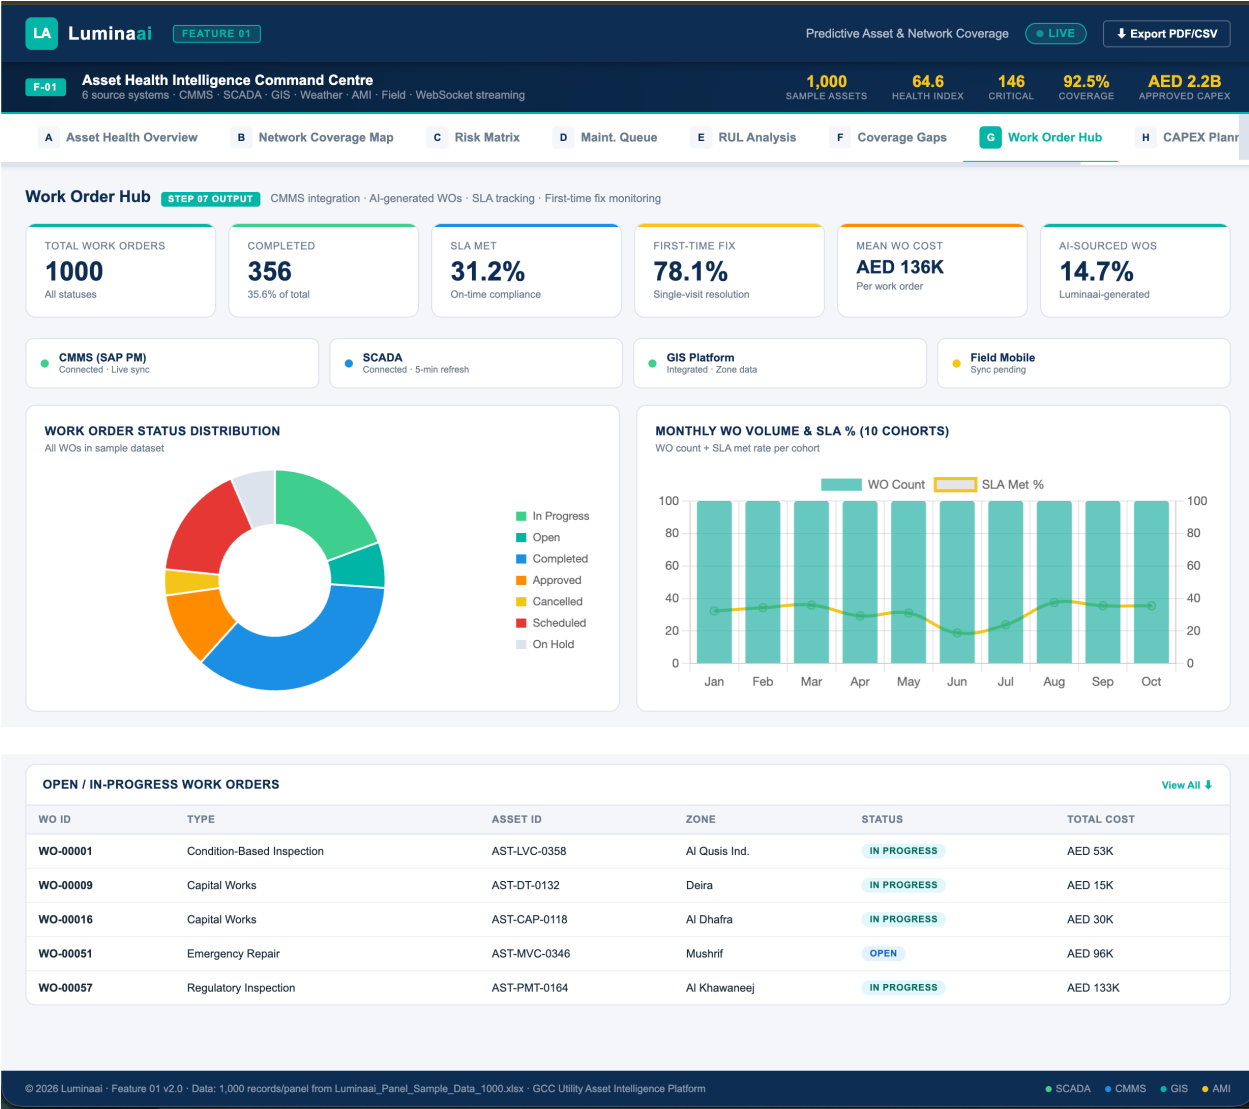

A

Asset Health Overview

B

Network Coverage Map

C

Risk Matrix

D

Maint. Queue

E

RUL Analysis

F

Coverage Gaps

G

Work Order Hub

H

CAPEX Plan

Work Order Hub

STEP 07 OUTPUT

CMMS integration · AI-generated WOs · SLA tracking · First-time fix monitoring

TOTAL WORK ORDERS

1000

All statuses

COMPLETED

356

35.6% of total

SLA MET

31.2%

On-time compliance

FIRST-TIME FIX

78.1%

Single-visit resolution

MEAN WO COST

AED 136K

Per work order

AI-SOURCED WOS

14.7%

Luminaai-generated

CMMS (SAP PM)

Connected · Live sync

SCADA

Connected · 5-min refresh

GIS Platform

Integrated · Zone data

Field Mobile

Sync pending

WORK ORDER STATUS DISTRIBUTION

All WOs in sample dataset

In Progress

Open

Completed

Approved

Cancelled

Scheduled

On Hold

MONTHLY WO VOLUME & SLA % (10 COHORTS)

WO count + SLA met rate per cohort

WO Count

SLA Met %

OPEN / IN-PROGRESS WORK ORDERS

View All

© 2026 Luminaai · Feature 01 v2.0 · Data: 1,000 records/panel from Luminaai_Panel_Sample_Data_1000.xlsx · GCC Utility Asset Intelligence Platform


SCADA

CMMS

GIS

AMI

Panel 8-CAPEX planner

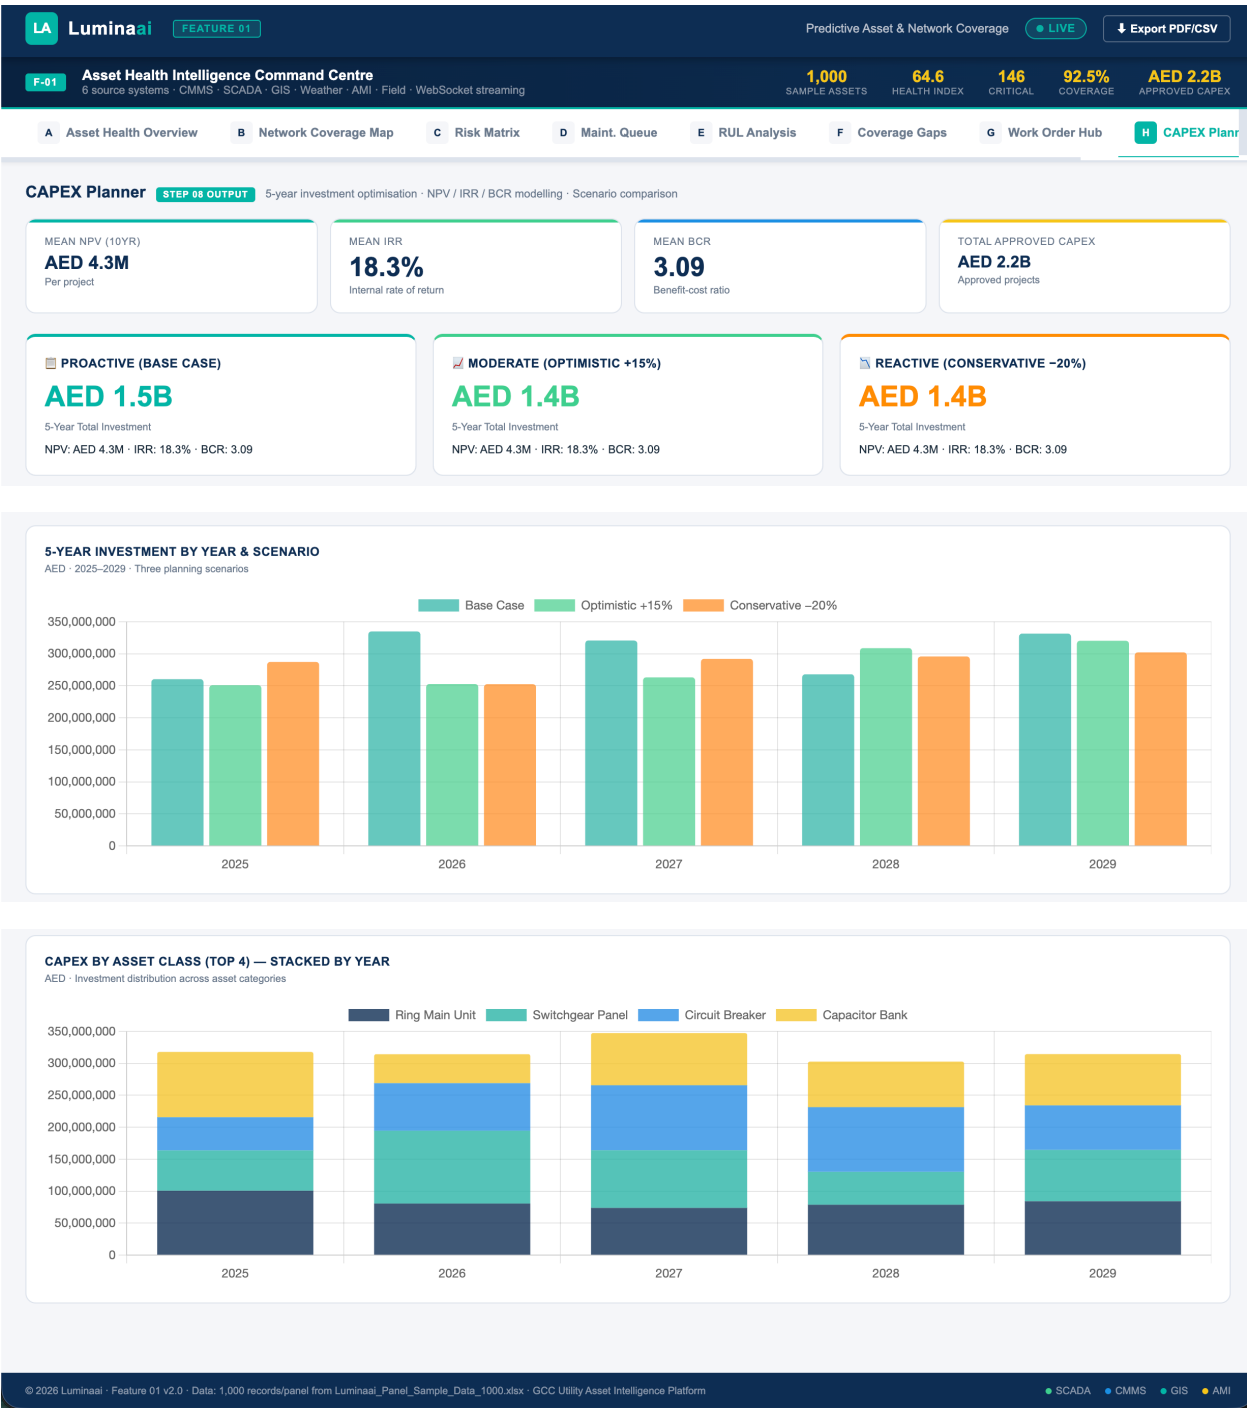

A Asset Health Overview

B Network Coverage Map

C Risk Matrix

D Maint. Queue

E RUL Analysis

F Coverage Gaps

G Work Order Hub

H CAPEX Planner

CAPEX Planner

STEP 08 OUTPUT

5-year investment optimisation · NPV / IRR / BCR modelling · Scenario comparison

MEAN NPV (10YR)

AED 4.3M

Per project

MEAN IRR

18.3%

Internal rate of return

MEAN BCR

3.09

Benefit-cost ratio

TOTAL APPROVED CAPEX

AED 2.2B

Approved projects

PROACTIVE (BASE CASE)

AED 1.5B

5-Year Total Investment

NPV: AED 4.3M · IRR: 18.3% · BCR: 3.09

MODERATE (OPTIMISTIC +15%)

AED 1.4B

5-Year Total Investment

NPV: AED 4.3M · IRR: 18.3% · BCR: 3.09

REACTIVE (CONSERVATIVE -20%)

AED 1.4B

5-Year Total Investment

NPV: AED 4.3M · IRR: 18.3% · BCR: 3.09

5-YEAR INVESTMENT BY YEAR & SCENARIO

AED · 2025-2029 · Three planning scenarios

Base Case

Optimistic +15%

Conservative -20%

Year	Base Case	Optimistic +15%	Conservative -20%
2025	260,000,000	250,000,000	280,000,000
2026	330,000,000	250,000,000	250,000,000
2027	320,000,000	260,000,000	290,000,000
2028	260,000,000	310,000,000	290,000,000
2029	330,000,000	320,000,000	300,000,000

CAPEX BY ASSET CLASS (TOP 4) — STACKED BY YEAR

AED · Investment distribution across asset categories

Ring Main Unit

Switchgear Panel

Circuit Breaker

Capacitor Bank

Year	Ring Main Unit	Switchgear Panel	Circuit Breaker	Capacitor Bank
2025	100,000,000	60,000,000	50,000,000	100,000,000
2026	80,000,000	120,000,000	70,000,000	50,000,000
2027	70,000,000	90,000,000	100,000,000	100,000,000
2028	80,000,000	50,000,000	100,000,000	80,000,000
2029	80,000,000	80,000,000	70,000,000	100,000,000

© 2026 Luminaai · Feature 01 v2.0 · Data: 1,000 records/panel from Luminaai_Panel_Sample_Data_1000.xlsx · GCC Utility Asset Intelligence Platform

SCADA

CMMS

GIS

AMI