


<u>C1</u>

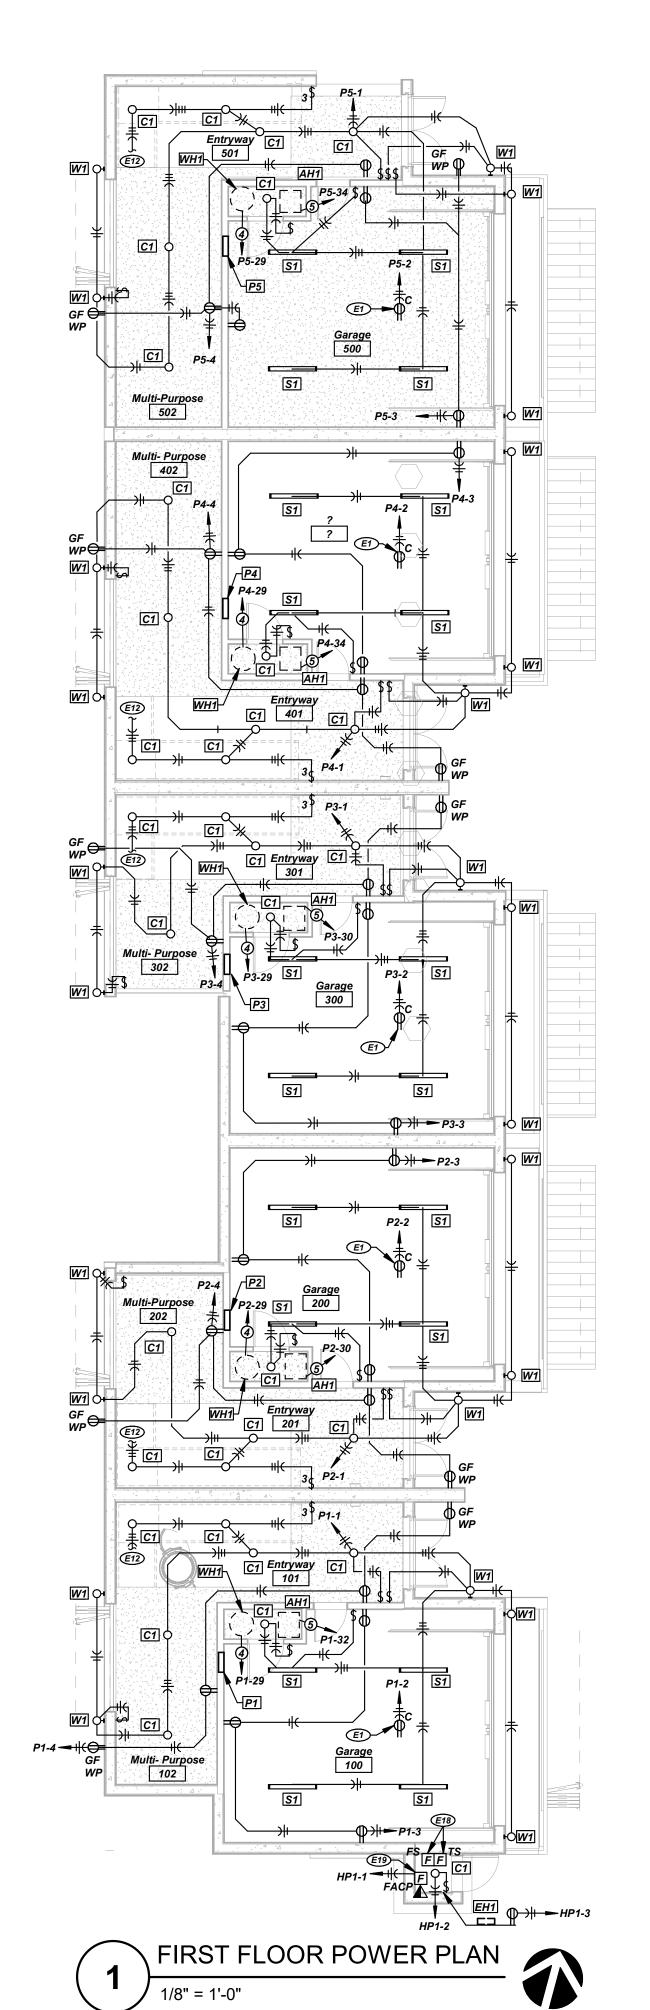

KEYNOTES:

E1 RECEPTACLE FOR OVERHEAD GARAGE DOOR. FIELD VERIFY EXACT LOCATION.

E7 LIGHT FIXTURES INSTALLED ON THIRD FLOOR AND CIRCUITED TO SWITCH LOCATED ON SECOND FLOOR.

E8 LIGHT SWITCH CIRCUITED TO LIGHT FIXTURES ON THIRD FLOOR ABOVE GREAT ROOM. E10 REFER TO 3/E1.1 FOR CONTINUATION.

E11 REFER TO 3/E1.2 FOR CONTINUATION. E12 REFER TO 2/E1.1 FOR CONTINUATION.

E13 REFER TO 1/E1.1 FOR CONTINUATION. E14 REFER TO 1/E1.2 FOR CONTINUATION. E16 POWER FOR ELECTRIC FIREPLACE. COORDINATE LOCATION AND REQUIREMENTS WITH ARCHITECT PRIOR TO ROUGH-IN.

E17 RECEPTACLE FOR TV. COORDINATE LOCATION AND MOUNTING HEIGHT WITH ARCHITECT PRIOR TO ROUGH-IN. E18 COORDINATE INSTALLATION OF FIRE FLOW AND TAMER

SWITCHES WITH FIRE SPRINKLER CONTRACTOR. E19 PROVIDE FIRE ALARM CONTROL PANEL WITH DIGITAL ALARM COMMUNICATOR. PROVIDE ALL COMPONENTS FOR MONITORING FIRE SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES. COORDINATE WITH FIRE SPRINKLER CONTRACTOR. PROVIDE TWO DEDICATED PHONE LINES, PROGRAMMING AND COORDINATION WITH OWNER FOR REMOTE MONITORING.

(3) #10 AND (1) #10 GROUND IN 0.75" CONDUIT.

② (3) #8 AND (1) #10 GROUND IN 0.75" CONDUIT. 3 (2) #10 AND (1) #10 GROUND IN 0.5" CONDUIT. (2) #8 AND (1) #10 GROUND IN 0.75" CONDUIT.

(2) #6 AND (1) #8 GROUND IN 0.75" CONDUIT.

Ryan S. Jones, Engineer Florida PE 79022

X

SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

PROJECT NO: 090721

2/23/23