
Delactylation-associated regulators and DDR protein fractions

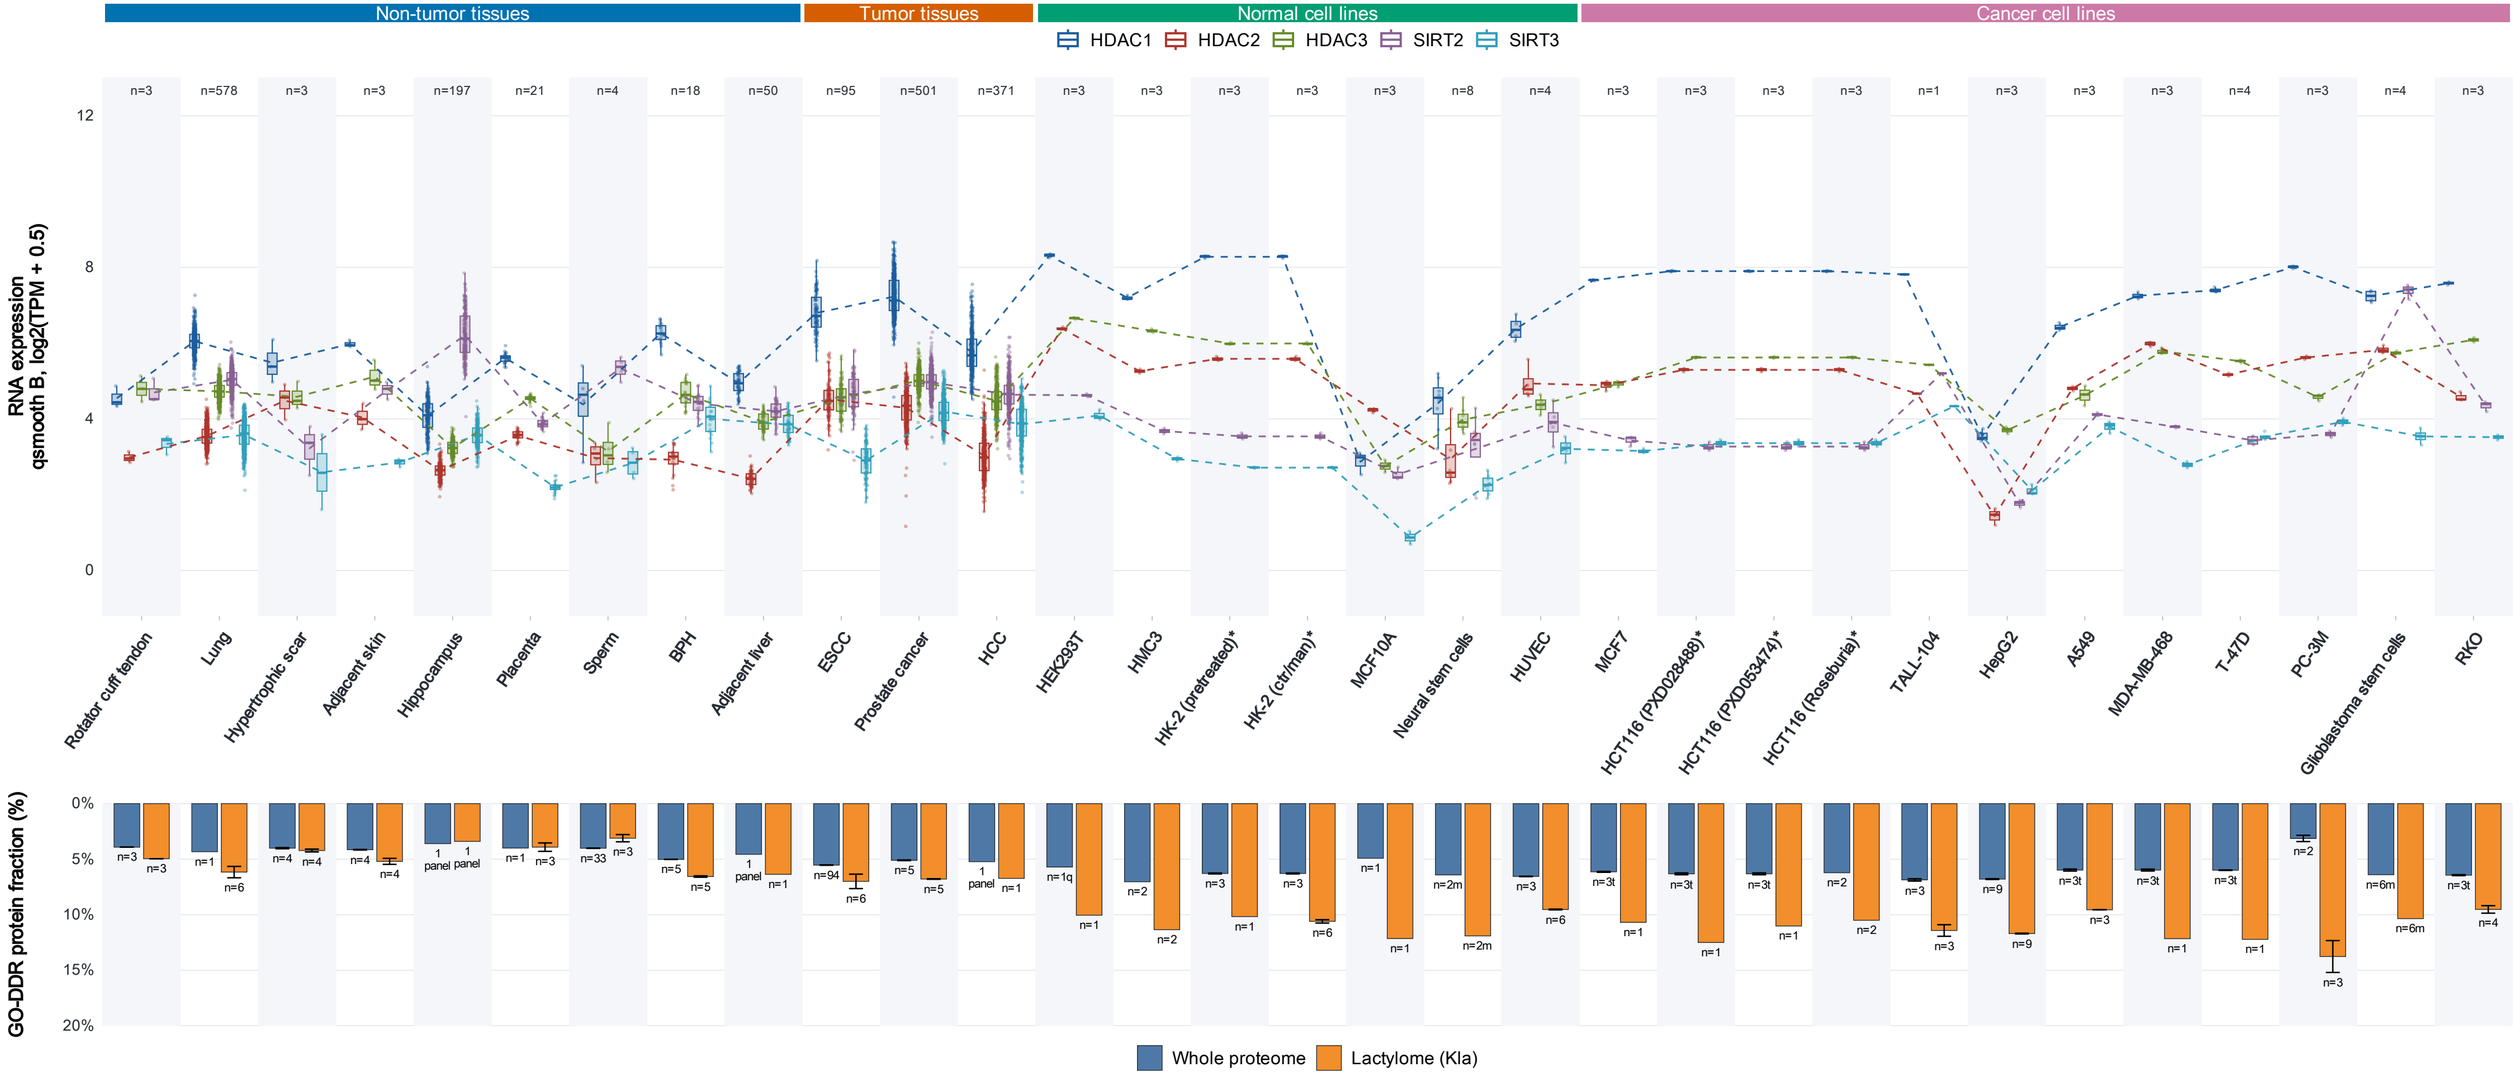

RNA: boxes show median and IQR; whiskers extend to 1.5 x IQR. Points are sample records; dashed lines connect material-level means.
Counts: RNA n = unique sample IDs per reference; each DDR bar labels its own source-unit n. 1 panel denotes a processed matrix, not a sample count.
DDR: calculate 100 x GO-DDR proteins / detected proteins per source unit, then plot mean +/- SEM (62 bars). Singletons and unreplicated conditions have no error bar.
t: technical-preparation SEM; m: cell-model mean, no SEM; q: pooled QC source. Other errors describe included source observations; conditions are in the data table.
p: one author-processed protein panel; original per-sample detection masks are unavailable, so no sample SEM is shown.
* Shared RNA reference: HCT116 (3 columns), HK-2 (2 columns). 31 display columns correspond to 28 RNA references; reference cohorts and conditions are listed in the mapping table.