3CON Anlagenbau GmbH

Kleinfeld 16
A-6341 Ebbs
+43 (0) 5373 42111 - 0

Company / customer	3CON
Description	DAG_BR
Collector number	1011002189

Project name	1011005811_CEFA
Responsible for project	Projektleiter
Last EPLAN version used	2024.0.3
Manufacturing date	2024
Place of installation	Zaragoza / ESP

Created on 23.08.2024

Edit date 16.01.2025 by (short name) C.DEMIR

Number of pages 164

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
&BAA	1	Title / cover page		23.08.2024	AK
&BAB	1	Table of contents		27.11.2024	AK
&BAB	2	Table of contents		27.11.2024	AK
&BAB	3	Table of contents		11.11.2024	AK
&BAB	4	Table of contents		27.11.2024	AK
&BAB	5	Table of contents		16.01.2025	AK
&BAB	6	Table of contents		16.01.2025	AK
&BAB	7	Table of contents		16.01.2025	AK
&BAB	8	Table of contents		16.01.2025	AK
&EEB	1	IEC 61439-2		23.08.2024	AK
&EEC	1	Implementation regulations		23.08.2024	AK
&EDB	1	Overview projects		27.11.2024	AK
&EDB	2	Structure identifier overview		25.09.2024	AK
&EDB	3	Structure identifier overview		25.09.2024	AK
&EDB	4	Structure identifier overview		25.09.2024	AK
&EFA	1	Bus overview LT01		23.08.2024	AK
&EFA	2	Bus overview UT01		23.08.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=GE		**POT equalization**			
&EFS +LT01 =GE	1	Potential distribution		11.11.2024	KP
&EFS +UT01 =GE	1	Potential distribution		23.08.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=GD24		**Power DC (24Vdc)**			
&EFS +LT01.X01 =GD24	1	Potential distribution	81	27.11.2024	AK

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=GD24		**Power DC (24Vdc)**			
&EFS +UT01.X01 =GD24	1	Potential distribution	81	27.11.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=GN		**N-distribution**			
&EFS +LT01 =GN	1	Neutral conductor distribution		03.09.2024	AK
&EFS +UT01 =GN	1	Neutral conductor distribution		03.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=PLC		**PLC control**			
&EFA2 +LT01.X01 =PLC	1	PLC-Diagram		27.11.2024	AK
&EFA2 +LT01.X01 =PLC	2	PLC-Diagram		27.11.2024	AK
&EFA2 +LT01.X01 =PLC	3	PLC-Diagram		25.09.2024	AK
&EFA3 +LT01.X01 =PLC	1	PLC card overview		27.11.2024	AK
&EFS +LT01.X01 =PLC	1	PLC-ET200SP		27.11.2024	AK
&EFS +LT01.X01 =PLC	2	PLC-ET200SP		27.11.2024	AK
&EFA2 +UT01.X01 =PLC	1	PLC-Diagram		27.11.2024	AK
&EFA2 +UT01.X01 =PLC	2	PLC-Diagram		27.11.2024	AK
&EFA3 +UT01.X01 =PLC	1	PLC card overview		27.11.2024	AK
&EFS +UT01.X01 =PLC	1	PLC-ET200SP		27.11.2024	AK
&EFS +UT01.X01 =PLC	2	Information storage		25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=HMI		**Human Machine Interface**			
&EFS +LT01 =HMI	1	Push buttons and switches		25.09.2024	AK
&EFS +LT01 =HMI	2	Push buttons and switches		25.09.2024	AK

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=XS		**Connecting systems (docking station)**			
&EFS +LT01 =XS	1	Plug		23.08.2024	AK
&EFS +UT01 =XS	1	Plug		23.08.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=EA		**process water**			
&EFS +LT01 =EA	1	Temperature queries temperature control circuits		25.09.2024	AK
&EFS +UT01 =EA	1	Temperature queries temperature control circuits		25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=EB		**Generation process heat infrared**			
&EFS +LT01.HS01=EB	1	Heating XS2		26.09.2024	AK
&EFS +LT01.HS01=EB	2	Heating XS3		04.09.2024	AK
&EFS +LT01.HS01=EB	3	Heating XS4		11.11.2024	AK
&EFS +LT01.HS01=EB	4	Heating XS4		26.09.2024	AK
&EFS +LT01.HS01=EB	5	Heating XS5		26.09.2024	AK
&EFS +LT01.HS01=EB	6	Heating XS6		04.09.2024	AK
&EFS +LT01.HS01=EB	7	Heating XS7		11.11.2024	AK
&EFS +LT01.HS01=EB	8	Heating XS7		26.09.2024	AK
&EFS +LT01.HS01=EB	9	Temperature queries temperature control circuits		25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=GK.1		**Energy air**			
&EFS +UT01 =GK.1	1	Accumulation heat fan		23.08.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=GQ		**Energy vacuum**			
&EFS +LT01 =GQ	1	Component recognition	81	11.11.2024	AK

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=GQ		**Energy vacuum**			
&EFS +LT01 =GQ	2	Valves		27.11.2024	AK
&EFS +UT01 =GQ	1	Component recognition	81	11.11.2024	AK
&EFS +UT01 =GQ	2	Valves		27.11.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=XF01		**Field distributor**			
&EFS1 +LT01 =XF01	1	Field distributor		25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=BA05		**Component-recognition**			
&EFS +LT01 =BA05	1	Queries		27.11.2024	AK
&EFS +LT01 =BA05	2	Queries		27.11.2024	AK
&EFS +UT01 =BA05	1	Queries		25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=M25		**Drive heating shuttle**			
&EFS1 +LT01 =M25	1	Drive		11.11.2024	KP
&EFS1 +LT01 =M25	2	Queries		30.10.2024	AK
&EFS1 +LT01 =M25	3	Queries		25.09.2024	AK
&EFS1 +LT01 =M25	4	single valves		11.11.2024	AK
&EFS1 +UT01 =M25	1	Drive		27.11.2024	AK
&EFS1 +UT01 =M25	2	Drive		27.11.2024	AK
&EFS1 +UT01 =M25	3	Queries	81	25.09.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=M51		**Slider**			
&EFS1 +LT01 =M51	1	Queries		25.09.2024	AK

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=M51		**Slider**			
&EFS1 +LT01 =M51	2	Queries		25.09.2024	AK
&EFS1 +LT01 =M51	3	Queries		25.09.2024	AK
&EFS1 +LT01 =M51	4	single valves		25.09.2024	AK
&EFS1 +LT01 =M51	5	single valves		25.09.2024	AK
&EFS1 +UT01 =M51	1	Queries		25.09.2024	AK
&EFS1 +UT01 =M51	2	Queries		25.09.2024	AK
&EFS1 +UT01 =M51	3	single valves		30.10.2024	AK
Function designation	**Page**	**Page description**	**Notes**	**Date**	**Processor**
=REPORT		**Project-related evaluations**			
&EMA3 +LT01 =REPORT	1	connector overview		04.09.2024	AK
&EMA4 +LT01 =REPORT	1	Connector layout plan : HAR.09 14 024 0371		16.01.2025	
&EMA4 +LT01 =REPORT	2	Connector layout plan : HAR.09 14 024 0371		16.01.2025	
&EMA4 +LT01 =REPORT	3	Connector layout plan : HAR.09 33 024 2601		16.01.2025	
&EMA4 +LT01 =REPORT	4	Connector layout plan : HAR.09 33 024 2601		16.01.2025	
&EMA4 +LT01 =REPORT	5	Connector layout plan : HAR.09 14 024 0371		16.01.2025	
&EMA4 +LT01 =REPORT	6	Connector layout plan : HAR.09 33 024 2601		16.01.2025	
&EMA4 +LT01 =REPORT	7	Connector layout plan : HAR.09 33 024 2601		16.01.2025	
&EMA4 +LT01 =REPORT	8	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EMA4 +LT01 =REPORT	9	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EPA +LT01 =REPORT	1	Equipment list		04.09.2024	AK
&EPC1 +LT01 =REPORT	1	Article Sum BOM		16.01.2025	
&EPC1 +LT01 =REPORT	2	Article Sum BOM		16.01.2025	
&EPC1 +LT01 =REPORT	3	Article Sum BOM		16.01.2025	
&EPC1 +LT01 =REPORT	4	Article Sum BOM		16.01.2025	
&EPC1 +LT01 =REPORT	5	Article Sum BOM		16.01.2025	

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=REPORT		**Project-related evaluations**			
&EPC1 +LT01 =REPORT	6	Article Sum BOM		16.01.2025	
&ELU +LT01.X01 =REPORT	1	LT01.X01		16.01.2025	
&ELU +LT01.X01 =REPORT	8	S1:Montageplatte		16.01.2025	
&ELU +LT01.X01 =REPORT	9	S1:Montageplatte		16.01.2025	
&EMA1 +LT01.X01 =REPORT	1	Terminal-strip overview		23.08.2024	AK
&EMA2 +LT01.X01 =REPORT	1	Klemmenplan ==1005811+LT01.X01-XD.21		25.09.2024	AK
&EMA2 +LT01.X01 =REPORT	2	Klemmenplan ==1005811+LT01.X01-XD.22		25.09.2024	AK
&EMA2 +LT01.X01 =REPORT	3	Klemmenplan ==1005811+LT01.X01-XD.24		04.09.2024	AK
&EMA2 +LT01.X01 =REPORT	4	Klemmenplan ==1005811+LT01.X01-XD.25		04.09.2024	AK
&EMA2 +LT01.X01 =REPORT	5	Klemmenplan ==1005811+LT01.X01-XEA.1		04.09.2024	AK
&EPA +LT01.X01 =REPORT	1	Equipment list		04.09.2024	AK
&EPC1 +LT01.X01 =REPORT	1	Article Sum BOM		16.01.2025	
&EPC1 +LT01.X01 =REPORT	2	Article Sum BOM		16.01.2025	
&EPC1 +LT01.X01 =REPORT	3	Article Sum BOM		16.01.2025	
&EMA3 +LT01.HS01=REPORT	1	connector overview		25.09.2024	AK
&EMA4 +LT01.HS01=REPORT	1	Connector layout plan : WEI.1674760000_1pcs		16.01.2025	
&EMA4 +LT01.HS01=REPORT	2	Connector layout plan : WEI.1674760000_1pcs		16.01.2025	
&EMA4 +LT01.HS01=REPORT	3	Connector layout plan : WEI.1674760000_1pcs		16.01.2025	
&EMA4 +LT01.HS01=REPORT	4	Connector layout plan : WEI.1674760000_1pcs		16.01.2025	
&EPA +LT01.HS01=REPORT	1	Equipment list		25.09.2024	AK
&EPC1 +LT01.HS01=REPORT	1	Article Sum BOM		16.01.2025	
&EPC1 +LT01.HS01=REPORT	2	Article Sum BOM		16.01.2025	
&EMA3 +UT01 =REPORT	1	connector overview		04.09.2024	AK
&EMA4 +UT01 =REPORT	1	Connector layout plan : HAR.09 14 024 0371		16.01.2025	
&EMA4 +UT01 =REPORT	2	Connector layout plan : HAR.09 14 024 0371		16.01.2025	

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=REPORT		**Project-related evaluations**			
&EMA4 +UT01 =REPORT	3	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EMA4 +UT01 =REPORT	4	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EMA4 +UT01 =REPORT	5	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EMA4 +UT01 =REPORT	6	Connector layout plan : PXC.SACC-M 8MS-3QO-0,5-M		16.01.2025	
&EPA +UT01 =REPORT	1	Equipment list		04.09.2024	AK
&EPC1 +UT01 =REPORT	1	Article Sum BOM		16.01.2025	
&EPC1 +UT01 =REPORT	2	Article Sum BOM		16.01.2025	
&EPC1 +UT01 =REPORT	3	Article Sum BOM		16.01.2025	
&EPC1 +UT01 =REPORT	4	Article Sum BOM		16.01.2025	
&ELU +UT01.X01 =REPORT	1	UT01.X01		16.01.2025	
&ELU +UT01.X01 =REPORT	6	S1:Montageplatte		16.01.2025	
&ELU +UT01.X01 =REPORT	7	S1:Montageplatte		16.01.2025	
&EMA1 +UT01.X01 =REPORT	1	Terminal-strip overview		23.08.2024	AK
&EMA2 +UT01.X01 =REPORT	1	Klemmenplan ==1005811+UT01.X01-XD.21		04.09.2024	AK
&EMA2 +UT01.X01 =REPORT	2	Klemmenplan ==1005811+UT01.X01-XD.22		04.09.2024	AK
&EMA2 +UT01.X01 =REPORT	3	Klemmenplan ==1005811+UT01.X01-XD.24		04.09.2024	AK
&EMA2 +UT01.X01 =REPORT	4	Klemmenplan ==1005811+UT01.X01-XD.25		04.09.2024	AK
&EMA2 +UT01.X01 =REPORT	5	Klemmenplan ==1005811+UT01.X01-XE		04.09.2024	AK
&EPA +UT01.X01 =REPORT	1	Equipment list		04.09.2024	AK
&EPC1 +UT01.X01 =REPORT	1	Article Sum BOM		16.01.2025	
&EPC1 +UT01.X01 =REPORT	2	Article Sum BOM		16.01.2025	
&EPC1 +UT01.X01 =REPORT	3	Article Sum BOM		16.01.2025	
&ELU +LT01.HS01.X01 =REPORT	1	LT01.HS01.X01		16.01.2025	
&ELU +LT01.HS01.X01 =REPORT	3	S1:Montageplatte		16.01.2025	
&ELU +LT01.HS01.X01 =REPORT	4	S1:Montageplatte		16.01.2025	

Table of contents

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F06_001_V01

Function designation	Page	Page description	Notes	Date	Processor
=REPORT		**Project-related evaluations**			
&EMA1 +LT01.HS01=REPORT	1	Terminal-strip overview		23.08.2024	AK
&EMA2 +LT01.HS01=REPORT	1	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		23.08.2024	AK
&EMA2 +LT01.HS01=REPORT	2	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	3	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	4	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	5	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		23.08.2024	AK
&EMA2 +LT01.HS01=REPORT	6	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	7	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	8	Klemmenplan ==1005811+LT01.HS01.X01-XD.51		04.09.2024	AK
&EPA +LT01.HS01=REPORT	1	Equipment list		03.09.2024	AK
&EPC1 +LT01.HS01=REPORT	1	Article Sum BOM		16.01.2025	
&ELU +LT01.HS01=REPORT	1	LT01.HS01.X02		16.01.2025	
&ELU +LT01.HS01=REPORT	2	S1:Montageplatte		16.01.2025	
&ELU +LT01.HS01=REPORT	3	S1:Montageplatte		16.01.2025	
&EMA1 +LT01.HS01=REPORT	1	Terminal-strip overview		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	1	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	2	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	3	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	4	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	5	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	6	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	7	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EMA2 +LT01.HS01=REPORT	8	Klemmenplan ==1005811+LT01.HS01.X02-XD.51		04.09.2024	AK
&EPA +LT01.HS01=REPORT	1	Equipment list		03.09.2024	AK
&EPC1 +LT01.HS01=REPORT	1	Article Sum BOM		16.01.2025	

IEC 61439-2

Standard	IEC 61439-2	Protection class	IP43 (external): Indoor installation	IP2X / IPXXB (internal)	
Grid form (feed-in)	TN-S	Basic protection	Protection by housing	Fault protection	Protection through automatic switch-off
Rated voltage			Un = 4X0V	Rated current (switchgear combination)	InA = **XXX**
Rated insulation voltage			Ui = 4X0V	Rated load factor (switchgear combination)	RDF = 0,9
Rated impulse withstand voltage			Uimp = 2,5kV (Cat. II)	Rated impulse withstand current (switchgear and controlgear assembly)	Ipk = 35kA
Rated frequency			fn = 50Hz		
Rated short-circuit current, conditional (back-up fuse)			Icc = XXXkA	Recommended fuse	Siemens 3NA3xxx (IEC 60269-3-1)
Current limiting properties (back-up fuse)			I²t = XXXXXXXA²S	min. Cable cross-section 35mm² for connecting cable Cable dimensioning of the connecting cable must be carried out by the operator of the system.	
Rated current (circuits)		Übersetzung fehlt			
Auxiliary circuits			Vaux = 24VDC		
		Electromagnetic compatibility		EMC immunity	Environment A
				EMC interference emission	Environment B
Installation type			stationary	CONFIRMATION	
Installation height			<2000m		
Ambient air temperature			-5°C - +40°C		
Maximum average ambient air temperature in 24h			+35°C		
Relative humidity			< 70%		
Degree of soiling			3		
Weight			~ 580kg	Date	Signature

IMPLEMENTATION REGULATIONS

WIRING REGULATIONS

(Symbol in accordance with IEC 60757)

WIRING COLORS

Main current AC	black (BK)	Control circuit AC > 50V	red (RD) after Control transformer	External voltage	orange (OG)
Main current DC	black (BK)	Control circuit AC < 50V	red (RD) after Control transformer	Interlock circuit	orange (OG)
Neutral conductor	blue (BU)	Control circuit 24Vdc	dark blue (DBU)	Measuring lines	white (WH)
Protective wire	green-yellow (GNYE)	Control circuit GND	dark blue/white (DBU/WH)		

MINIMUM CROSS-SECTIONS

Main current	1,5 mm²
Protective wire	1,5 mm²
Control line	1.0 mm²
PLC wiring	0.5 mm²

WIRING

0.5 - 1.0 mm²	H05V-K PVC conductor line
1.5 - 150 mm²	H07V-K PVC conductor line
Wire end finishing	not required

MATERIAL REGULATIONS

ENCLOSURES

Enclosures	RITTAL VX25
Enclosure base	RITTAL VX25
Enclosure color	RAL 7035

LABELING

Operating resources	Standard
Single wires	not required

CONFIRMATION

Date Signature

Structure identifier overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F24_002_V01_2

Project	Type
1005811	BR 449_glove box_LHD/RHD_WELD_TOOL_1+1
TOOL_STD	

Structure identifier overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F24_002_V01

Complete designation	Labeling	Structure description
&BAA	Dokumentenart	Title / cover page
&BAB	Dokumentenart	Table of contents
&EDB	Dokumentenart	Structure description
&EEB	Dokumentenart	Standards and guidelines
&EEC	Dokumentenart	Safety instructions / Technical implementation regulations
&EFA	Dokumentenart	Functional overview documents
&EFA2	Dokumentenart	PLC diagram
&EFA3	Dokumentenart	PLC card overview
&EFS	Dokumentenart	Wiring diagram
&EFS1	Dokumentenart	Electrical engineering schematic
&ELU	Dokumentenart	In/on-equipment location documents
&EMA1	Dokumentenart	Terminal strip overview
&EMA2	Dokumentenart	Terminal diagram
&EMA3	Dokumentenart	Connector overview
&EMA4	Dokumentenart	Connector layout plan
&EPA	Dokumentenart	Material lists
&EPC1	Dokumentenart	Article sum BOM
+B01	Ortskennzeichen	Base
+B02	Ortskennzeichen	Lift table
+B03	Ortskennzeichen	Turntable
+LT01	Ortskennzeichen	lower tool 1
+LT01.HS01	Ortskennzeichen	Heating shuttle 1 lower tool 1
+LT01.HS01.X01	Ortskennzeichen	
+LT01.HS01.X02	Ortskennzeichen	
+LT01.X01	Ortskennzeichen	Terminal box lower tool 1
+LT02	Ortskennzeichen	Lower tool 2

Structure identifier overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F24_002_V01

Complete designation	Labeling	Structure description
+UT01	Ortskennzeichen	Upper tool 1
+UT01.HS01	Ortskennzeichen	Heating shuttle 1 upper tool 1
+UT01.X01	Ortskennzeichen	Terminal box upper tool 1
+UT02	Ortskennzeichen	Upper tool 2
==1005811	Funktionale Zuordnung	BR 449_glove box_LHD/RHD_WELD_TOOL_1+1
=AA	Funktionskennzeichen	General installations
=AC	Funktionskennzeichen	Installation control cabinet tempering
=BA05	Funktionskennzeichen	Component-recognition
=EA	Funktionskennzeichen	process water
=EB	Funktionskennzeichen	Generation process heat infrared
=EC	Funktionskennzeichen	Generation process heat cartridge
=GB	Funktionskennzeichen	Power AC
=GD24	Funktionskennzeichen	Power DC (24Vdc)
=GE	Funktionskennzeichen	POT equalization
=GK	Funktionskennzeichen	Energy air
=GK.1	Funktionskennzeichen	Fan
=GM	Funktionskennzeichen	Energy measurement
=GN	Funktionskennzeichen	N-distribution
=GQ	Funktionskennzeichen	Energy vacuum
=HMI	Funktionskennzeichen	Human Machine Interface
=M25	Funktionskennzeichen	Drive heating shuttle
=M51	Funktionskennzeichen	Slider
=ME	Funktionskennzeichen	Drives controlled (servo)
=ME.1	Funktionskennzeichen	Drive lift table
=ME.3	Funktionskennzeichen	Drive turn table
=PLC	Funktionskennzeichen	PLC control

Structure identifier overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F24_002_V01

Complete designation	Labeling	Structure description
=REPORT	Funktionskennzeichen	Project-related evaluations
=TC	Funktionskennzeichen	Tool change
=TC.CS1	Funktionskennzeichen	Clamping system typ 1
=TC.CS2	Funktionskennzeichen	Clamping system typ 2
=XF01	Funktionskennzeichen	Field distributor
=XQHC	Funktionskennzeichen	Hot contact welding
=XS	Funktionskennzeichen	Connecting systems (docking station)

lower tool 1
+LT01

Terminal box lower tool 1
+LT01.X01

=XS
lower tool 1

A1-YE
A2-OG
A3-WH
A4-BU

-WGB1
FD 2x2xAWG22
PN Cat.5 FD

=XS+LT01&EFS/1.0
-XS1 A1

=XS+LT01&EFS/1.0
XS1 A1 =GD24+LT01.X01&EFS/1.2
XS1

=PLC
PLC control

-KEC1 =PLC+LT01.X01&EFS/1.0
Siemens
6ES7155-6AA01-0BN0
IM 155-6PN ST incl. BA 2xRJ45

-KF1 **CPU:** TIA1005587.S7_CPU.1
P1 PN 192.168.0.2
255.255.255.0
P2 PN
CPU: TIA1005587.S7_CPU.1

==&EDB/4

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Bus overview LT01	==1005811	=	&EFA
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Functional overview documents
				Drawing number 1005811	Version				+	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 23.08.2024		Sheet 16 from 164

Upper tool 1
+UT01

Terminal box upper tool 1
+UT01.X01

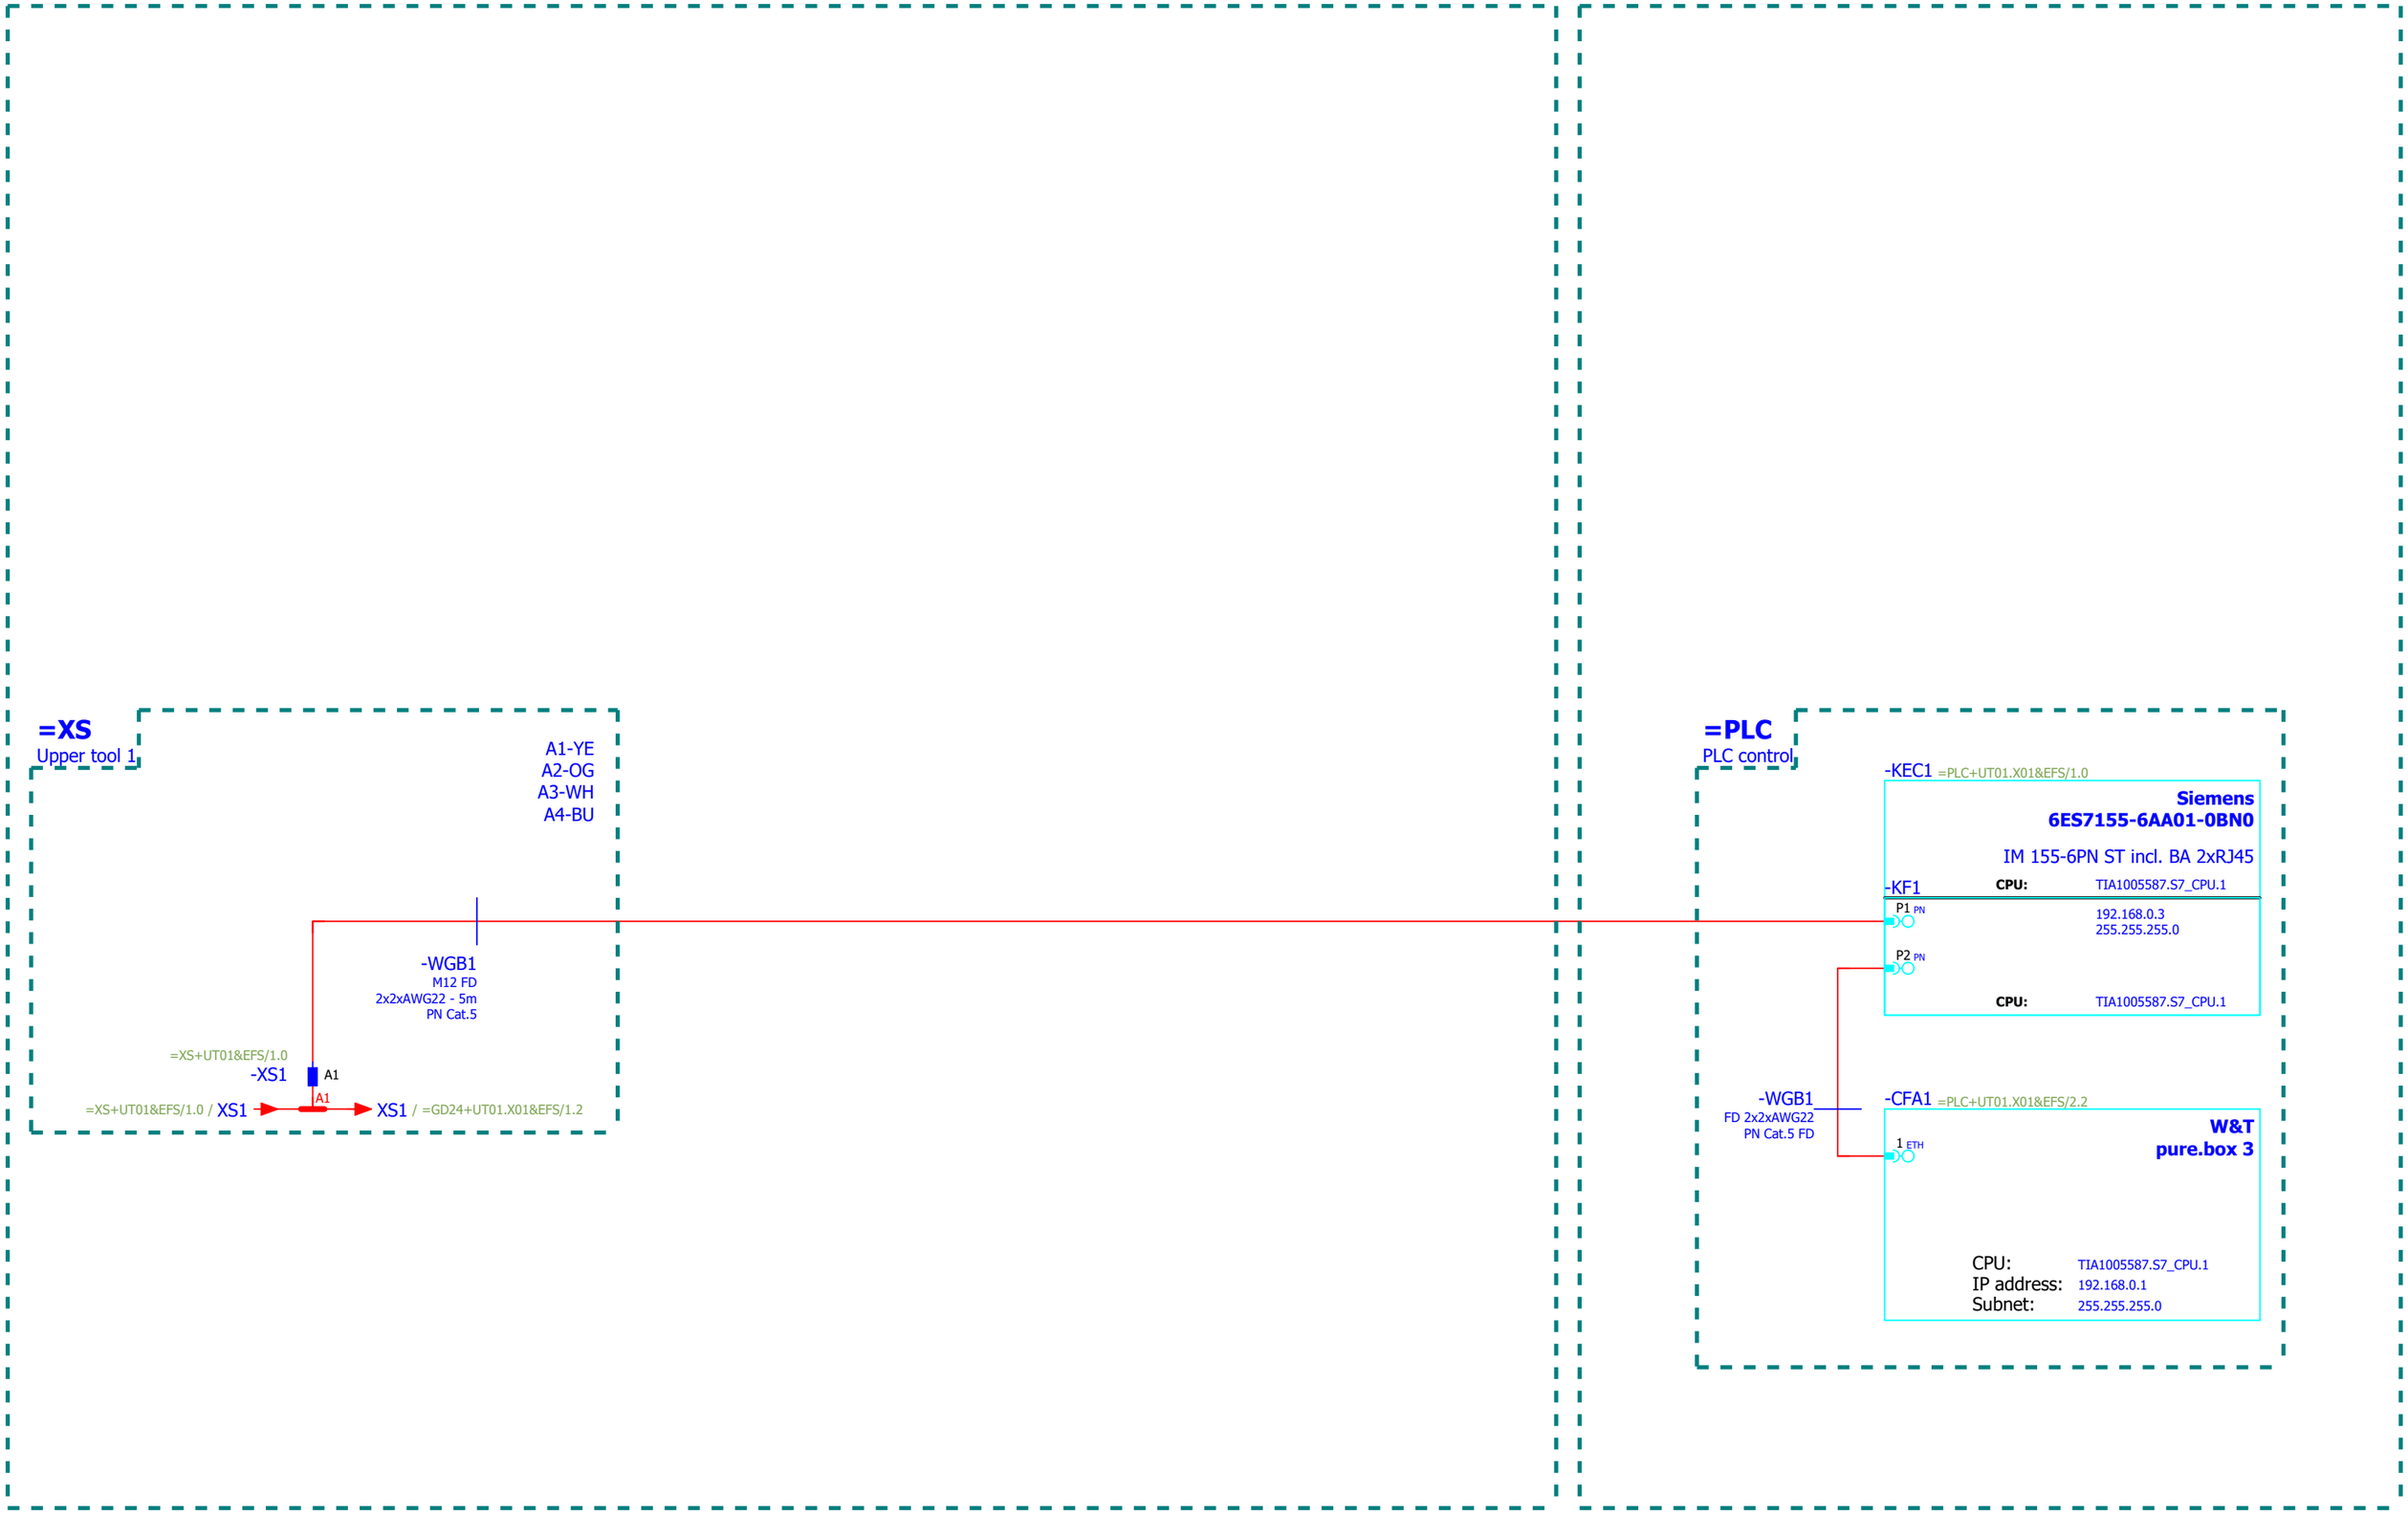

1

=GE+LT01&EFS/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Bus overview UT01	==1005811	=	&EFA
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Functional overview documents
					Drawing number 1005811	Version				+	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 23.08.2024		Sheet 17 from 164

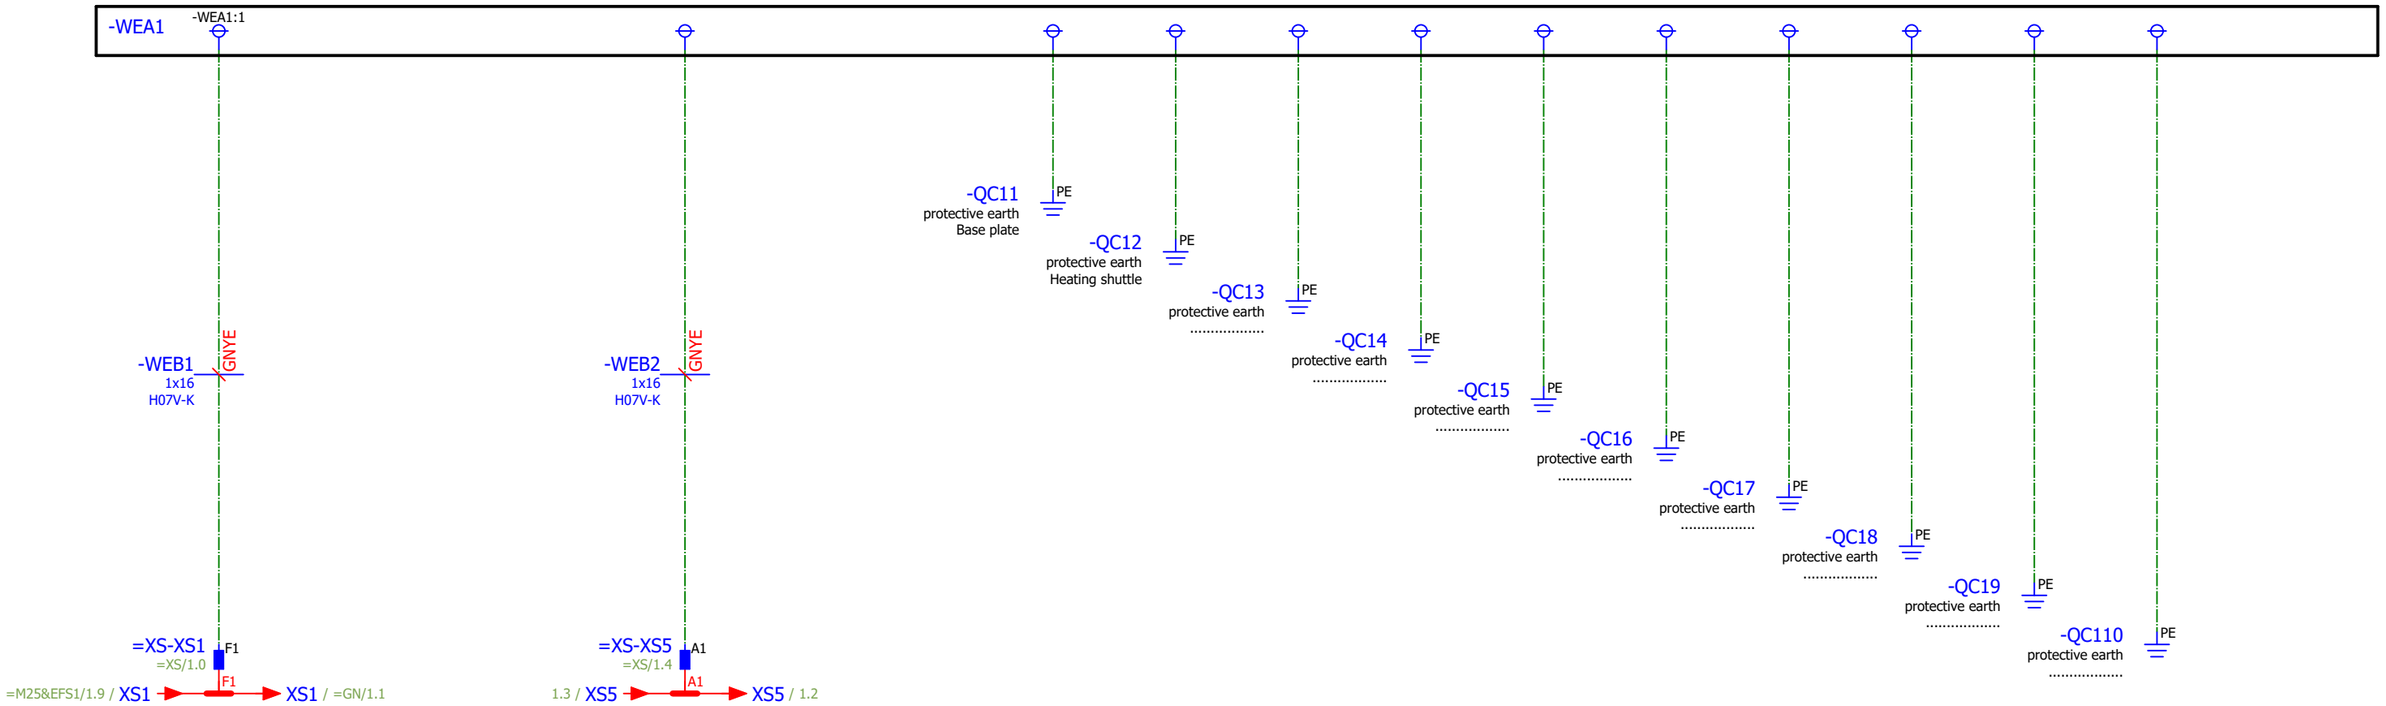

=+&EFA/2

+UT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Potential distribution	==1005811	=GE	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							POT equalization	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor KP Kevin Poveleit	Date 11.11.2024	lower tool 1	Sheet 18 from 164

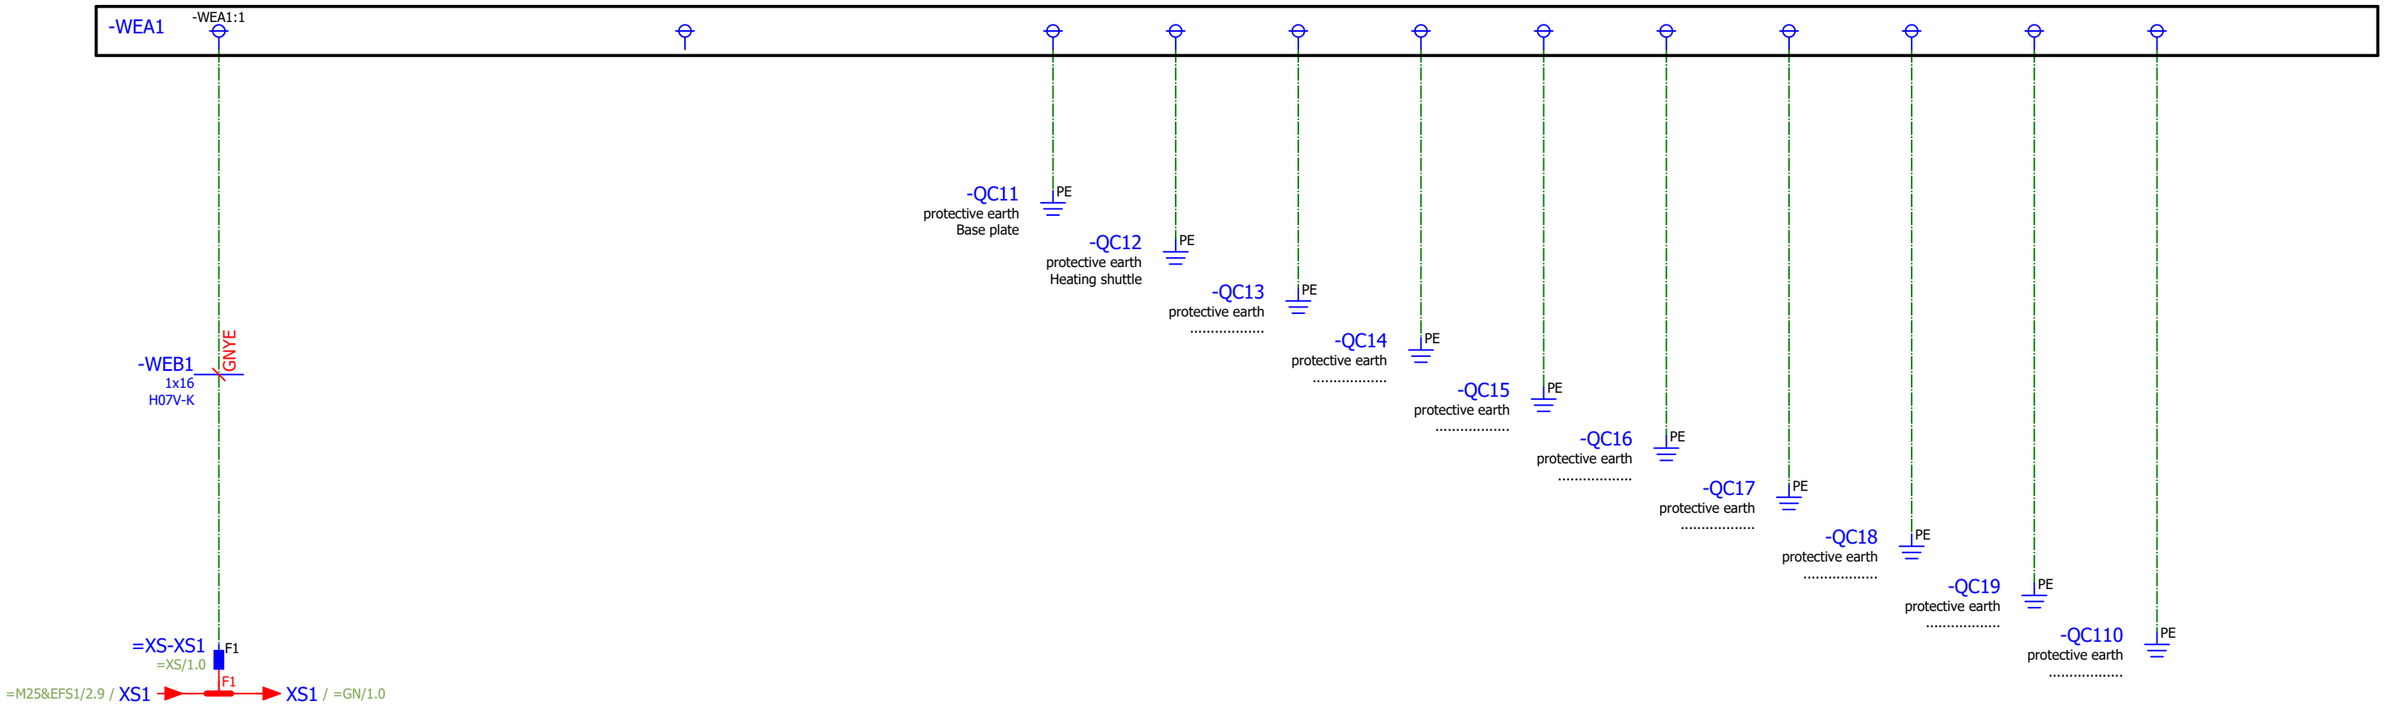

+LT01/1

=GD24+LT01.X01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Potential distribution	==1005811	=GE	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							POT equalization	Wiring diagram
					Drawing number 1005811	Version				+UT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 23.08.2024	Upper tool 1	Sheet 19 from 164

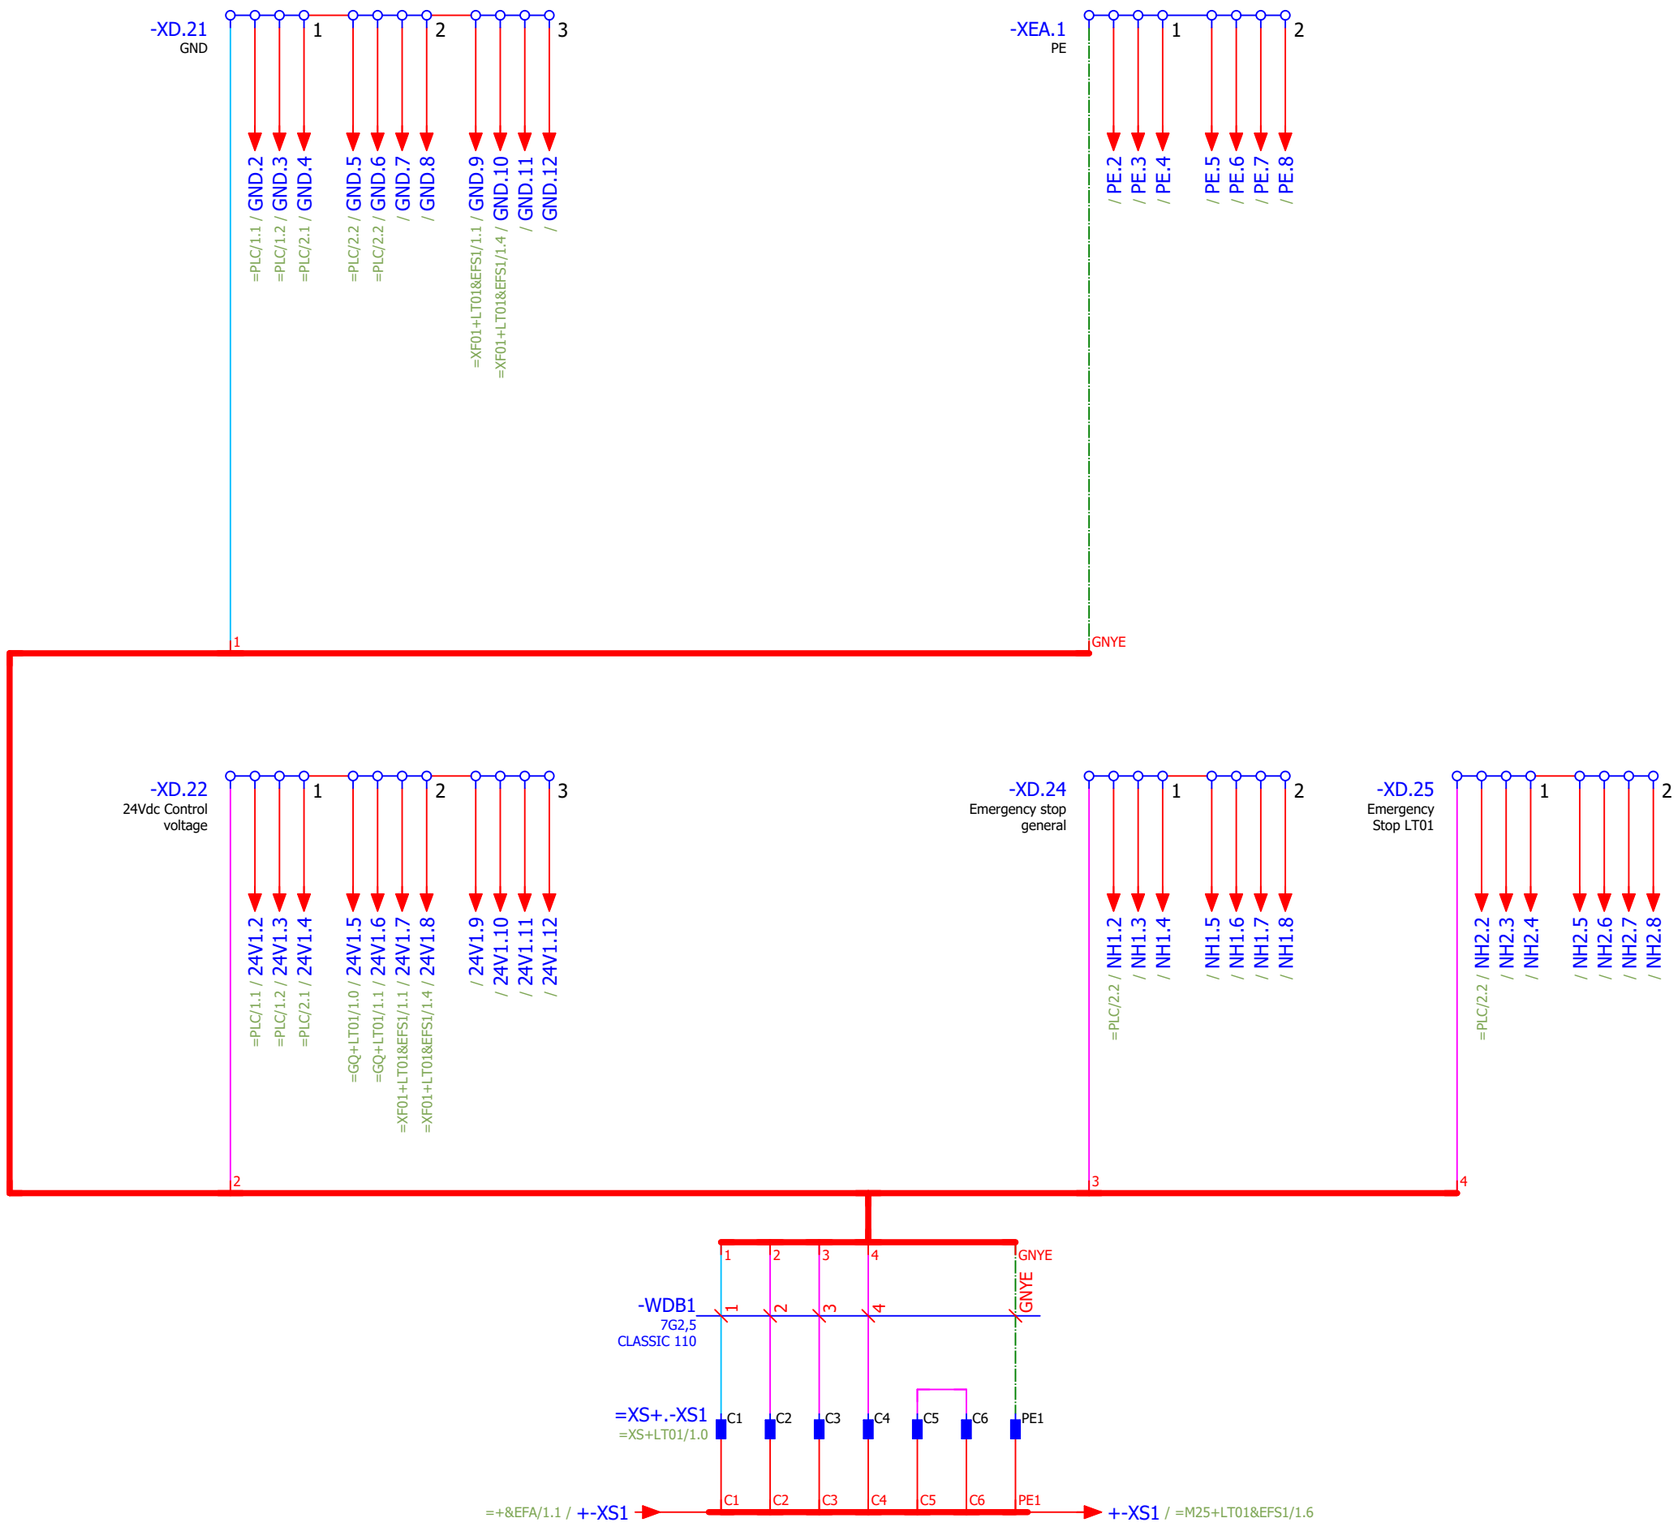

=GE+UT01/1

+UT01.X01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Potential distribution	==1005811	=GD24	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Power DC (24Vdc)	Wiring diagram
					Drawing number 1005811	Version				+LT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	lower tool 1	Sheet 20 from 164

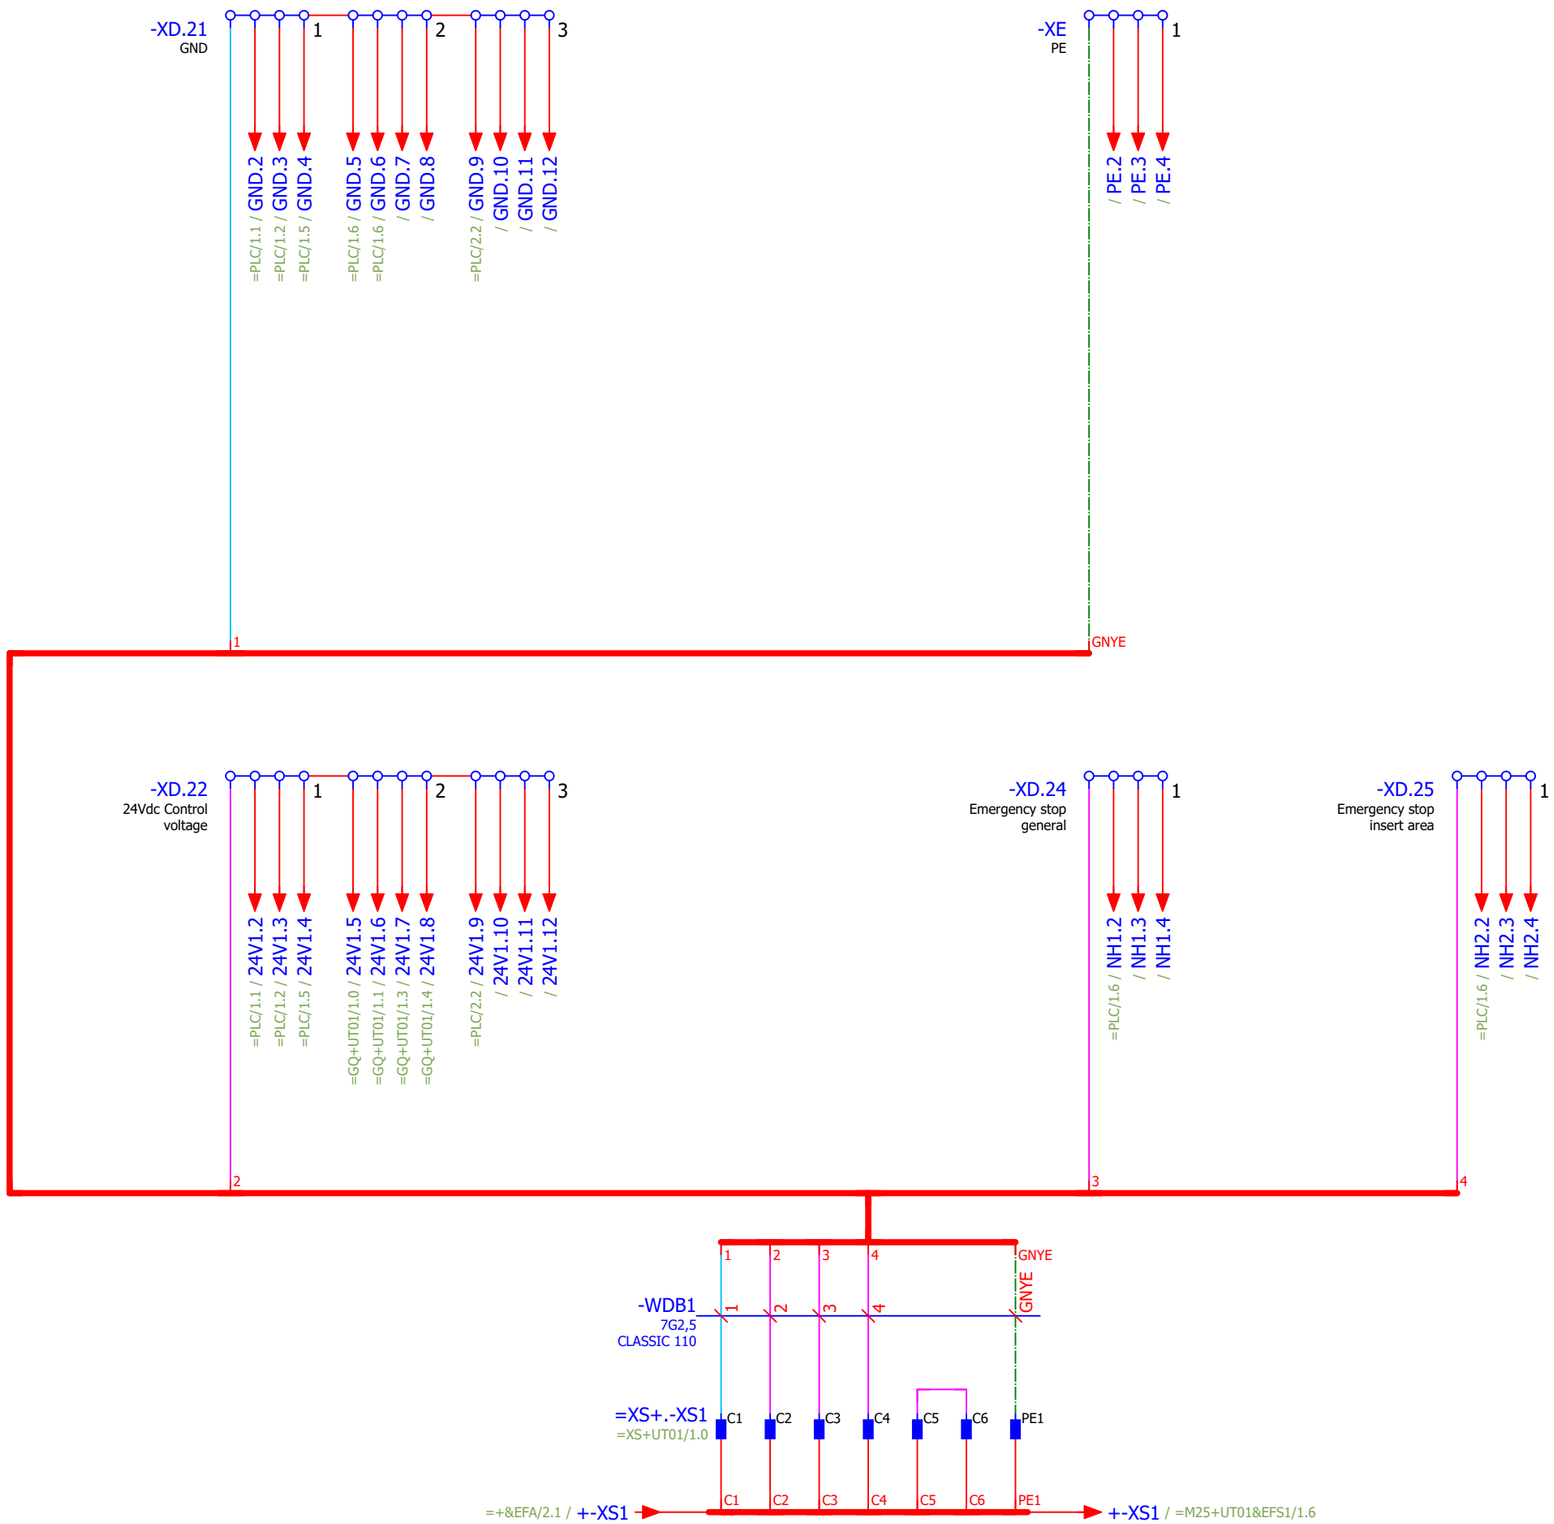

+LT01.X01/1

=GN+LT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Potential distribution	==1005811	=GD24	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Power DC (24Vdc)	Wiring diagram
					Drawing number 1005811	Version				+UT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	Upper tool 1	Sheet 21 from 164

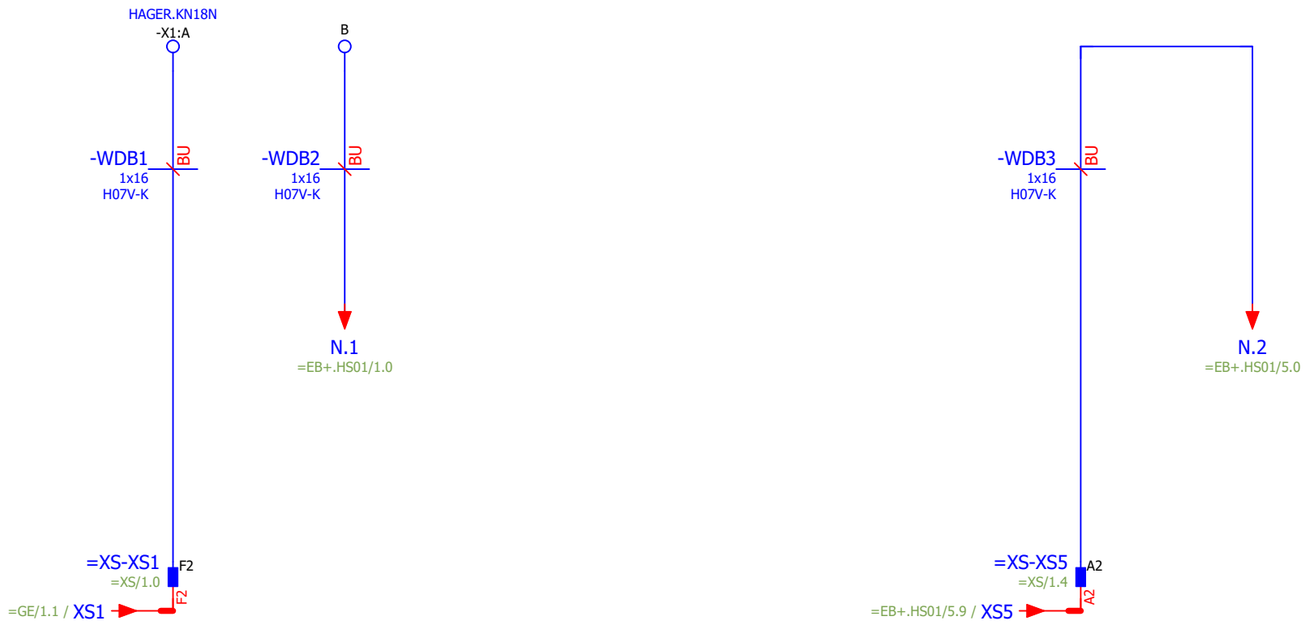
HAGER.KN18N
-X1:A
B
-WDB1
1x16
H07V-K
BU
-WDB2
1x16
H07V-K
BU
-WDB3
1x16
H07V-K
BU
N.1
=EB+.HS01/1.0
N.2
=EB+.HS01/5.0
=XS-XS1
=XS/1.0
F2
F2
=GE/1.1 / XS1
=XS-XS5
=XS/1.4
A2
A2
=EB+.HS01/5.9 / XS5

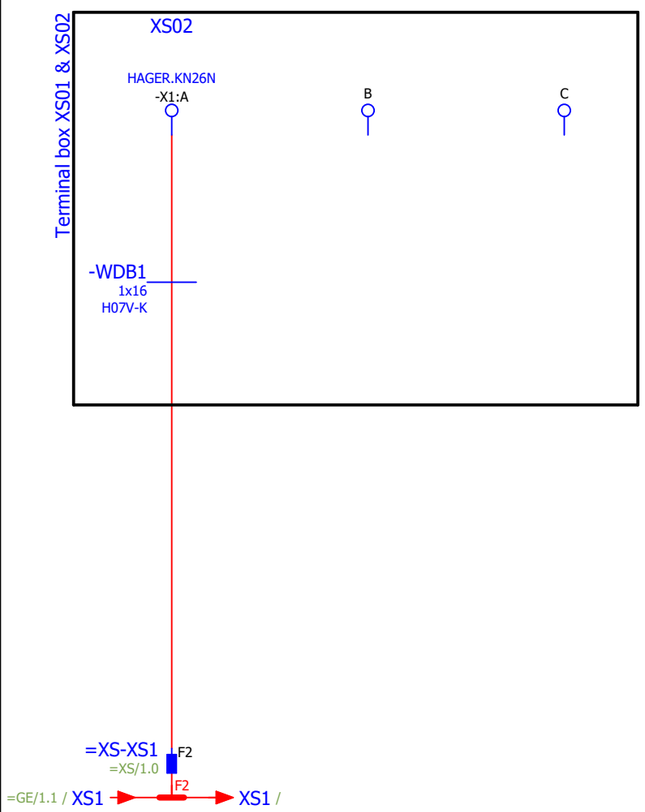

+LT01/1

=PLC+LT01.X01&EFA2/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Neutral conductor distribution		==1005811	=GN	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								N-distribution	Wiring diagram
					Drawing number 1005811	Version					+UT01	Page 1
Modification	Date	Name	Creator	AK Andreas Krischker	Approved by			last Editor	AK Andreas Krischker	Date 03.09.2024	Upper tool 1	Sheet 23 from 164

PLC diagram

IO-Test: _____ Date _____ Electrician _____ Programmer

DT: =PLC+LT01.X01-KE1

Placement: =PLC+LT01.X01&EFS/1.2
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12000.0 :1/DI0	==1005811=BA05+LT01-BGB1:4	part detection 1.1.1	=BA05+LT01&EFS/1.0	
I12000.1 :2/DI1	==1005811=BA05+LT01-BGB2:4	part detection 1 1.3.1	=BA05+LT01&EFS/1.1	
I12000.2 :3/DI2	==1005811=BA05+LT01-BGD1:4	part detection 2 1.5.1	=BA05+LT01&EFS/1.2	
I12000.3 :4/DI3	==1005811=BA05+LT01-BGC1:4	part detection 3 1.7.1	=BA05+LT01&EFS/1.3	
I12000.4 :5/DI4	==1005811=BA05+LT01-BGC2:4	part detection 3 1.7.2	=BA05+LT01&EFS/1.4	
I12000.5 :6/DI5	I12000.5		=BA05+LT01&EFS/1.5	
I12000.6 :7/DI6	I12000.6		=BA05+LT01&EFS/1.6	
I12000.7 :8/DI7	I12000.7		=BA05+LT01&EFS/1.7	

DT: =PLC+LT01.X01-KE2

Placement: =PLC+LT01.X01&EFS/1.2
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12001.0 :1/DI0	==1005811=BA05+LT01-BGB3:4	part detection 1.3.1	=BA05+LT01&EFS/2.0	
I12001.1 :2/DI1	==1005811=BA05+LT01-BGB4:4	part detection 1 2.4.1	=BA05+LT01&EFS/2.1	
I12001.2 :3/DI2	==1005811=BA05+LT01-BGD2:4	part detection 2 2.6.1	=BA05+LT01&EFS/2.2	
I12001.3 :4/DI3	==1005811=BA05+LT01-BGC3:4	part detection 3 2.8.1	=BA05+LT01&EFS/2.3	
I12001.4 :5/DI4	==1005811=BA05+LT01-BGC4:4	part detection 3 2.8.2	=BA05+LT01&EFS/2.4	
I12001.5 :6/DI5	I12001.5		=BA05+LT01&EFS/2.5	
I12001.6 :7/DI6	I12001.6		=BA05+LT01&EFS/2.6	
I12001.7 :8/DI7	I12001.7		=BA05+LT01&EFS/2.7	

DT: =PLC+LT01.X01-KE3

Placement: =PLC+LT01.X01&EFS/1.3
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12002.0 :1/DI0	==1005811=M25+LT01-BGB1:4	position heating shuttle 1.13.1	=M25+LT01&EFS1/2.0	
I12002.1 :2/DI1	==1005811=M25+LT01-BGB2:4	position heating shuttle 1.13.2	=M25+LT01&EFS1/2.1	
I12002.2 :3/DI2	==1005811=M25+LT01.HS01-BGB2:4	locking 1.3.1.1 WP	=M25+LT01&EFS1/2.2	
I12002.3 :4/DI3	==1005811=M25+LT01.HS01-BGB4:4	locking 1.3.2.1 HP	=M25+LT01&EFS1/2.4	
I12002.4 :5/DI4	==1005811=M25+LT01.HS01-BGB6:4	locking 1.3.5.1 WP	=M25+LT01&EFS1/3.0	
I12002.5 :6/DI5	==1005811=M25+LT01.HS01-BGB8:4	locking 1.3.6.1 HP	=M25+LT01&EFS1/3.2	
I12002.6 :7/DI6	==1005811=M25+LT01.HS01-BGB9:4	indexing 1.4.1.1 WP	=M25+LT01&EFS1/3.4	
I12002.7 :8/DI7	==1005811=M25+LT01.HS01-BGB10:4	indexing 1.4.1.1 HP	=M25+LT01&EFS1/3.5	

DT: =PLC+LT01.X01-KE4

Placement: =PLC+LT01.X01&EFS/1.4
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12003.0 :1/DI0	==1005811=M51+LT01-BGB1:4	slider 1.1.1.1 WP	=M51+LT01&EFS1/1.0	
I12003.1 :2/DI1	==1005811=M51+LT01-BGB2:4	slider 1.1.1.1 HP	=M51+LT01&EFS1/1.1	
I12003.2 :3/DI2	==1005811=M51+LT01-BGB3:4	slider 1.1.2.1 WP	=M51+LT01&EFS1/1.2	
I12003.3 :4/DI3	==1005811=M51+LT01-BGB4:4	slider 1.1.2.1 HP	=M51+LT01&EFS1/1.3	
I12003.4 :5/DI4	==1005811=M51+LT01-BGB5:4	slider 1.1.3.1 WP	=M51+LT01&EFS1/1.4	
I12003.5 :6/DI5	==1005811=M51+LT01-BGB6:4	slider 1.1.3.1 HP	=M51+LT01&EFS1/1.5	
I12003.6 :7/DI6	==1005811=M51+LT01-BGB7:4	slider 1.1.4.1 WP	=M51+LT01&EFS1/1.6	
I12003.7 :8/DI7	==1005811=M51+LT01-BGB8:4	slider 1.1.4.1 HP	=M51+LT01&EFS1/1.7	

DT: =PLC+LT01.X01-KE5

Placement: =PLC+LT01.X01&EFS/1.4
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12004.0 :1/DI0	==1005811=M51+LT01-BGB9:4	slider 2.1.1.1 WP	=M51+LT01&EFS1/2.0	
I12004.1 :2/DI1	==1005811=M51+LT01-BGB10:4	slider 2.1.1.1 HP	=M51+LT01&EFS1/2.1	
I12004.2 :3/DI2	==1005811=M51+LT01-BGB11:4	slider 2.1.2.1 WP	=M51+LT01&EFS1/2.2	
I12004.3 :4/DI3	==1005811=M51+LT01-BGB12:4	slider 2.1.2.1 HP	=M51+LT01&EFS1/2.3	
I12004.4 :5/DI4	==1005811=M51+LT01-BGB13:4	slider 2.1.3.1 WP	=M51+LT01&EFS1/2.4	
I12004.5 :6/DI5	==1005811=M51+LT01-BGB14:4	slider 2.1.3.1 HP	=M51+LT01&EFS1/2.5	
I12004.6 :7/DI6	==1005811=M51+LT01-BGB15:4	slider 2.1.4.1 WP	=M51+LT01&EFS1/2.6	
I12004.7 :8/DI7	==1005811=M51+LT01-BGB16:4	slider 2.1.4.1 HP	=M51+LT01&EFS1/2.7	

DT: =PLC+LT01.X01-KE6

Placement: =PLC+LT01.X01&EFS/1.5
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path	
I12005.0 :1/DI0	==1005811=M51+LT01.HS01-BGB11:4	slider 1.1.1.1 HP	=M51+LT01&EFS1/3.0	
I12005.1 :2/DI1	==1005811=M51+LT01.HS01-BGB12:4	slider 1.1.1.2 WP	=M51+LT01&EFS1/3.1	
I12005.2 :3/DI2	==1005811=M51+LT01.HS01-BGB13:4	slider 1.2.1.2 WP	=M51+LT01&EFS1/3.2	
I12005.3 :4/DI3	==1005811=M51+LT01.HS01-BGB14:4	slider 1.2.1.1 HP	=M51+LT01&EFS1/3.3	
I12005.4 :5/DI4	I12005.4		=M51+LT01&EFS1/3.4	
I12005.5 :6/DI5	I12005.5		=M51+LT01&EFS1/3.5	
I12005.6 :7/DI6	I12005.6		=M51+LT01&EFS1/3.6	
I12005.7 :8/DI7	I12005.7		=M51+LT01&EFS1/3.7	

PLC diagram

IO-Test: _____ Date _____ Electrician _____ Programmer

DT: =PLC+LT01.X01-KE7

Placement: =PLC+LT01.X01&EFS/1.6
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
I12006.0 :1/DI0	==1005811=HMI+LT01-SJC1:14	release button 1.1.1	=HMI+LT01&EFS/1.0
I12006.1 :2/DI1	I12006.1	release button spare	=HMI+LT01&EFS/1.1
I12006.2 :3/DI2	==1005811=HMI+LT01-SJC3:14	release button 1.2.1	=HMI+LT01&EFS/1.2
I12006.3 :4/DI3	==1005811=HMI+LT01-SJC4:14	release button vacuum 1.5.1	=HMI+LT01&EFS/2.1
I12006.4 :5/DI4	==1005811=HMI+LT01-SJC5:14	release button vacuum 1.5.2	=HMI+LT01&EFS/2.5
I12006.5 :6/DI5	I12006.5		
I12006.6 :7/DI6	I12006.6		
I12006.7 :8/DI7	I12006.7		

DT: =PLC+LT01.X01-KE8

Placement: =PLC+LT01.X01&EFS/1.6
Type: ET 200SP AI 4xRTD/TC 2-/4-WIRE HF 6ES7134-6JD00-0CA1

IO-Test

Address	symbol name	Function text	/Page . path
IW12100 :1/M0+	==1005811=EA+LT01-BTA1:+	temperature water return 1.11.1	=EA+LT01&EFS/1.0
IW12102 :2/M1+	IW12102		=EA+LT01&EFS/1.1
IW12104 :3/M2+	IW12104		
IW12106 :4/M3+	IW12106		

DT: =PLC+LT01.X01-KE9

Placement: =PLC+LT01.X01&EFS/1.7
Type: ET 200SP AI 4xRTD/TC 2-/4-WIRE HF 6ES7134-6JD00-0CA1

IO-Test

Address	symbol name	Function text	/Page . path
IW12108 :1/M0+	==1005811=EB+LT01.HS01-BTA1:+	temperature check IR bulb 1.1.1	=EB+.HS01&EFS/9.0
IW12110 :2/M1+	==1005811=EB+LT01.HS01-BTA2:+	temperature check IR bulb 1.1.2	=EB+.HS01&EFS/9.1
IW12112 :3/M2+	==1005811=EB+LT01.HS01-BTA3:+	temperature check IR bulb 2.2.1	=EB+.HS01&EFS/9.2
IW12114 :4/M3+	==1005811=EB+LT01.HS01-BTA4:+	temperature check IR bulb 2.2.2	=EB+.HS01&EFS/9.3

DT: =PLC+LT01.X01-KE10

Placement: =PLC+LT01.X01&EFS/1.8
Type: ET 200SP AI 4xU/I 2-WIRE ST 6ES7134-6HD01-0BA1

IO-Test

Address	symbol name	Function text	/Page . path
IW12116 :1/U0+	==1005811=GQ+LT01-BGB1:BK	vacuum check 1.5.1	=GQ+LT01&EFS/1.0
IW12118 :2/U1+	==1005811=GQ+LT01-BGB2:BK	vacuum check 1.5.2	=GQ+LT01&EFS/1.1
IW12120 :3/U2+	IW12120		
IW12122 :4/U3+	IW12122		

DT: =PLC+LT01.X01-KE11

Placement: =PLC+LT01.X01&EFS/2.1
Type: ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
Q12000.0 :1/DQ0	==1005811=HMI+LT01-SJC1:X1	LED release button 1.1.1	=HMI+LT01&EFS/1.0
Q12000.1 :2/DQ1	Q12000.1	LED spare	=HMI+LT01&EFS/1.2
Q12000.2 :3/DQ2	==1005811=HMI+LT01-SJC3:X1	LED release button 1.2.1	=HMI+LT01&EFS/1.3
Q12000.3 :4/DQ3	==1005811=GQ+LT01-KK1:14:+	vacuum 1.1.1	=GQ+LT01&EFS/2.0
Q12000.4 :5/DQ4	==1005811=GQ+LT01-KK2:14:+	vacuum 1.2.1	=GQ+LT01&EFS/2.1
Q12000.5 :6/DQ5	Q12000.5		
Q12000.6 :7/DQ6	Q12000.6		
Q12000.7 :8/DQ7	Q12000.7		

DT: =PLC+LT01.X01-KE12

Placement: =PLC+LT01.X01&EFS/2.2
Type: ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
Q12001.2 :3/DQ2	Q12001.2		
Q12001.3 :4/DQ3	Q12001.3		
Q12001.4 :5/DQ4	Q12001.4		
Q12001.5 :6/DQ5	Q12001.5		
Q12001.6 :7/DQ6	Q12001.6		
Q12001.7 :8/DQ7	Q12001.7		

DT: =PLC+LT01.X01-KE13

Placement: =PLC+LT01.X01&EFS/2.2
Type: ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
Q12002.0 :1/DQ0	==1005811=M25+LT01.HS01-KHB1:14:+	indexing 1.4 WP	=M25+LT01&EFS1/4.0
Q12002.1 :2/DQ1	==1005811=M25+LT01.HS01-KHB1:12:+	indexing 1.4 HP	=M25+LT01&EFS1/4.1
Q12002.2 :3/DQ2	==1005811=M25+LT01.HS01-KHB2:14:+	locking 1.3 WP	=M25+LT01&EFS1/4.2
Q12002.3 :4/DQ3	==1005811=M25+LT01.HS01-KHB2:12:+	locking 1.3 HP	=M25+LT01&EFS1/4.3
Q12002.4 :5/DQ4	==1005811=M51+LT01-KHB1:14:+	slider 1.1 WP	=M51+LT01&EFS1/4.0
Q12002.5 :6/DQ5	==1005811=M51+LT01-KHB1:12:+	slider 1.1 HP	=M51+LT01&EFS1/4.1
Q12002.6 :7/DQ6	==1005811=M51+LT01-KHB2:14:+	slider 2.1 WP	=M51+LT01&EFS1/4.2
Q12002.7 :8/DQ7	==1005811=M51+LT01-KHB2:12:+	slider 2.1 HP	=M51+LT01&EFS1/4.3

PLC diagram

IO-Test: _____ Date _____ Electrician _____ Programmer

DT:	=PLC+LT01.X01-KE14	IO-Test
Placement:	=PLC+LT01.X01&EFS/2.3	
Type:	ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0	

Address	symbol name	Function text	/Page . path	
Q12003.0 :1/DQ0	==1005811=M51+LT01.HS01-KHB3:14:+	slider 1.1 WP	=M51+LT01&EFS1/5.0	
Q12003.1 :2/DQ1	==1005811=M51+LT01.HS01-KHB3:12:+	slider 1.1 HP	=M51+LT01&EFS1/5.1	
Q12003.2 :3/DQ2	==1005811=M51+LT01.HS01-KHB4:14:+	slider 1.2 WP	=M51+LT01&EFS1/5.2	
Q12003.3 :4/DQ3	==1005811=M51+LT01.HS01-KHB4:12:+	slider 1.2 HP	=M51+LT01&EFS1/5.3	
Q12003.4 :5/DQ4	Q12003.4			
Q12003.5 :6/DQ5	Q12003.5			
Q12003.6 :7/DQ6	Q12003.6			
Q12003.7 :8/DQ7	Q12003.7			

PLC card overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F20_002-V2

Device tag PLC	Workstation name Workstation type	Start address IN	Start address OUT	Rack	Module	CPU
-KE1	ET200SP	12000			1	TIA1005587.S7_CPU.1
-KE2	ET200SP	12001			2	TIA1005587.S7_CPU.1
-KE3	ET200SP	12002			3	TIA1005587.S7_CPU.1
-KE4	ET200SP	12003			4	TIA1005587.S7_CPU.1
-KE5	ET200SP	12004			5	TIA1005587.S7_CPU.1
-KE6	ET200SP	12005			6	TIA1005587.S7_CPU.1
-KE7	ET200SP	12006			7	TIA1005587.S7_CPU.1
-KE8	ET200SP_Station_LT1	12100			8	TIA1005587.S7_CPU.1
-KE9	ET200SP_Station_LT1	12108			9	TIA1005587.S7_CPU.1
-KE10	ET200SP_Station_LT1 ET200SP	12116			10	TIA1005587.S7_CPU.1
-KE11	ET200SP	12000			11	TIA1005587.S7_CPU.1
-KE12	ET200SP	12001			12	TIA1005587.S7_CPU.1
-KE13	ET200SP	12002			13	TIA1005587.S7_CPU.1
-KE14	ET200SP	12003			14	TIA1005587.S7_CPU.1

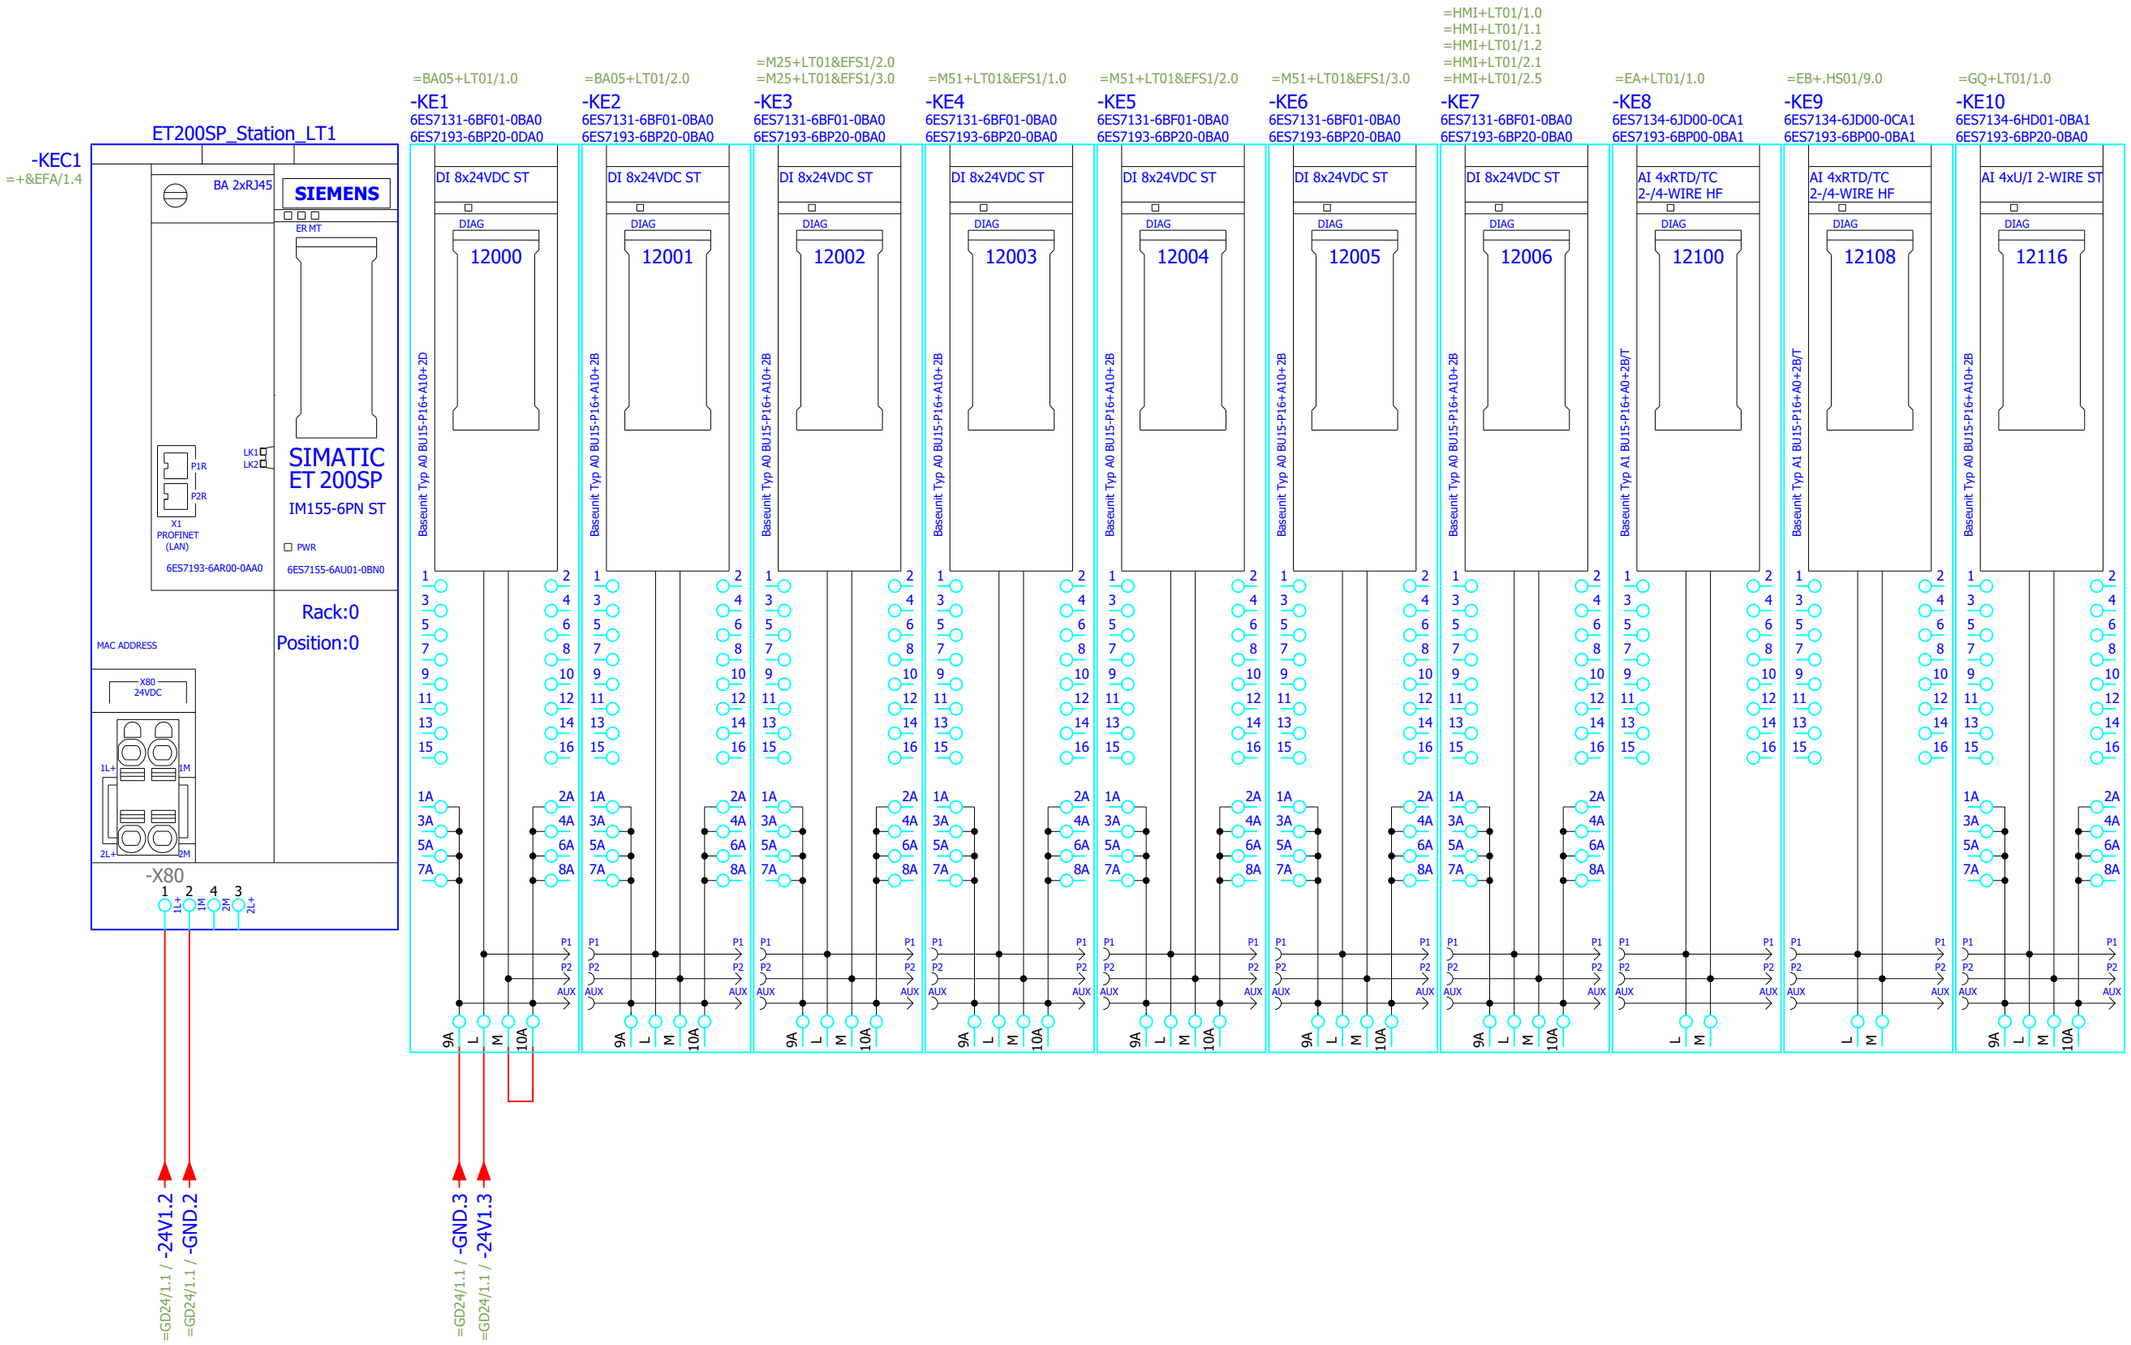

&EFA3/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	PLC-ET200SP	==1005811	=PLC	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						PLC control	Wiring diagram
				Drawing number 1005811	Version				+LT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 27.11.2024	lower tool 1	Sheet 28 from 164

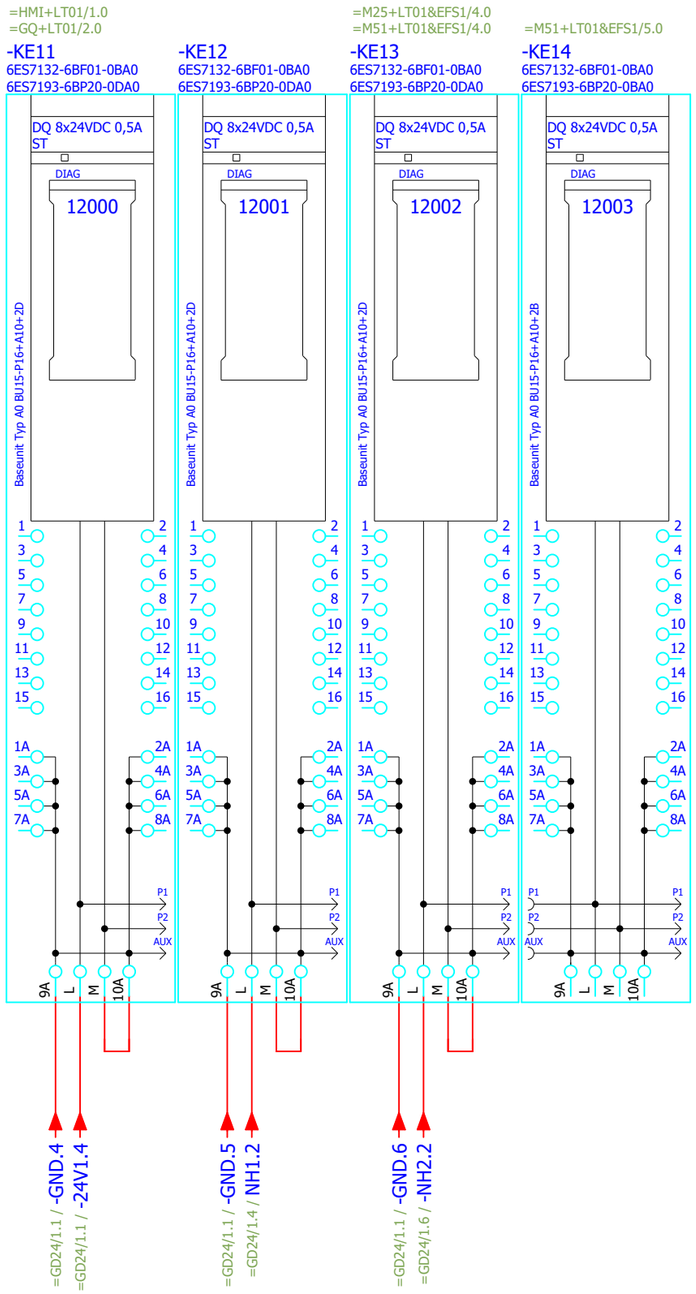

1

+UT01.X01&EFA2/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	PLC-ET200SP		==1005811	=PLC	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								PLC control	Wiring diagram
					Drawing number 1005811	Version					+LT01.X01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024		lower tool 1	Sheet 29 from 164

PLC diagram

IO-Test: _____ Date _____ Electrician _____ Programmer

DT: =PLC+UT01.X01-KE1

Placement: =PLC+UT01.X01&EFS/1.2
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
I12500.0 :1/DI0	==1005811=BA05+UT01-BGB1:4	part detection 1.3.1	=BA05+UT01&EFS/1.0
I12500.1 :2/DI1	==1005811=BA05+UT01-BGB2:4	part detection 2.4.1	=BA05+UT01&EFS/1.1
I12500.2 :3/DI2	==1005811=M25+UT01-BGB1:4	position nesting tool 1.1.1	=M25+UT01&EFS1/3.0
I12500.3 :4/DI3	==1005811=M25+UT01-BGB2:4	position nesting tool 1.1.2	=M25+UT01&EFS1/3.1
I12500.4 :5/DI4	==1005811=M25+UT01-BGB3:4	position nesting tool 2.2.1	=M25+UT01&EFS1/3.2
I12500.5 :6/DI5	==1005811=M25+UT01-BGB4:4	position nesting tool 2.2.2	=M25+UT01&EFS1/3.3
I12500.6 :7/DI6	I12500.6		=M25+UT01&EFS1/3.4
I12500.7 :8/DI7	I12500.7		=M25+UT01&EFS1/3.5

DT: =PLC+UT01.X01-KE2

Placement: =PLC+UT01.X01&EFS/1.2
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
I12501.0 :1/DI0	==1005811=M51+UT01-BGB1:4	slider 1.2.1.1 HP	=M51+UT01&EFS1/1.0
I12501.1 :2/DI1	==1005811=M51+UT01-BGB2:4	slider 1.2.1.2 WP	=M51+UT01&EFS1/1.1
I12501.2 :3/DI2	==1005811=M51+UT01-BGB3:4	slider 2.1.1.1 HP	=M51+UT01&EFS1/1.2
I12501.3 :4/DI3	==1005811=M51+UT01-BGB4:4	slider 2.1.1.2 WP	=M51+UT01&EFS1/1.3
I12501.4 :5/DI4	I12501.4		=M51+UT01&EFS1/1.4
I12501.5 :6/DI5	I12501.5		=M51+UT01&EFS1/1.5
I12501.6 :7/DI6	I12501.6		=M51+UT01&EFS1/1.6
I12501.7 :8/DI7	I12501.7		=M51+UT01&EFS1/1.7

DT: =PLC+UT01.X01-KE3

Placement: =PLC+UT01.X01&EFS/1.3
Type: ET 200SP DI 8x24VDC ST 6ES7131-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
I12502.0 :1/DI0	==1005811=M51+UT01-BGB5:4	locking 1.1.1.1 WP	=M51+UT01&EFS1/2.0
I12502.1 :2/DI1	==1005811=M51+UT01-BGB6:4	locking 1.1.1.1 HP	=M51+UT01&EFS1/2.1
I12502.2 :3/DI2	==1005811=M51+UT01-BGB7:4	locking 1.1.2.1 WP	=M51+UT01&EFS1/2.2
I12502.3 :4/DI3	==1005811=M51+UT01-BGB8:4	locking 1.1.2.1 HP	=M51+UT01&EFS1/2.3
I12502.4 :5/DI4	==1005811=M51+UT01-BGB9:4	locking 1.1.3.1 WP	=M51+UT01&EFS1/2.4
I12502.5 :6/DI5	==1005811=M51+UT01-BGB10:4	locking 1.1.3.1 HP	=M51+UT01&EFS1/2.5
I12502.6 :7/DI6	==1005811=M51+UT01-BGB11:4	locking 1.1.4.1 WP	=M51+UT01&EFS1/2.6
I12502.7 :8/DI7	==1005811=M51+UT01-BGB12:4	locking 1.1.4.1 HP	=M51+UT01&EFS1/2.7

DT: =PLC+UT01.X01-KE4

Placement: =PLC+UT01.X01&EFS/1.4
Type: ET 200SP AI 4xRTD/TC 2-/4-WIRE HF 6ES7134-6JD00-0CA1

IO-Test

Address	symbol name	Function text	/Page . path
IW12600 :1/M0+	==1005811=EA+UT01-BTA1:+	temperature water return 1.7.1	=EA+UT01&EFS/1.0
IW12602 :2/M1+	IW12602		=EA+UT01&EFS/1.1
IW12604 :3/M2+	IW12604		=EA+UT01&EFS/1.2
IW12606 :4/M3+	IW12606		=EA+UT01&EFS/1.3

DT: =PLC+UT01.X01-KE5

Placement: =PLC+UT01.X01&EFS/1.4
Type: ET 200SP AI 4xU/I 2-WIRE ST 6ES7134-6HD01-0BA1

IO-Test

Address	symbol name	Function text	/Page . path
IW12608 :1/U0+	==1005811=GQ+UT01-BGB1:BK	vacuum check 1.9.1	=GQ+UT01&EFS/1.0
IW12610 :2/U1+	==1005811=GQ+UT01-BGB2:BK	vacuum check 1.10.1	=GQ+UT01&EFS/1.1
IW12612 :3/U2+	==1005811=GQ+UT01-BGB3:BK	vacuum check 2.6.1	=GQ+UT01&EFS/1.2
IW12614 :4/U3+	==1005811=GQ+UT01-BGB4:BK	vacuum check 2.6.2	=GQ+UT01&EFS/1.4

DT: =PLC+UT01.X01-KE6

Placement: =PLC+UT01.X01&EFS/1.5
Type: ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
Q12500.0 :1/DQ0	==1005811=PLC+UT01.X01-KFA1:A1	Reset web and application server	&EFS/2.8
Q12500.1 :2/DQ1	==1005811=GQ+UT01-KK1:14:+	vacuum 1.3.1	=GQ+UT01&EFS/2.0
Q12500.2 :3/DQ2	==1005811=GQ+UT01-KK2:14:+	vacuum 1.4.1	=GQ+UT01&EFS/2.1
Q12500.3 :4/DQ3	==1005811=GQ+UT01-KK3:14:+	vacuum 2.5.1	=GQ+UT01&EFS/2.2
Q12500.4 :5/DQ4	==1005811=GQ+UT01-KK4:14:+	vacuum 2.6.1	=GQ+UT01&EFS/2.3
Q12500.5 :6/DQ5	Q12500.5		
Q12500.6 :7/DQ6	Q12500.6		
Q12500.7 :8/DQ7	Q12500.7		

DT: =PLC+UT01.X01-KE7

Placement: =PLC+UT01.X01&EFS/1.6
Type: ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0

IO-Test

Address	symbol name	Function text	/Page . path
Q12501.2 :3/DQ2	==1005811=M51+UT01-KHB3:14:+	locking 1.1 WP	=M51+UT01&EFS1/3.4
Q12501.3 :4/DQ3	==1005811=M51+UT01-KHB3:12:+	locking 1.1 HP	=M51+UT01&EFS1/3.5
Q12501.6 :7/DQ6	Q12501.6		
Q12501.7 :8/DQ7	Q12501.7		

PLC diagram

IO-Test: _____ Date _____ Electrician _____ Programmer

DT:	=PLC+UT01.X01-KE8			IO-Test
Placement:	=PLC+UT01.X01&EFS/1.6			
Type:	ET 200SP DQ 8x24VDC 0,5A ST 6ES7132-6BF01-0BA0			
Address	**symbol name**	**Function text**	**/Page . path**	
Q12502.0 :1/DQ0	==1005811=M51+UT01-KHB1:14:+	slider 1.1 WP	=M51+UT01&EFS1/3.0	
Q12502.1 :2/DQ1	==1005811=M51+UT01-KHB1:12:+	slider 1.1 HP	=M51+UT01&EFS1/3.1	
Q12502.2 :3/DQ2	==1005811=M51+UT01-KHB2:14:+	slider 2.1 WP	=M51+UT01&EFS1/3.2	
Q12502.3 :4/DQ3	==1005811=M51+UT01-KHB2:12:+	slider 2.1 HP	=M51+UT01&EFS1/3.3	
Q12502.4 :5/DQ4	Q12502.4			
Q12502.5 :6/DQ5	Q12502.5			
Q12502.6 :7/DQ6	Q12502.6			
Q12502.7 :8/DQ7	Q12502.7			

PLC card overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F20_002-V2

Device tag PLC	Workstation name Workstation type	Start address IN	Start address OUT	Rack	Module	CPU
-KE1	ET200SP	12500			1	TIA1005587.S7_CPU.1
-KE2	ET200SP	12501			2	TIA1005587.S7_CPU.1
-KE3	ET200SP	12502			3	TIA1005587.S7_CPU.1
-KE4	ET200SP_Station_UT1	12600			4	TIA1005587.S7_CPU.1
-KE5	ET200SP_Station_UT1 ET200SP	12608			5	TIA1005587.S7_CPU.1
-KE6	ET200SP	12500			6	TIA1005587.S7_CPU.1
-KE7	ET200SP	12501			7	TIA1005587.S7_CPU.1
-KE8	ET200SP	12502			8	TIA1005587.S7_CPU.1

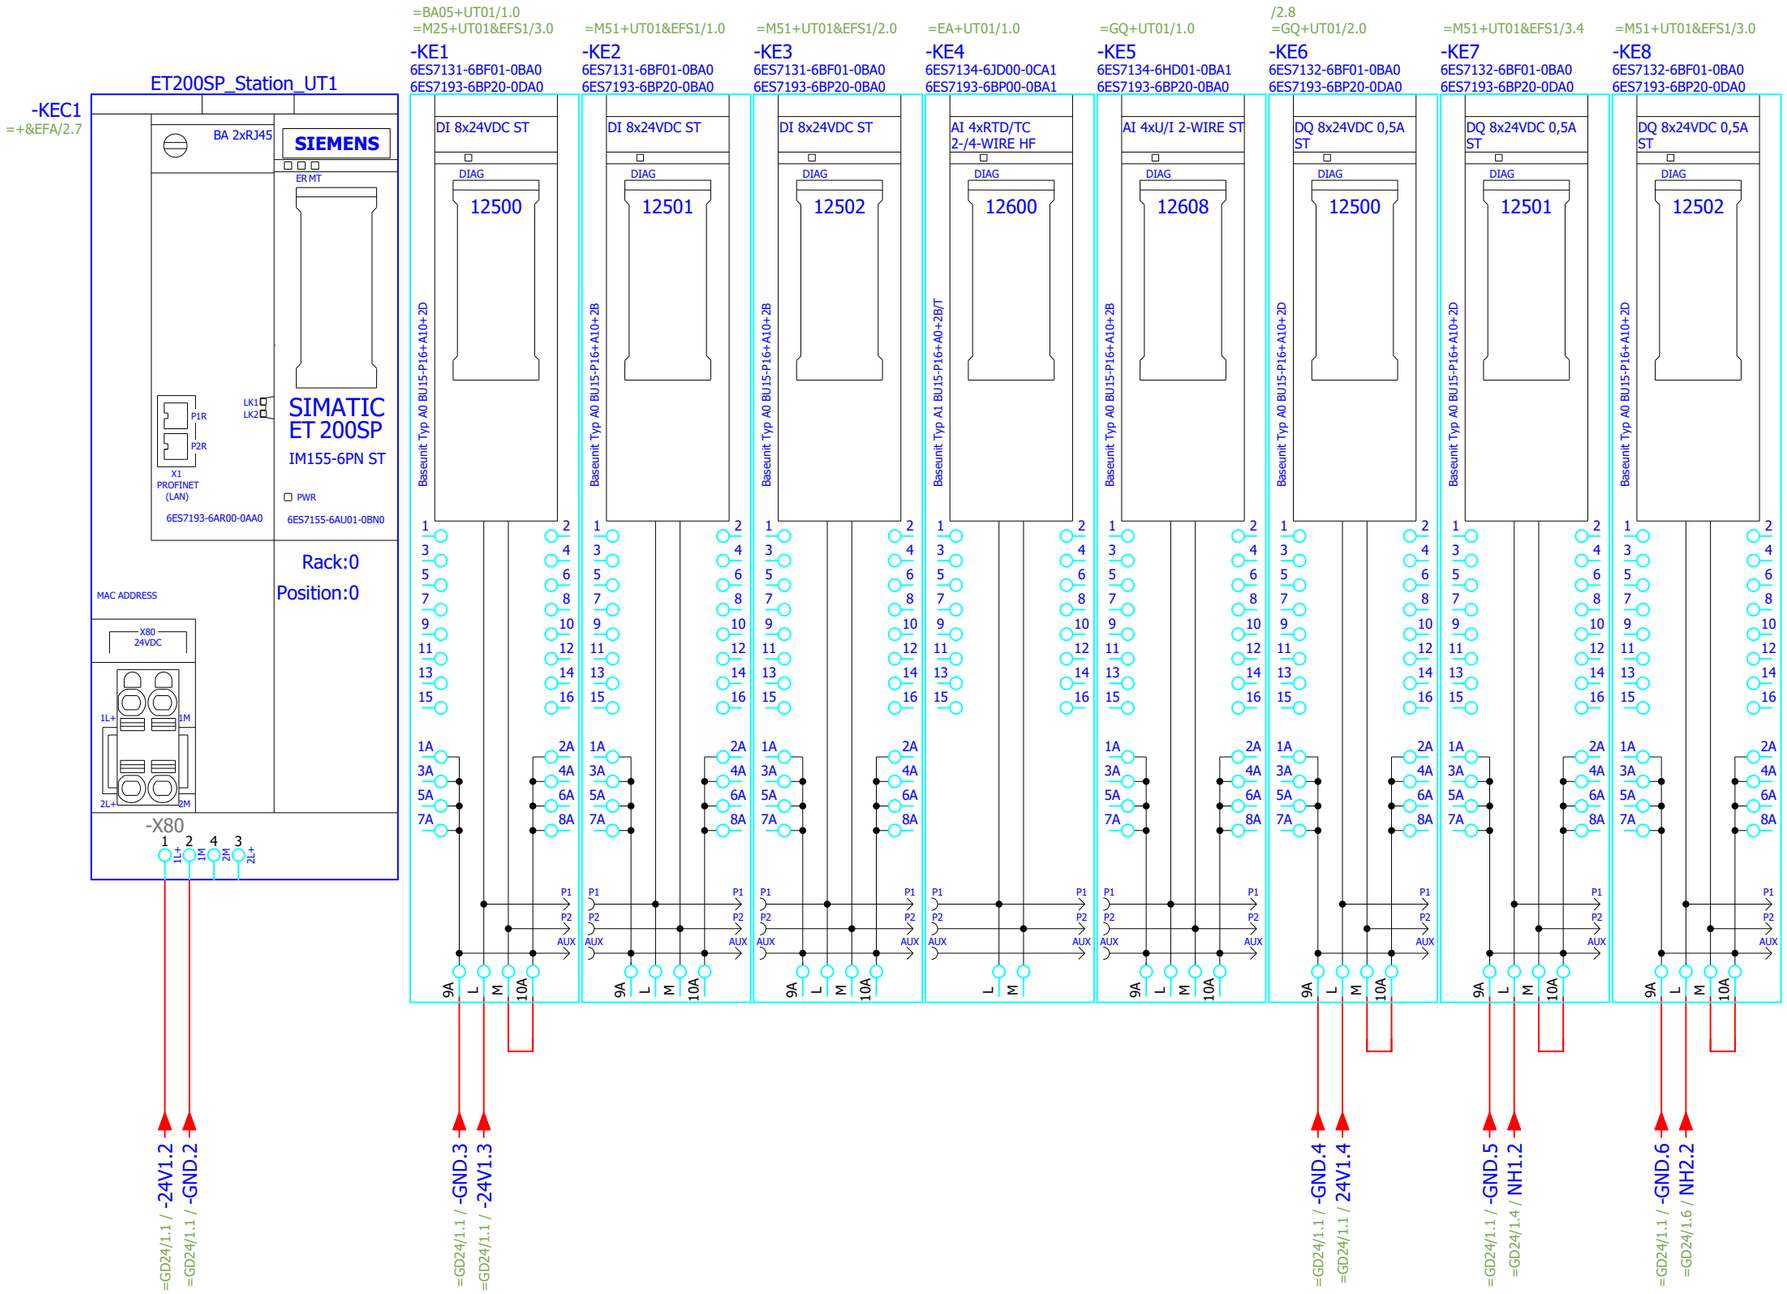

&EFA3/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	PLC-ET200SP	==1005811	=PLC	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						PLC control	Wiring diagram
				Drawing number 1005811	Version				+UT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 27.11.2024	Upper tool 1	Sheet 33 from 164

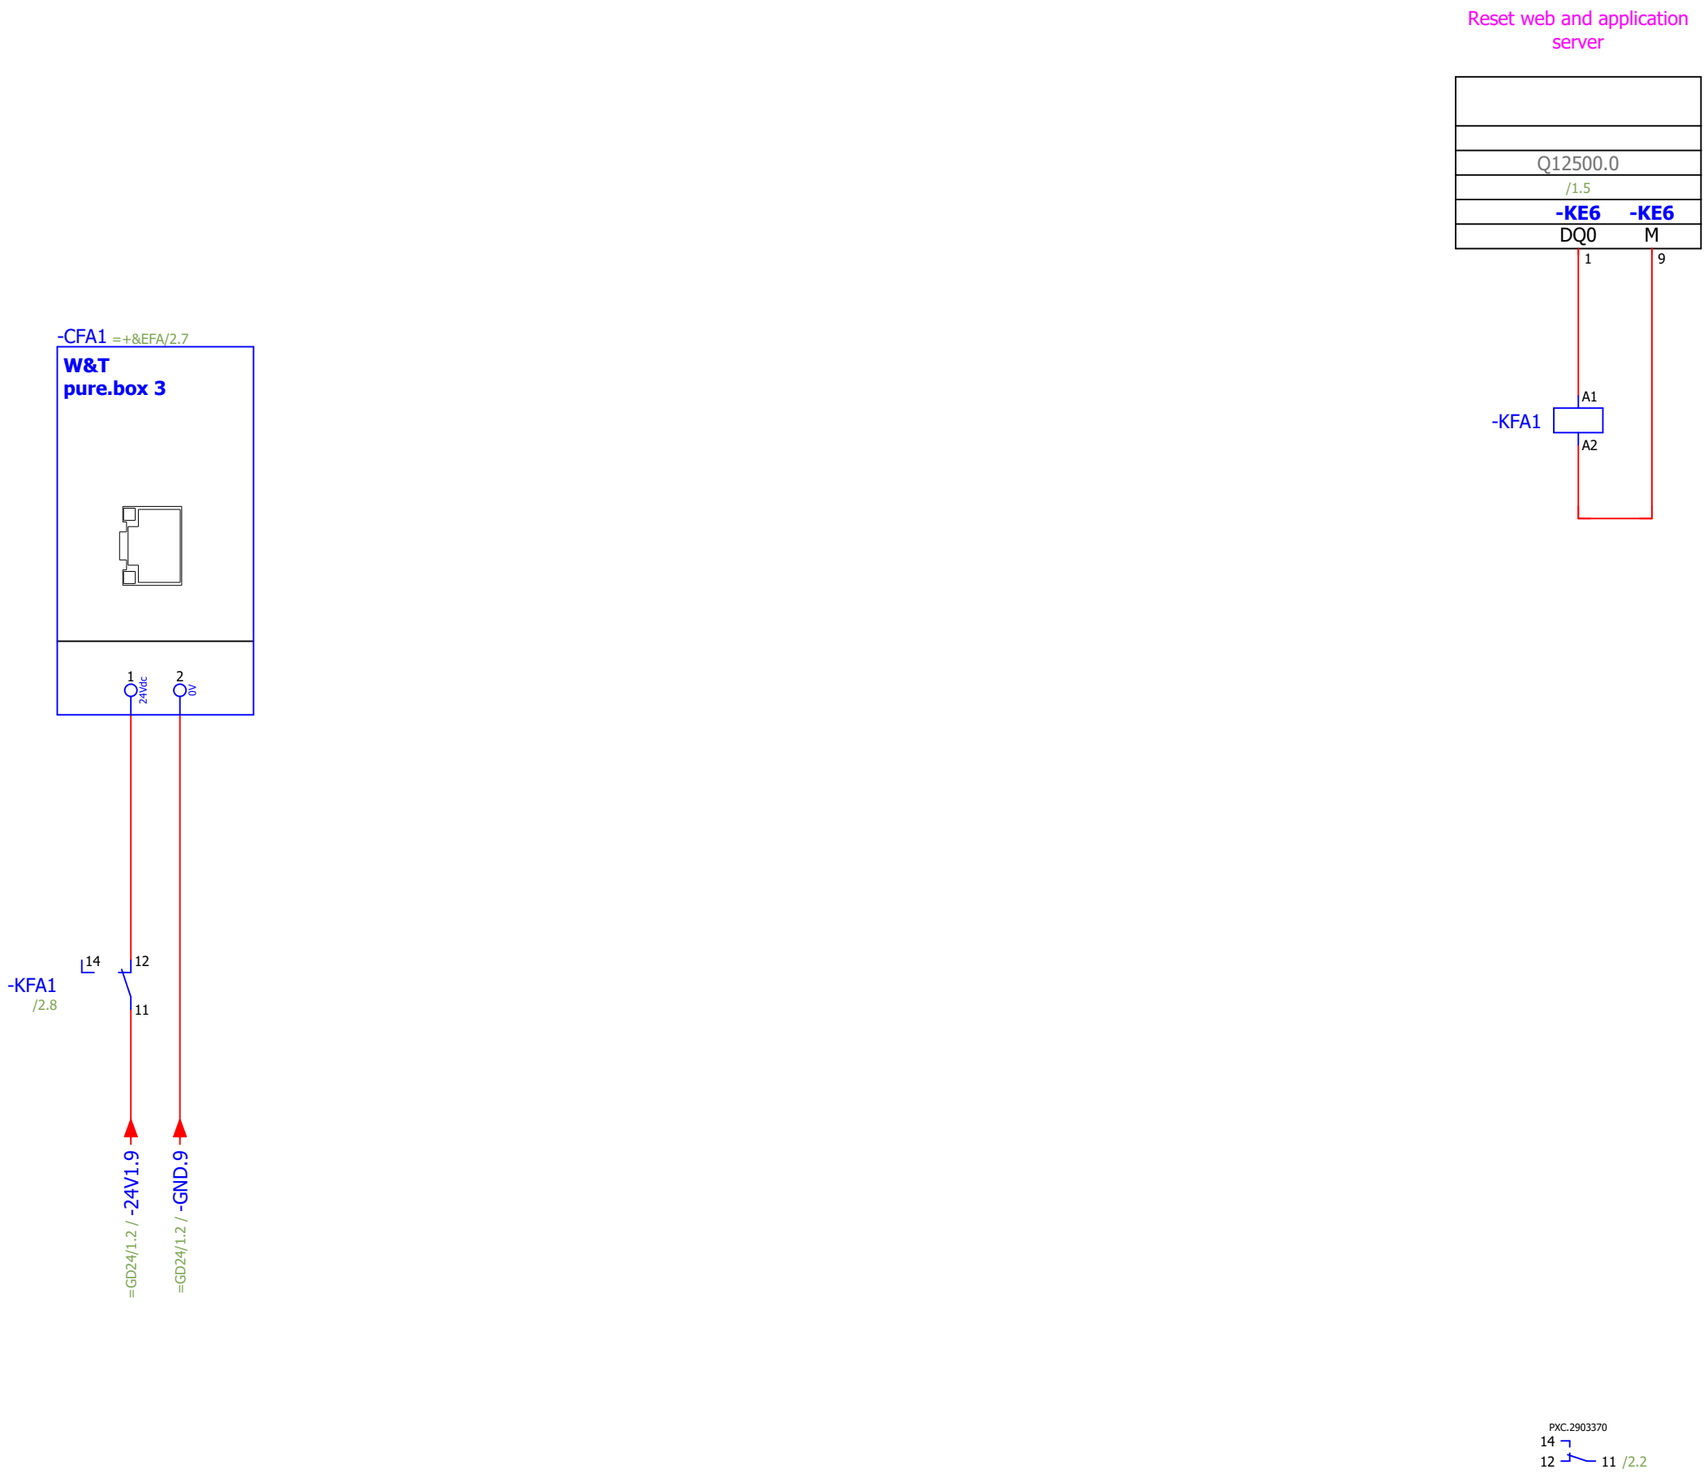

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Information storage	==1005811	=PLC	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							PLC control	Wiring diagram
					Drawing number 1005811	Version				+UT01.X01	Page 2
Modification	Date	Name	Creator	AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 25.09.2024	Upper tool 1	Sheet 34 from 164

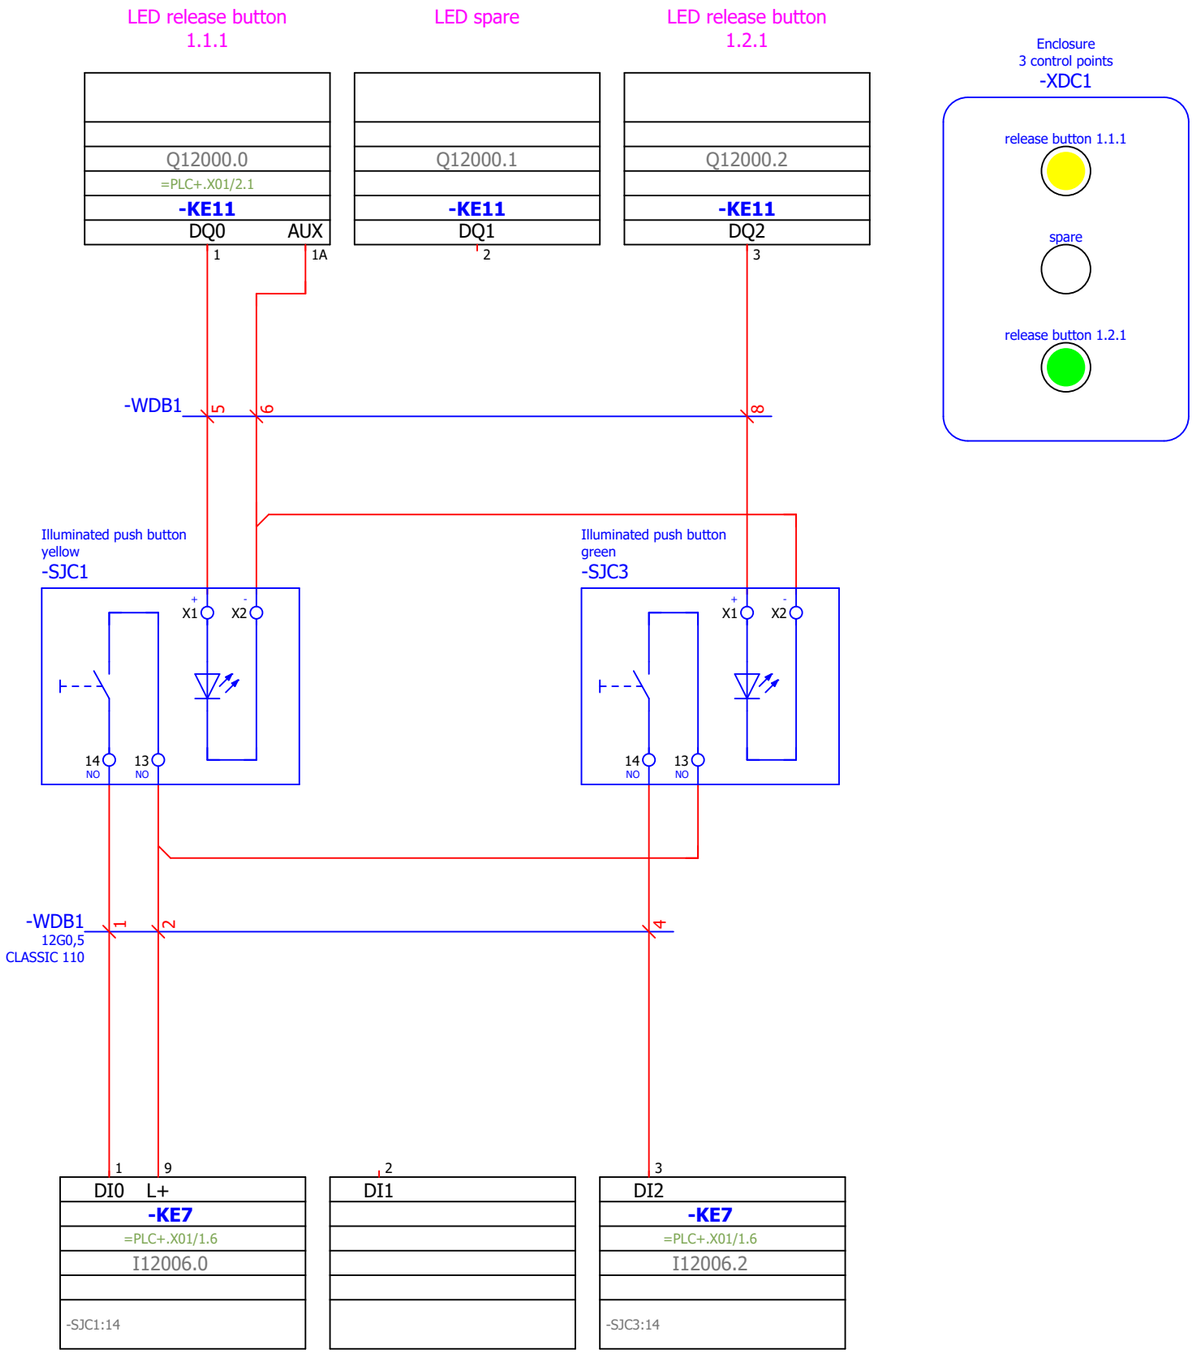

release button 1.1.1 release button spare release button 1.2.1

=PLC+UT01.X01/2

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Push buttons and switches	==1005811	=HMI	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Human Machine Interface	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 35 from 164

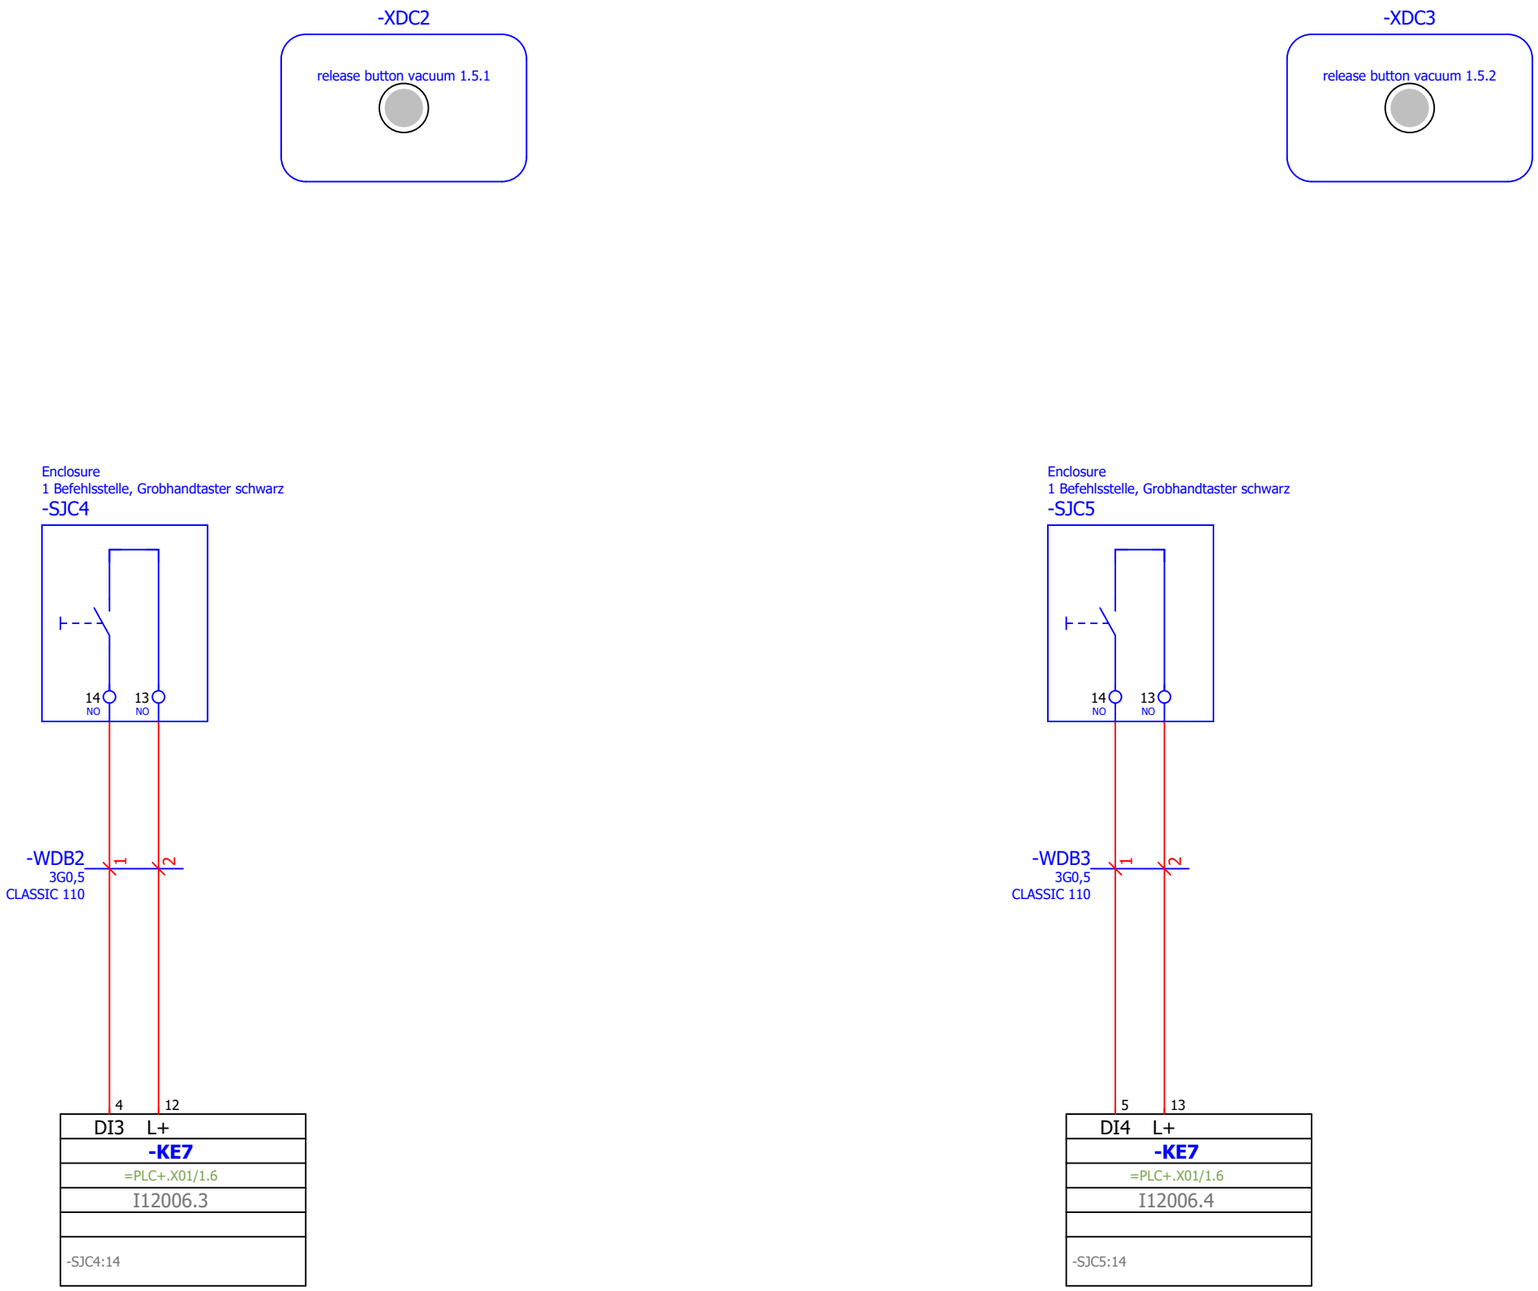

release button
vacuum 1.5.1

release button
vacuum 1.5.2

Machine

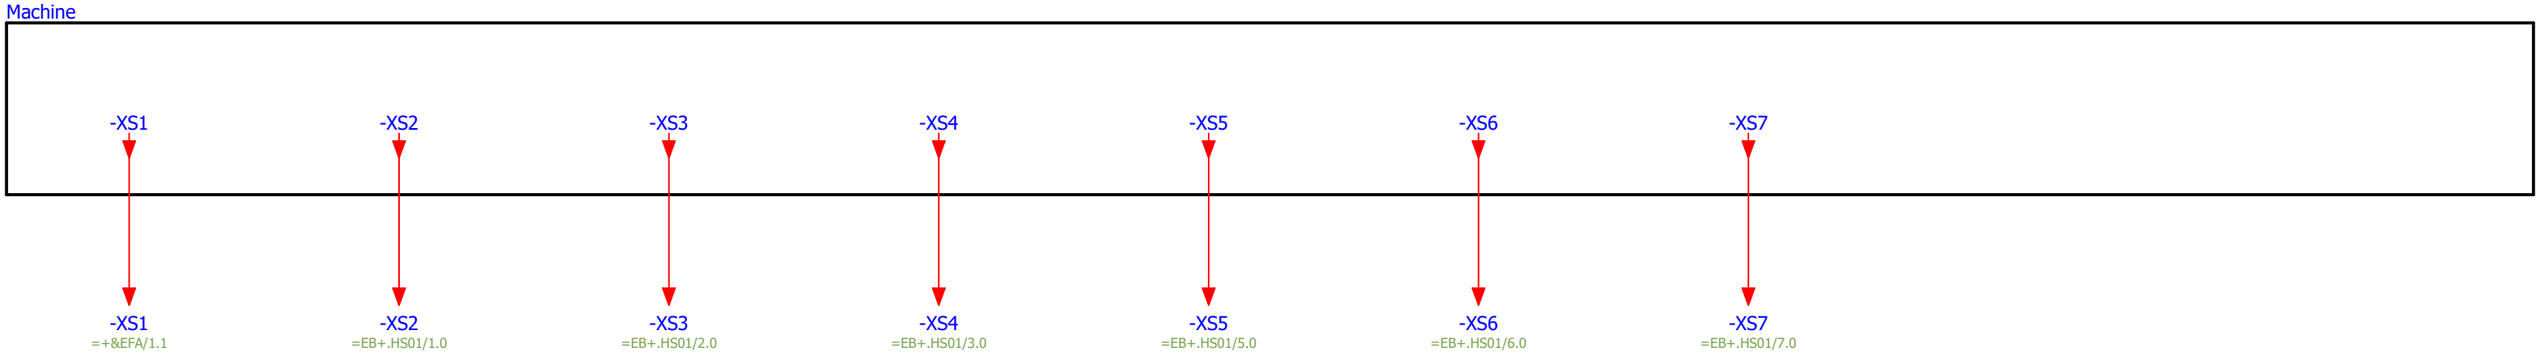

TOOL Plug 1:

-XS1 =

=+&EFA/1.1
=GD24+.X01/1.3
=M25&EFS1/1.7
=GE/1.1
=GN/1.1

TOOL Plug 2:

-XS2 =

=M25&EFS1/1.1
=EB+.HS01/1.0

TOOL Plug 3:

-XS3 =

=EB+.HS01/2.0

TOOL Plug 4:

-XS4 =

=EB+.HS01/3.0
=EB+.HS01/4.0

TOOL Plug 5:

-XS5 =

=GE/1.2
=GN/1.4
=EB+.HS01/5.0

TOOL Plug 6:

-XS6 =

=EB+.HS01/6.0

TOOL Plug 7:

-XS7 =

=EB+.HS01/7.0
=EB+.HS01/8.0

Machine

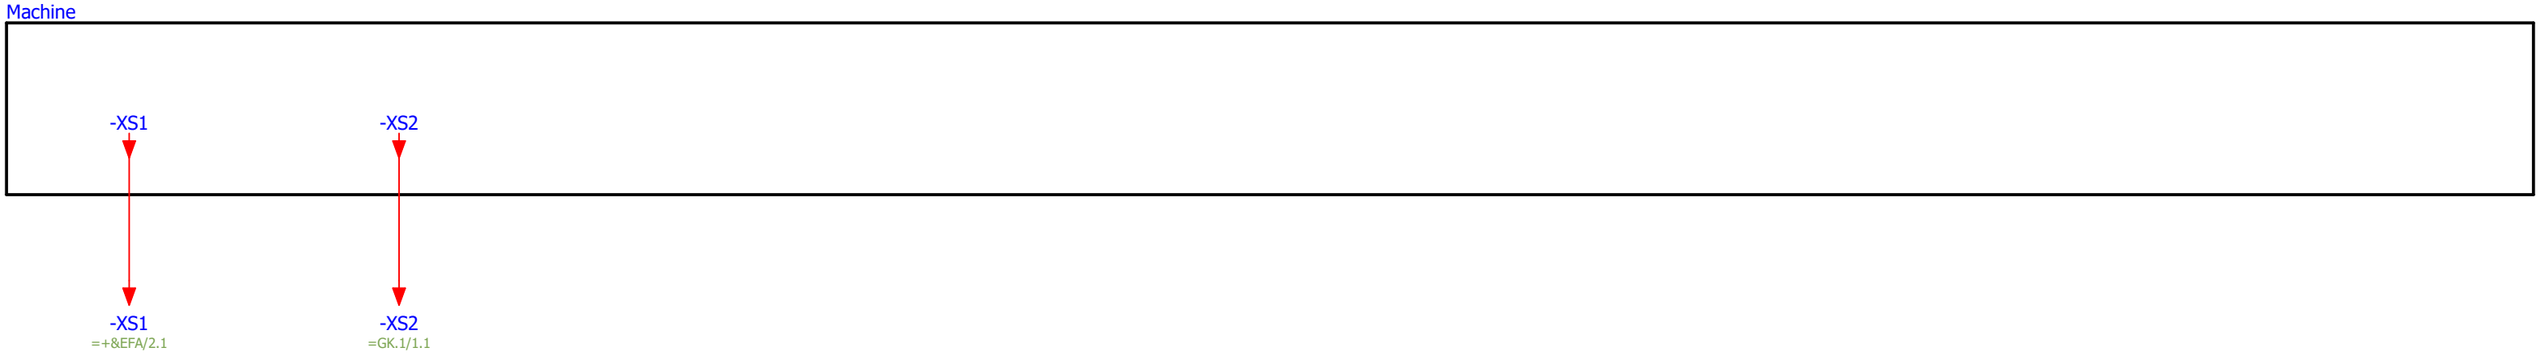

TOOL Plug 1:

-XS1 =

=GD24+.X01/1.3
=M25&EFS1/2.7
=M25&EFS1/1.7
=GE/1.1
=GN/1.0
=+&EFA/2.1

TOOL Plug 2:

-XS2 =

=M25&EFS1/1.1
=M25&EFS1/2.1
=GK.1/1.1

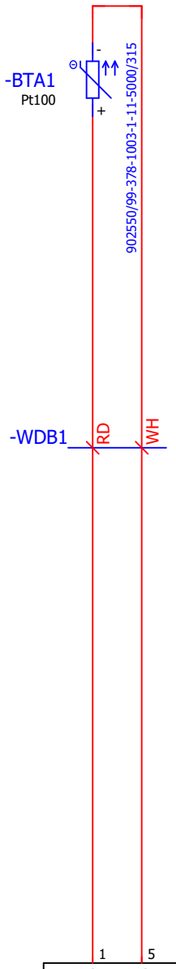

M0+ M0-	M1+ M1-
-KE8	**-KE8**
=PLC+.X01/1.6	
IW12100	IW12102
-BTA1:+	IW12102

temperature
water return
1.11.1

=XS+UT01/1

+UT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Temperature queries temperature control circ uits	==1005811	=EA	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							process water	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker Date 25.09.2024		lower tool 1	Sheet 39 from 164

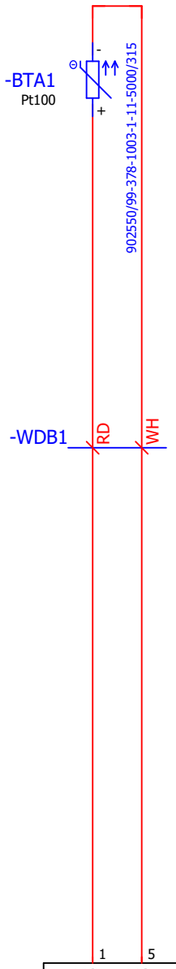

2	6	3	7	4	8
M0+ M0-	M1+ M1-	M2+ M2-		M3+ M3-	
-KE4	**-KE4**	**-KE4**		**-KE4**	
=PLC+.X01/1.4					
IW12600	IW12602	IW12604		IW12606	
-BTA1:+	IW12602	IW12604		IW12606	

temperature
water return
1.7.1

+LT01/1

=EB+LT01.HS01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Temperature queries temperature control circ uits	==1005811	=EA	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							process water	Wiring diagram
					Drawing number 1005811	Version				+UT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	Upper tool 1	Sheet 40 from 164

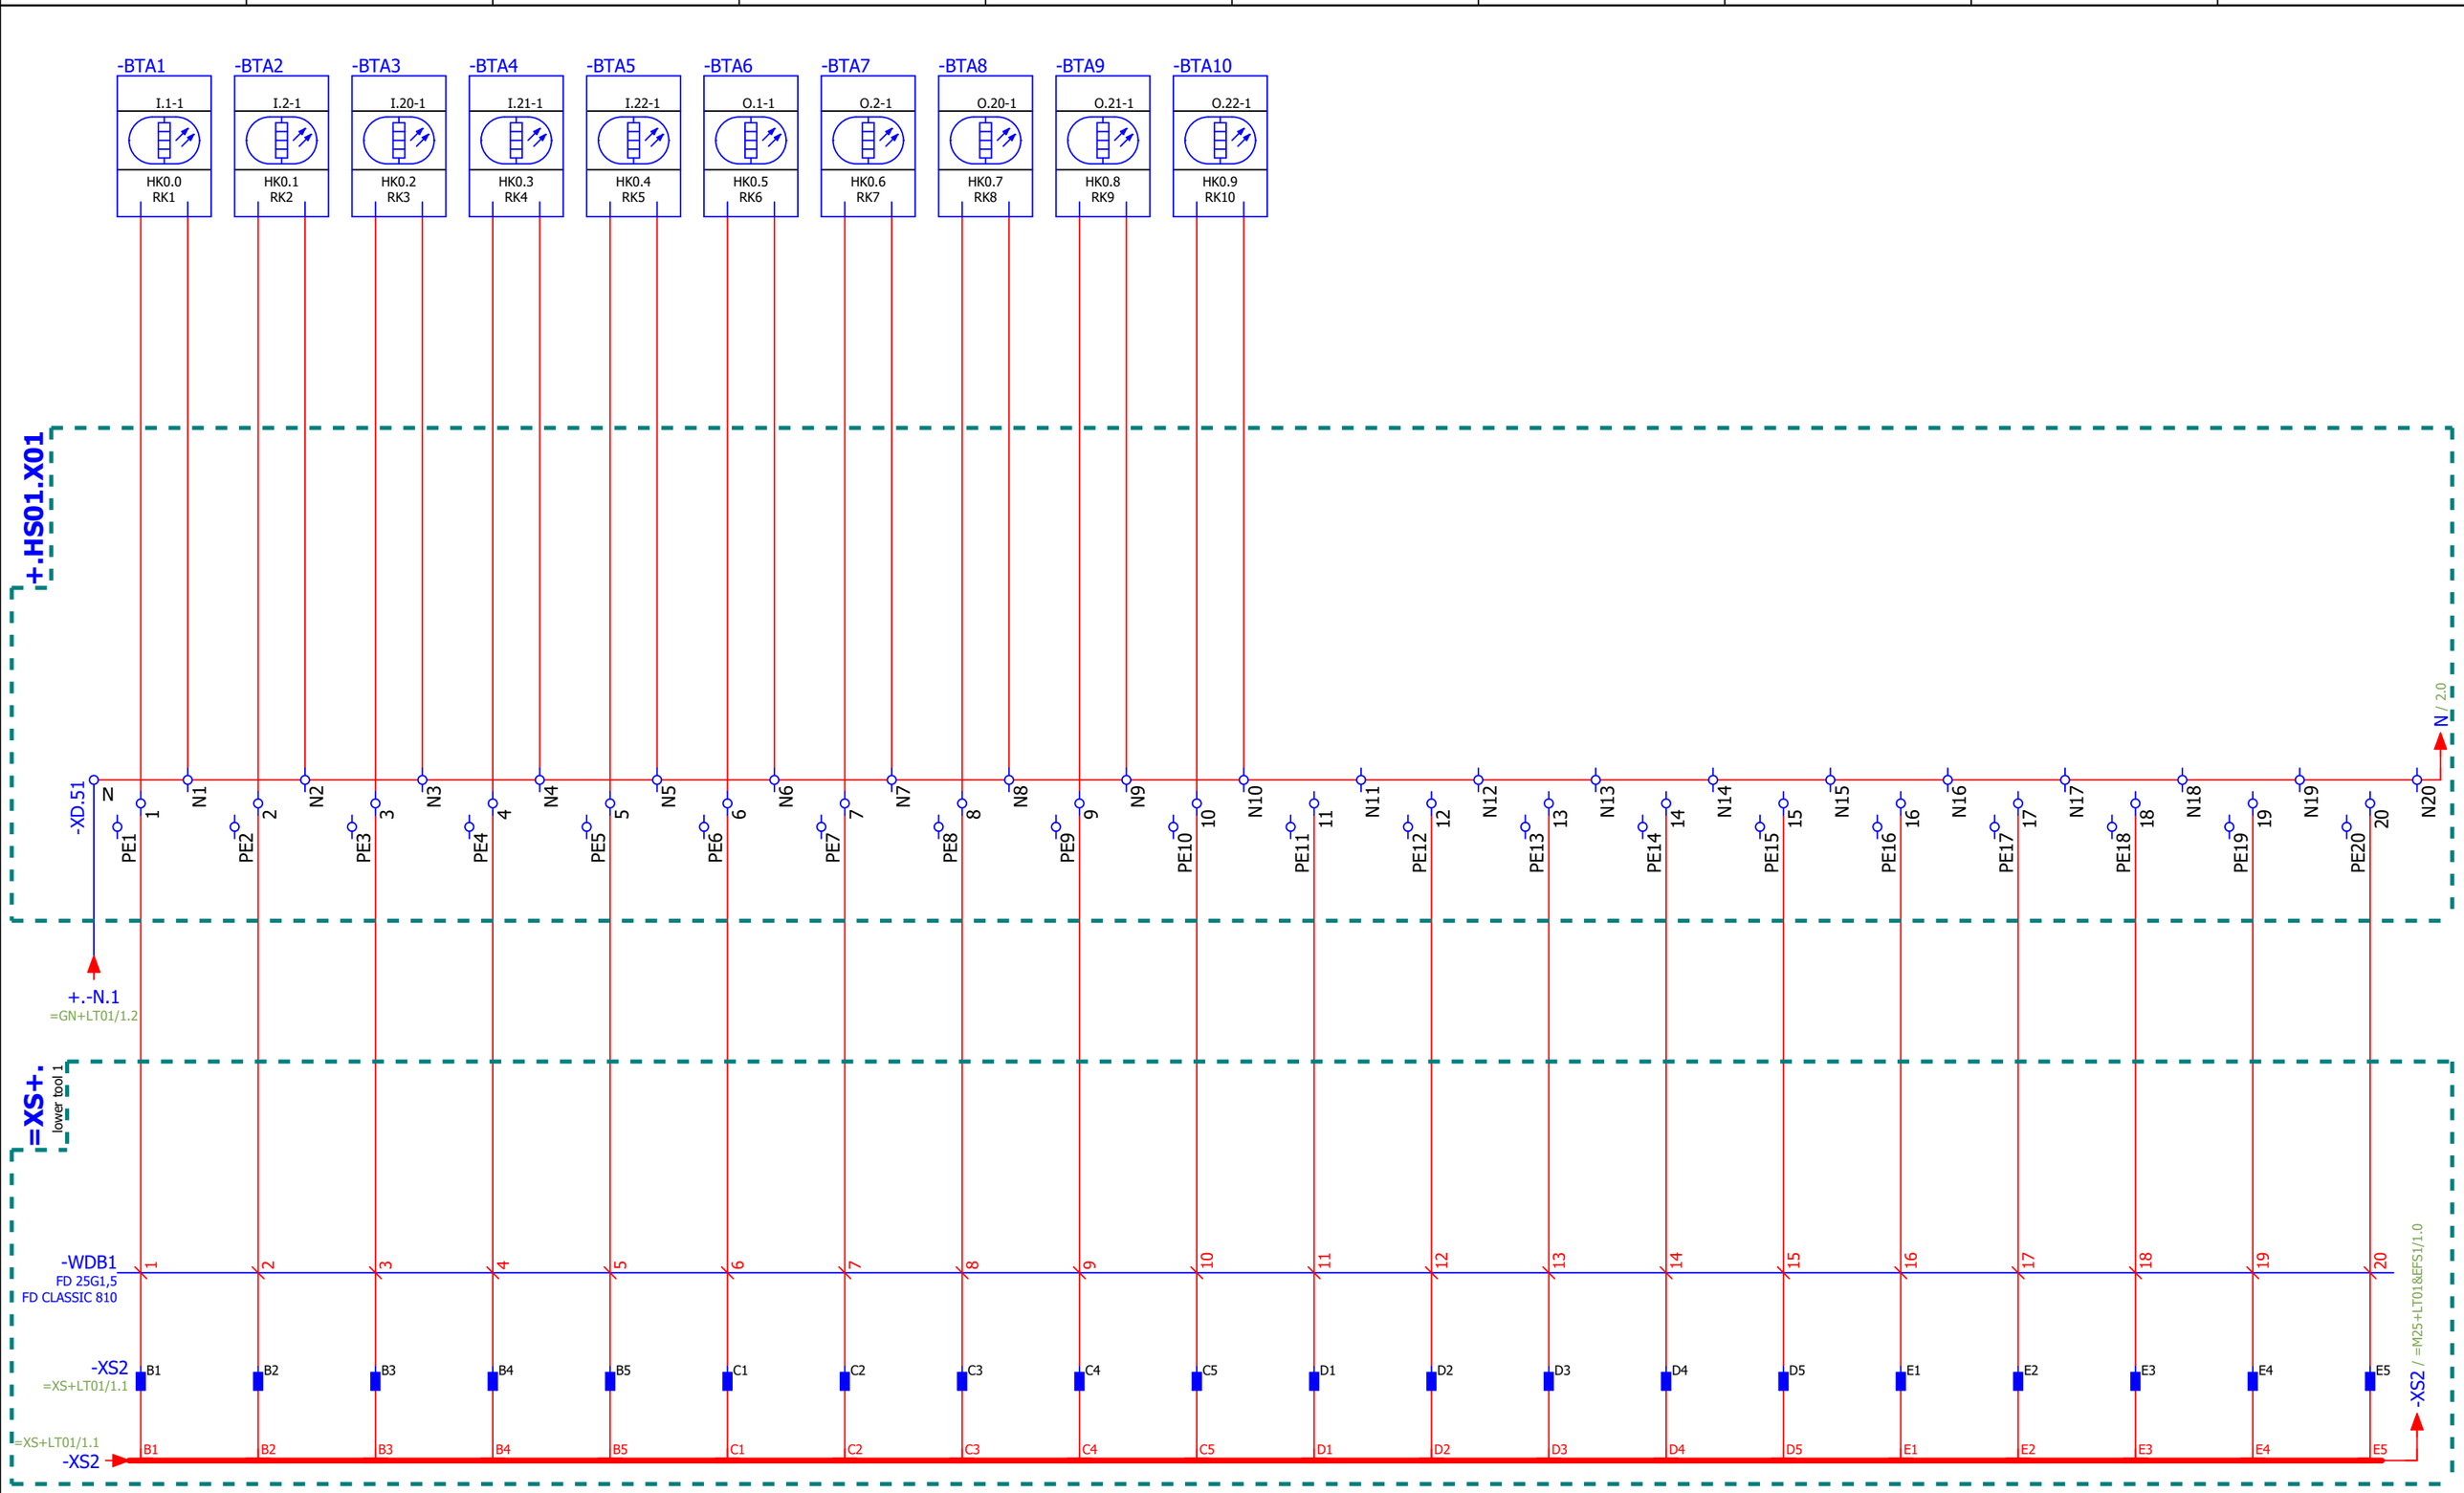

=EA+UT01/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS2	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 26.09.2024	lower tool 1	Sheet 41 from 164

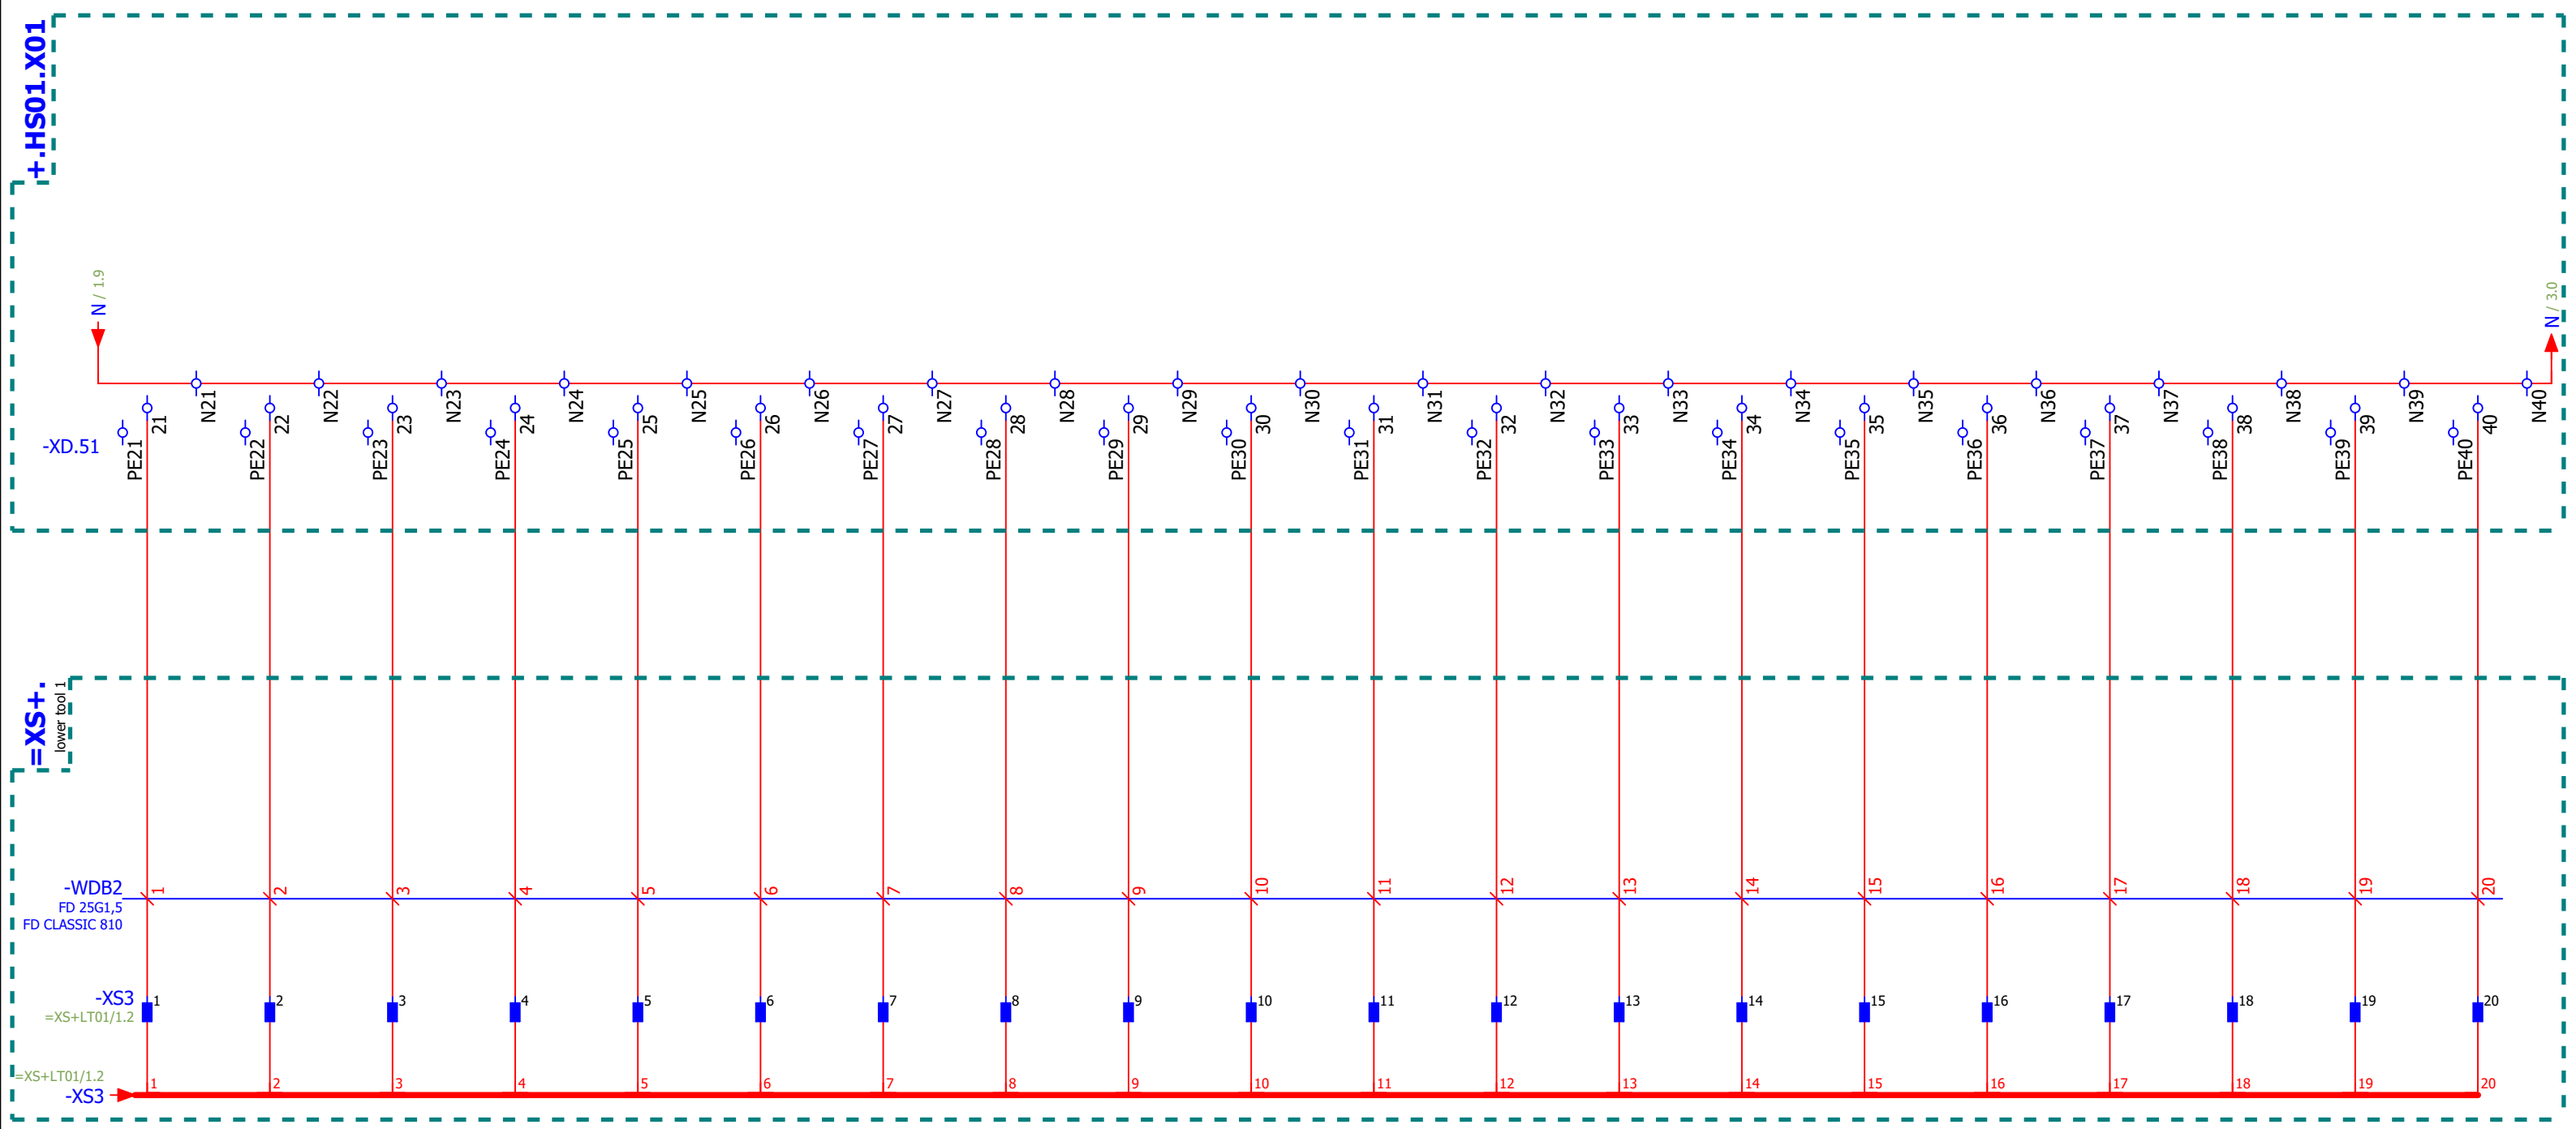

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS3	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 42 from 164

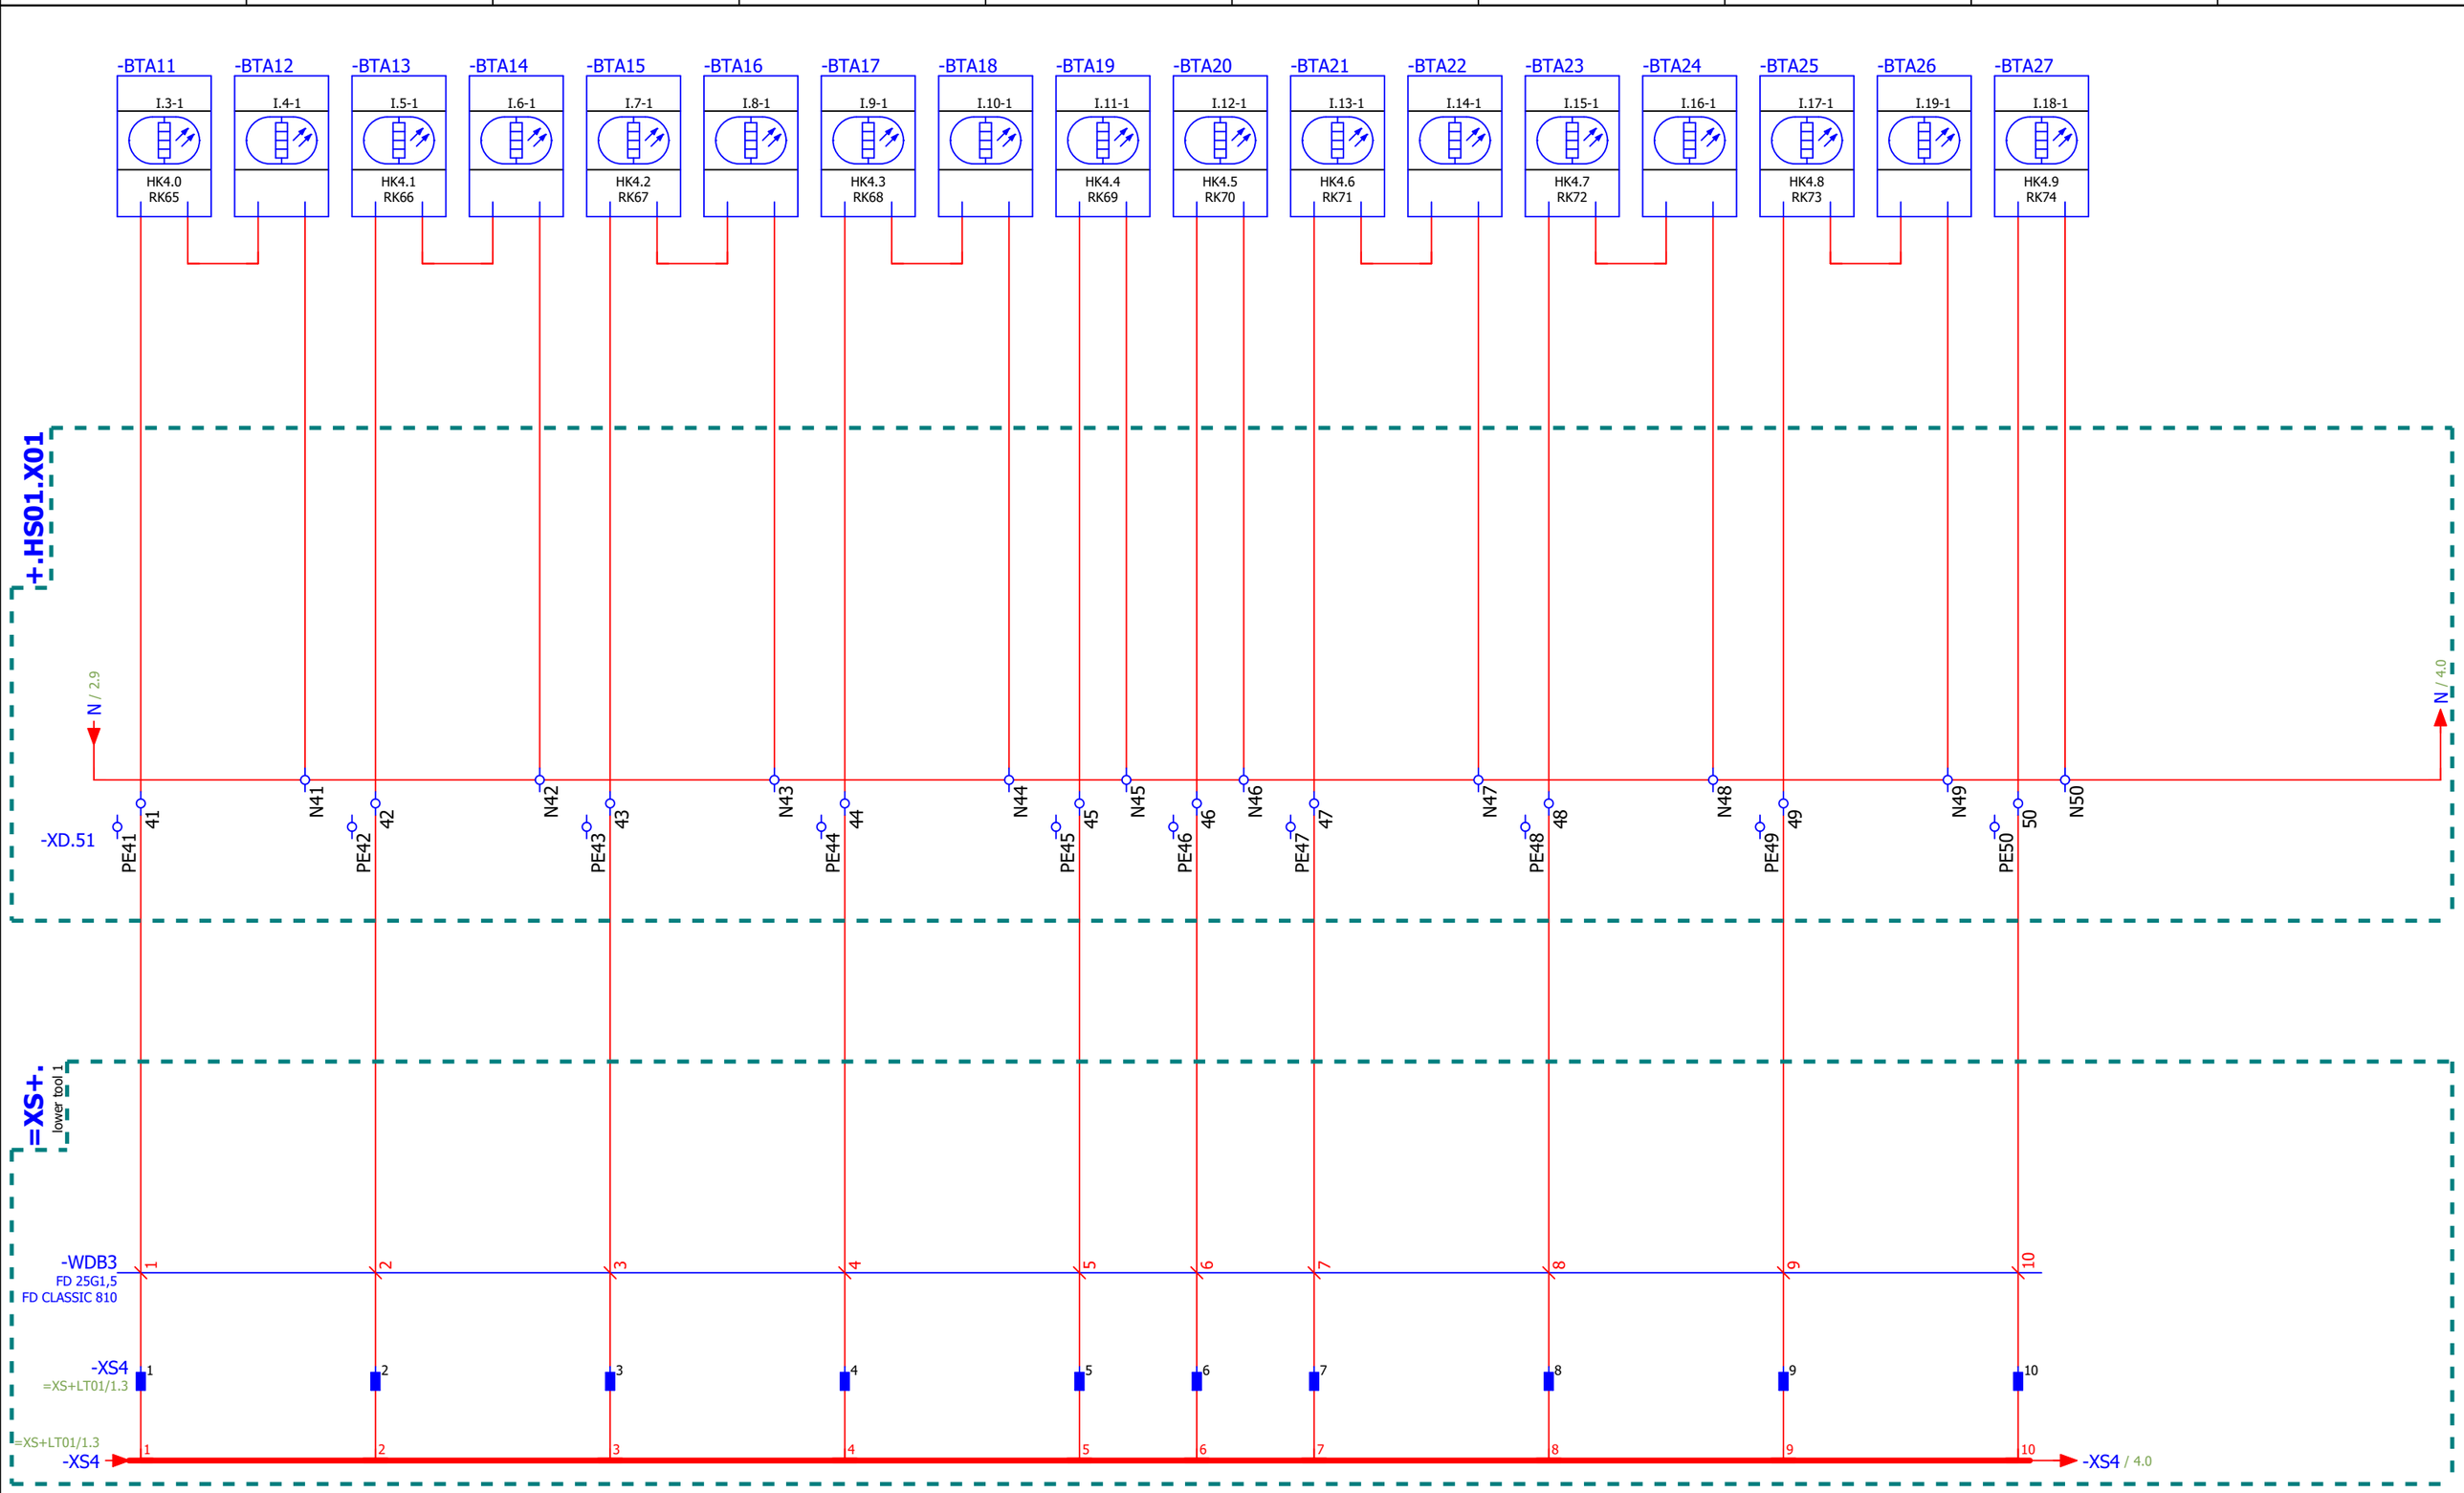

2 4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS4	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 11.11.2024	lower tool 1	Sheet 43 from 164

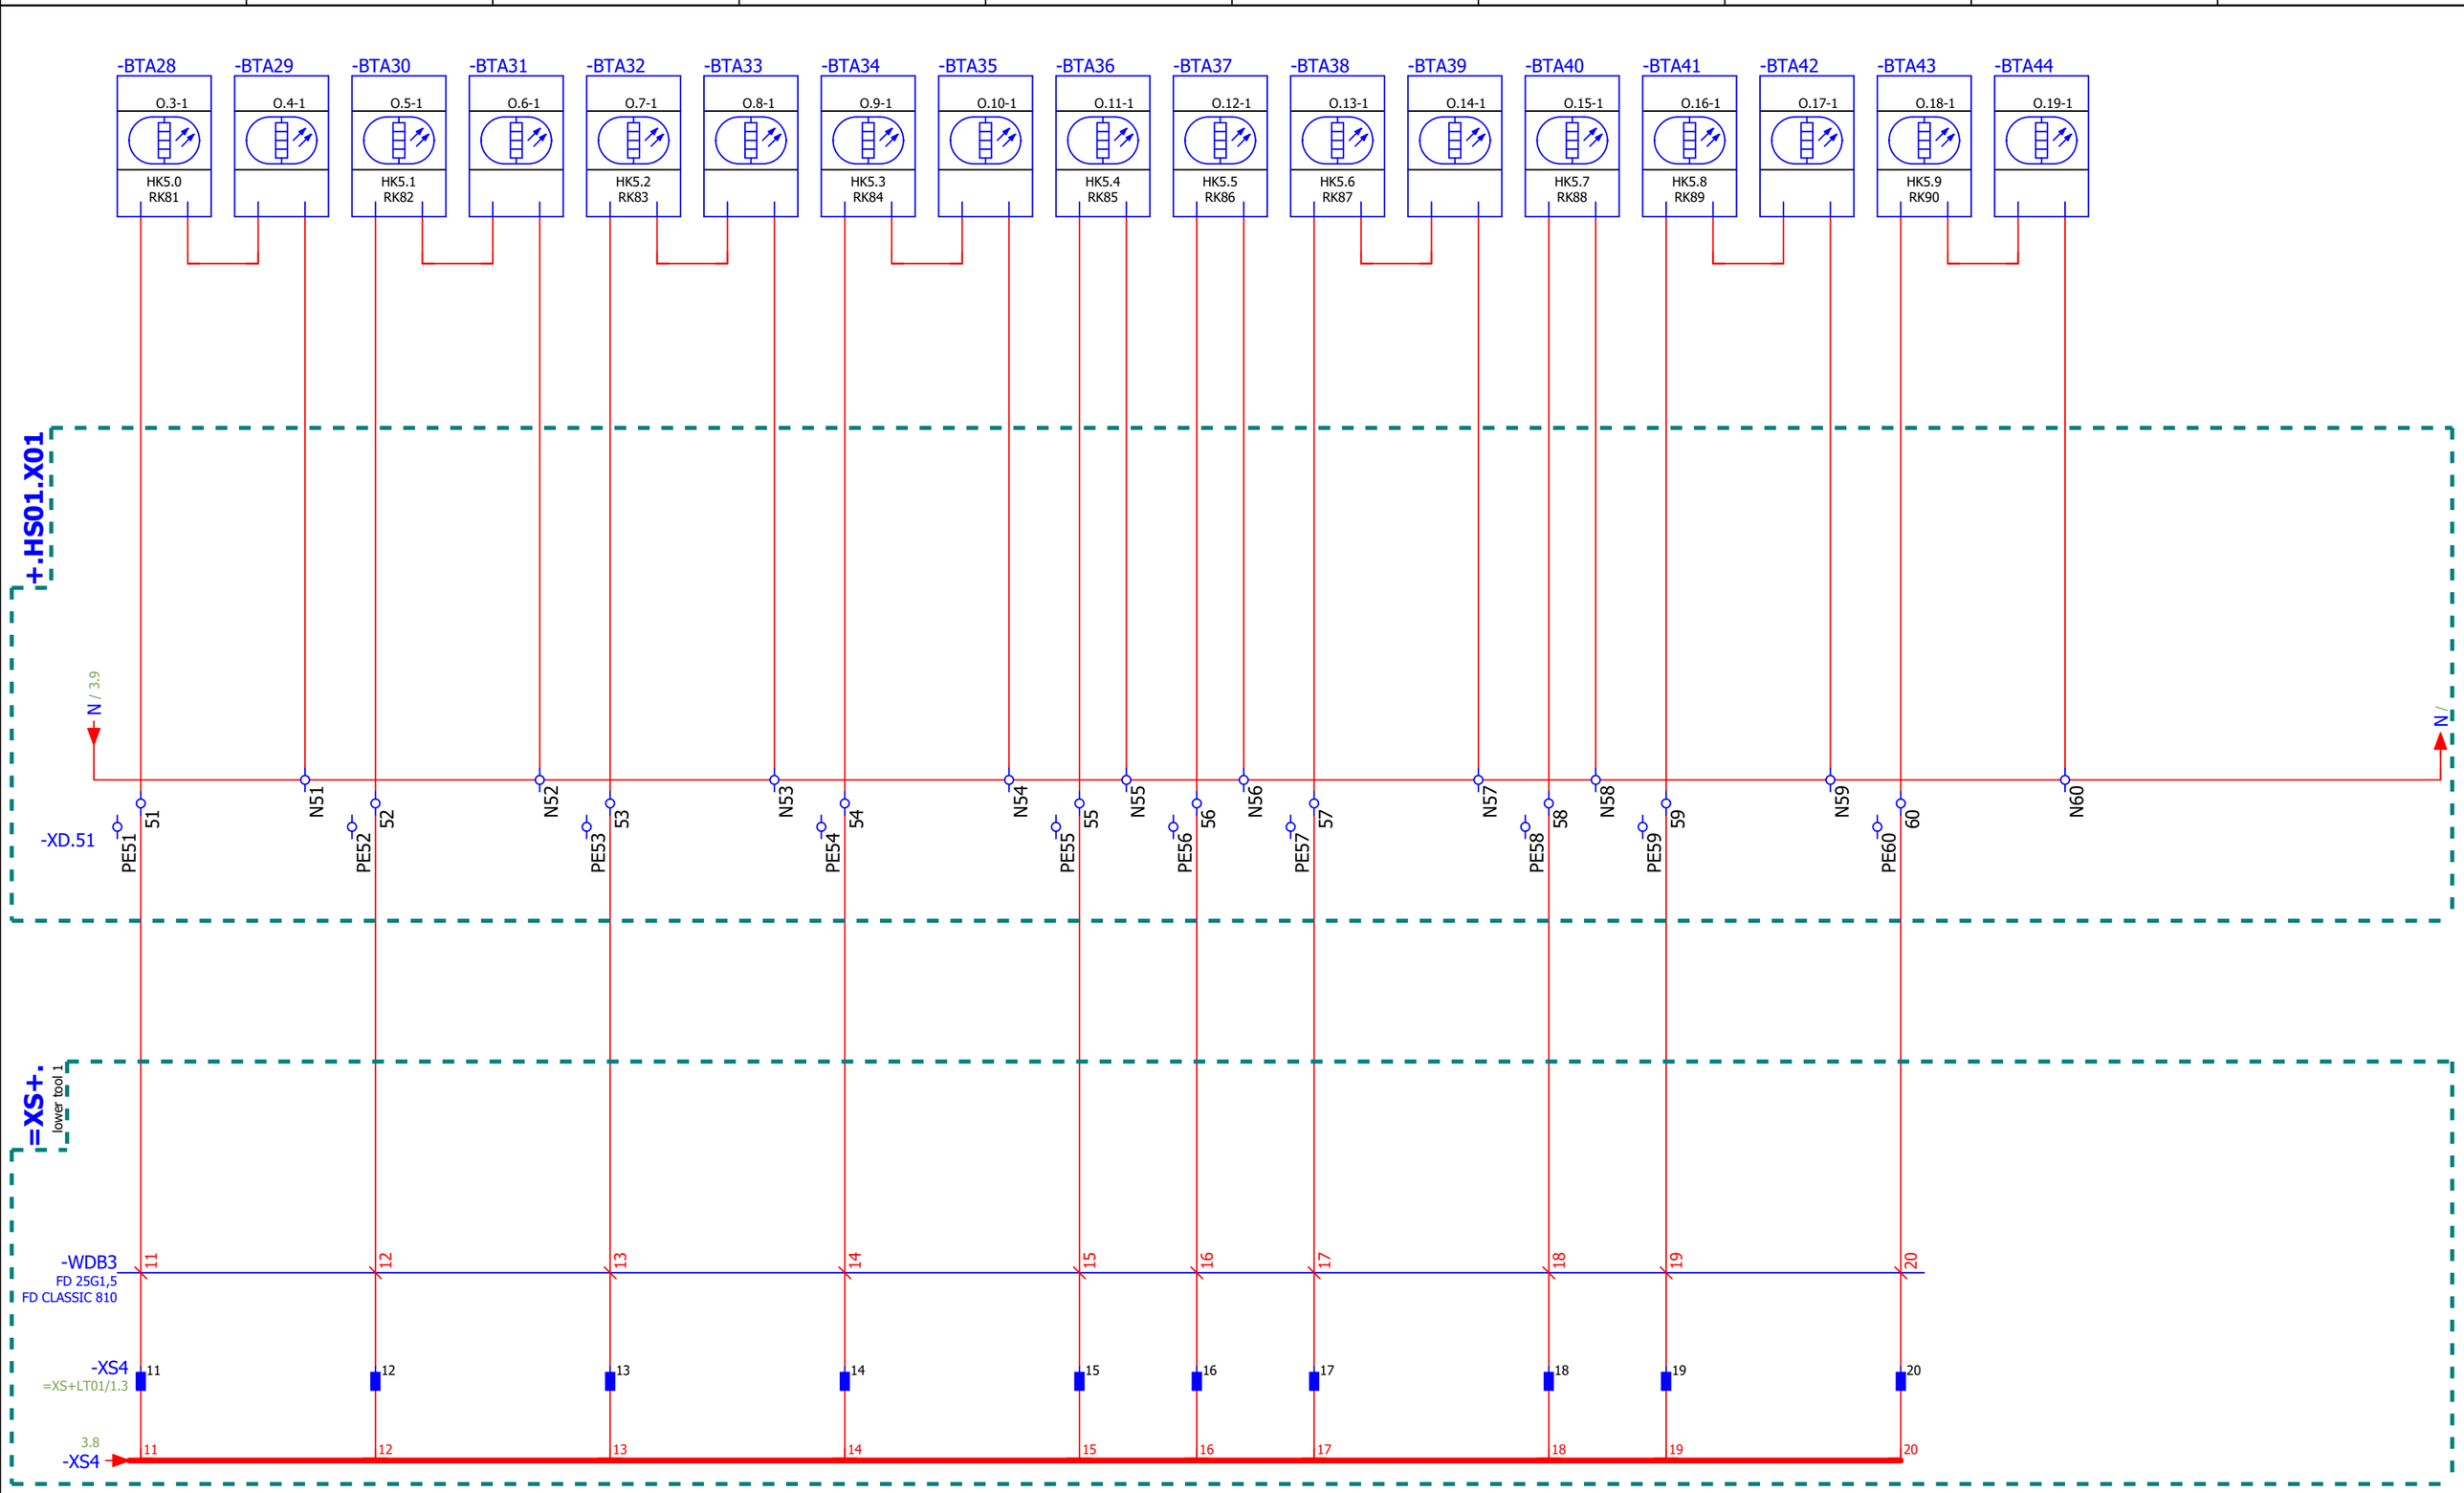

3 5

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS4		==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version					+LT01.HS01	Page 4
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 26.09.2024		lower tool 1	Sheet 44 from 164

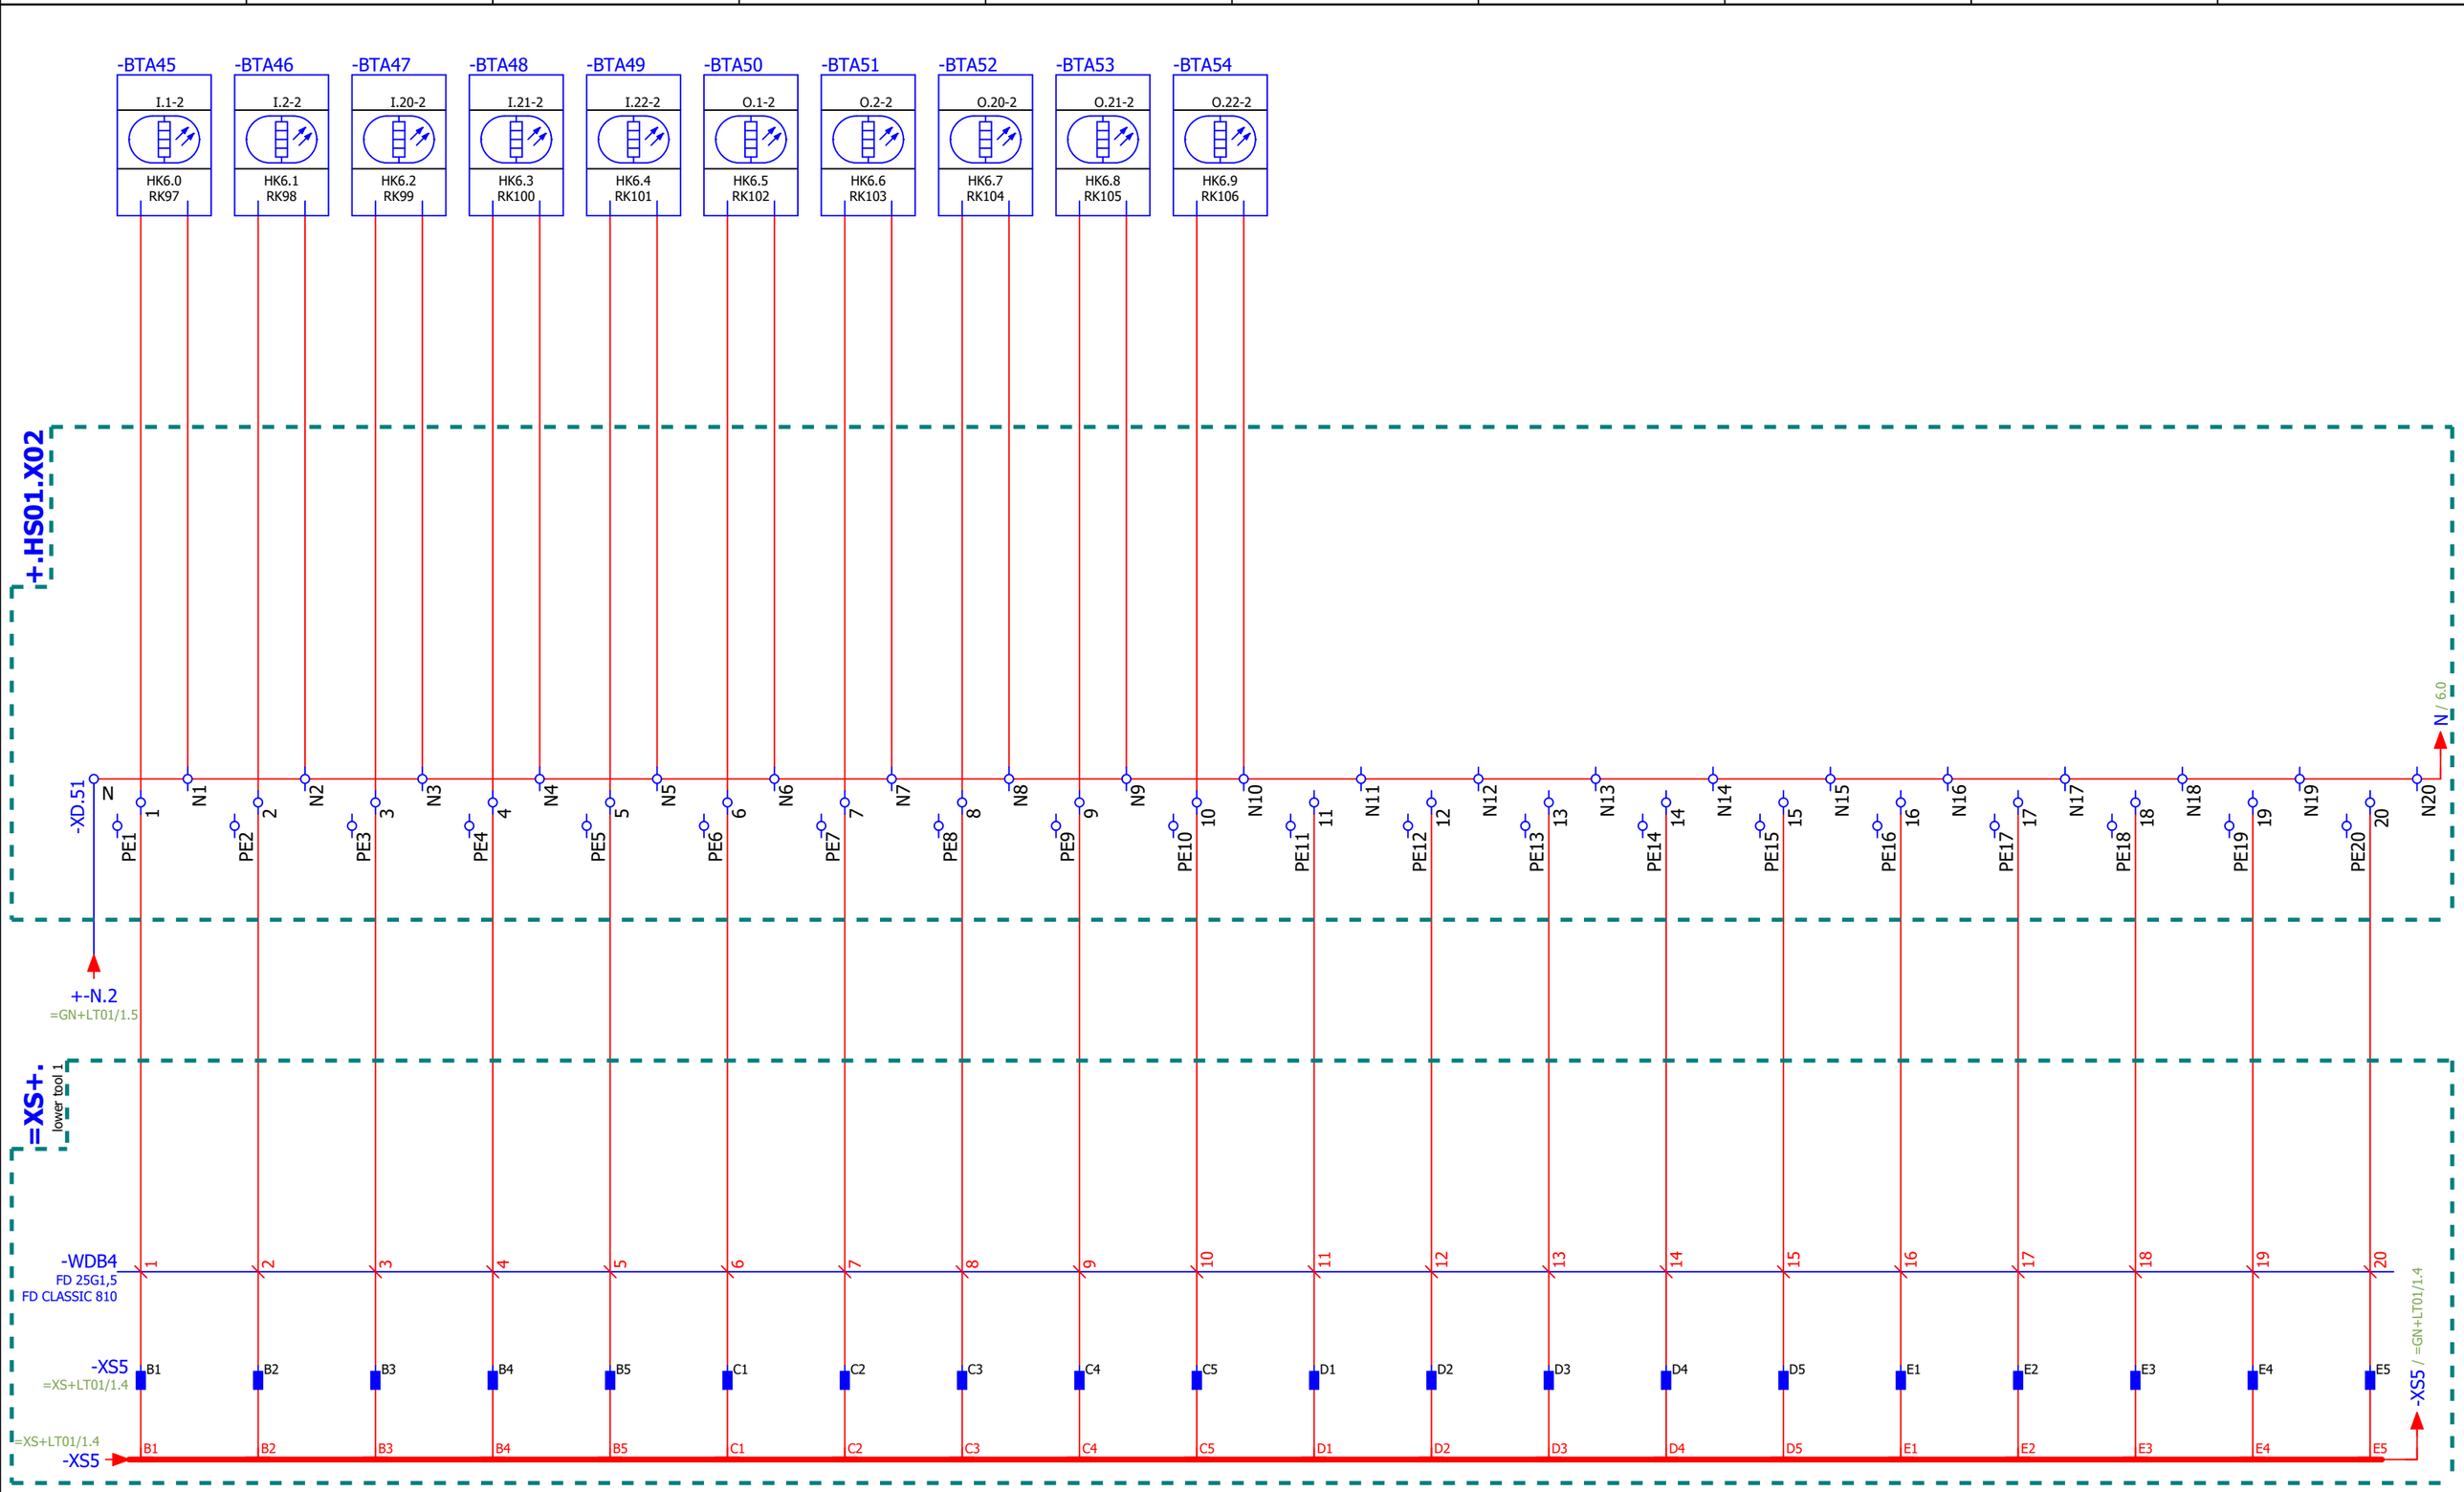

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS5	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 5
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 26.09.2024	lower tool 1	Sheet 45 from 164

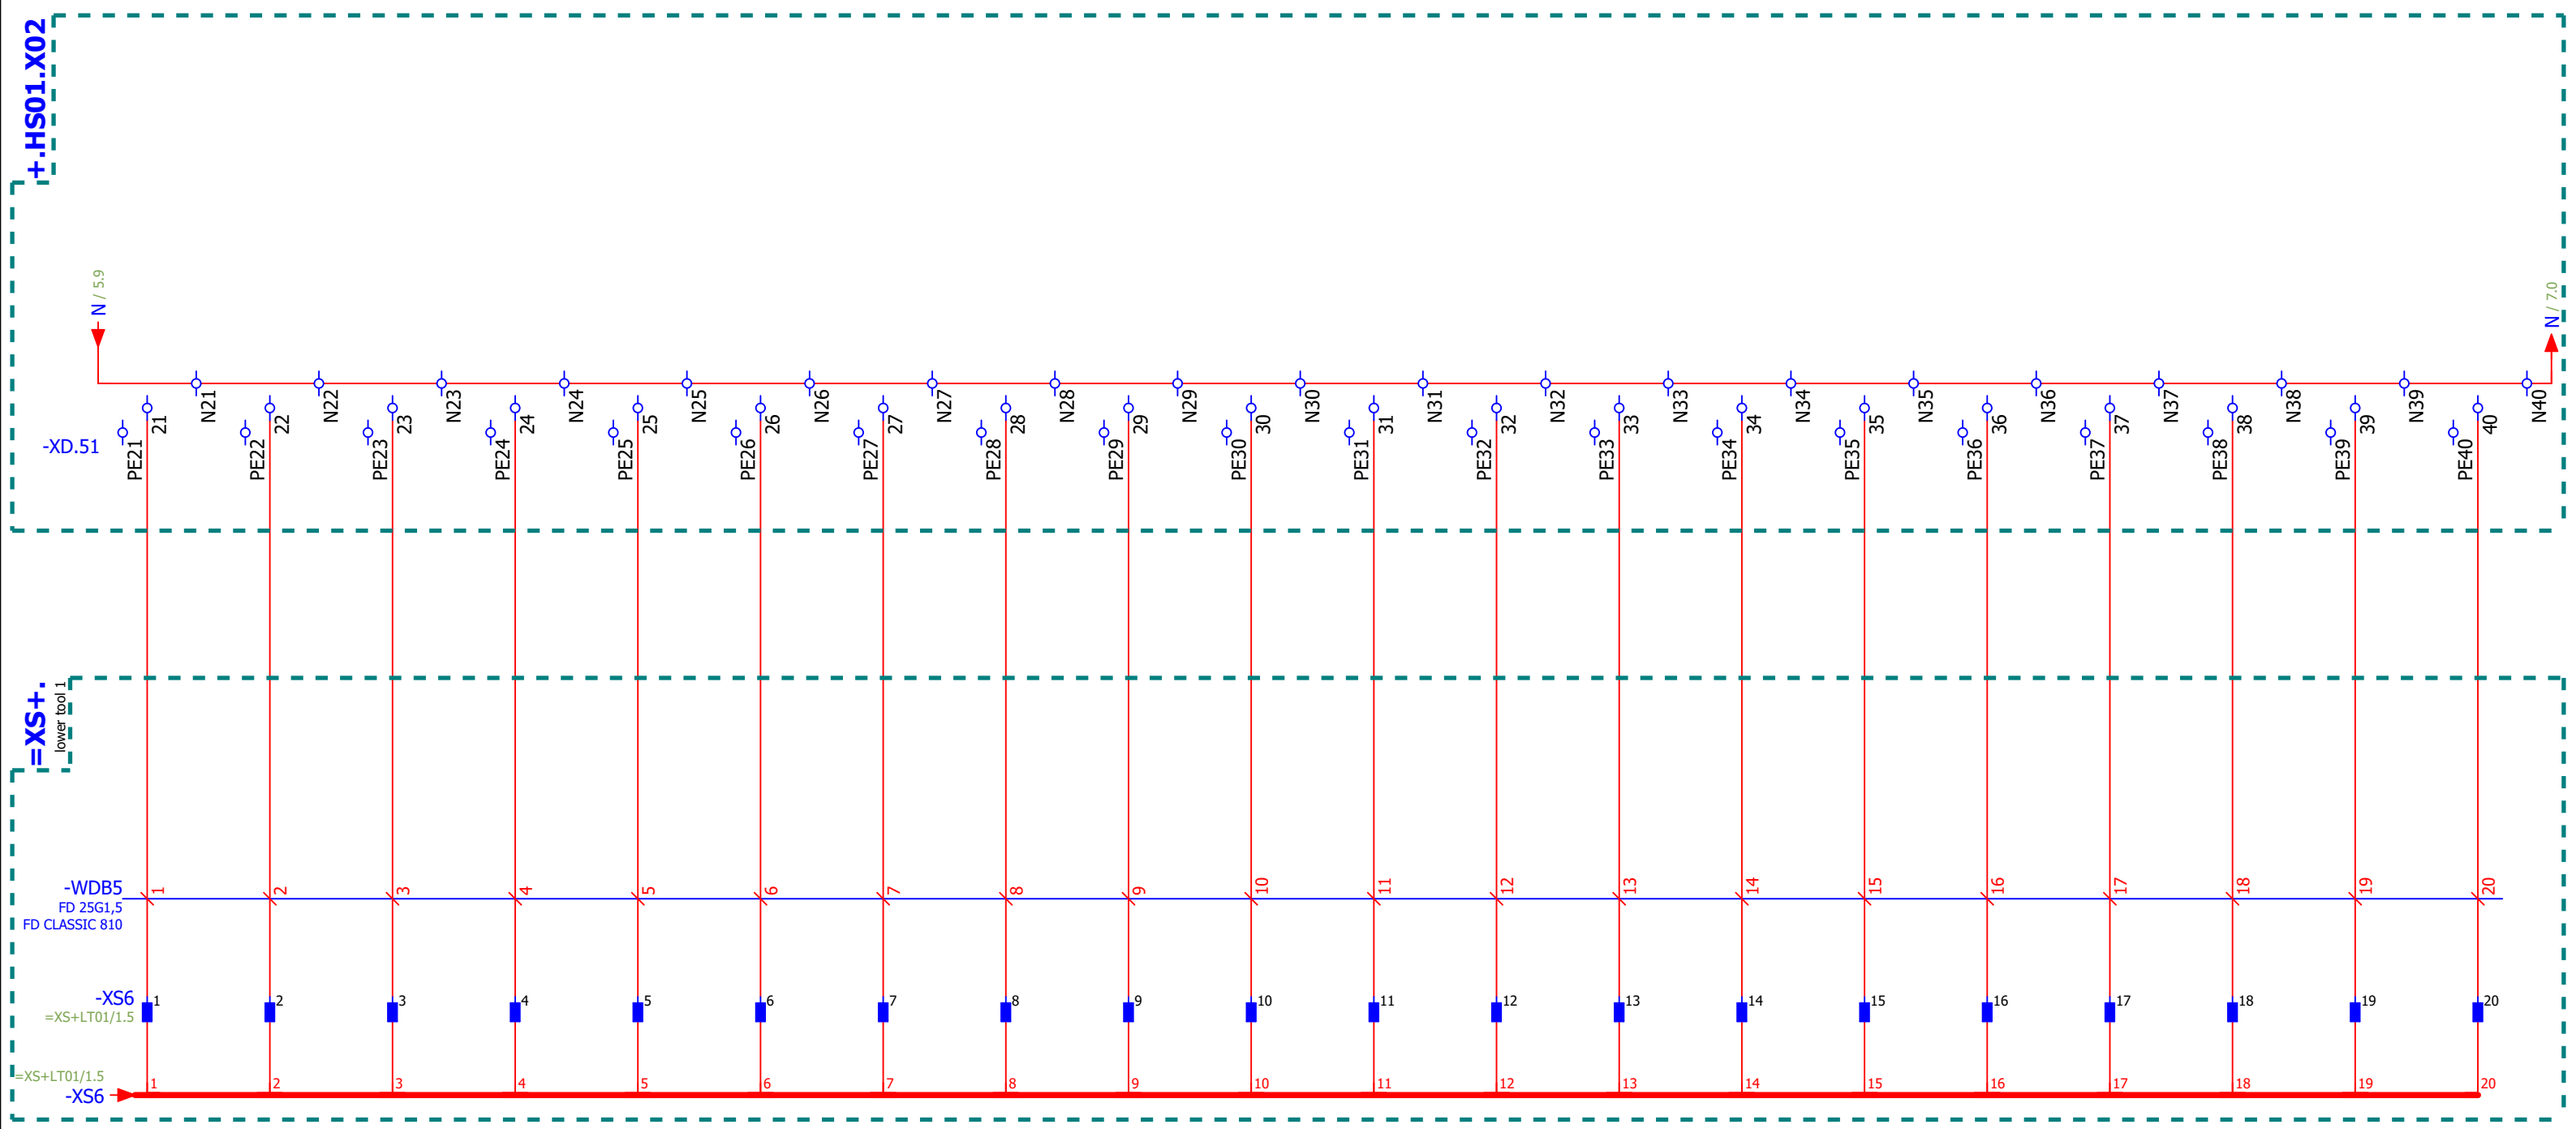

5 7

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS6	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 6
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 46 from 164

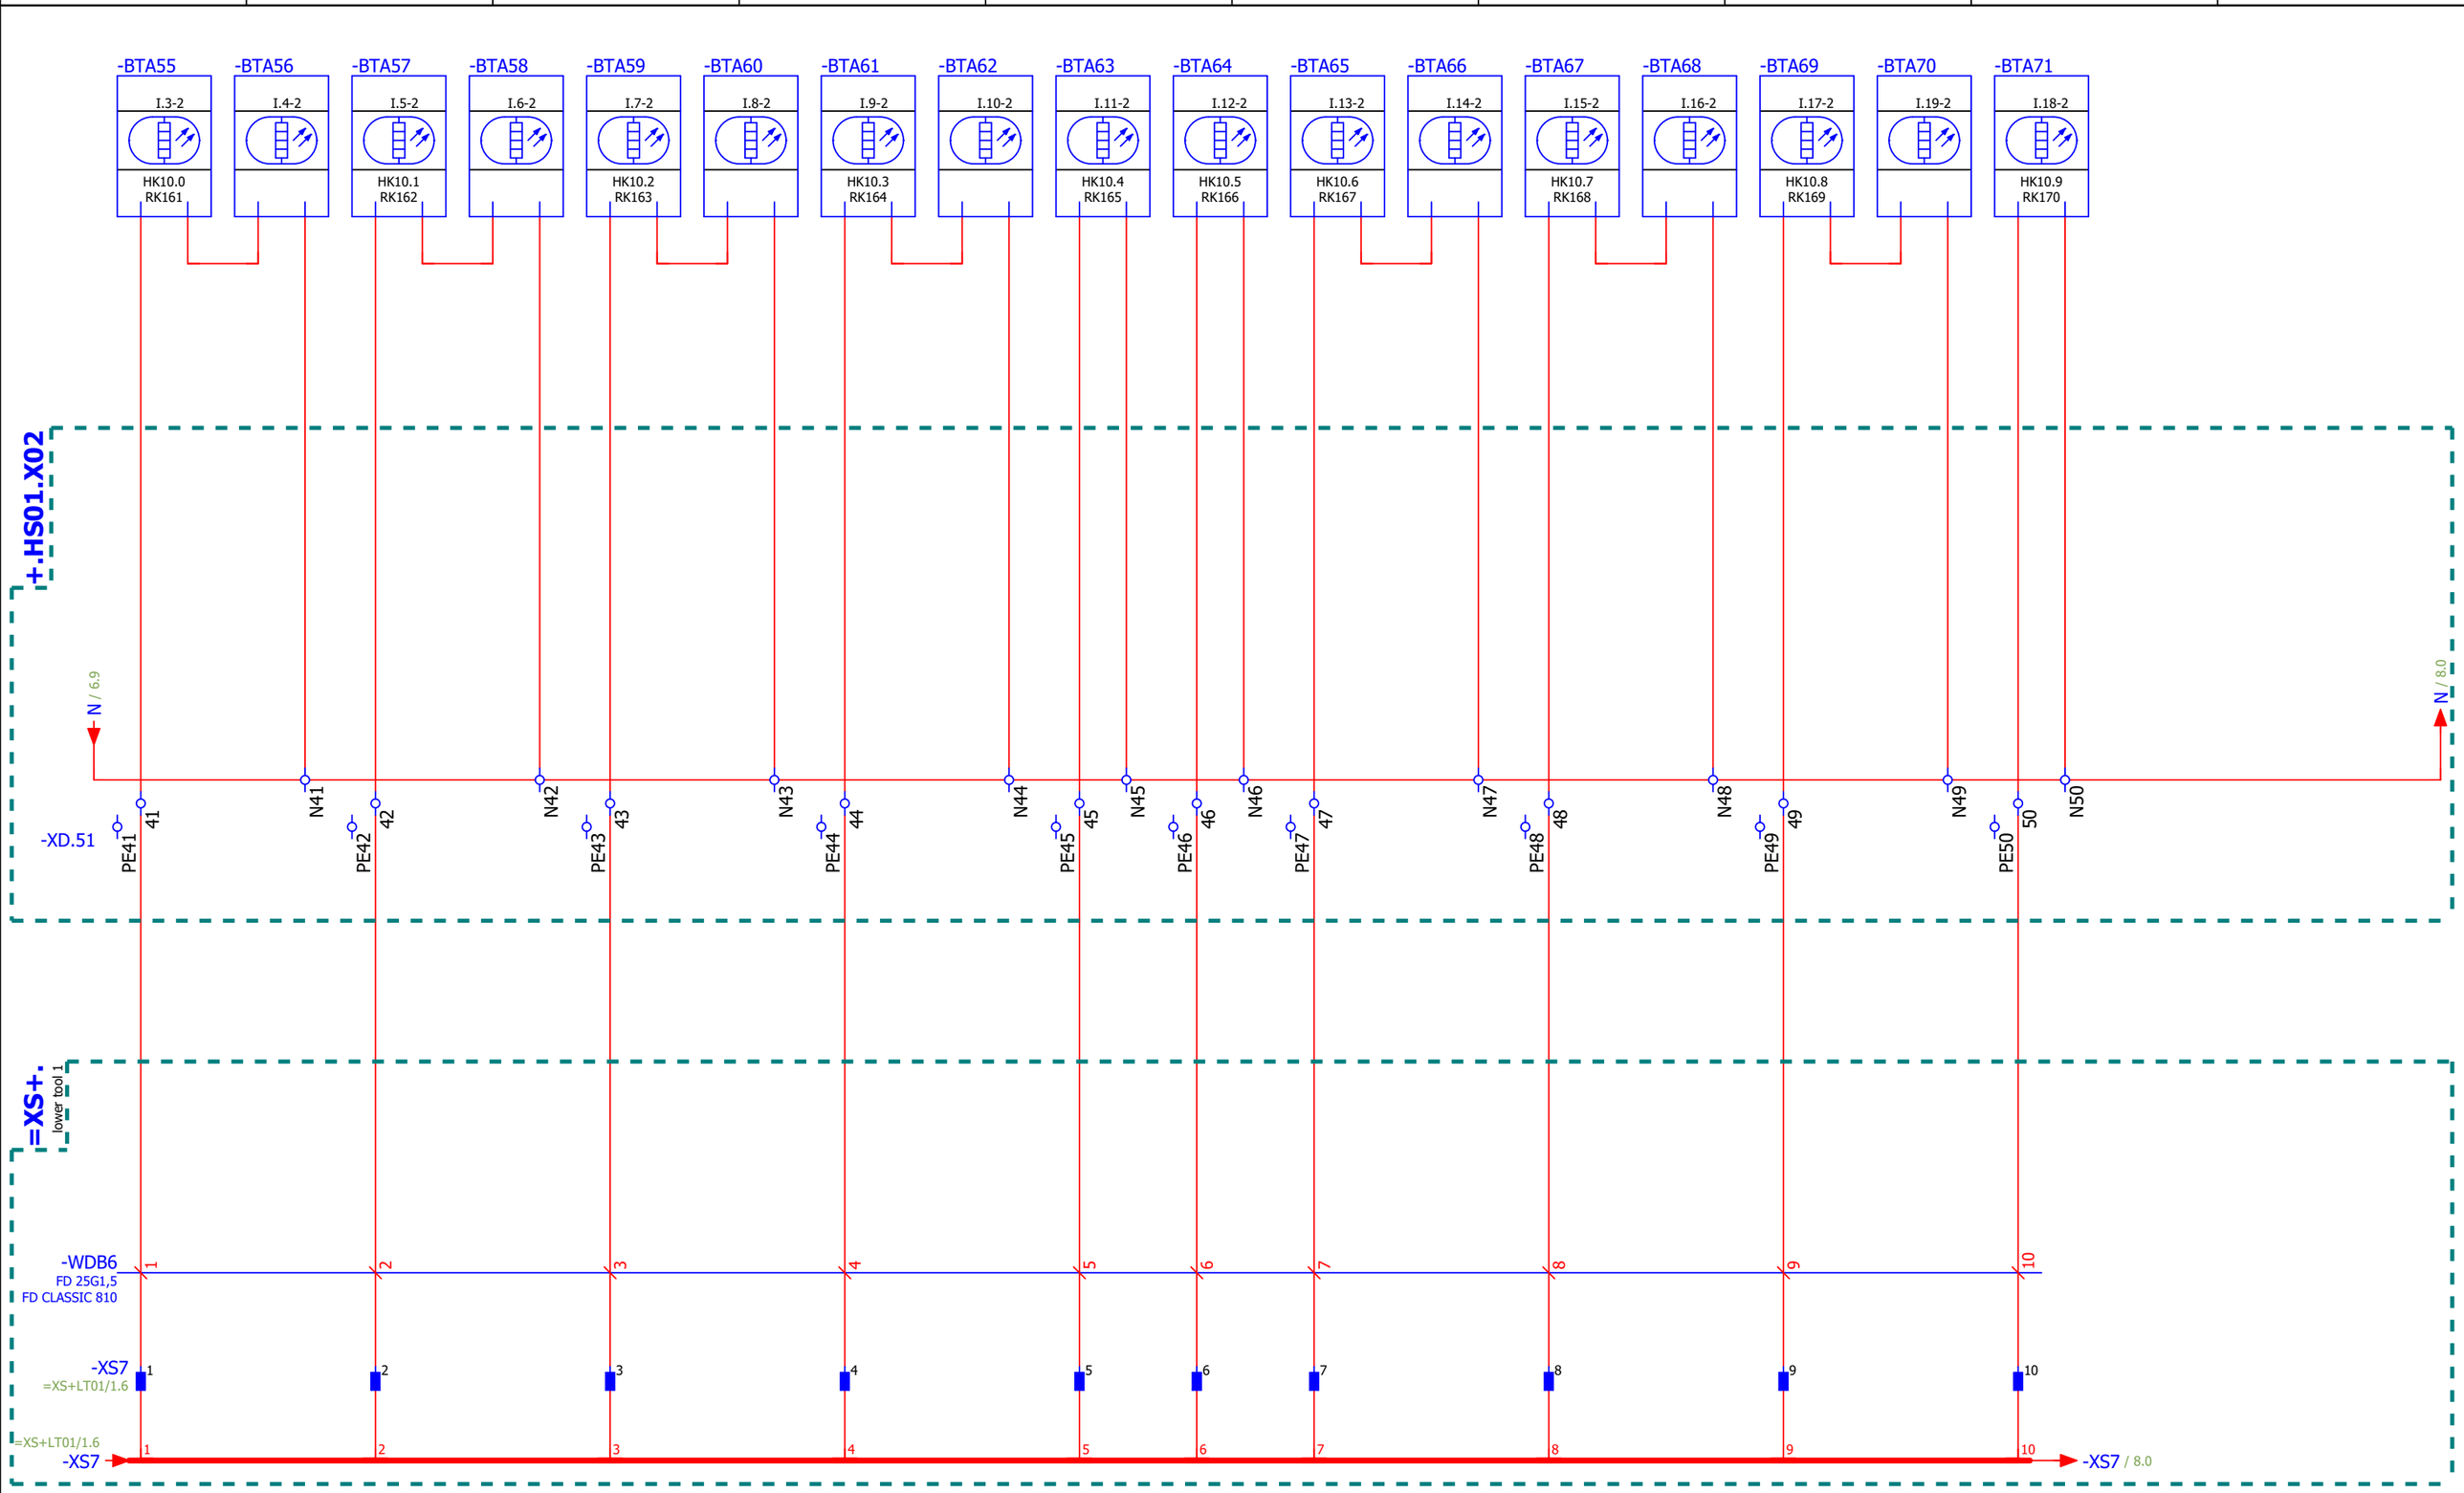

6 8

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS7	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 7
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 11.11.2024	lower tool 1	Sheet 47 from 164

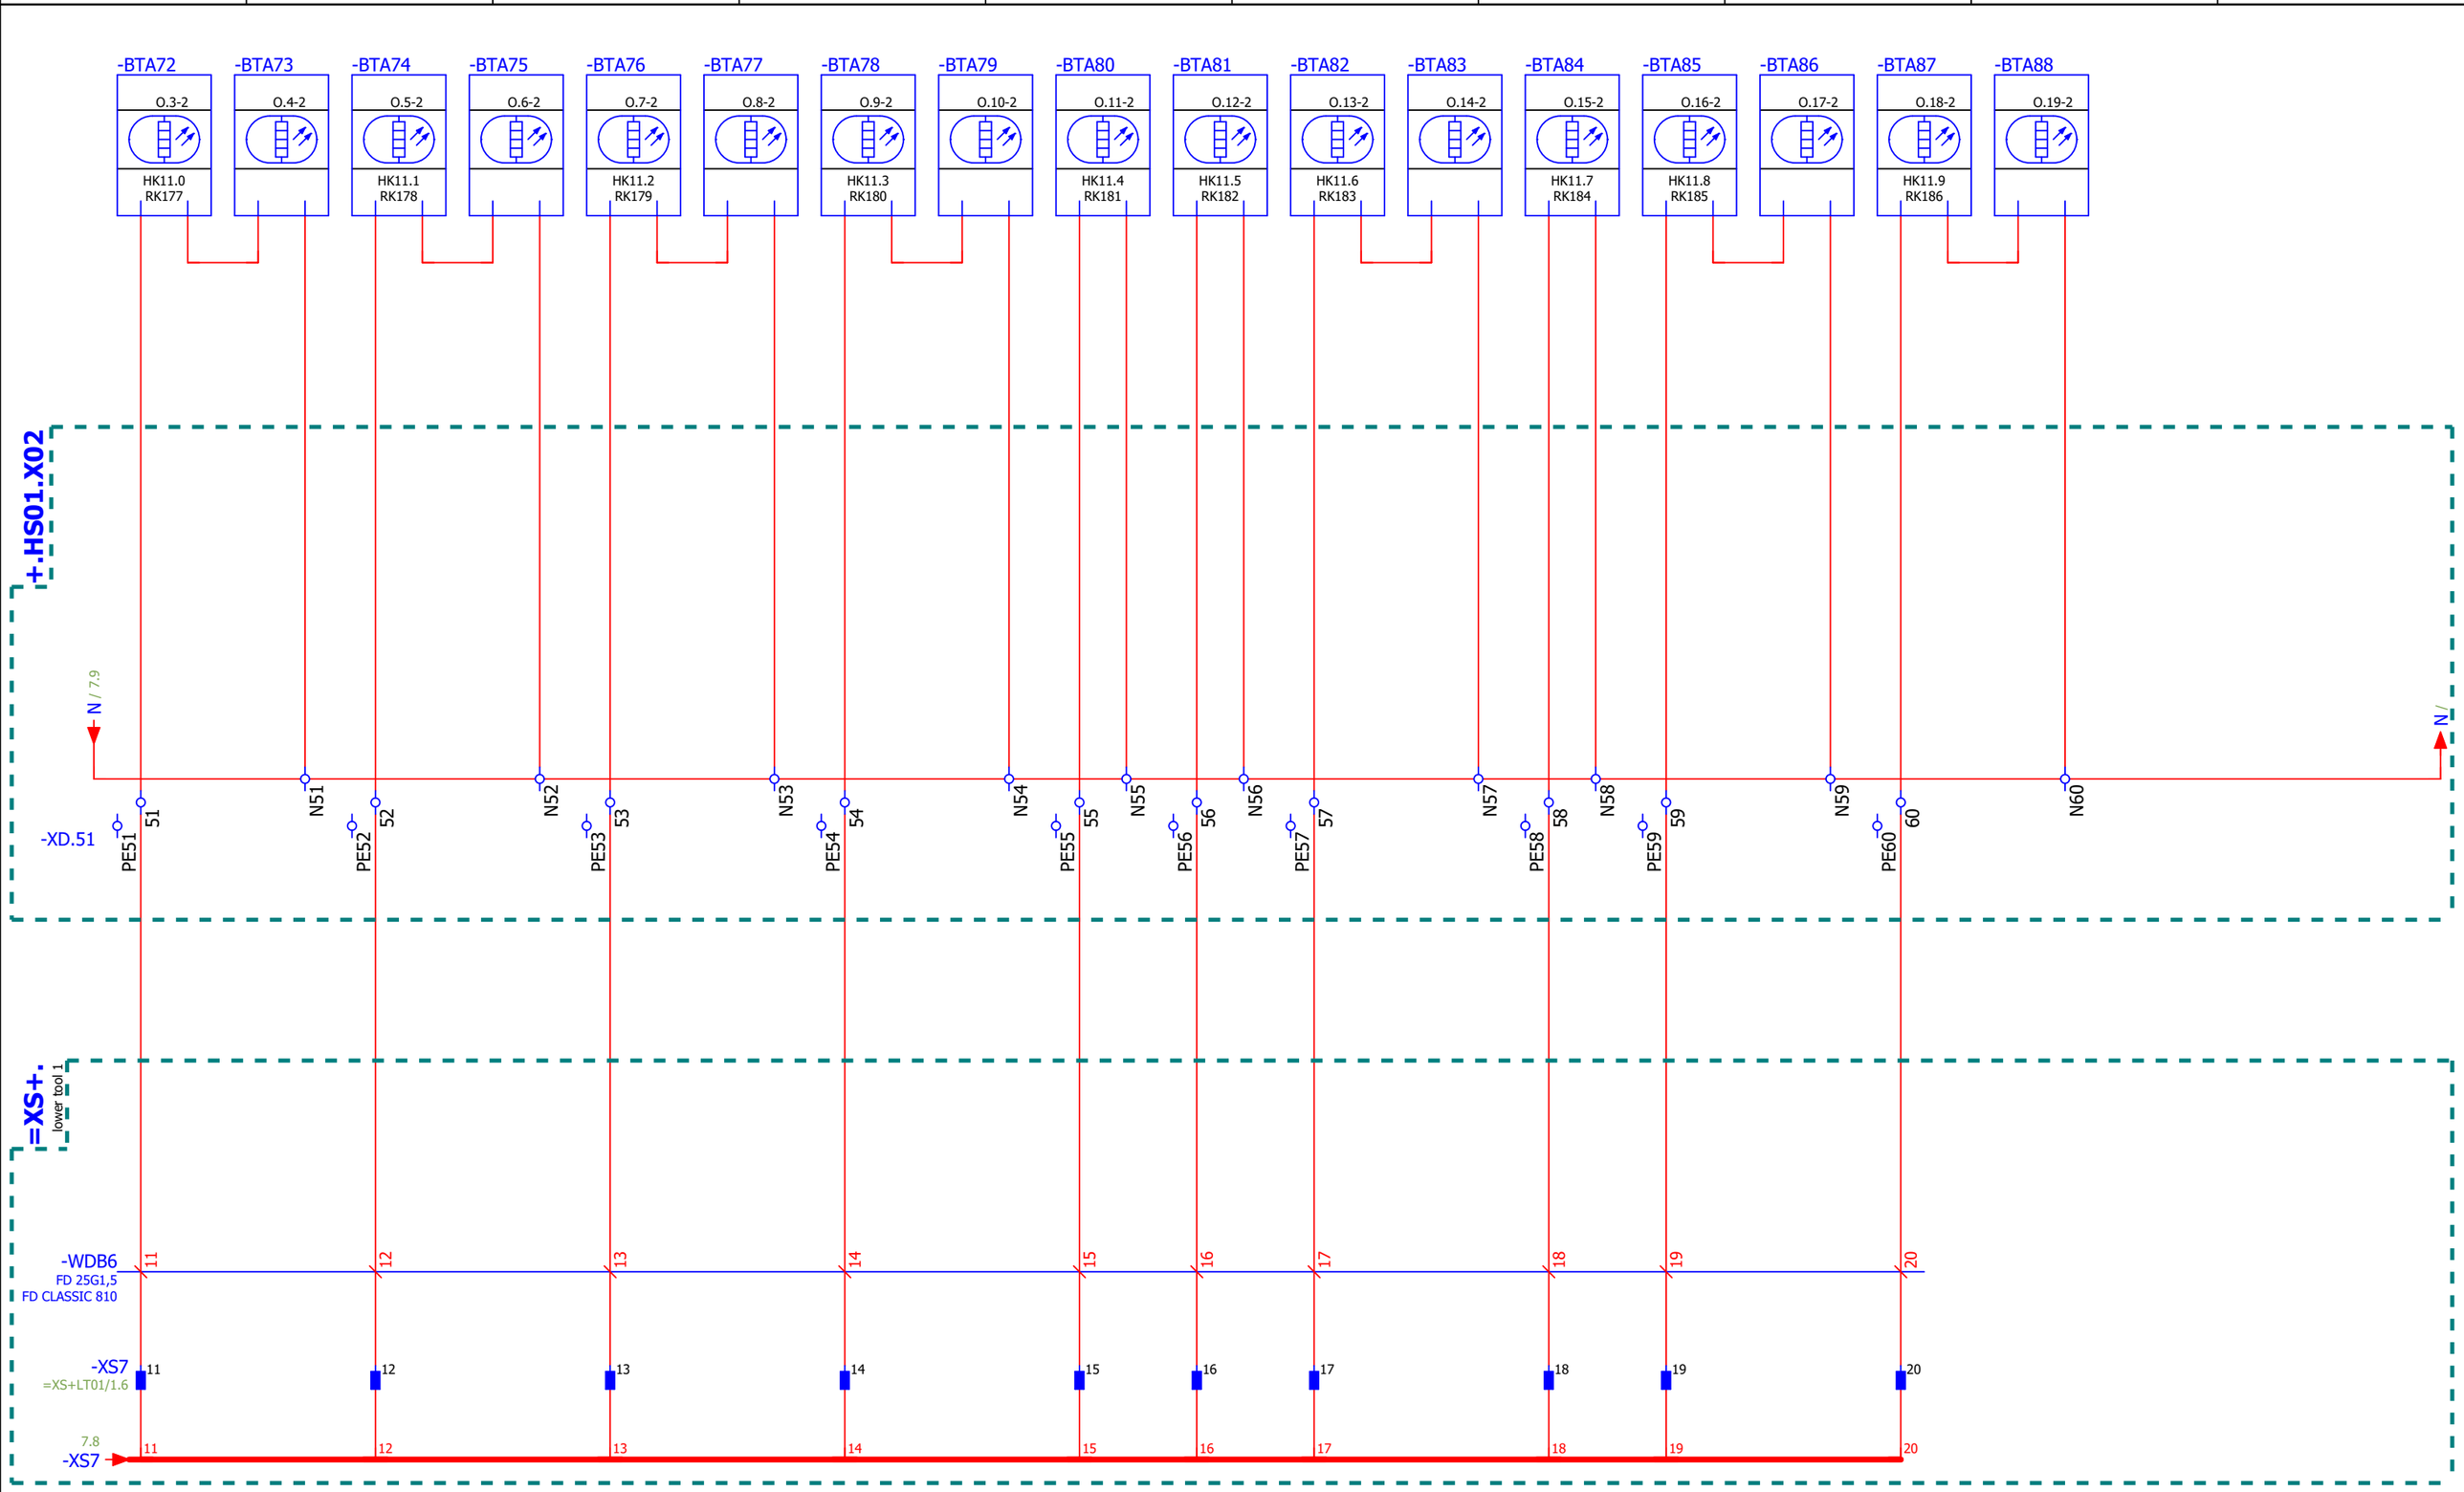

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Heating XS7	==1005811	=EB	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Generation process heat infrared	Wiring diagram
				Drawing number 1005811	Version				+LT01.HS01	Page 8
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 26.09.2024	lower tool 1	Sheet 48 from 164

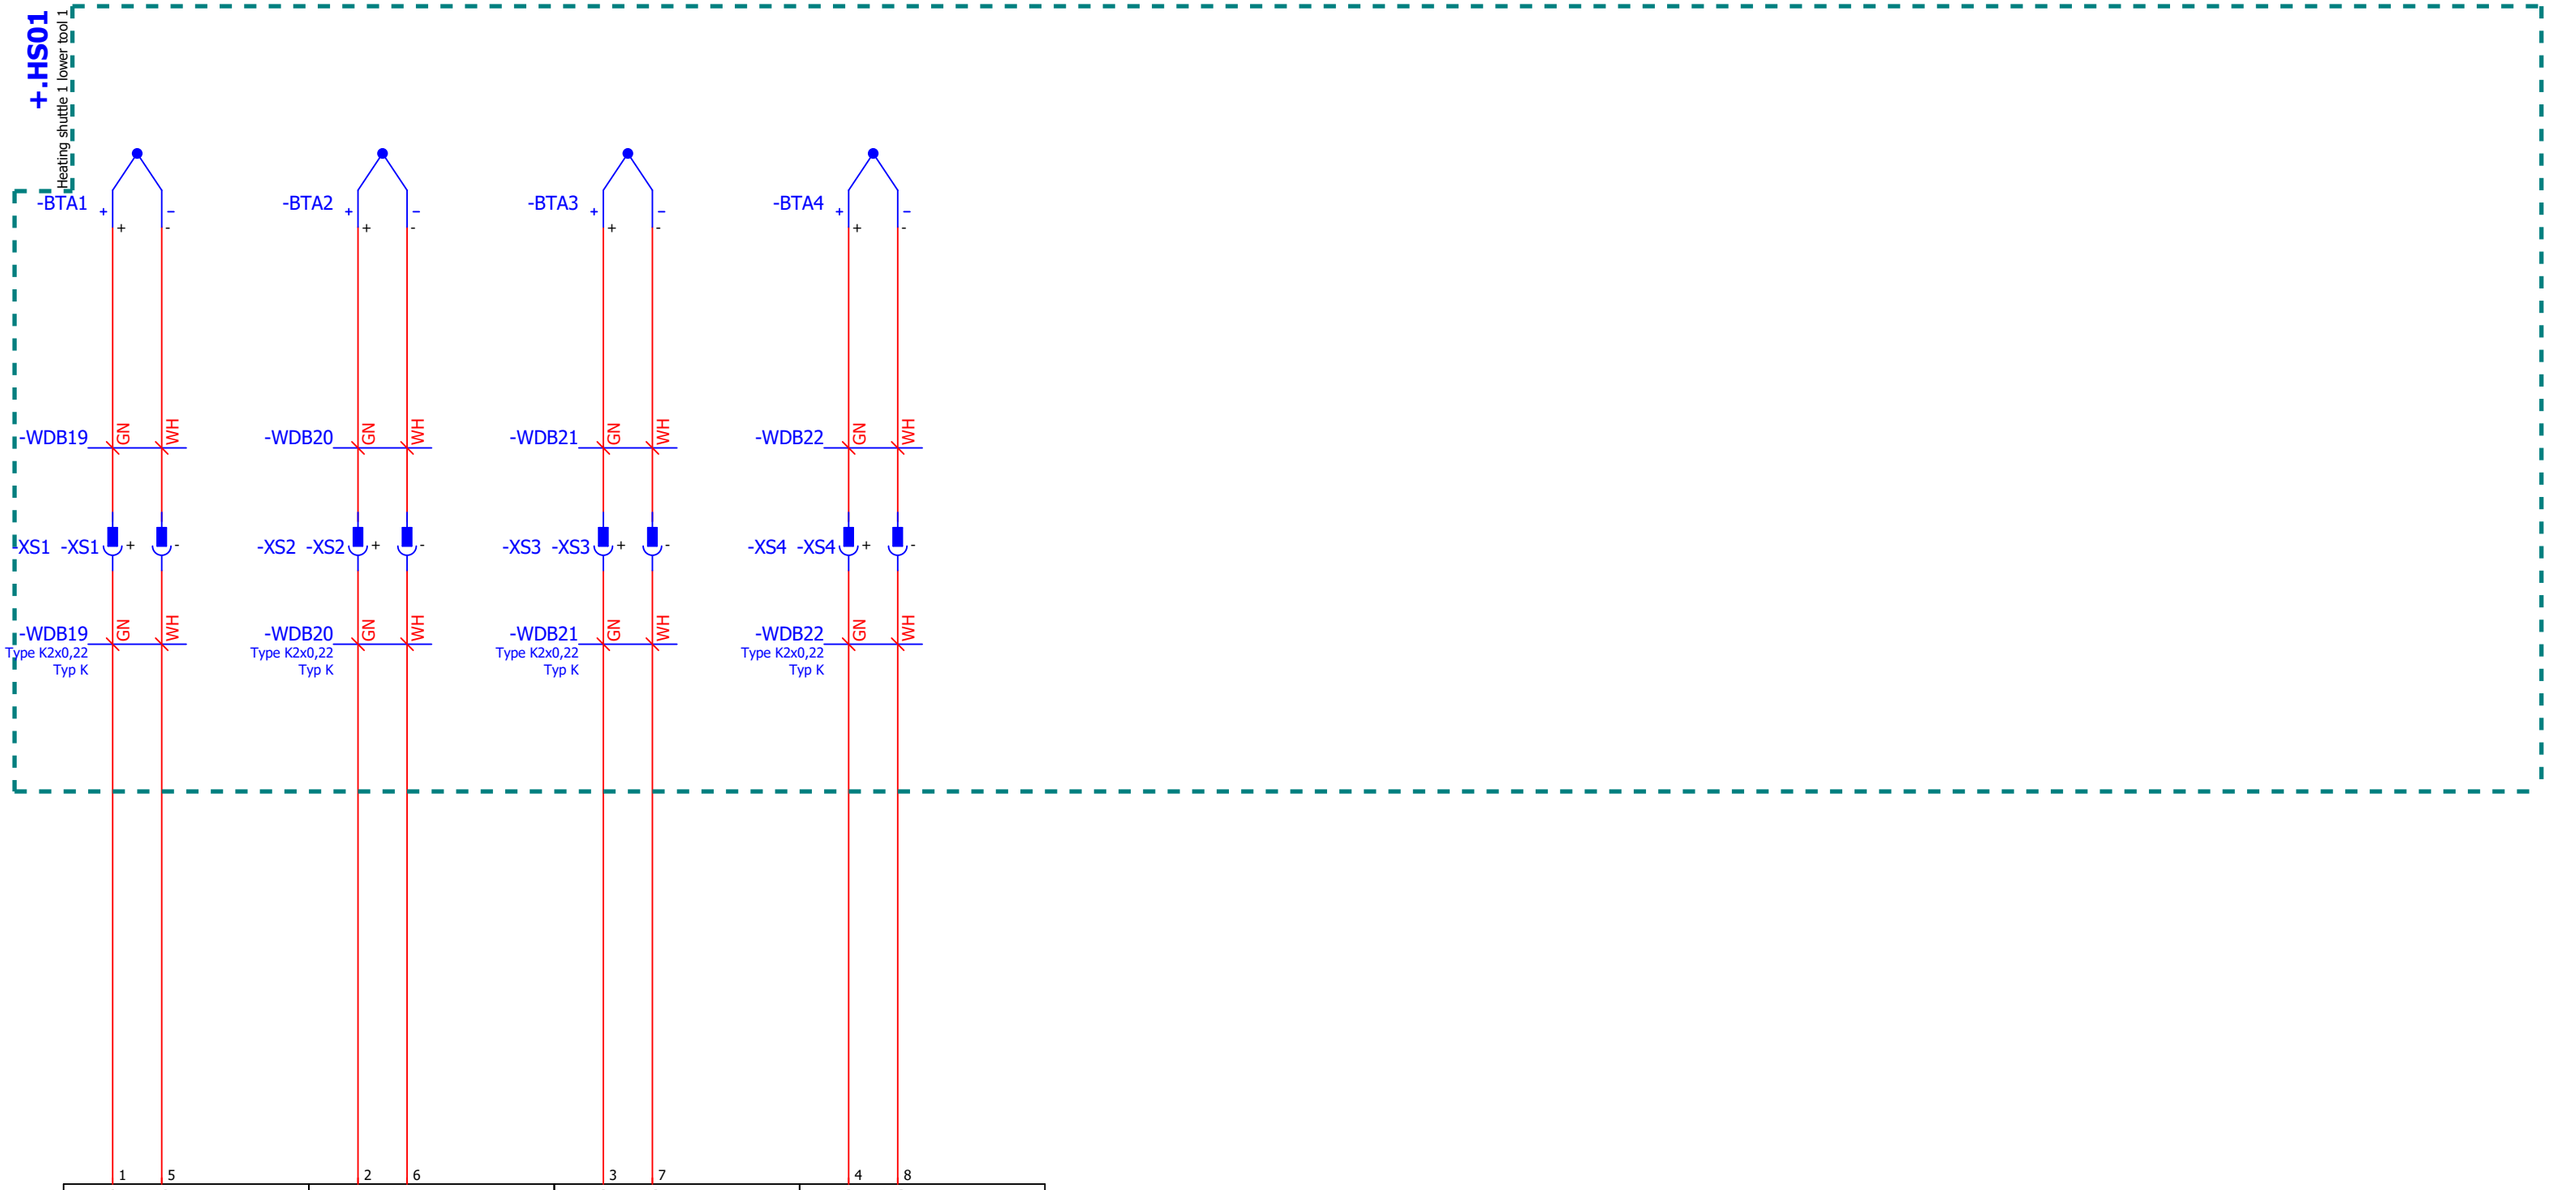

M0+ M0-	M1+ M1-	M2+ M2-	M3+ M3-
-KE9	**-KE9**	**-KE9**	**-KE9**
=PLC+.X01/1.7			
IW12108	IW12110	IW12112	IW12114
-BTA1:+	-BTA2:+	-BTA3:+	-BTA4:+

temperature check IR bulb 1.1.1

temperature check IR bulb 1.1.2

temperature check IR bulb 2.2.1

temperature check IR bulb 2.2.2

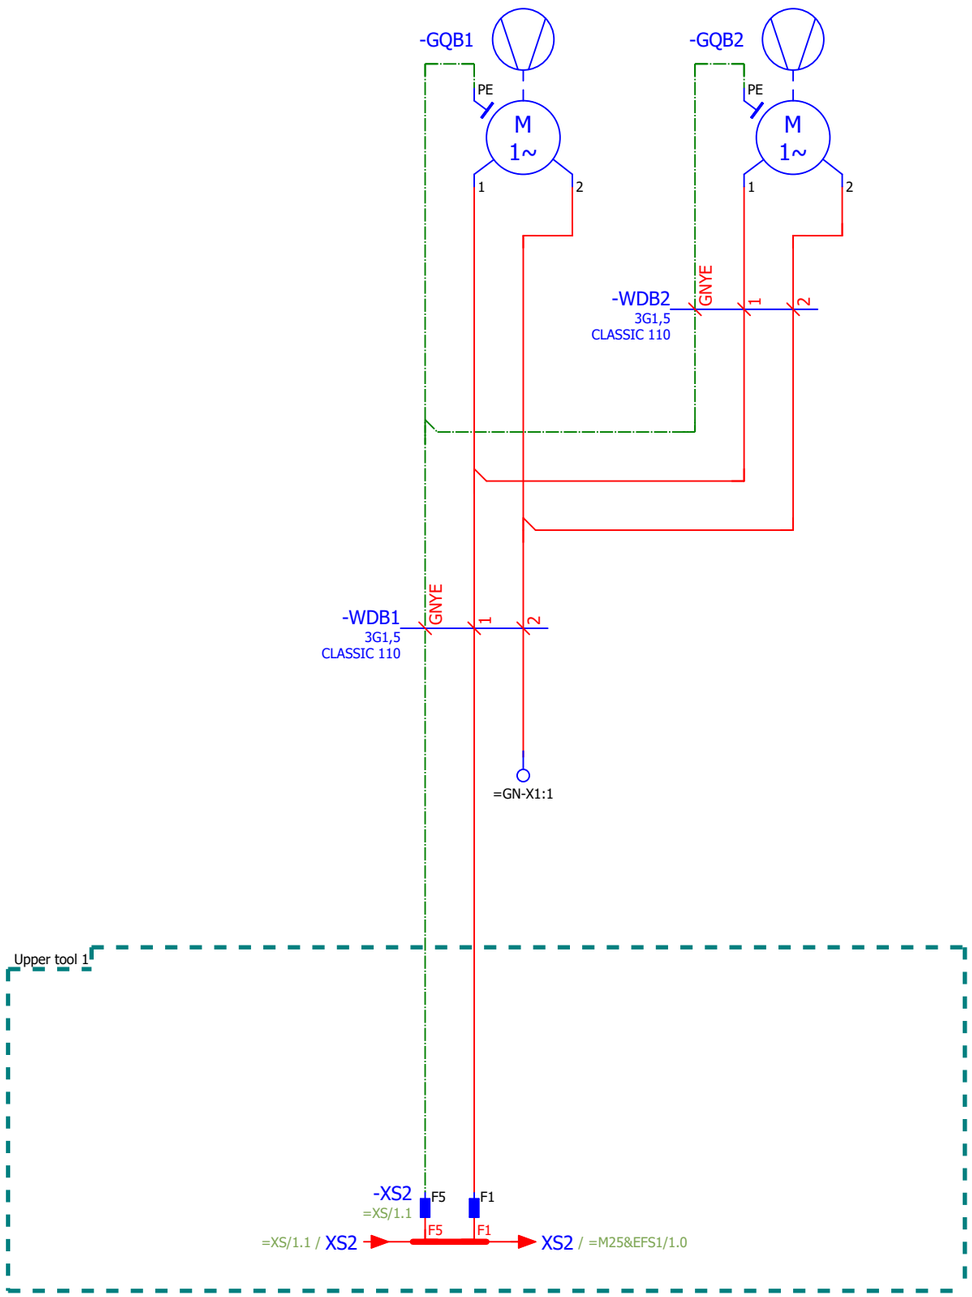
-GQB1
PE
M
1~
1
2
-GQB2
PE
M
1~
1
2
-WDB2
3G1,5
CLASSIC 110
GNYE
1
2
-WDB1
3G1,5
CLASSIC 110
GNYE
1
2
=GN-X1:1
Upper tool 1
-XS2
=XS/1.1
F5
F1
F5
F1
=XS/1.1 / XS2
XS2 / =M25&EFS1/1.0

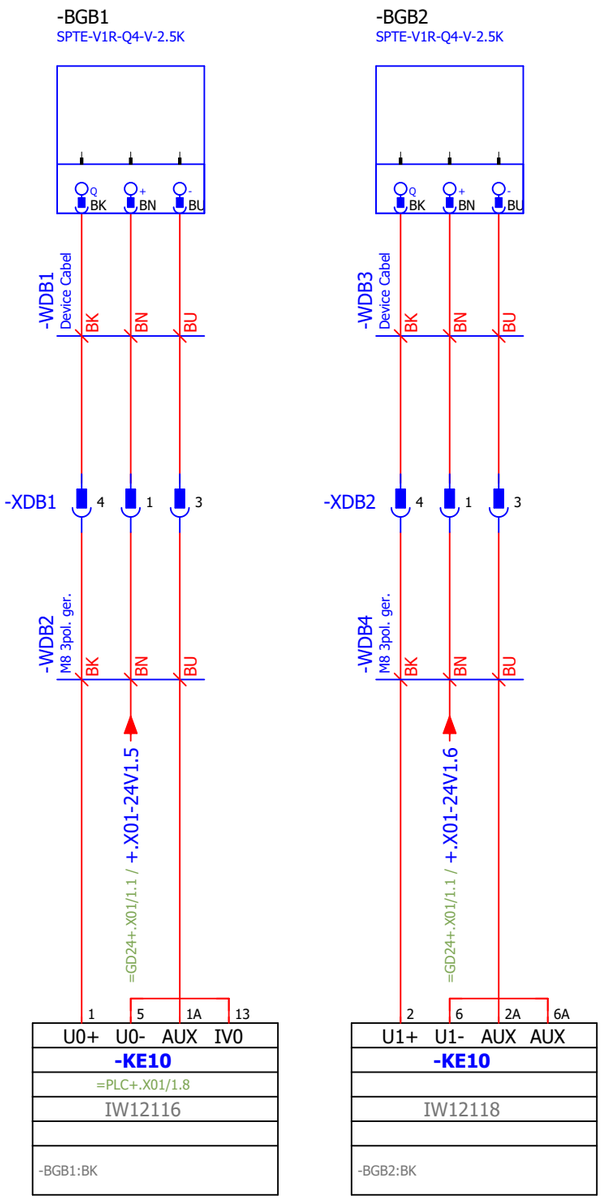

vacuum check 1.5.1

vacuum check 1.5.2

=GK.1+UT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Component recognition	==1005811	=GQ	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Energy vacuum	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 11.11.2024	lower tool 1	Sheet 51 from 164

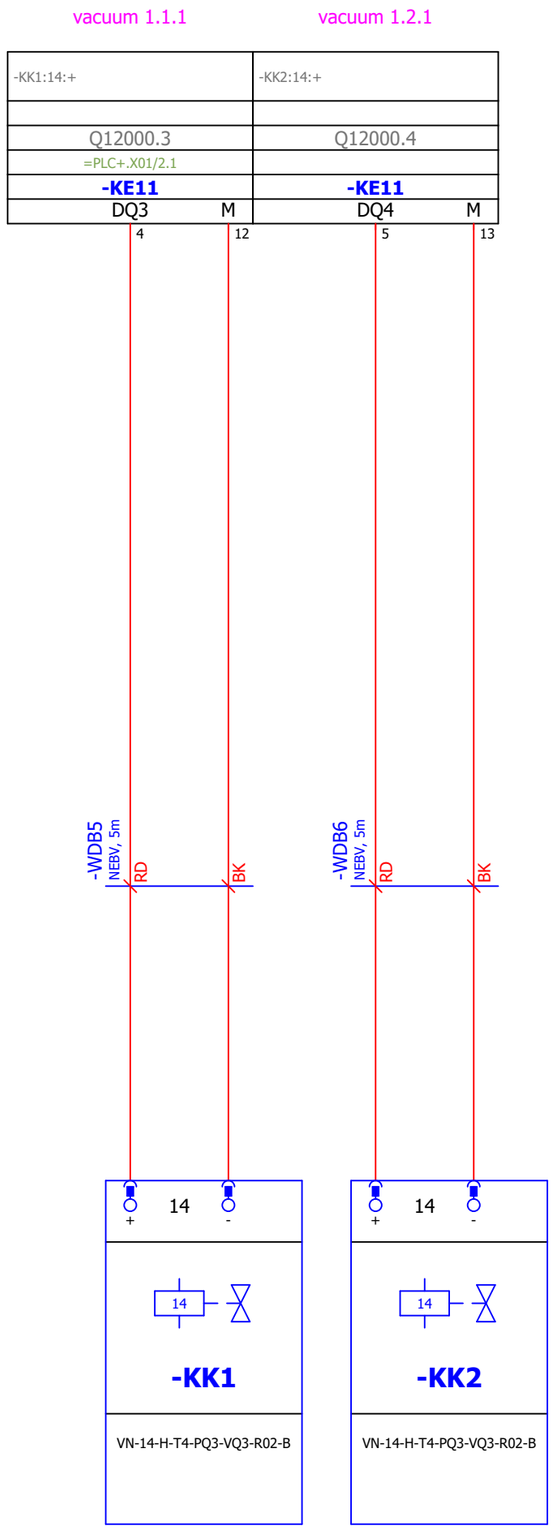

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Valves	==1005811	=GQ	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Energy vacuum	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	lower tool 1	Sheet 52 from 164

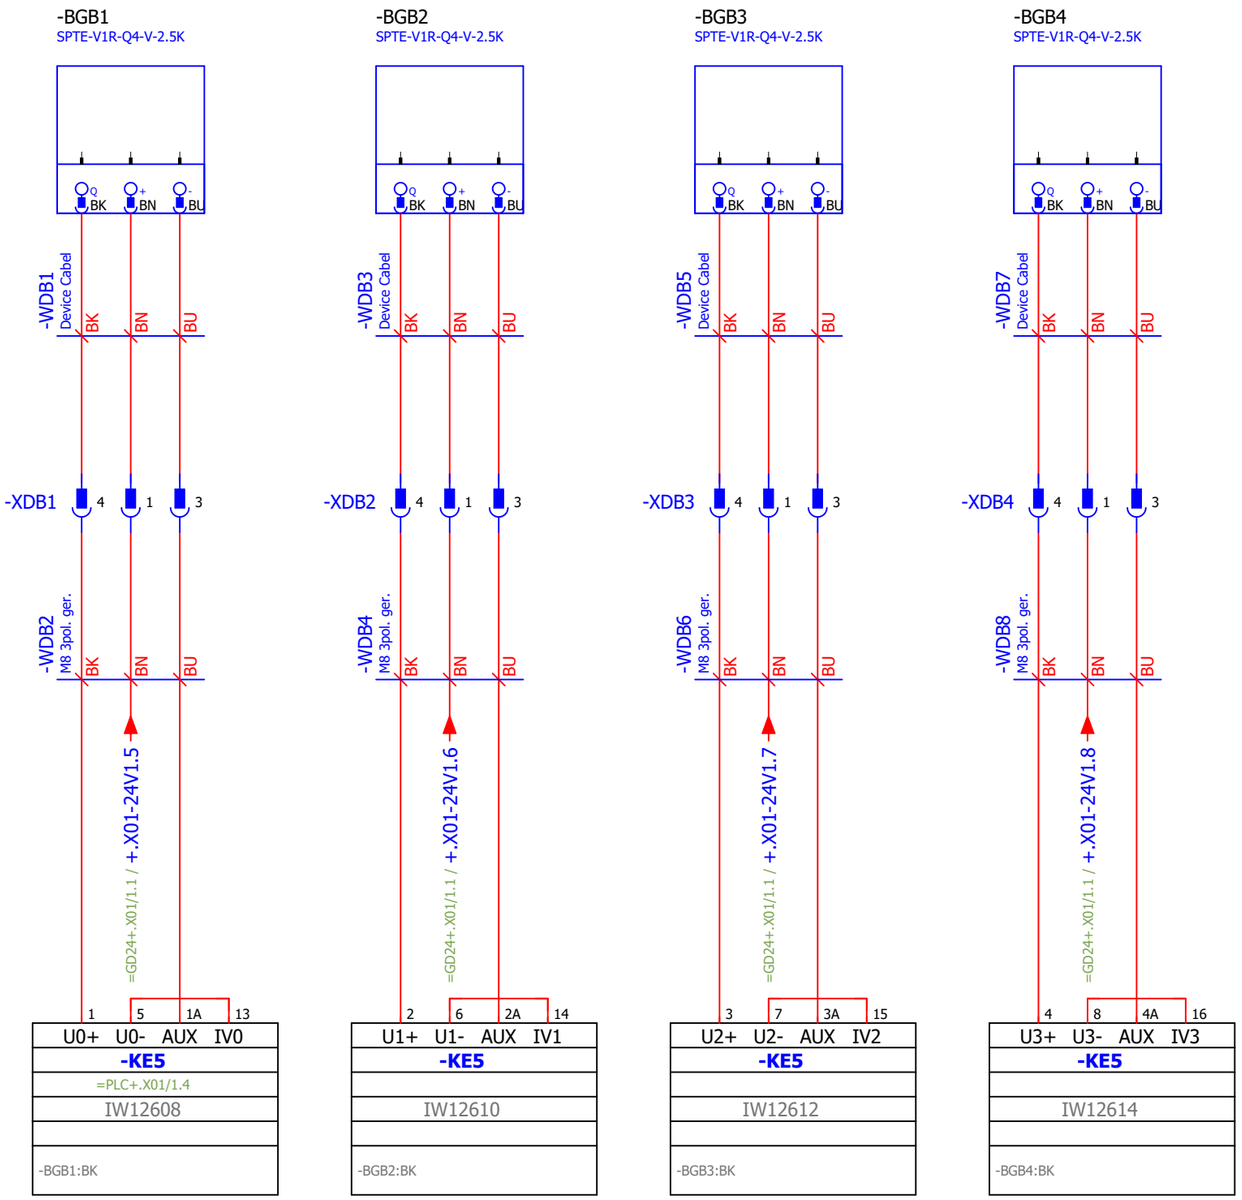

vacuum check 1.9.1 vacuum check 1.10.1 vacuum check 2.6.1 vacuum check 2.6.2

+LT01/2

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Component recognition	==1005811	=GQ	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Energy vacuum	Wiring diagram
				Drawing number 1005811	Version				+UT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 11.11.2024	Upper tool 1	Sheet 53 from 164

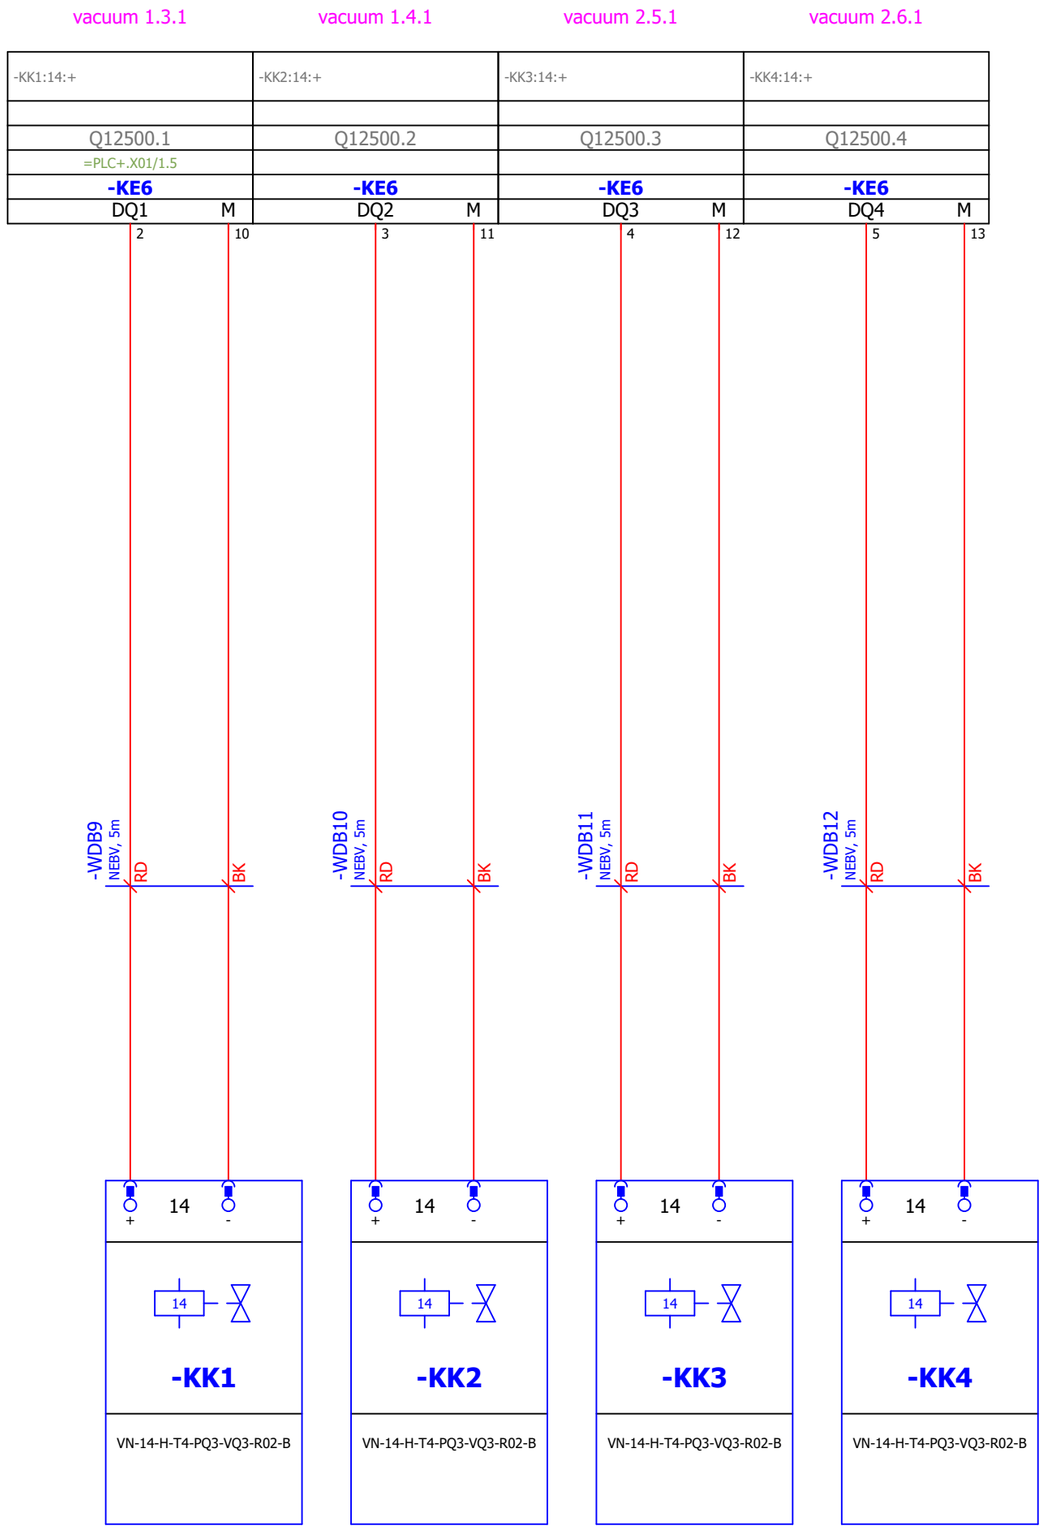

=XF01+LT01&EFS1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Valves	==1005811	=GQ	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Energy vacuum	Wiring diagram
					Drawing number 1005811	Version				+UT01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker / Date 27.11.2024		Upper tool 1	Sheet 54 from 164

+.HS01
Heating shuttle 1 lower tool 1

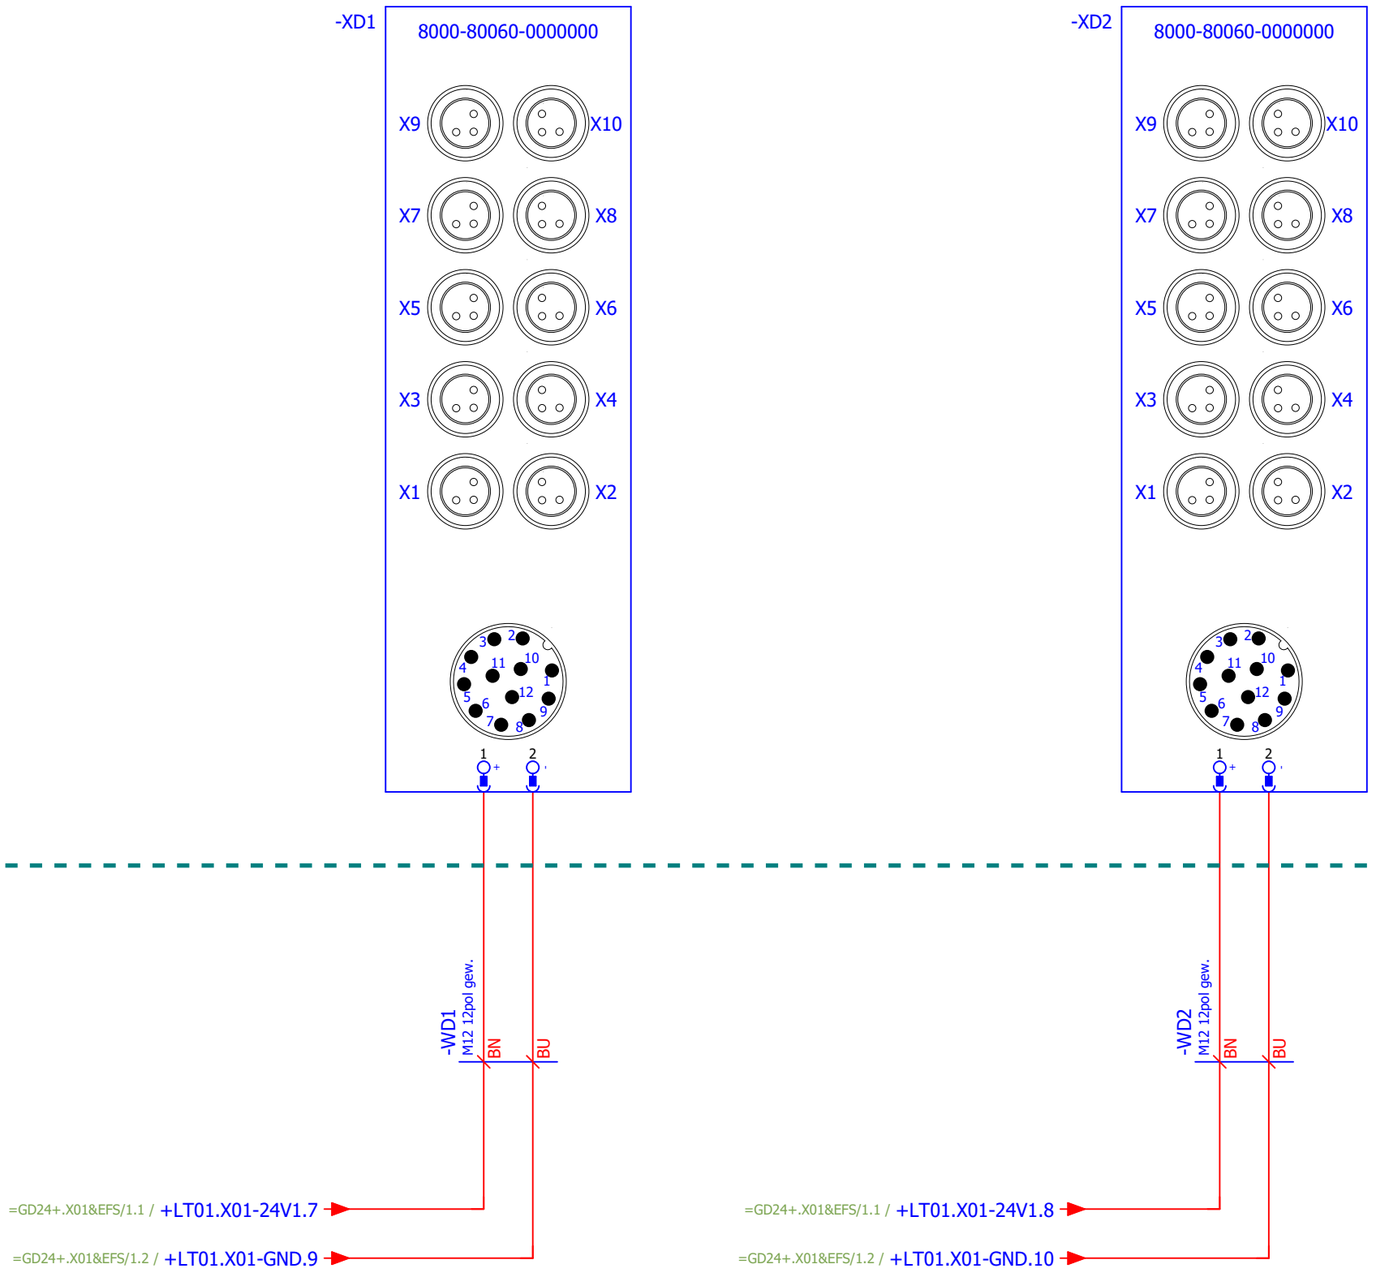

=GQ+UT01&EFS/2

=BA05&EFS/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Field distributor	==1005811	=XF01	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Field distributor	Electrical engineering schematic
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 55 from 164

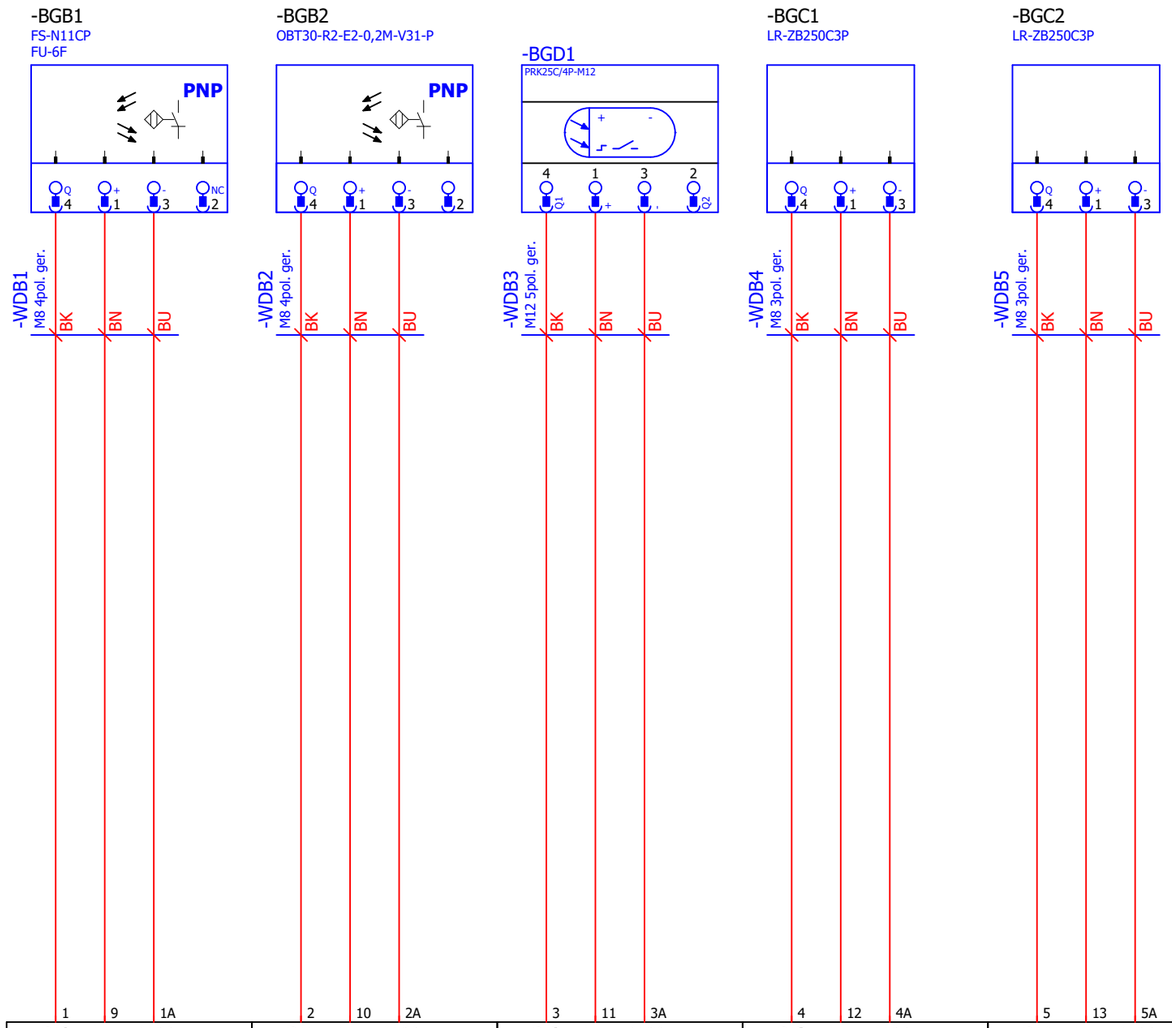

DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE1	**-KE1**	**-KE1**	**-KE1**	**-KE1**	**-KE1**	**-KE1**	**-KE1**
=PLC+.X01/1.2							
I12000.0	I12000.1	I12000.2	I12000.3	I12000.4	I12000.5	I12000.6	I12000.7
-BGB1:4	-BGB2:4	-BGD1:4	-BGC1:4	-BGC2:4	I12000.5	I12000.6	I12000.7

part detection 1.1.1 part detection 1 1.3.1 part detection 2 1.5.1 part detection 3 1.7.1 part detection 3 1.7.2

=XF01&EFS1/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries	==1005811	=BA05	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Component-recognition	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	lower tool 1	Sheet 56 from 164

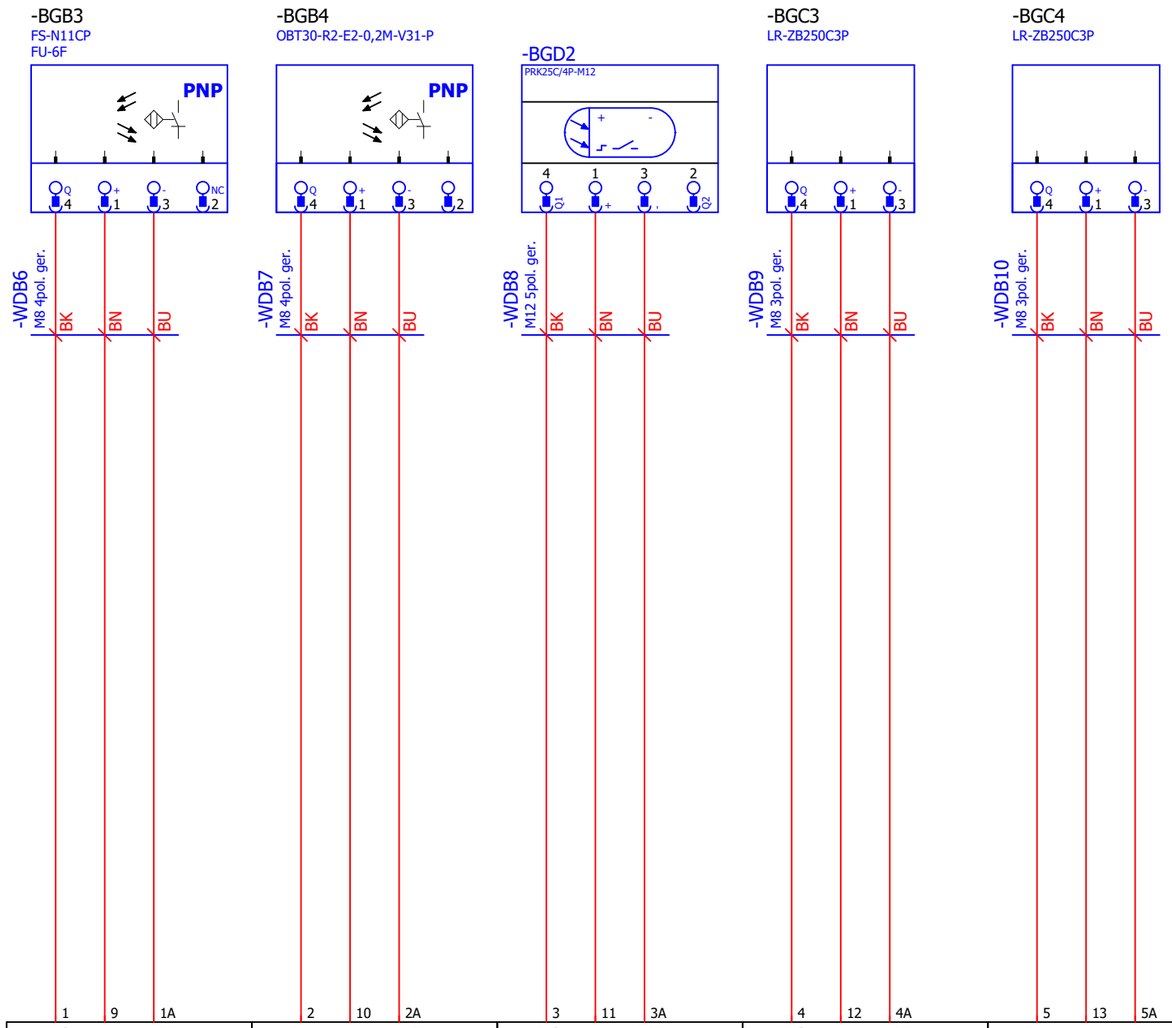

DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE2	**-KE2**	**-KE2**	**-KE2**	**-KE2**	**-KE2**	**-KE2**	**-KE2**
=PLC+.X01/1.2							
I12001.0	I12001.1	I12001.2	I12001.3	I12001.4	I12001.5	I12001.6	I12001.7
-BGB3:4	-BGB4:4	-BGD2:4	-BGC3:4	-BGC4:4	I12001.5	I12001.6	I12001.7

part detection 1.3.1 part detection 1 2.4.1 part detection 2 2.6.1 part detection 3 2.8.1 part detection 3 2.8.2

1

+UT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries	==1005811	=BA05	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Component-recognition	Wiring diagram
					Drawing number 1005811	Version				+LT01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	lower tool 1	Sheet 57 from 164

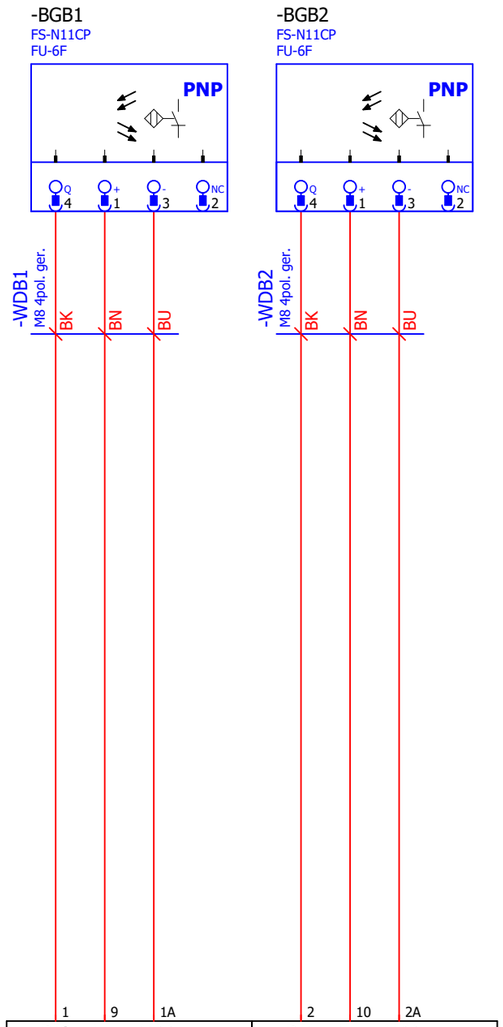

DI0 L+ AUX	DI1 L+ AUX
-KE1	**-KE1**
=PLC+.X01/1.2	
I12500.0	I12500.1
-BGB1:4	-BGB2:4

part detection 1.3.1 part detection 2.4.1

+LT01/2

=M25+LT01&EFS1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries		==1005811	=BA05	&EFS
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Component-recognition	Wiring diagram
					Drawing number 1005811	Version					+UT01	Page 1
Modification	Date	Name	Creator	AK Andreas Krischker	Approved by			last Editor	AK Andreas Krischker	Date 25.09.2024	Upper tool 1	Sheet 58 from 164

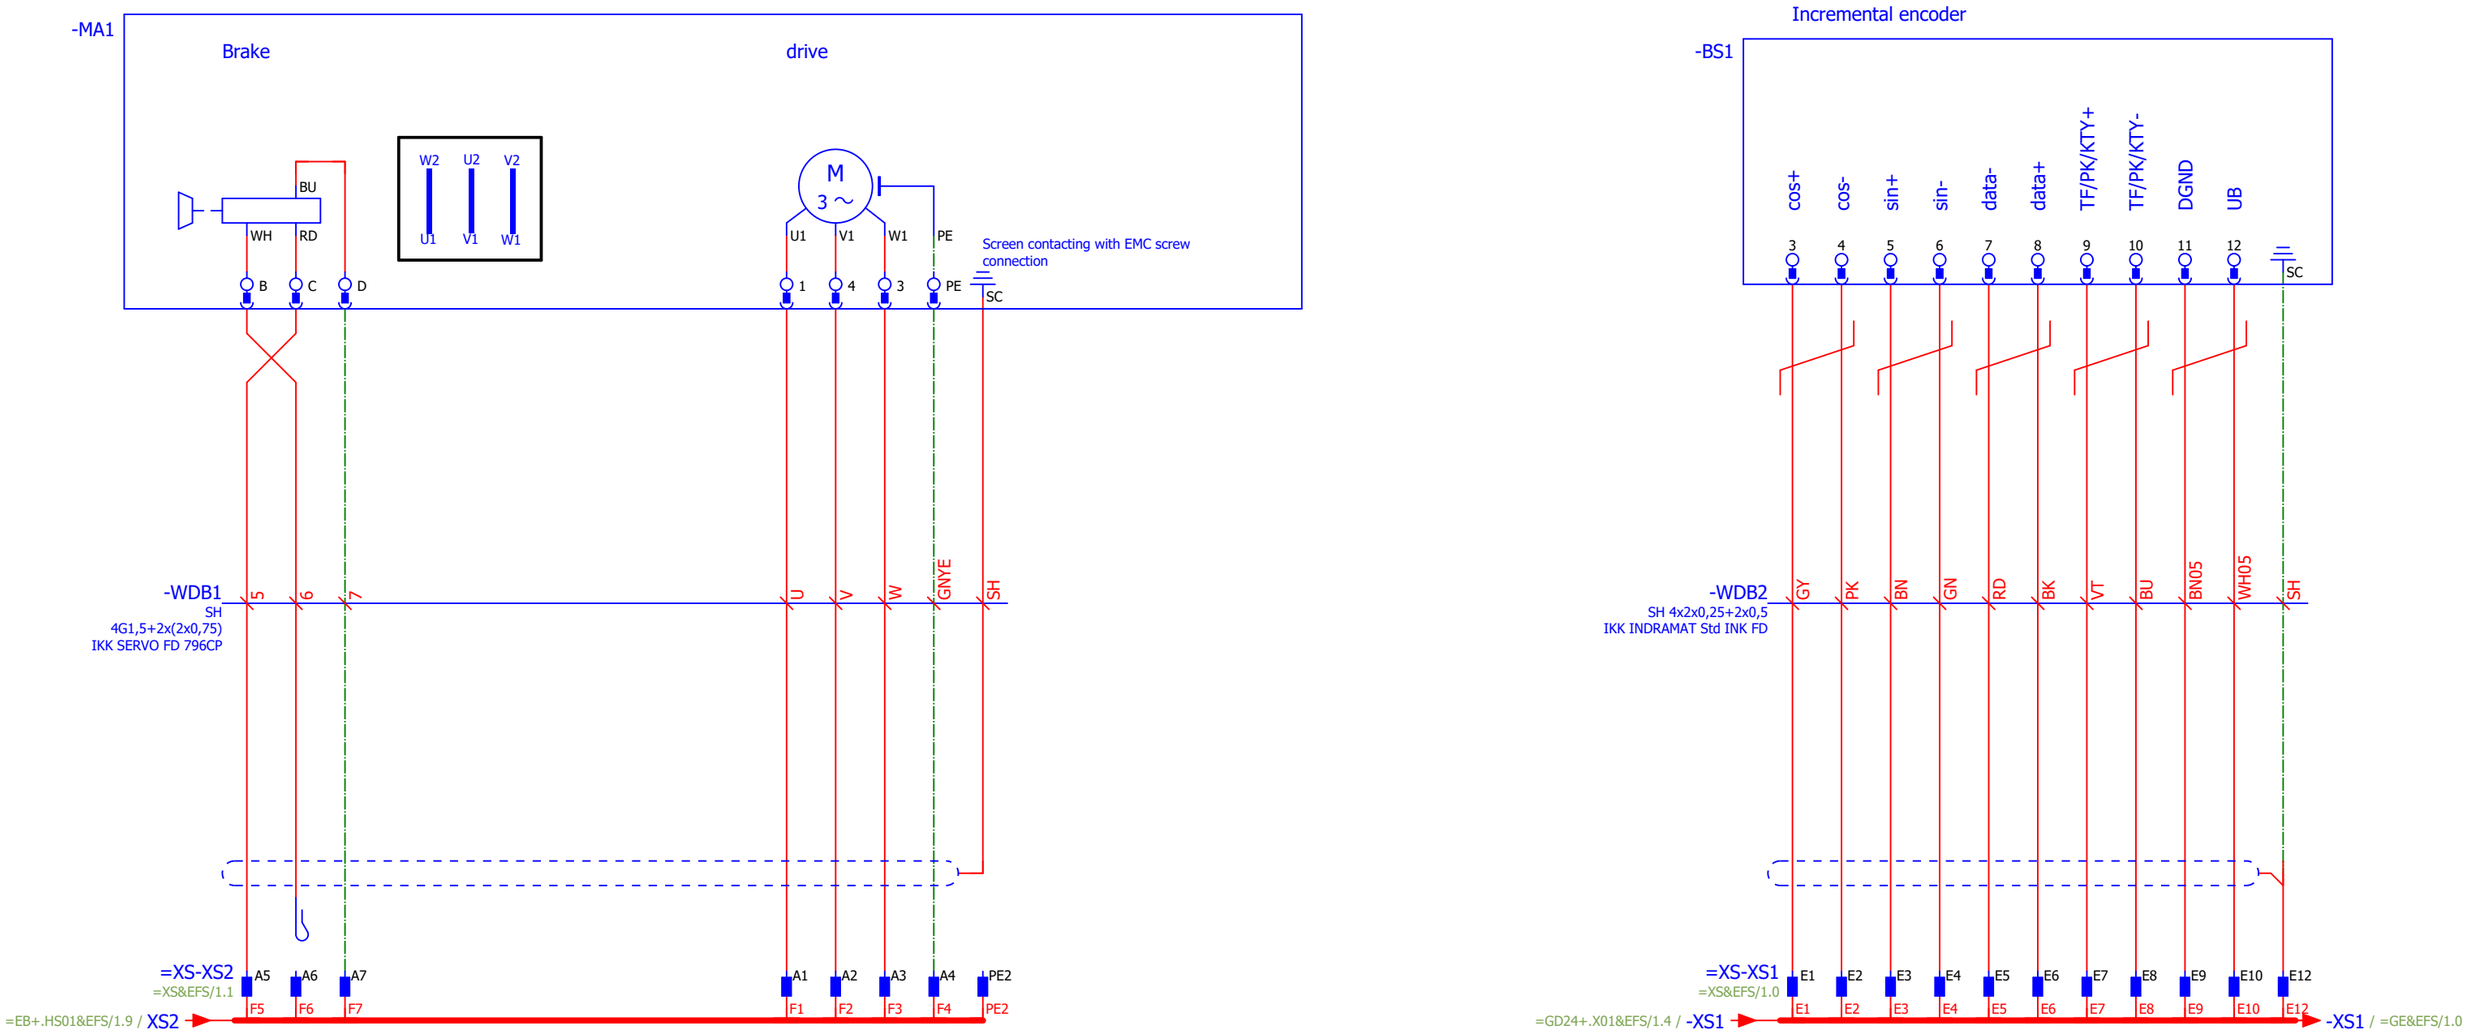

motor heating shuttle
1.1.1

=BA05+UT01&EFS/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Drive	==1005811	=M25	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1		Drawing number 1005811	Version				Drive heating shuttle	Electrical engineering schematic
										+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor KP Kevin Poveleit	Date 11.11.2024	lower tool 1	Sheet 59 from 164

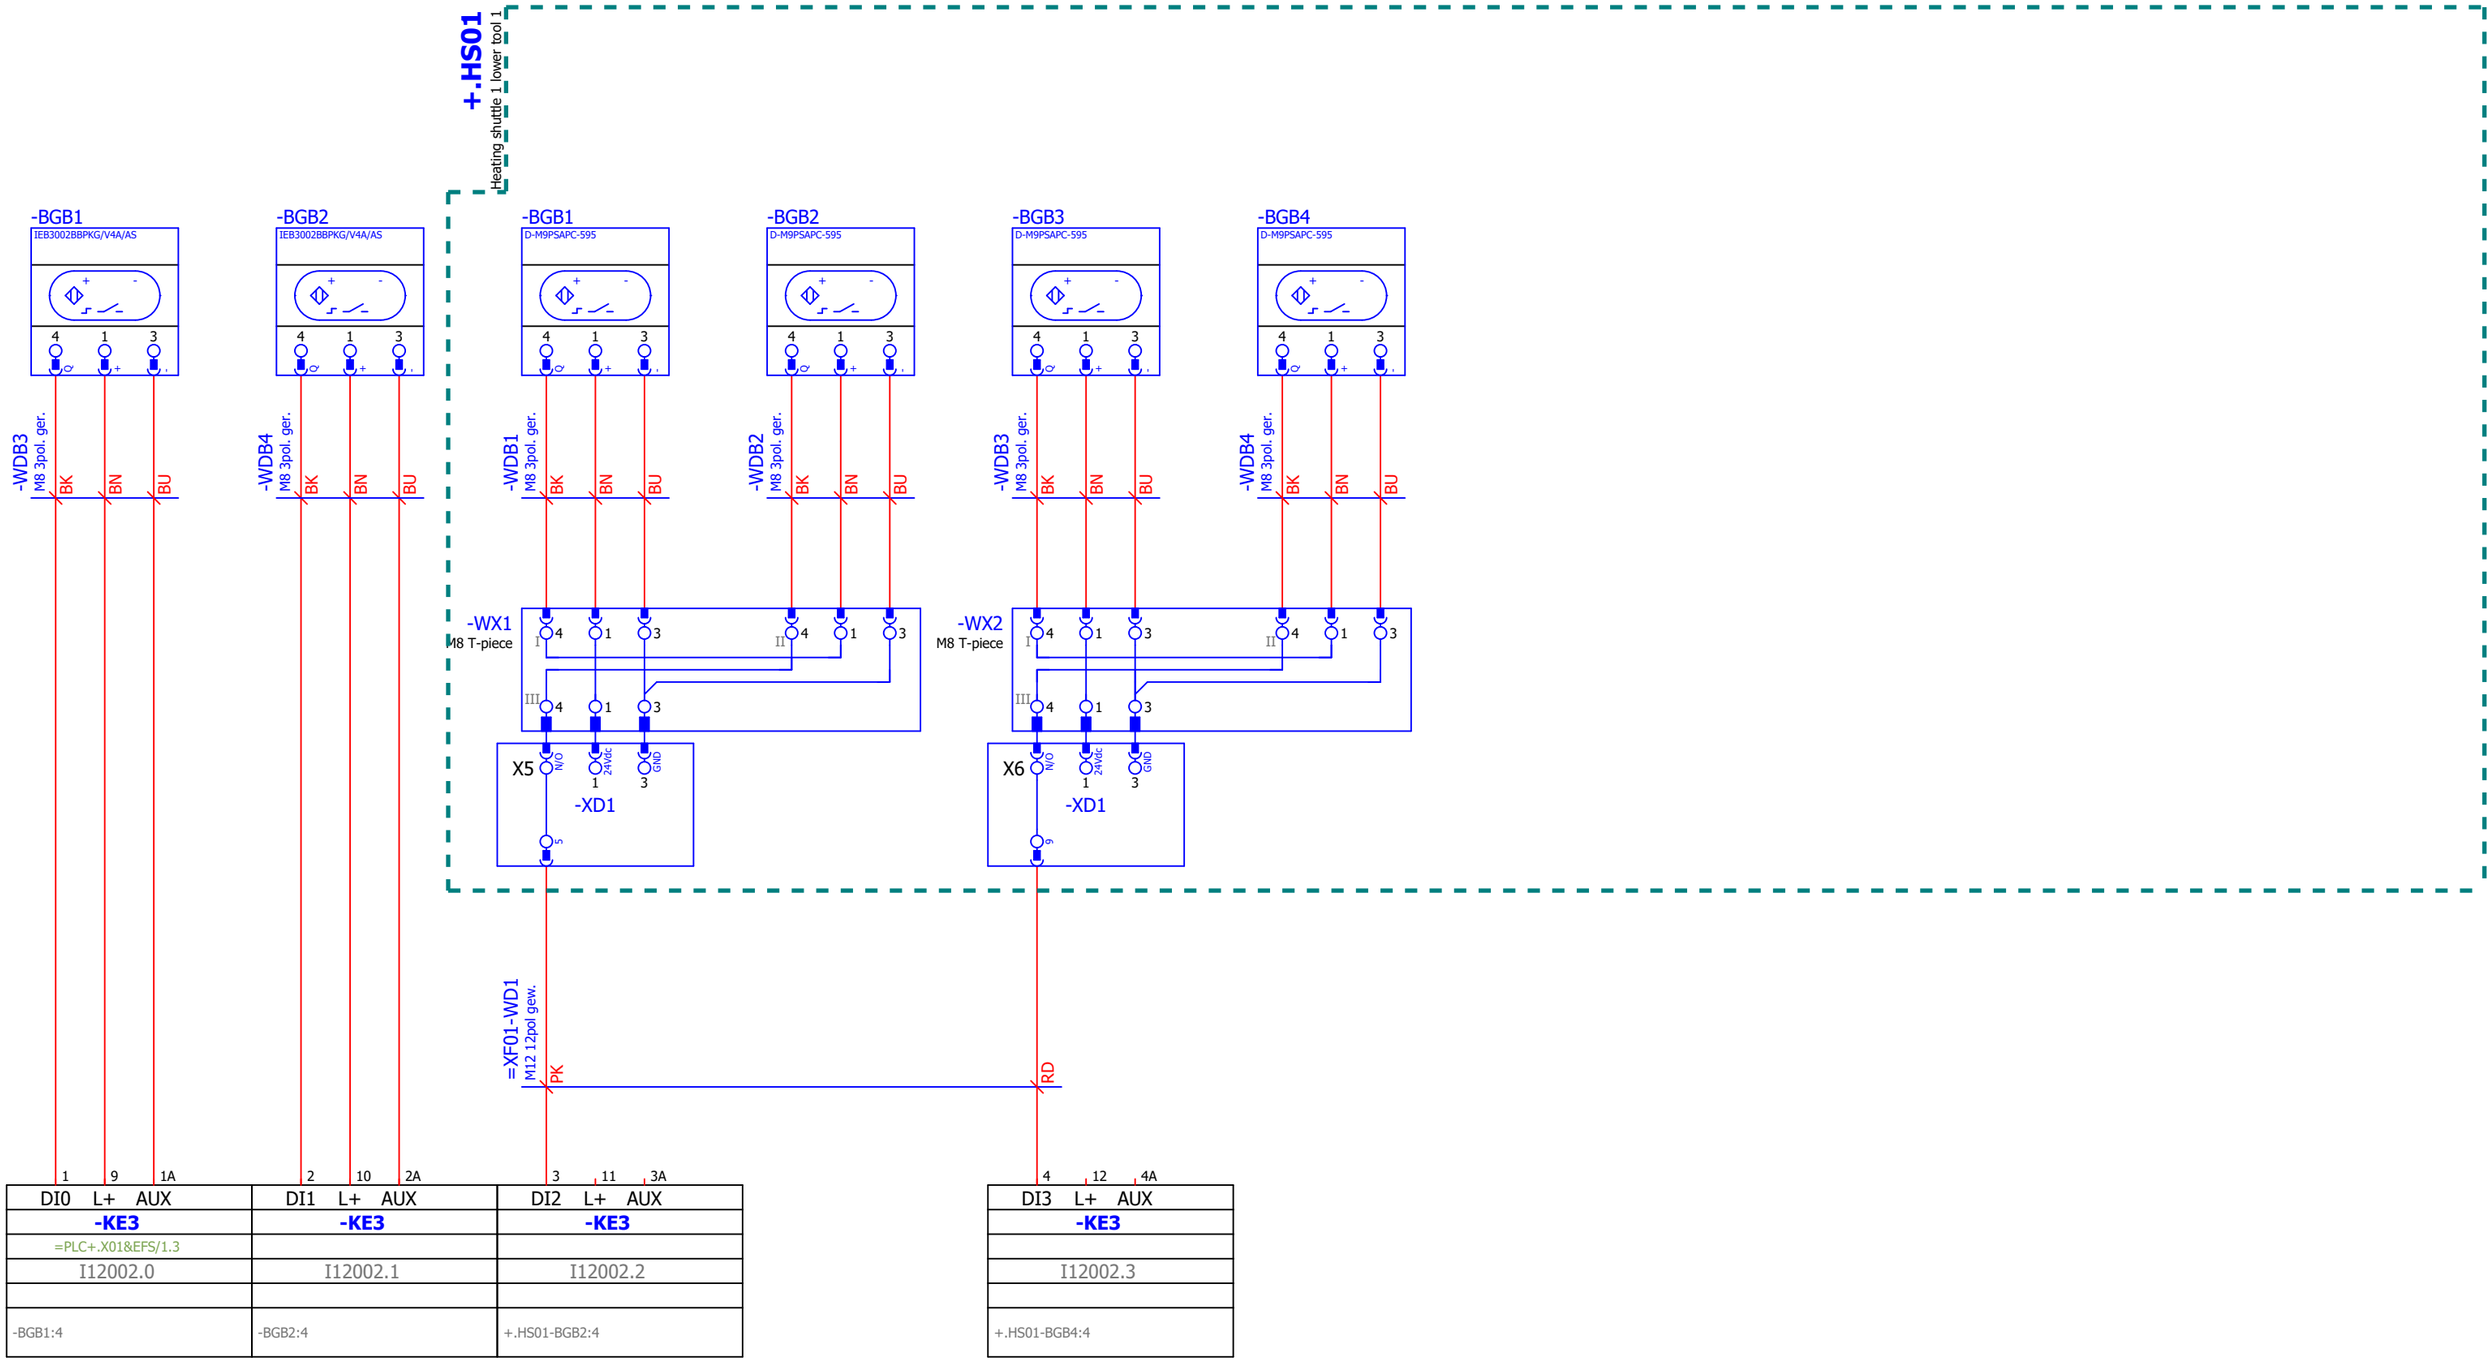

position heating shuttle 1.13.1

position heating shuttle 1.13.2

locking 1.3.1.1 WP

locking 1.3.3.1 WP

locking 1.3.2.1 HP

locking 1.3.4.1 HP

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries	==1005811	=M25	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Drive heating shuttle	Electrical engineering schematic
					Drawing number 1005811	Version				+LT01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 30.10.2024	lower tool 1	Sheet 60 from 164

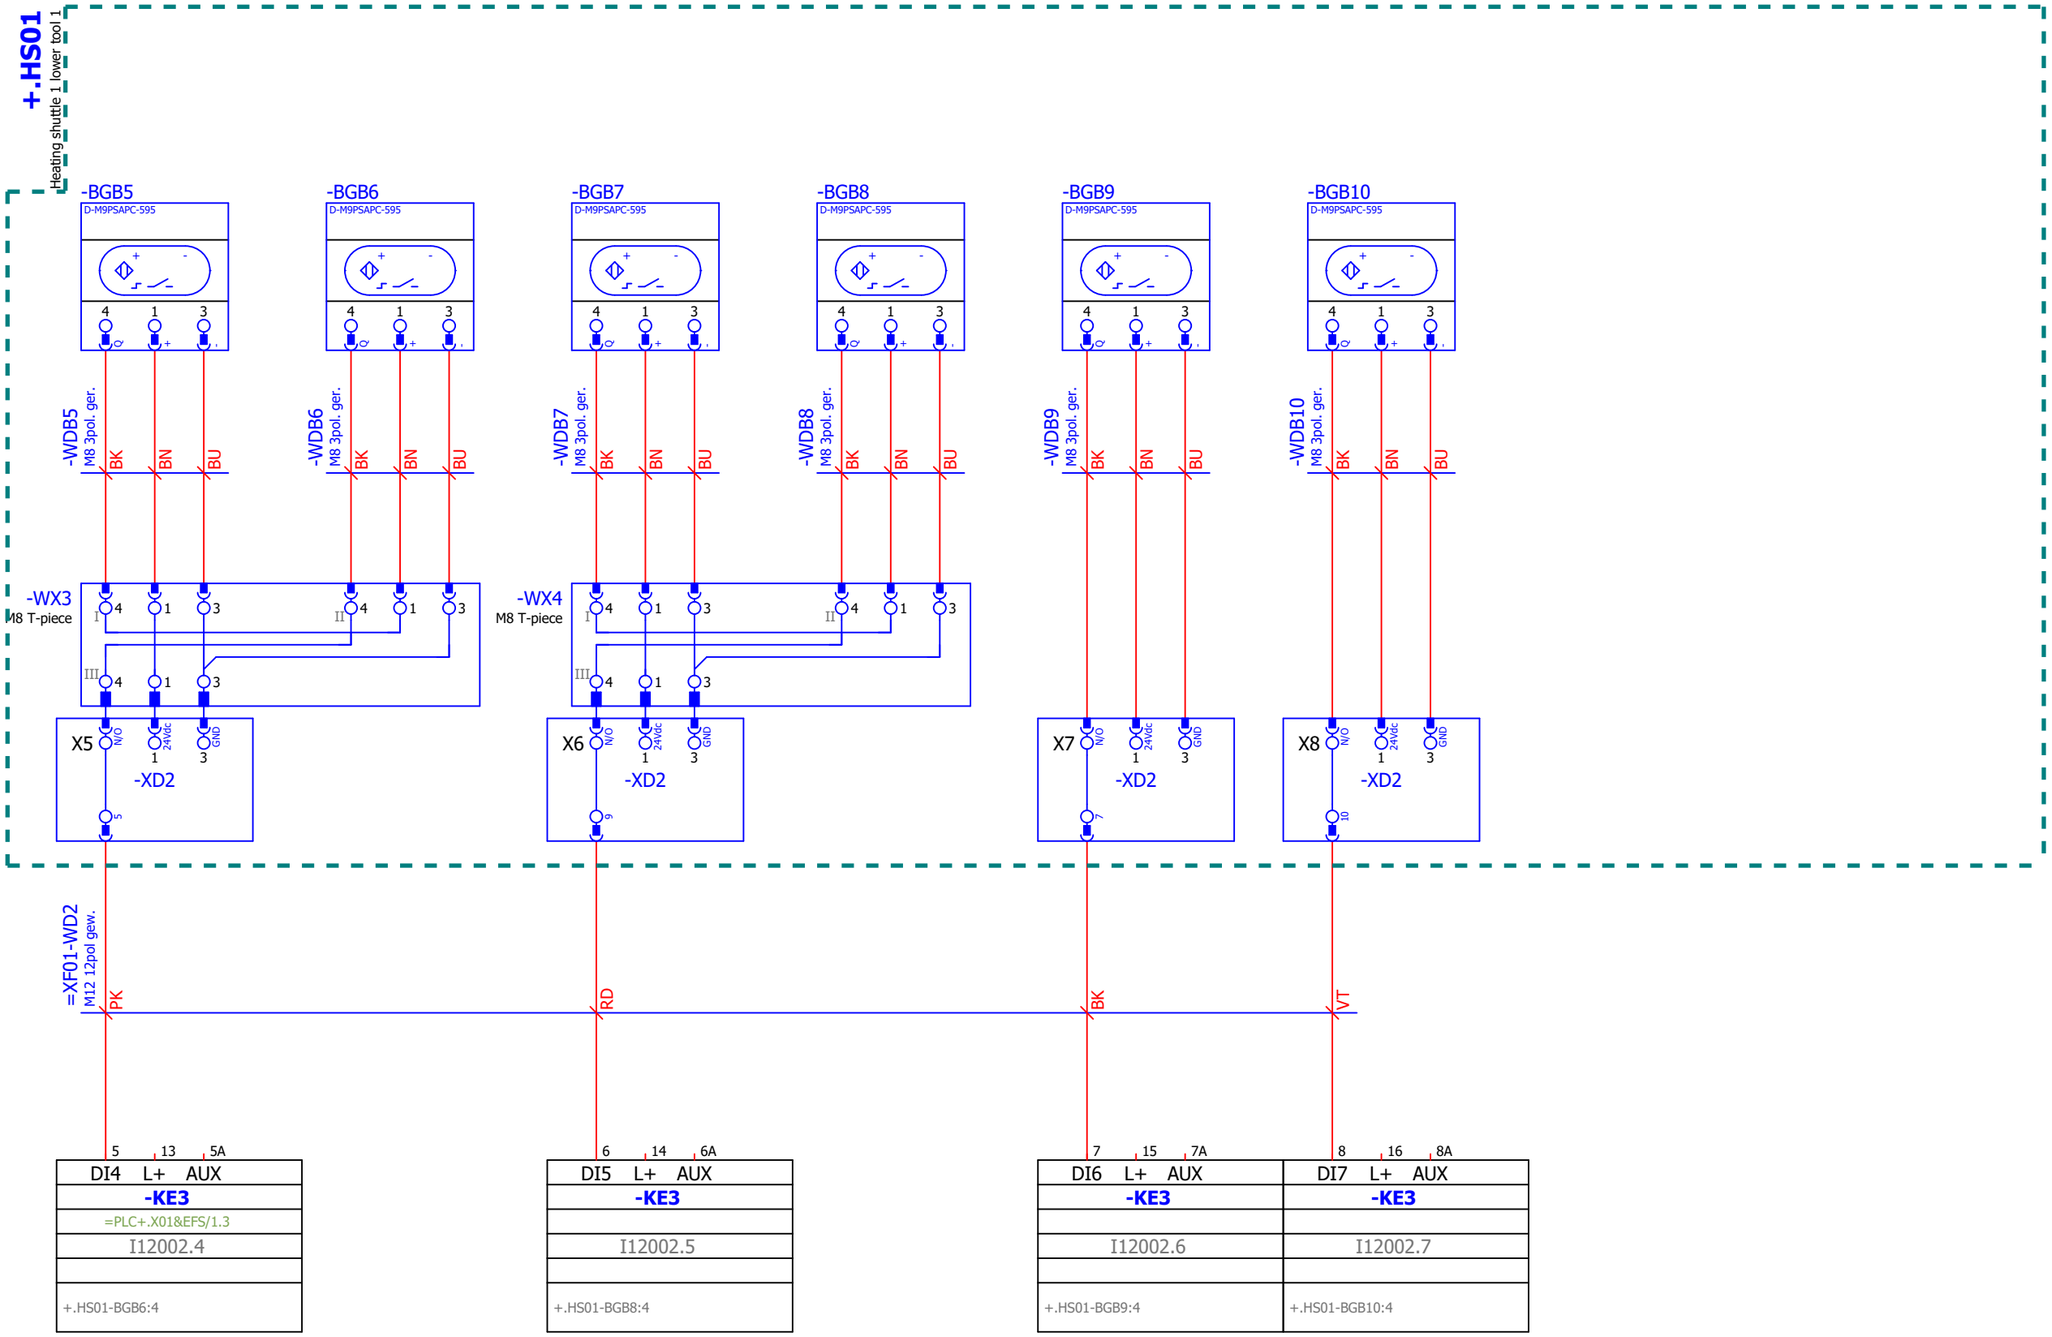

locking 1.3.5.1 WP locking 1.3.7.1 WP locking 1.3.6.1 HP locking 1.3.8.1 HP indexing 1.4.1.1 WP indexing 1.4.1.1 HP

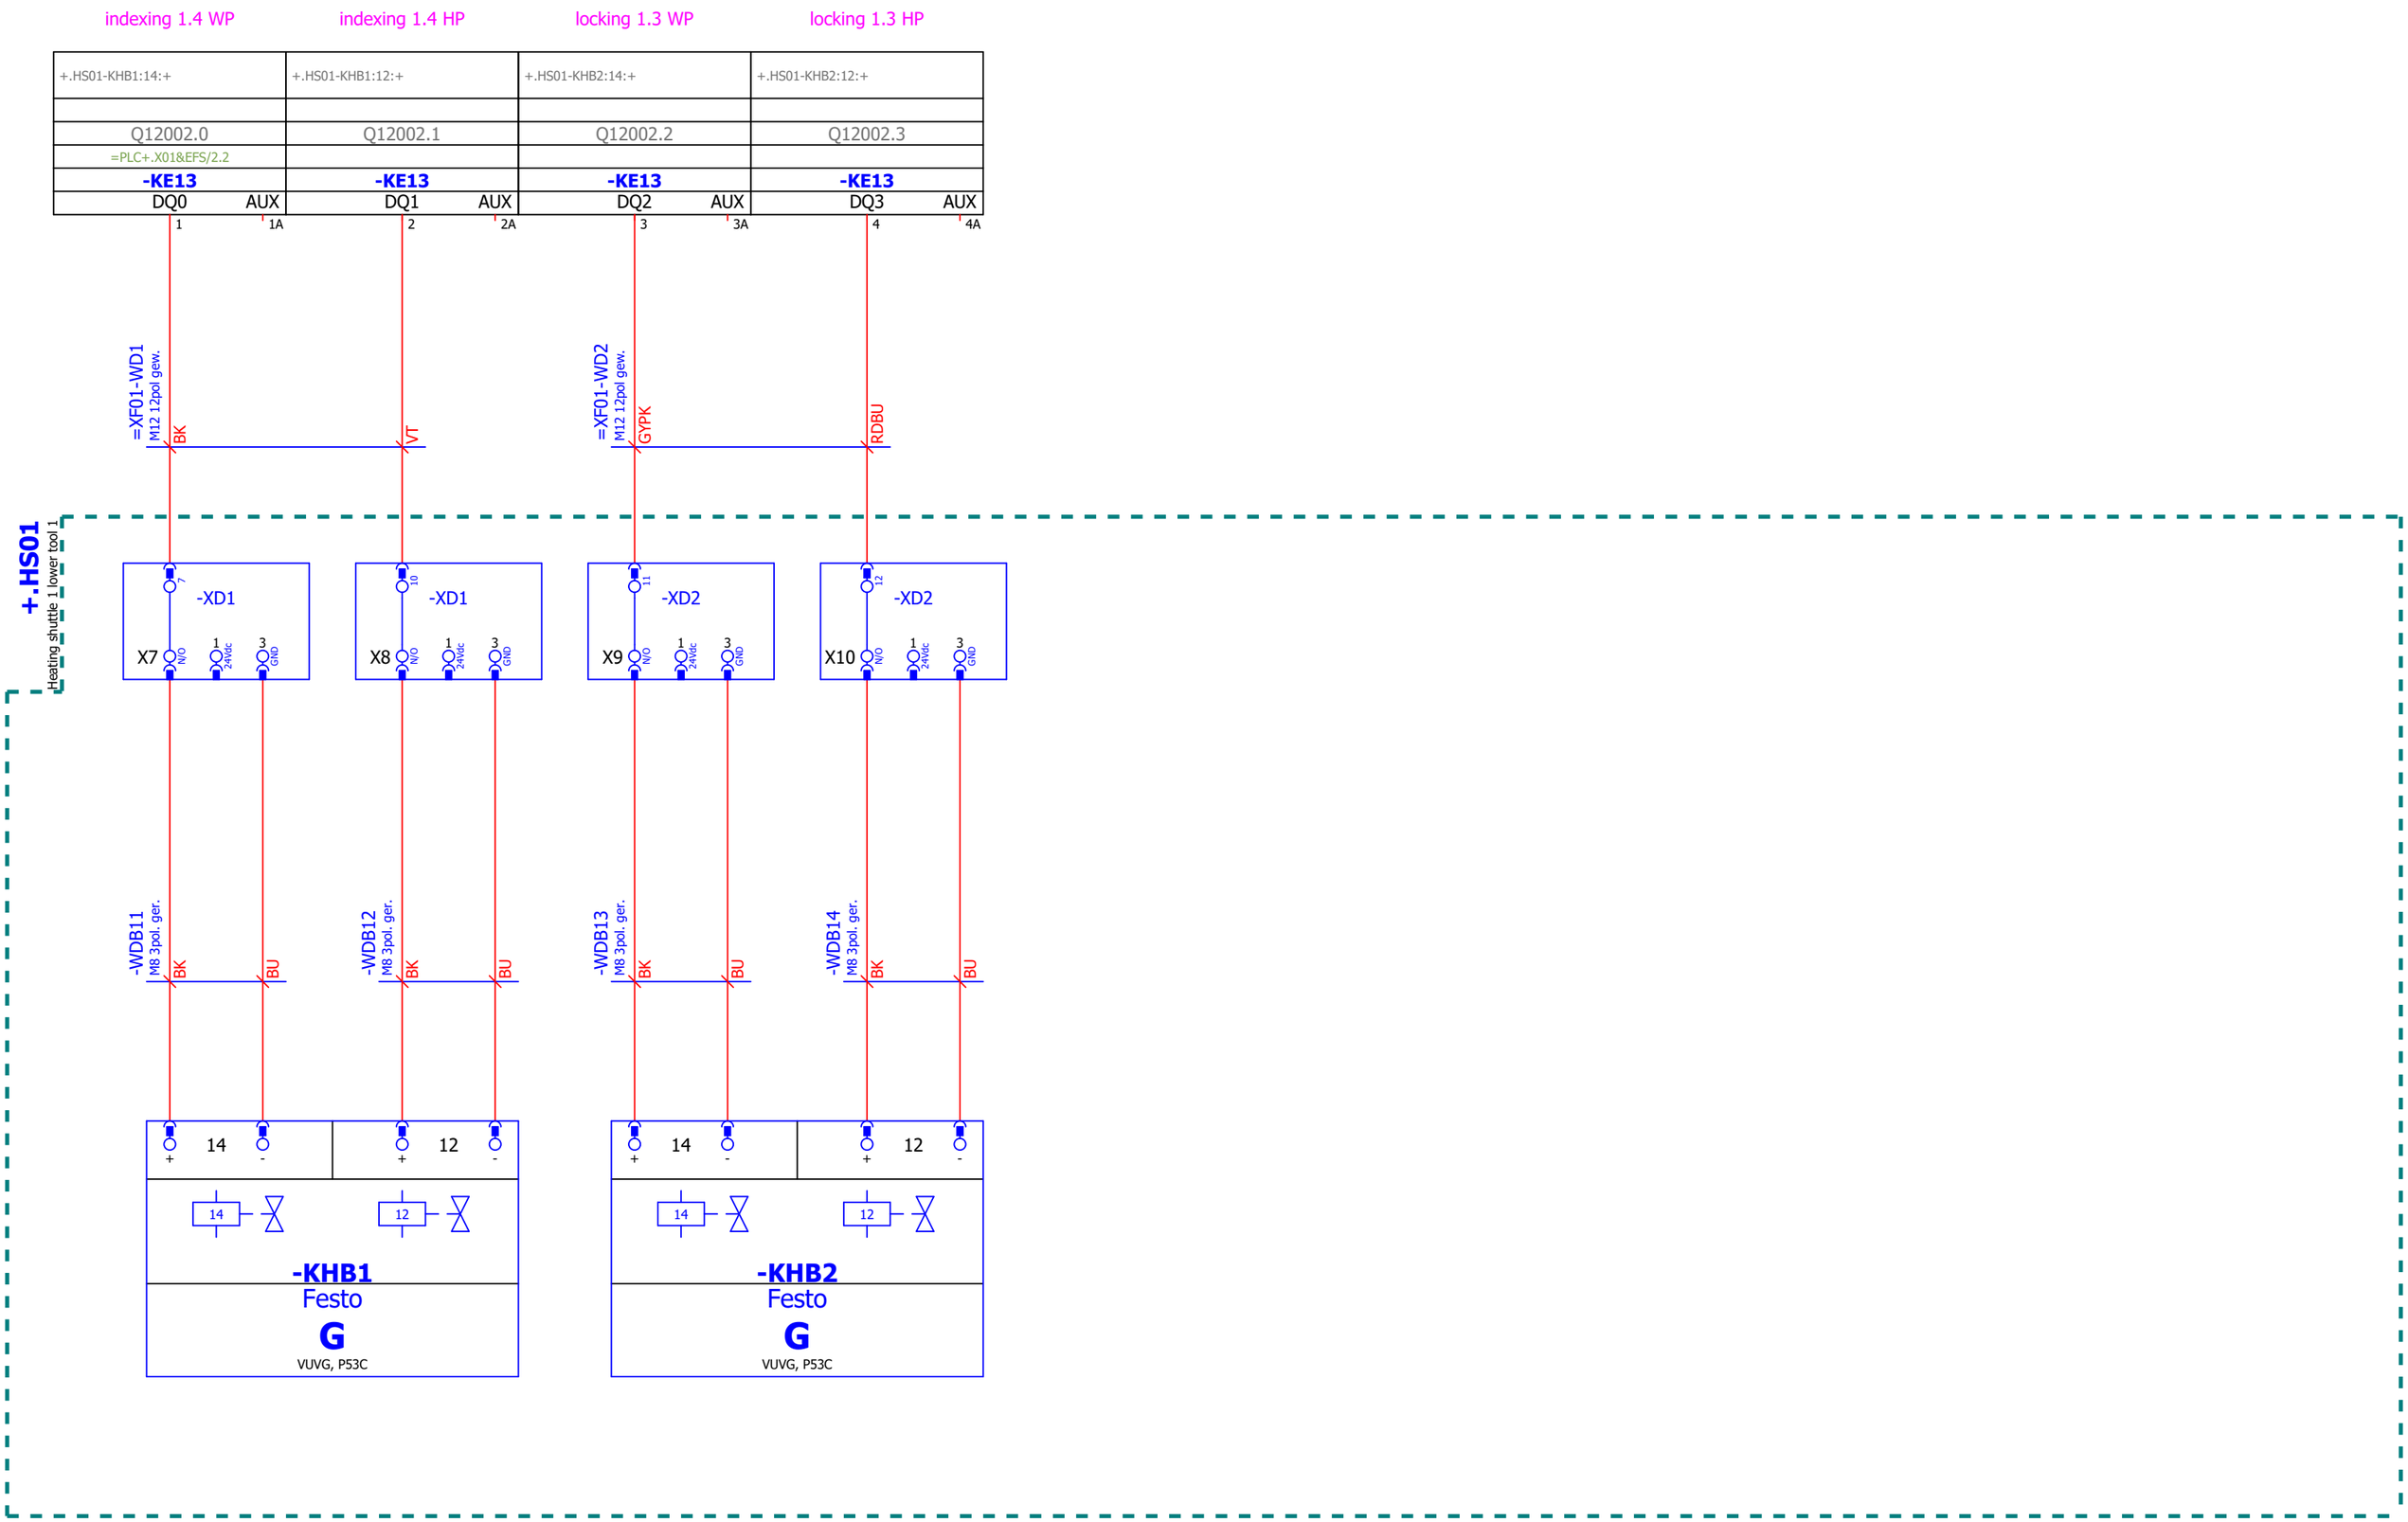

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	single valves	==1005811	=M25	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Drive heating shuttle	Electrical engineering schematic
					Drawing number 1005811	Version				+LT01	Page 4
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 11.11.2024	lower tool 1	Sheet 62 from 164

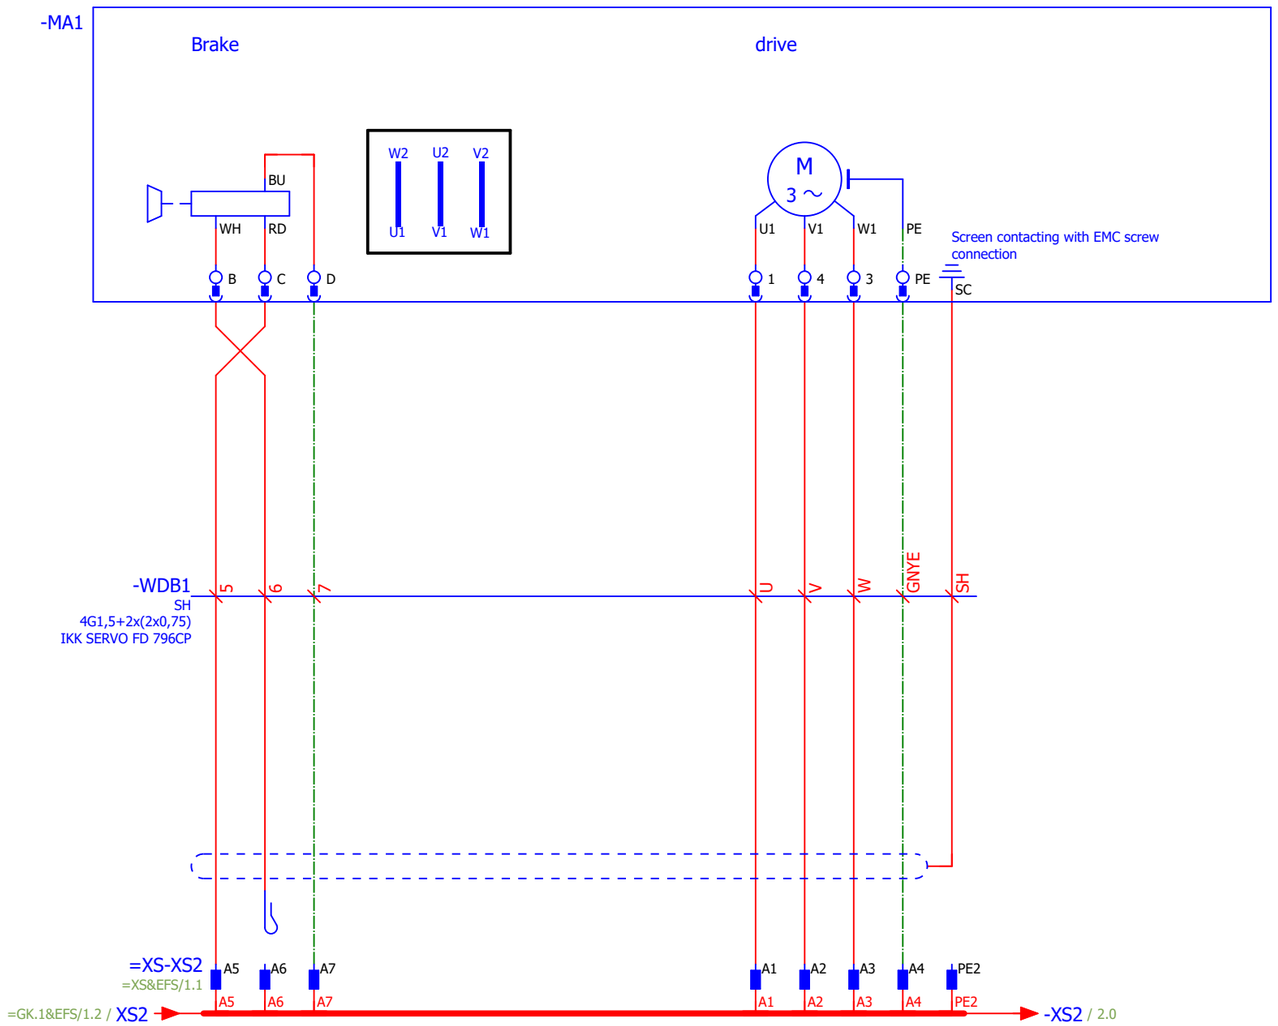

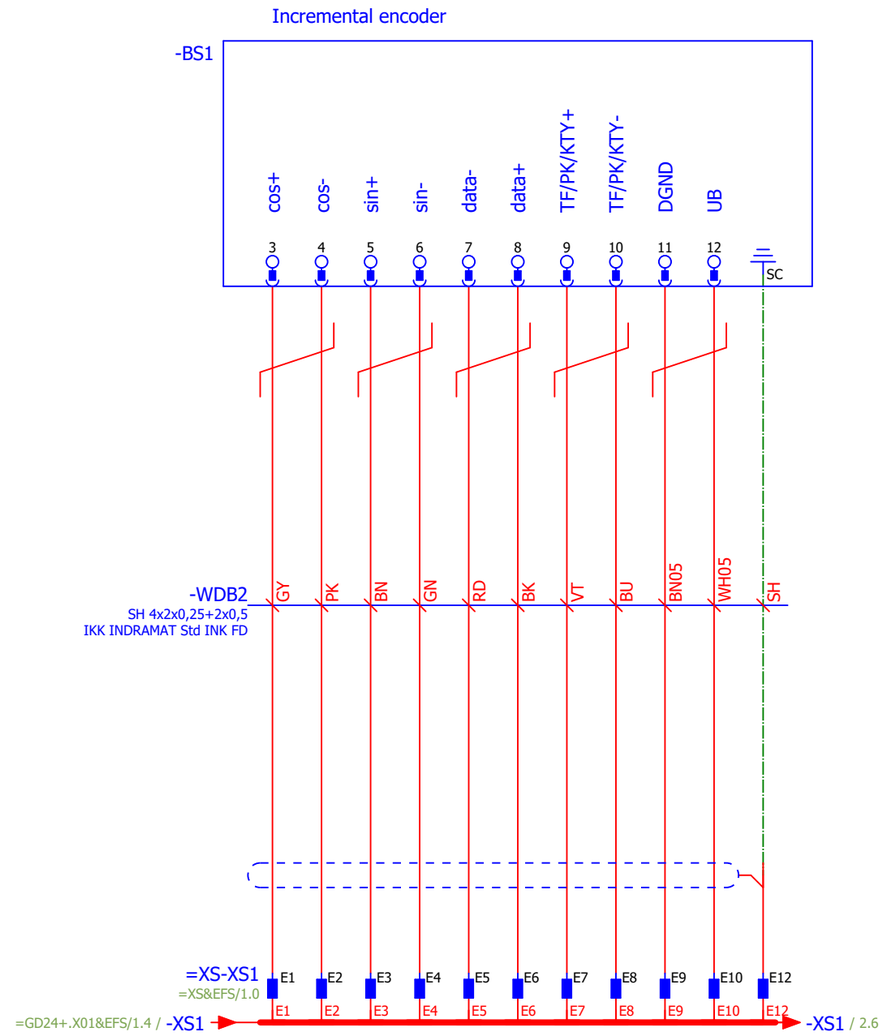

upper nesting 1.1.1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Drive	==1005811	=M25	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Drive heating shuttle	Electrical engineering schematic
					Drawing number 1005811	Version				+UT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	Upper tool 1	Sheet 63 from 164

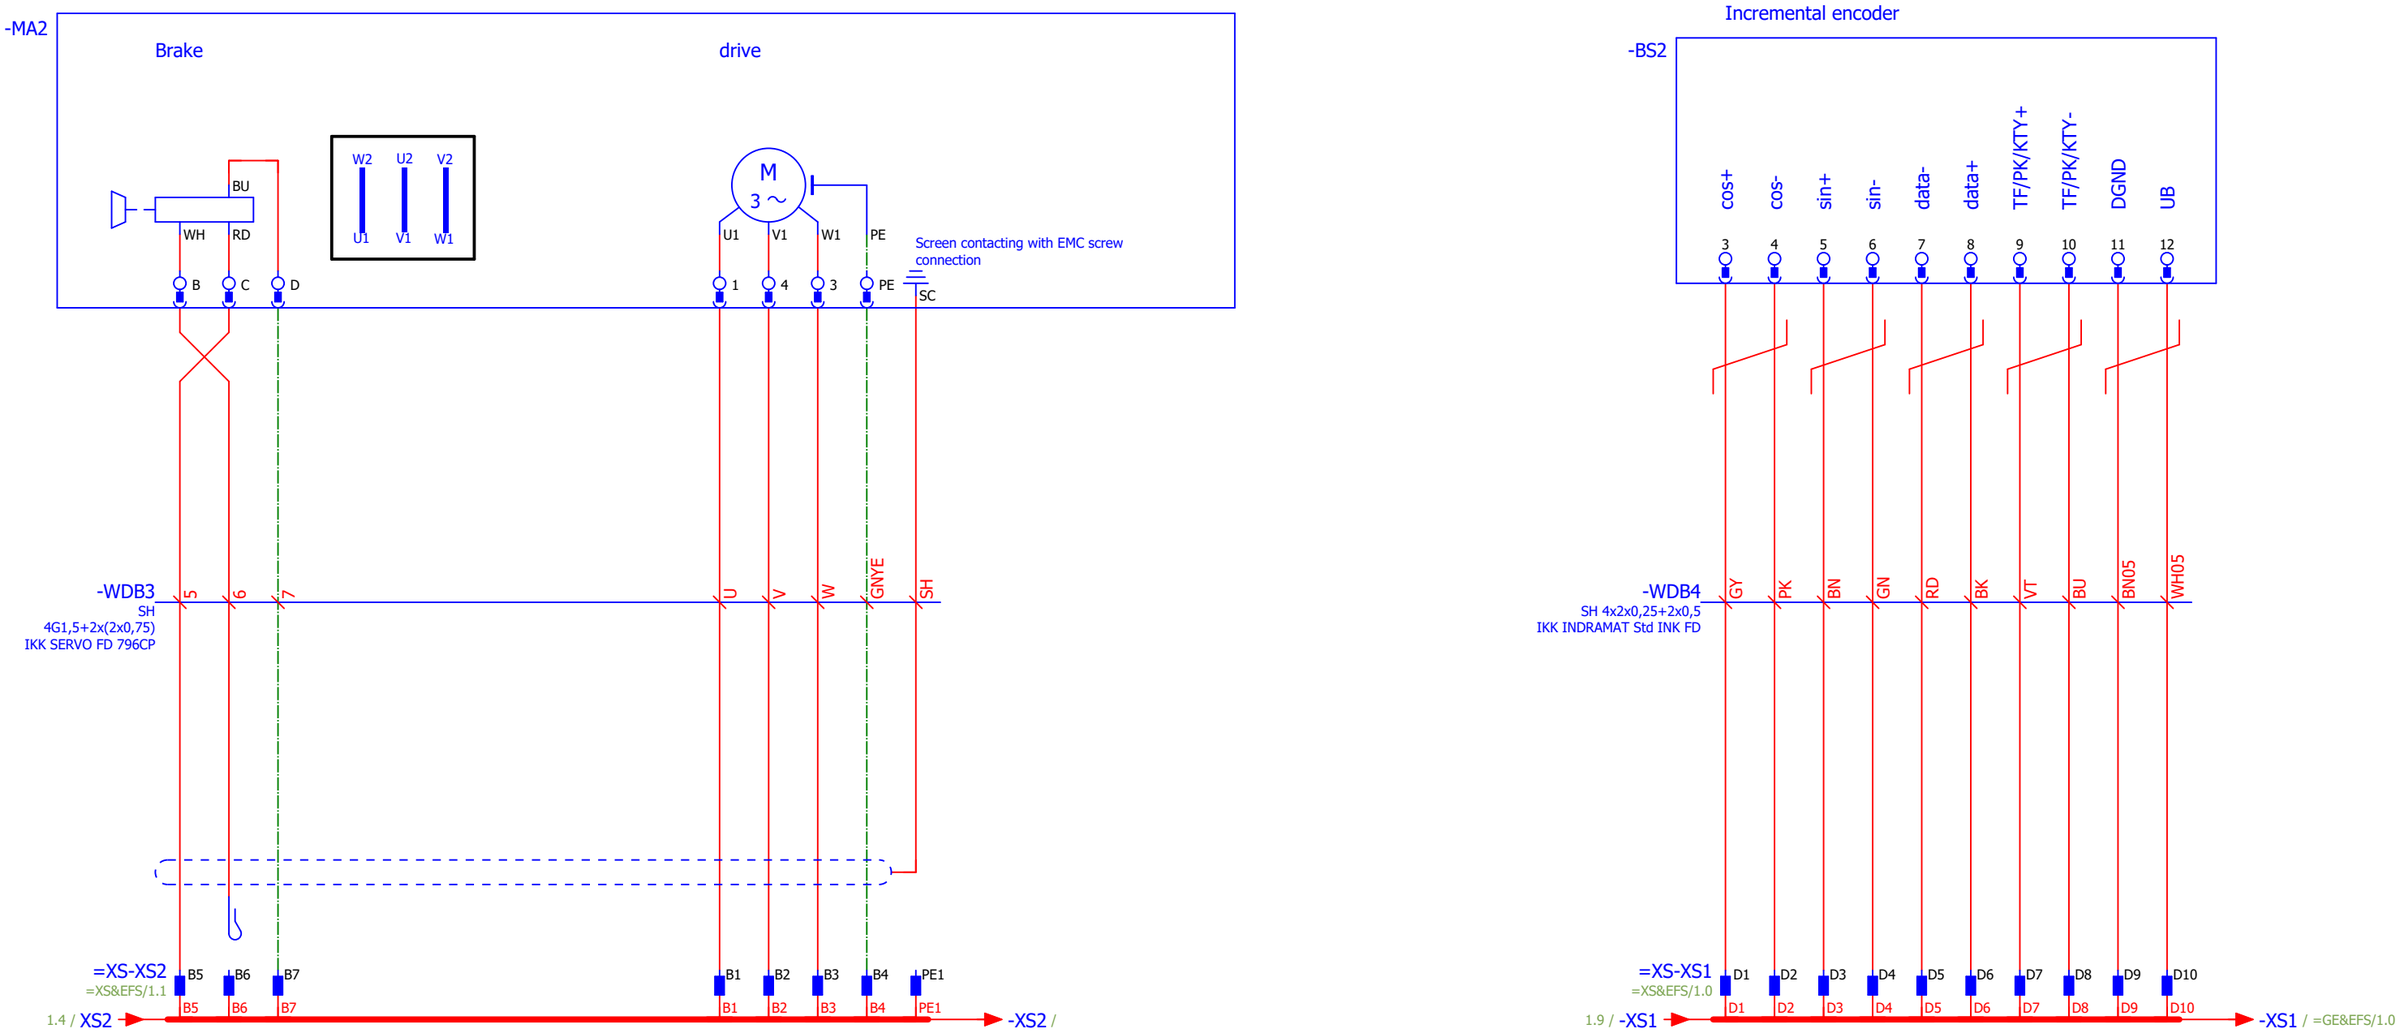

upper nesting 2.2.1

1

3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Drive	==1005811	=M25	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Drive heating shuttle	Electrical engineering schematic
					Drawing number 1005811	Version				+UT01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 27.11.2024	Upper tool 1	Sheet 64 from 164

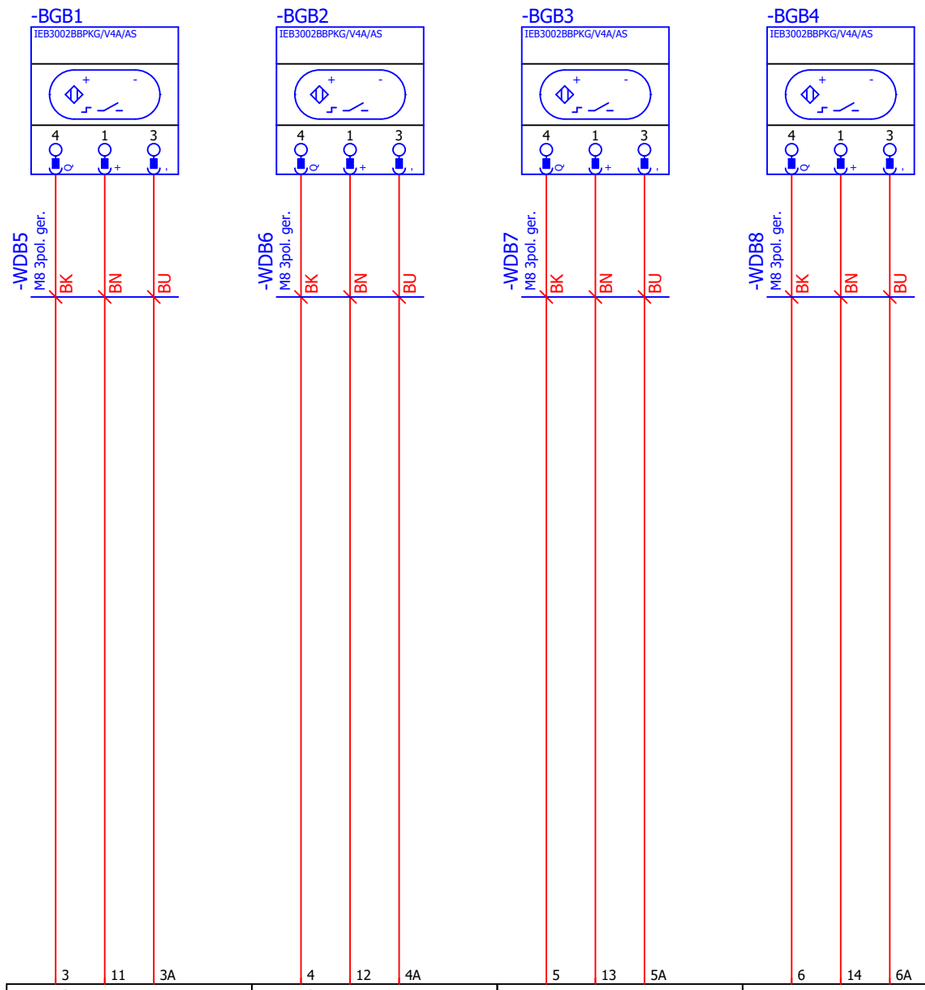

DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE1	**-KE1**	**-KE1**	**-KE1**	**-KE1**	**-KE1**
=PLC+.X01&EFS/1.2					
I12500.2	I12500.3	I12500.4	I12500.5	I12500.6	I12500.7
-BGB1:4	-BGB2:4	-BGB3:4	-BGB4:4	I12500.6	I12500.7

position nesting tool 1.1.1

position nesting tool 1.1.2

position nesting tool 2.2.1

position nesting tool 2.2.2

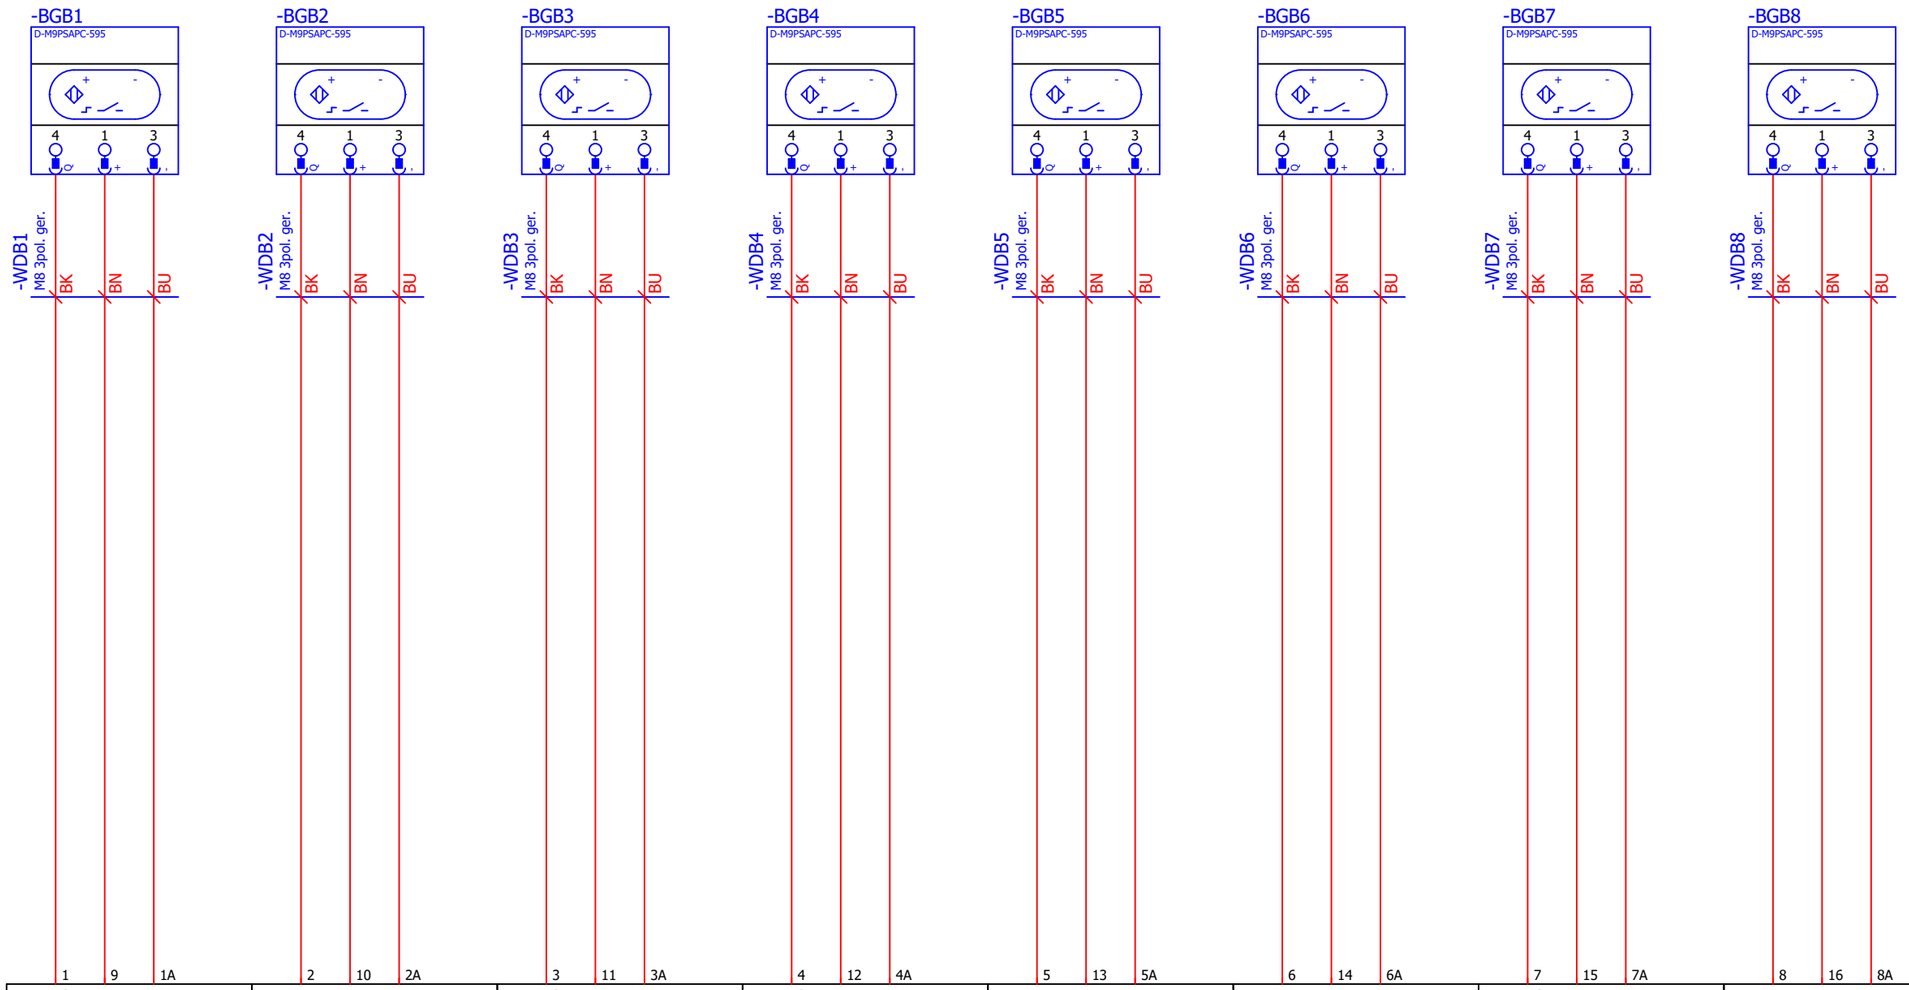

DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE4	**-KE4**	**-KE4**	**-KE4**	**-KE4**	**-KE4**	**-KE4**	**-KE4**
=PLC+.X01&EFS/1.4							
I12003.0	I12003.1	I12003.2	I12003.3	I12003.4	I12003.5	I12003.6	I12003.7
-BGB1:4	-BGB2:4	-BGB3:4	-BGB4:4	-BGB5:4	-BGB6:4	-BGB7:4	-BGB8:4

slider 1.1.1.1 WP slider 1.1.1.1 HP slider 1.1.2.1 WP slider 1.1.2.1 HP slider 1.1.3.1 WP slider 1.1.3.1 HP slider 1.1.4.1 WP slider 1.1.4.1 HP

=M25+UT01/3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries		==1005811	=M51	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Slider	Electrical engineering schematic
					Drawing number 1005811	Version					+LT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024		lower tool 1	Sheet 66 from 164

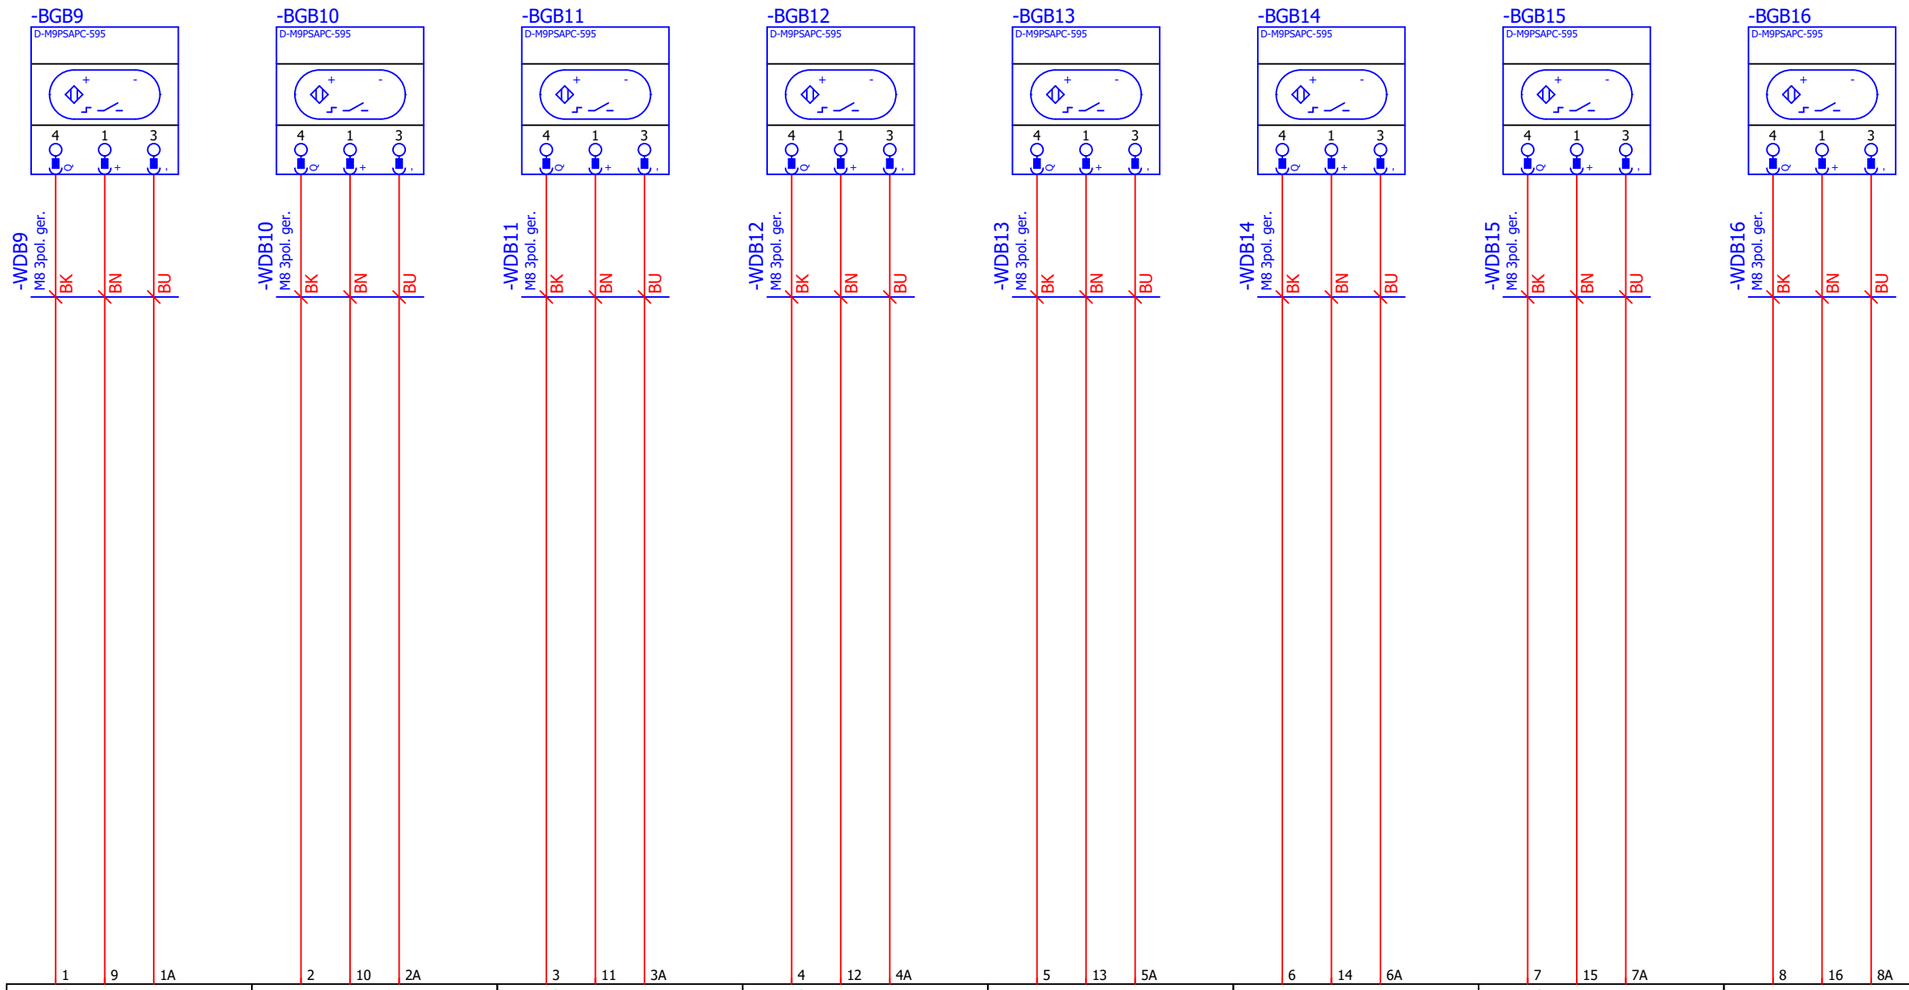

DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE5	**-KE5**	**-KE5**	**-KE5**	**-KE5**	**-KE5**	**-KE5**	**-KE5**
=PLC+.X01&EFS/1.4							
I12004.0	I12004.1	I12004.2	I12004.3	I12004.4	I12004.5	I12004.6	I12004.7
-BGB9:4	-BGB10:4	-BGB11:4	-BGB12:4	-BGB13:4	-BGB14:4	-BGB15:4	-BGB16:4

slider 2.1.1.1 WP slider 2.1.1.1 HP slider 2.1.2.1 WP slider 2.1.2.1 HP slider 2.1.3.1 WP slider 2.1.3.1 HP slider 2.1.4.1 WP slider 2.1.4.1 HP

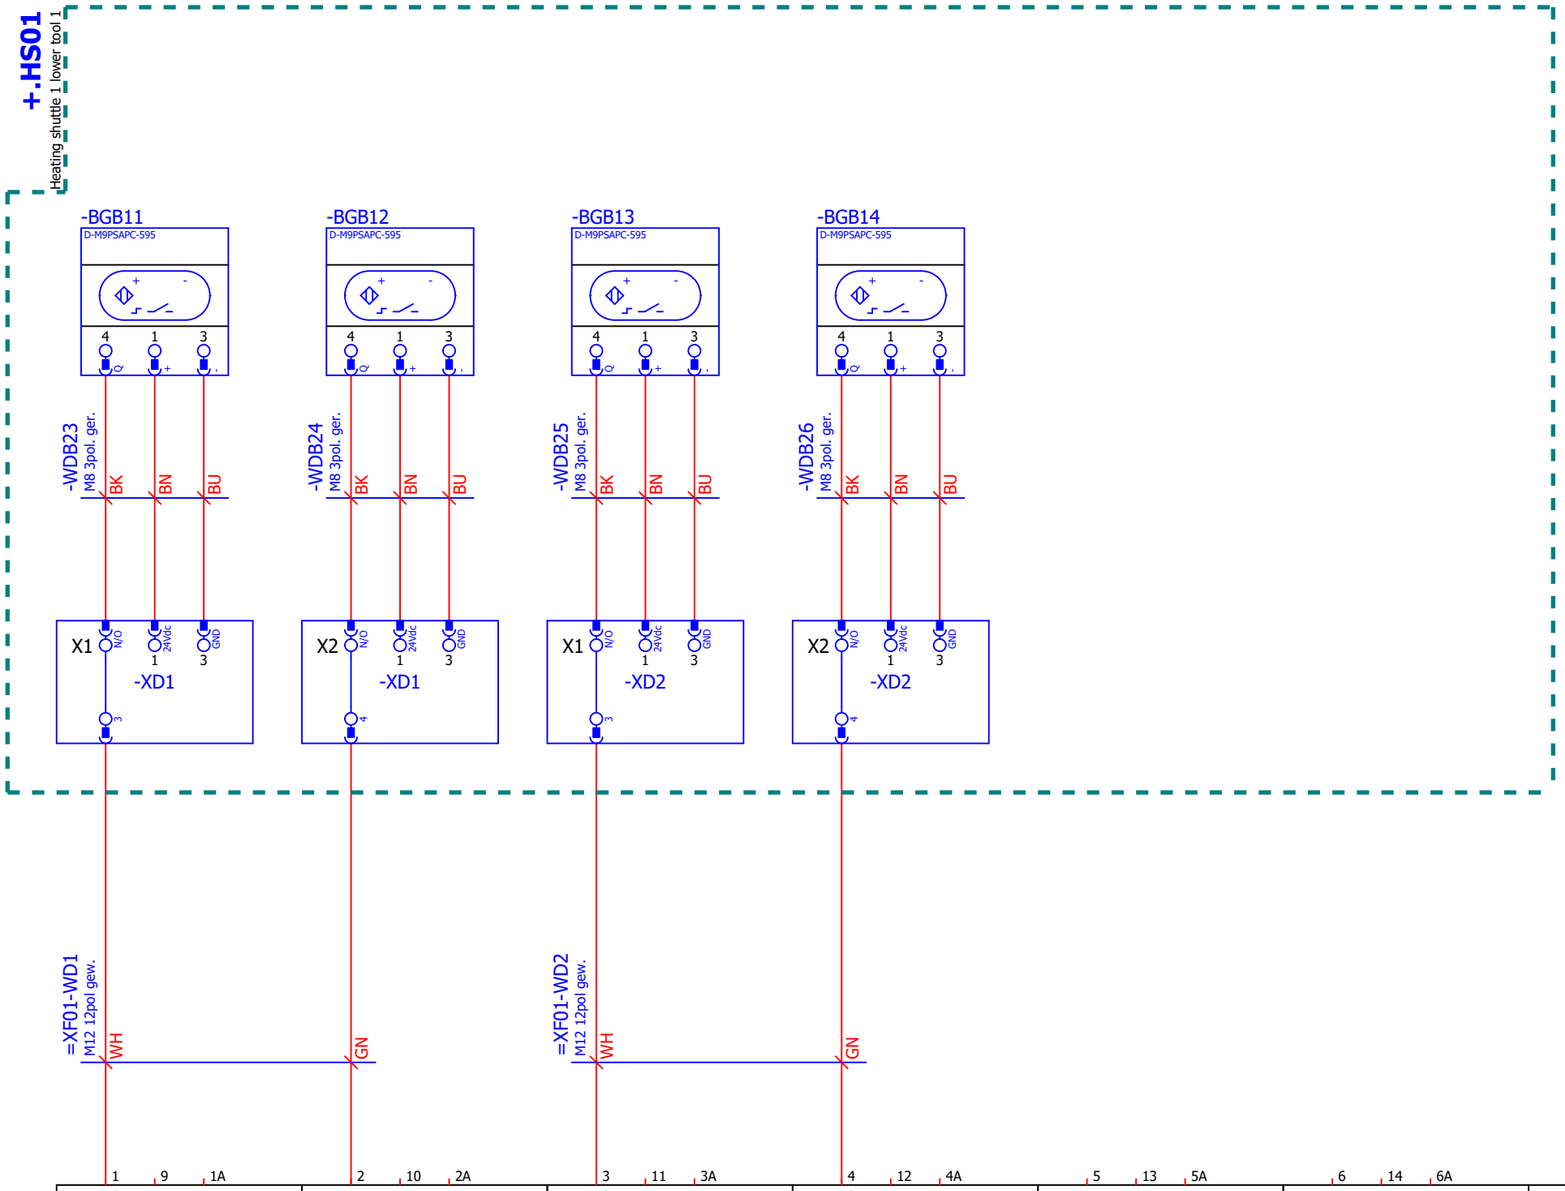

1 9 1A	2 10 2A	3 11 3A	4 12 4A	5 13 5A	6 14 6A	7 15 7A	8 16 8A
DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE6	**-KE6**	**-KE6**	**-KE6**	**-KE6**	**-KE6**	**-KE6**	**-KE6**
=PLC+.X01&EFS/1.5							
I12005.0	I12005.1	I12005.2	I12005.3	I12005.4	I12005.5	I12005.6	I12005.7
+.HS01-BGB11:4	+.HS01-BGB12:4	+.HS01-BGB13:4	+.HS01-BGB14:4	I12005.4	I12005.5	I12005.6	I12005.7

slider 1.1.1.1 HP slider 1.1.1.2 WP slider 1.2.1.2 WP slider 1.2.1.1 HP

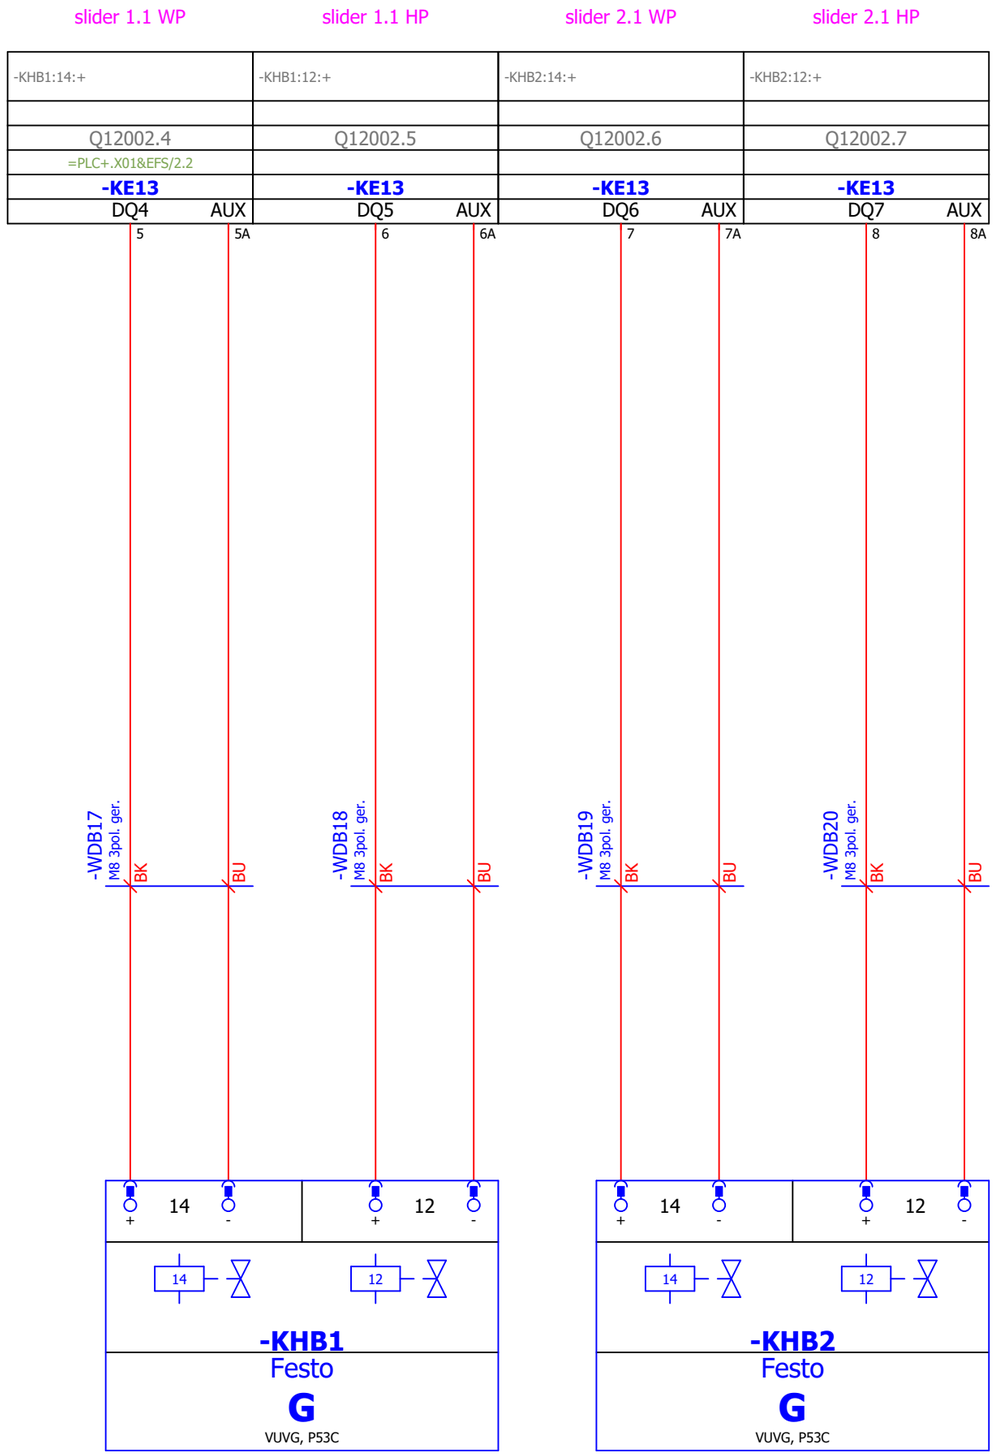

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	single valves	==1005811	=M51	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Slider	Electrical engineering schematic
					Drawing number 1005811	Version				+LT01	Page 4
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 69 from 164

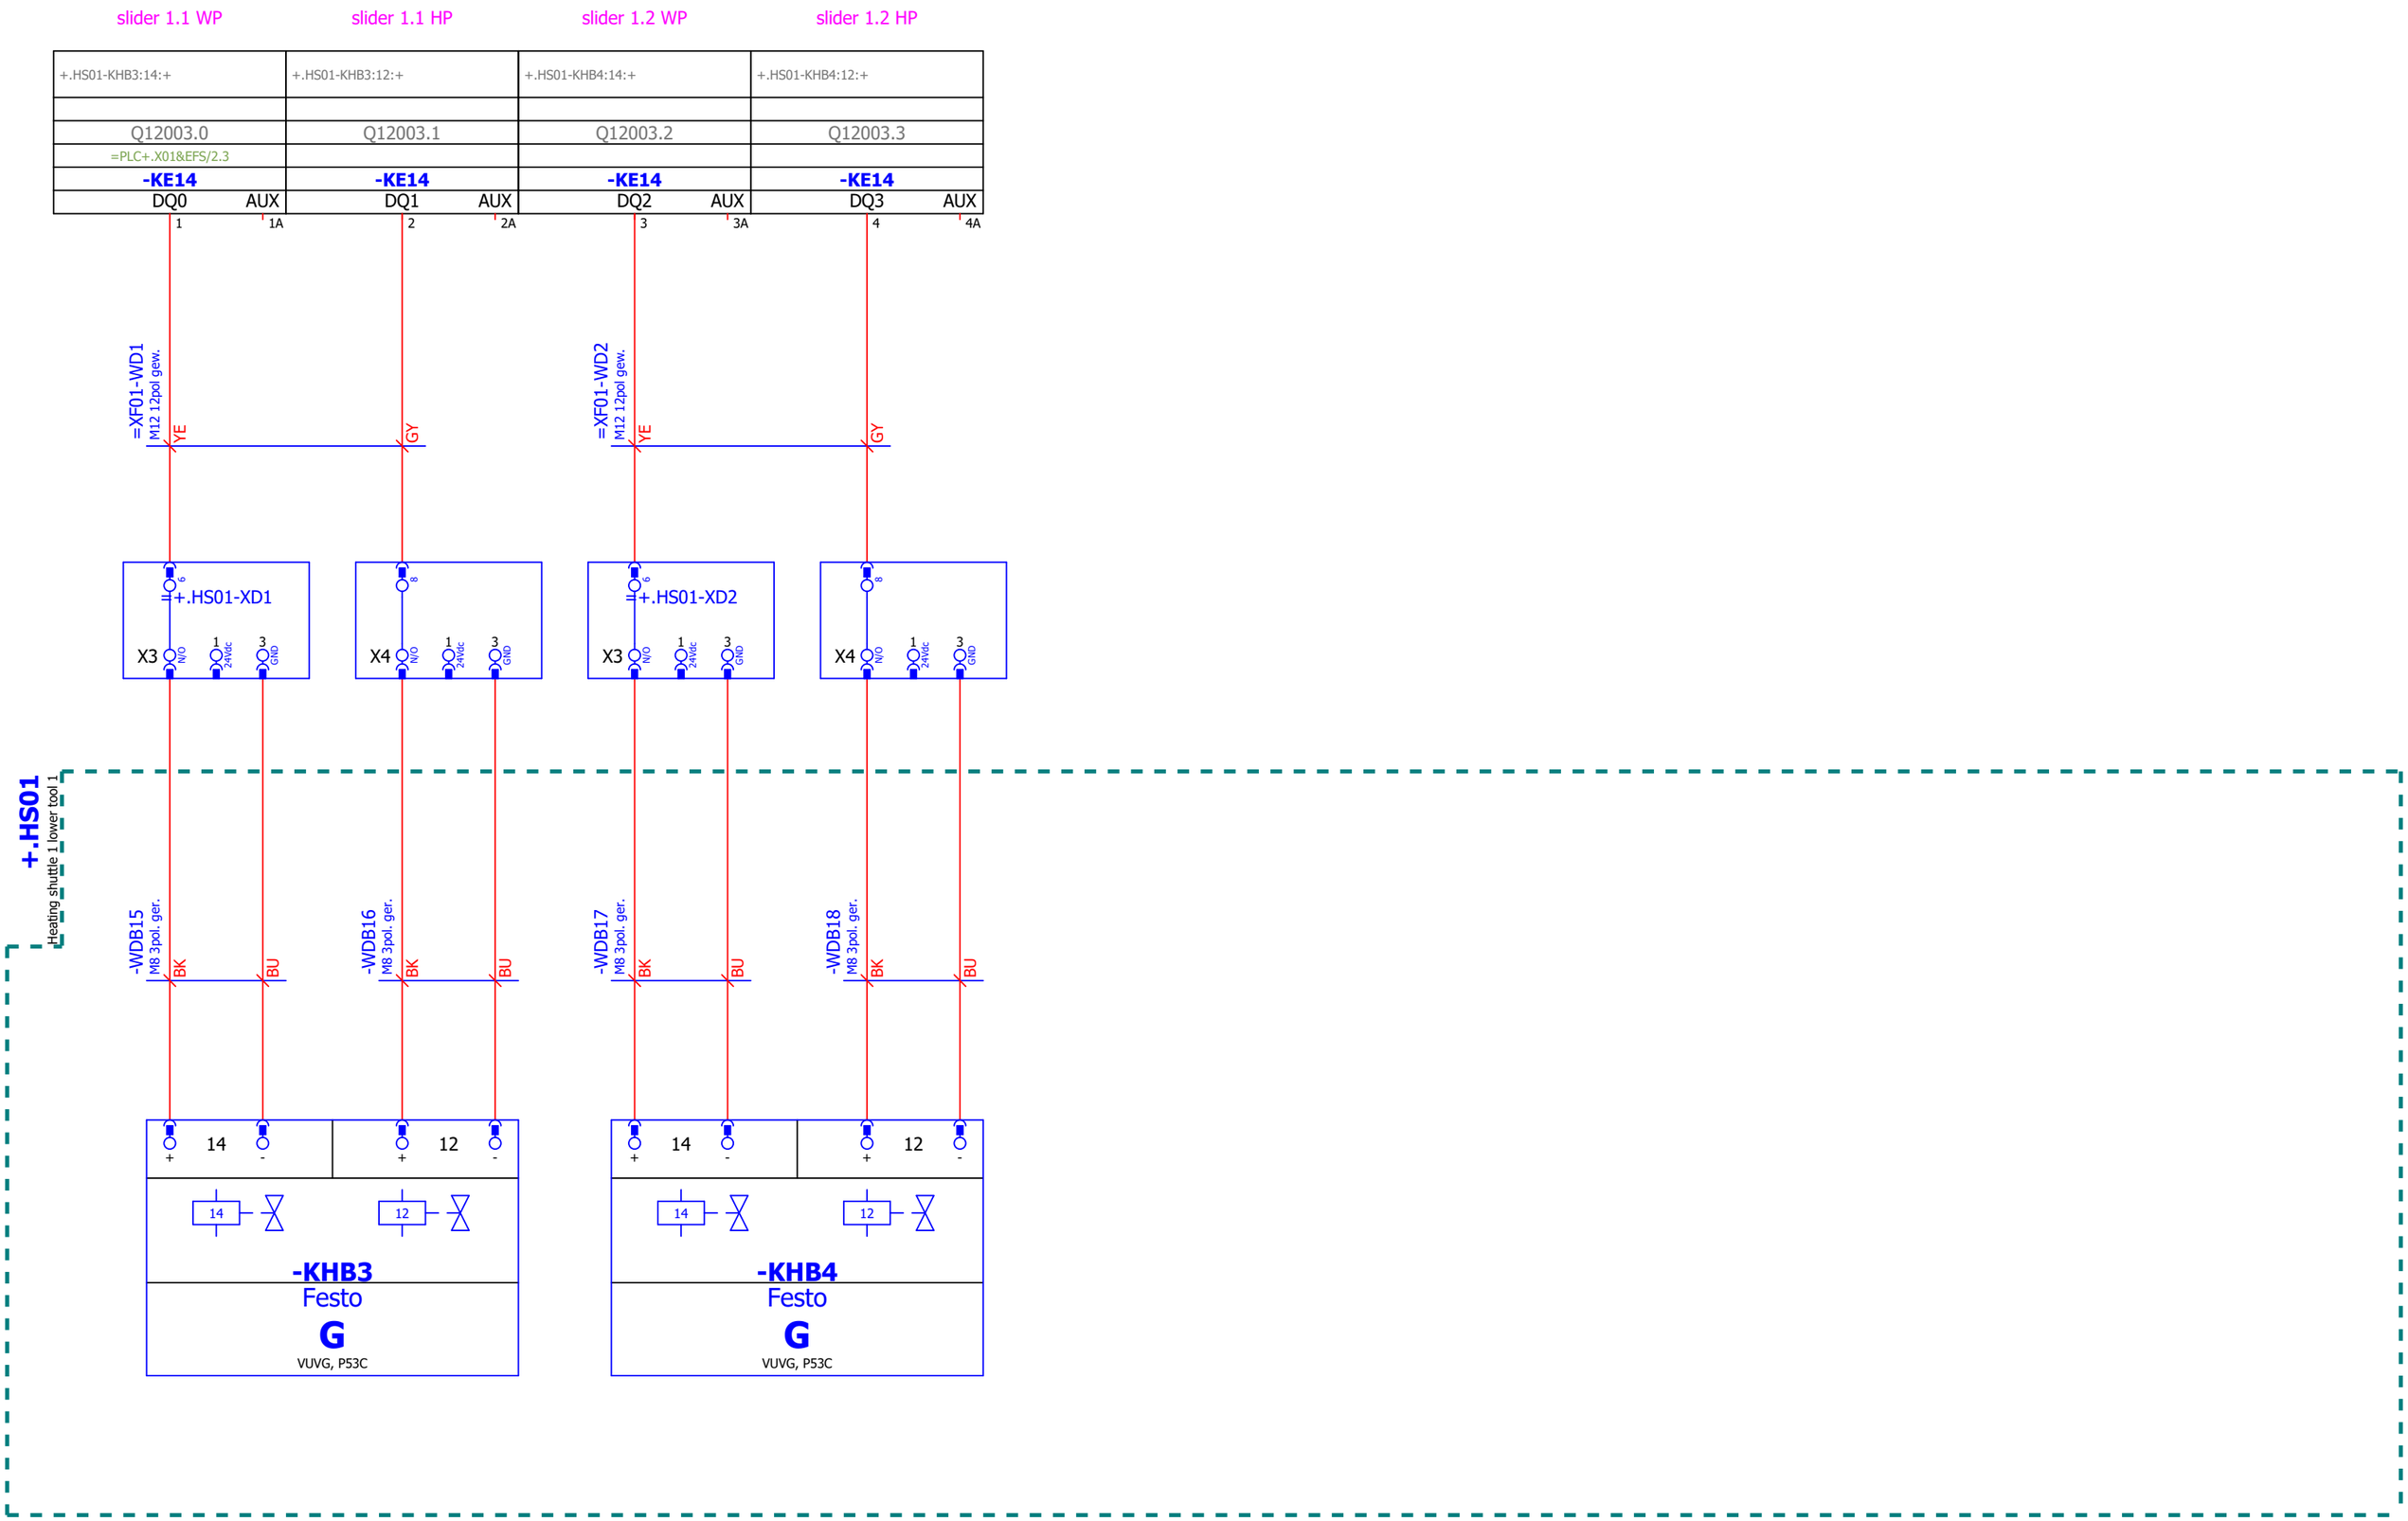

+UT01/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	single valves	==1005811	=M51	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Slider	Electrical engineering schematic
					Drawing number 1005811	Version				+LT01	Page 5
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 70 from 164

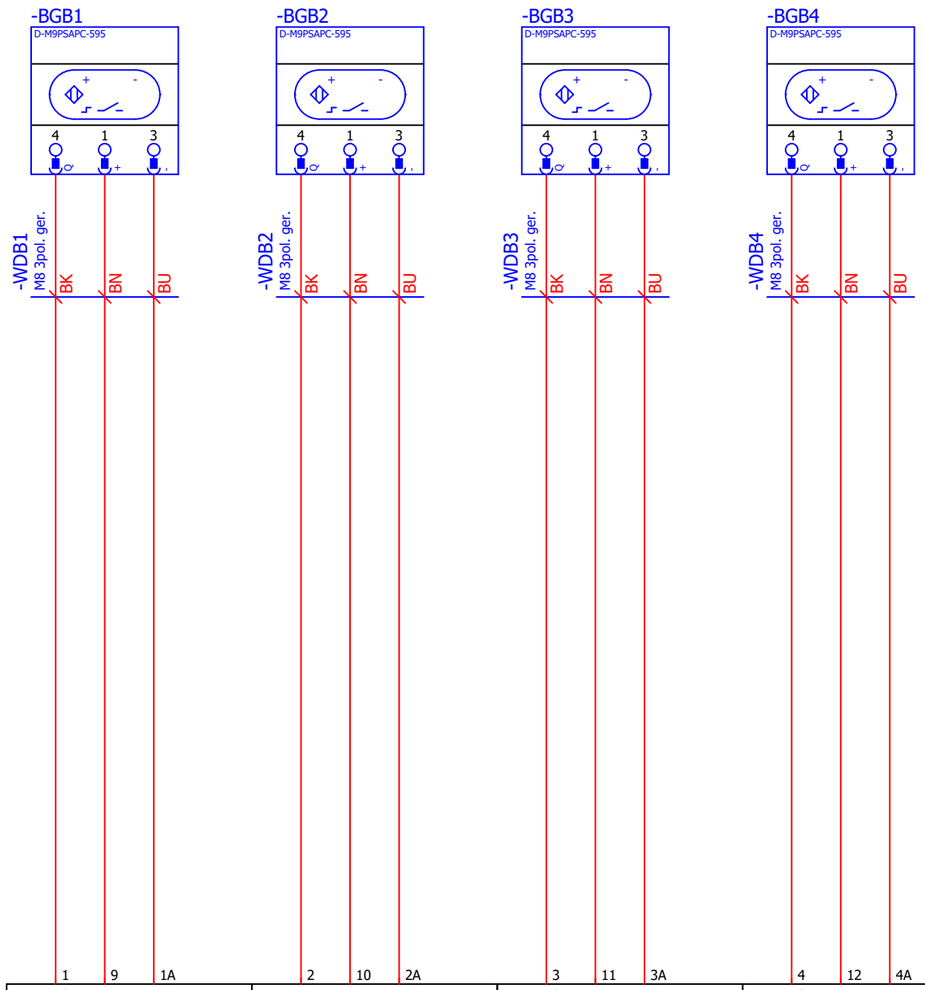

5 13 5A	6 14 6A	7 15 7A	8 16 8A
DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE2	-KE2	-KE2	-KE2
I12501.4	I12501.5	I12501.6	I12501.7
I12501.4	I12501.5	I12501.6	I12501.7

1 9 1A	2 10 2A	3 11 3A	4 12 4A
DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX
-KE2	-KE2	-KE2	-KE2
=PLC+.X01&EFS/1.2			
I12501.0	I12501.1	I12501.2	I12501.3
-BGB1:4	-BGB2:4	-BGB3:4	-BGB4:4

slider 1.2.1.1 HP slider 1.2.1.2 WP slider 2.1.1.1 HP slider 2.1.1.2 WP

+LT01/5

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Queries	==1005811	=M51	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Slider	Electrical engineering schematic
					Drawing number 1005811	Version				+UT01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	Upper tool 1	Sheet 71 from 164

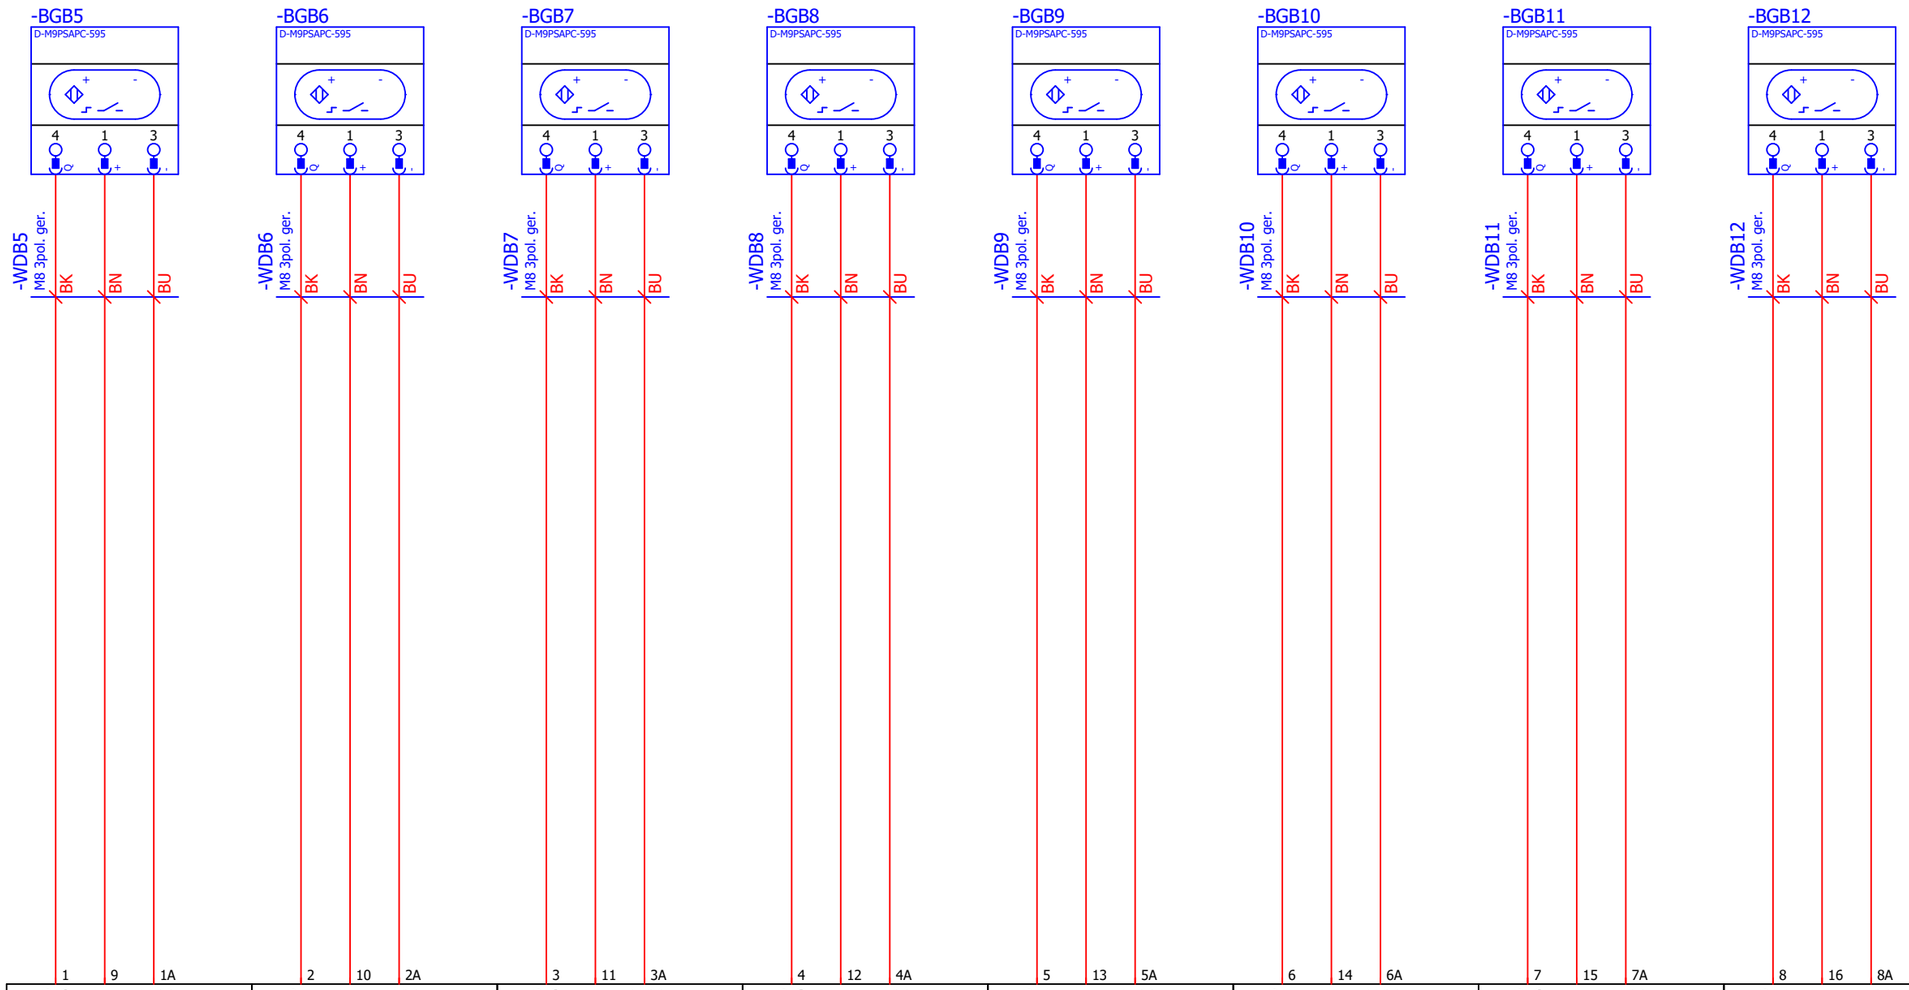

DI0 L+ AUX	DI1 L+ AUX	DI2 L+ AUX	DI3 L+ AUX	DI4 L+ AUX	DI5 L+ AUX	DI6 L+ AUX	DI7 L+ AUX
-KE3	**-KE3**	**-KE3**	**-KE3**	**-KE3**	**-KE3**	**-KE3**	**-KE3**
=PLC+.X01&EFS/1.3							
I12502.0	I12502.1	I12502.2	I12502.3	I12502.4	I12502.5	I12502.6	I12502.7
-BGB5:4	-BGB6:4	-BGB7:4	-BGB8:4	-BGB9:4	-BGB10:4	-BGB11:4	-BGB12:4

locking 1.1.1.1 WP | locking 1.1.1.1 HP | locking 1.1.2.1 WP | locking 1.1.2.1 HP | locking 1.1.3.1 WP | locking 1.1.3.1 HP | locking 1.1.4.1 WP | locking 1.1.4.1 HP

=REPORT+LT01&EMA3/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	single valves	==1005811	=M51	&EFS1
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Slider	Electrical engineering schematic
				Drawing number 1005811	Version				+UT01	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 30.10.2024	Upper tool 1	Sheet 73 from 164

connector overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

Plug designation	Function text	Plug					Page of plug diagram
		first	last	Total PE	Total N	Total number	
=XS-XS1	Data	PE1	F2	2	0	28	
=XS-XS2	Heating system	PE1	F5	2	0	35	
=XS-XS3	Heating system	1	PE	1	0	25	
=XS-XS4	Heating system	1	PE	1	0	25	
=XS-XS5	Heating system	PE1	F5	2	0	29	
=XS-XS6	Heating system	1	PE	1	0	25	
=XS-XS7	Heating system	1	PE	1	0	25	
=GQ-XDB1				0	0	0	
=GQ-XDB2				0	0	0	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS1	10011715		Hinged frame	09 14 024 0371	HARTING Technology Group	
	10010866		Pin module	09 14 002 3001	HARTING Technology Group	
	10010875	a	Pin module	09 15 004 3013	HARTING Technology Group	
	10010925	c	Pin module	09 14 008 2633	HARTING Technology Group	
	10010863	D	Dummy module	09 14 000 9950	HARTING Technology Group	
	10010927	e	Pin module	09 14 012 2632	HARTING Technology Group	
	10011993	f	Pin module	09 14 002 2646	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS2	10011715		Hinged frame	09 14 024 0371	HARTING Technology Group	
	10010925	a	Pin module	09 14 008 2633	HARTING Technology Group	
	10010868	b;c;d;e;f	Pin module	09 14 005 2616	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS3	10010944		Pin insert	09 33 024 2601	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS4	10010944		Pin insert	09 33 024 2601	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS5	10011715		Hinged frame	09 14 024 0371	HARTING Technology Group	
	10011993	a	Pin module	09 14 002 2646	HARTING Technology Group	
	10010868	b;c;d;e;f	Pin module	09 14 005 2616	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS6	10010944		Pin insert	09 33 024 2601	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS7	10010944		Pin insert	09 33 024 2601	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB1	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB2	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
=HMI+LT01 **-SJC1**	Illuminated push button yellow	=HMI&EFS/1.0
=HMI+LT01 **-SJC3**	Illuminated push button green	=HMI&EFS/1.2
=HMI+LT01 **-SJC4**	Enclosure 1 Befehlsstelle, Grobhandtaster schwarz	=HMI&EFS/2.1
=HMI+LT01 **-SJC5**	Enclosure 1 Befehlsstelle, Grobhandtaster schwarz	=HMI&EFS/2.4
=HMI+LT01 **-XDC1**	Enclosure 3 control points	=HMI&EFS/1.3
=EA+LT01 **-BTA1**	PT100 Contact resistance thermometer, moveable	=EA&EFS/1.0
=GQ+LT01 **-BGB1**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.0
=GQ+LT01 **-BGB2**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.1
=BA05+LT01 **-BGB1**	Measuring Amplifier Fiber optic, M8 4pin	=BA05&EFS/1.0
=BA05+LT01 **-BGB2**	Triangulation sensor OBT30-R2-E2-0,2M-V31-P, M8 4pin, BGS	=BA05&EFS/1.1
=BA05+LT01 **-BGB3**	Measuring Amplifier Fiber optic, M8 4pin	=BA05&EFS/2.0
=BA05+LT01 **-BGB4**	Triangulation sensor OBT30-R2-E2-0,2M-V31-P, M8 4pin, BGS	=BA05&EFS/2.1
=BA05+LT01 **-BGC1**	Lasersensor M8 3pin	=BA05&EFS/1.3
=BA05+LT01 **-BGC2**	Lasersensor M8 3pin	=BA05&EFS/1.4
=BA05+LT01 **-BGC3**	Lasersensor M8 3pin	=BA05&EFS/2.3
=BA05+LT01 **-BGC4**	Lasersensor M8 3pin	=BA05&EFS/2.4
=BA05+LT01 **-BGD1**	Reflexionslichtschranke PRK25C/4P-M12, M12 4pin, polarized	=BA05&EFS/1.2
=BA05+LT01 **-BGD2**	Reflexionslichtschranke PRK25C/4P-M12, M12 4pin, polarized	=BA05&EFS/2.2
=M25+LT01 **-BGB1**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/2.0
=M25+LT01 **-BGB2**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/2.1
=M25+LT01 **-BS1**	transmitter	=M25&EFS1/1.6
=M25+LT01 **-MA1**	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	=M25&EFS1/1.0
=M51+LT01 **-BGB1**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.0
=M51+LT01 **-BGB2**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.1

device tag	Article designation	X-Ref
=M51+LT01 **-BGB3**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.2
=M51+LT01 **-BGB4**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.3
=M51+LT01 **-BGB5**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.4
=M51+LT01 **-BGB6**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.5
=M51+LT01 **-BGB7**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.6
=M51+LT01 **-BGB8**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.7
=M51+LT01 **-BGB9**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.0
=M51+LT01 **-BGB10**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.1
=M51+LT01 **-BGB11**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.2
=M51+LT01 **-BGB12**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.3
=M51+LT01 **-BGB13**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.4
=M51+LT01 **-BGB14**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.5
=M51+LT01 **-BGB15**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.6
=M51+LT01 **-BGB16**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.7
=M51+LT01 **-KHB1**	Single valve VUVG, P53C	=M51&EFS1/4.0
=M51+LT01 **-KHB2**	Single valve VUVG, P53C	=M51&EFS1/4.2

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
BAL.BCC0K8C	24 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 5m	BCC M313-0000-10-001-PX0334-050-C003		1
BAL.BCC0K8J	4 pc	M8 4pin straight Sensor-/Aktor-Leitungen, 5m	BCC M314-0000-10-003-PX0434-050-C003		2
BAL.BCC0860	2 pc	M12 5pin straight Übersetzung fehlt	BCC M415-0000-1A-017-PX0534-100		3
BAL.BCC0KKP	4 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 10m	BCC M313-0000-10-001-PX0334-100-C003		4
FES.571477	2 pc	Pressure transmitter SPTE, 0-10V, 0--1bar	SPTE-V1R-Q4-V-2.5K		5
FES.566661	2 pc	Valve cable	NEBV-H1G2-P-5-N-LE2		6
FES.SV_VUVG_P53C	2 pc	Single valve VUVG, P53C			7
HAGER.KN18N	1 pc	Quick-Connect terminal N-teminal 4x25mm², 14x4mm²	KN18N		8

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
HAGER.KN00A	1 pc	Quick-Connect terminal Adapter	KN00A		9
HAR.09 14 024 0371	3 pc	Hinged frame Size: 24 B, 6 Module a-f	09 14 024 0371		10
HAR.09 14 002 3001	1 pc	Pin module modular Quintax	09 14 002 3001		11
HAR.09 15 004 3013	1 pc	Pin module modular Quintax, 4pin, 10A, shielded, without crimp contacts	09 15 004 3013		12
HAR.09 14 008 2633	2 pc	Pin module modular, 8pin, 16A, Quick-Lock connection	09 14 008 2633		13
HAR.09 14 000 9950	1 pc	Dummy module modular	09 14 000 9950		14
HAR.09 14 012 2632	1 pc	Pin module modular, 12pin, 10A, Quick-Lock connection	09 14 012 2632		15
HAR.09 14 002 2646	2 pc	Pin module modular, 2pin 70A, 6-16mm², axial screw connection	09 14 002 2646		16

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
HAR.09 30 024 1701	7 pc	Docking frame Size: 24 B	09 30 024 1701		17
HAR.09 14 005 2616	10 pc	Pin module modular, 5pin, 16A, cage clamp connection	09 14 005 2616		18
HAR.09 33 024 2601	4 pc	Pin insert Size: 24 B, 24pin, 16A, screw connection	09 33 024 2601		19
IFM.IE5366	2 pc	Inductive sensor IE5366, M8 3-pin	IEB3002BBPKG/V4A/AS		20
IKK.BM02111000111	1 meter	Brake motor cable Übersetzung fehlt	BM02111000111		21
IKK.AKXH101000000	1 meter	Encoder cable Übersetzung fehlt	AKXH101000000		22
JUM.TN 00635743	1 pc	PT100 Contact resistance thermometer, moveable	902550/99-378-1003-1-11-5000/315		23
KEY.FS-N11CP	2 pc	Measuring Amplifier Fiber optic, M8 4pin	FS-N11CP		24

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
KEY.FU-6F	2 pc	Fiber optic sensor	FU-6F		25
KEY.LR-ZB250C3P	4 pc	Lasersensor M8 3pin	LR-ZB250C3P		26
LAPP.1119012	1 meter	ÖLFLEX CLASSIC 110 12G0,5	1119012		27
LAPP.1119003	2 meter	ÖLFLEX CLASSIC 110 3G0,5	1119003		28
LAPP.0026157	6 meter	ÖLFLEX FD CLASSIC 810 25G1,5	0026157		29
LAPP.2170894	5,00 meter	ETHERLINE PN Cat.5 FD Profinet	2170894		30
LEU.50134279	2 pc	Reflexionslichtschranke PRK25C/4P-M12, M12 4pin, polarized	PRK25C/4P-M12		31
MURR.7000-19061-3011000	2 pc	M12 12pin 90°	7000-19061-3011000		32

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
MURR.7000-08325-0000000	2 pc	Cut clamp Pin M8 3pol straight, 0.25-0.5mm²	7000-08325-0000000		33
P&F.70141875	2 pc	Triangulation sensor OBT30-R2-E2-0,2M-V31-P, M8 4pin, BGS	OBT30-R2-E2-0,2M-V31-P		34
PXC.SACC-M 8MS-3QO-0,5-M	2 pc	Cut clamp Pin M8 3pol straight, 0.25-0.5mm²	SACC-M 8MS-3QO-0,5-M		35
SEW.GEBER	1 pc	transmitter			36
SIE.3SU1051-0AB30-0AA0	1 pc	Illuminated push button yellow	3SU1051-0AB30-0AA0		37
SIE.3SU1400-2AA10-3BA0	2 pc	Contact module 1NO, Boden	3SU1400-2AA10-3BA0		38
SIE.3SU1401-2BB30-3AA0	1 pc	LED module yellow, Boden	3SU1401-2BB30-3AA0		39
SIE.3SU1550-0AA10-0AA0	2 pc	Support 3 modules, metal	3SU1550-0AA10-0AA0		40

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
SIE.3SU1051-0AB40-0AA0	1 pc	Illuminated push button green	3SU1051-0AB40-0AA0		41
SIE.3SU1401-2BB40-3AA0	1 pc	LED module green, Boden	3SU1401-2BB40-3AA0		42
SIE.3SU1801-2GA00-2AA1	2 pc	Enclosure 1 Befehlsstelle, Grobhandtaster schwarz	3SU1801-2GA00-2AA1		43
SIE.3SU1803-0AA00-0AB1	1 pc	Enclosure 3 control points	3SU1803-0AA00-0AB1		44
SMC.D-M9PSAPC-595	16 pc	Proximity sensor Cylinder, M8 3-pin, straight	D-M9PSAPC-595		45
WEI.1876390000_2pcs	1 pc	Cable coding system TM-I 30 MC NE WS, 4 mm, Polyamide 66, white	1876390000		46
WEI.1674760000_1pcs	1 pc	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	1674760000		47

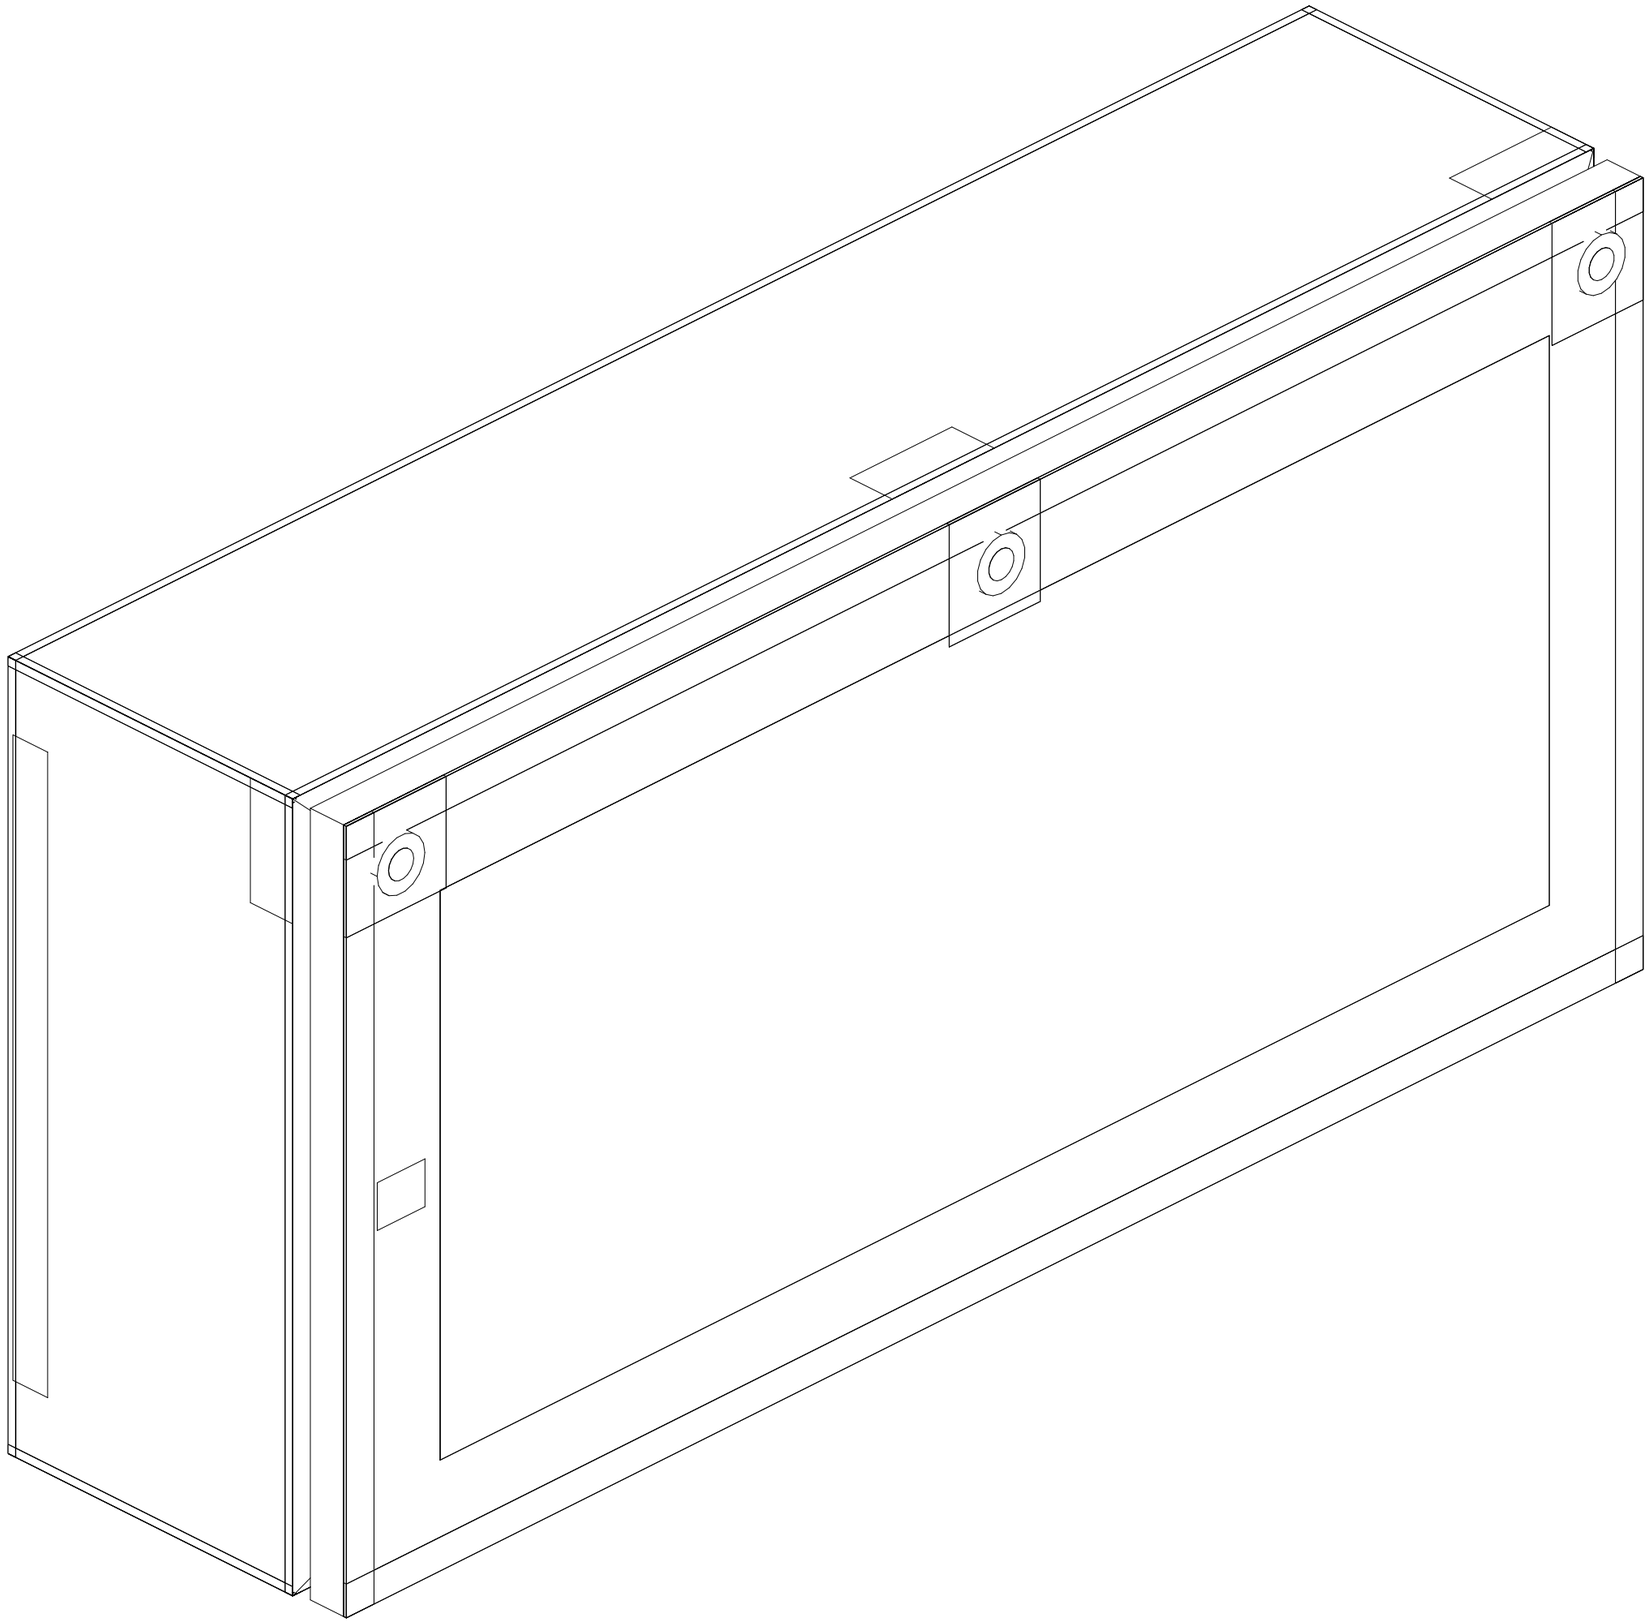

LT01.X01

+LT01&EPC1/6

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	LT01.X01		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1				3Con TECHNOLOGY FOR YOU				Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 91 from 164

Enclosure legend

Item n.	Device tag	Type number
14	PLC-KEC1	6ES7155-6AA01-0BN0
38	PLC-KE1	6ES7193-6BP20-0DA0
39	PLC-KE1	6ES7131-6BF01-0BA0
40	PLC-KE2	6ES7193-6BP20-0BA0
41	PLC-KE2	6ES7131-6BF01-0BA0
42	PLC-KE3	6ES7193-6BP20-0BA0
43	PLC-KE3	6ES7131-6BF01-0BA0
44	PLC-KE4	6ES7193-6BP20-0BA0
45	PLC-KE4	6ES7131-6BF01-0BA0
46	PLC-KE5	6ES7193-6BP20-0BA0
47	PLC-KE5	6ES7131-6BF01-0BA0
48	PLC-KE6	6ES7193-6BP20-0BA0
49	PLC-KE6	6ES7131-6BF01-0BA0
50	PLC-KE7	6ES7193-6BP20-0BA0
51	PLC-KE7	6ES7131-6BF01-0BA0
52	PLC-KE8	6ES7193-6BP00-0BA1
53	PLC-KE8	6ES7134-6JD00-0CA1
54	PLC-KE9	6ES7193-6BP00-0BA1
55	PLC-KE9	6ES7134-6JD00-0CA1
56	PLC-KE10	6ES7193-6BP20-0BA0
57	PLC-KE10	6ES7134-6HD01-0BA1
58	PLC-KE11	6ES7193-6BP20-0DA0
59	PLC-KE11	6ES7132-6BF01-0BA0
60	PLC-KE12	6ES7193-6BP20-0DA0
61	PLC-KE12	6ES7132-6BF01-0BA0
62	PLC-KE13	6ES7193-6BP20-0DA0
63	PLC-KE13	6ES7132-6BF01-0BA0
64	PLC-KE14	6ES7193-6BP20-0BA0
65	PLC-KE14	6ES7132-6BF01-0BA0

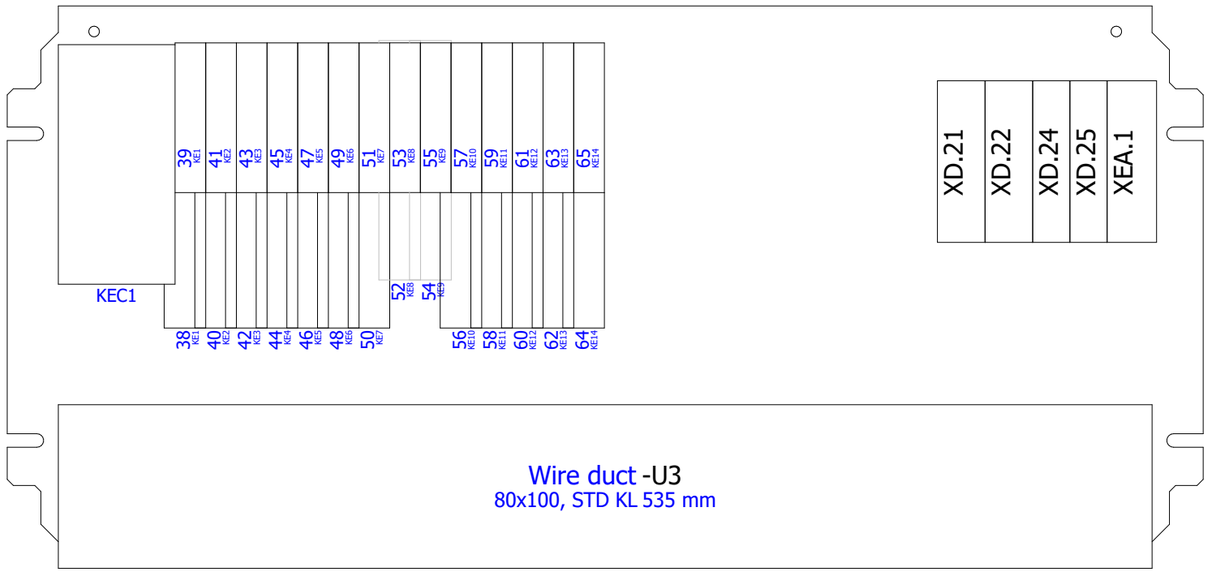

S1:Montageplatte

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte	==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version				+LT01.X01	Page 8
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025	lower tool 1	Sheet 92 from 164

Enclosure legend

11

Item number	BMK	Type number	Designation
12	-U3	BA7100080	Verdrahtungskanal 80x100, STD KL
13	-UA1	TS 35X7.5/LL 2M/ST/ZN	Tragschiene 35x7,5

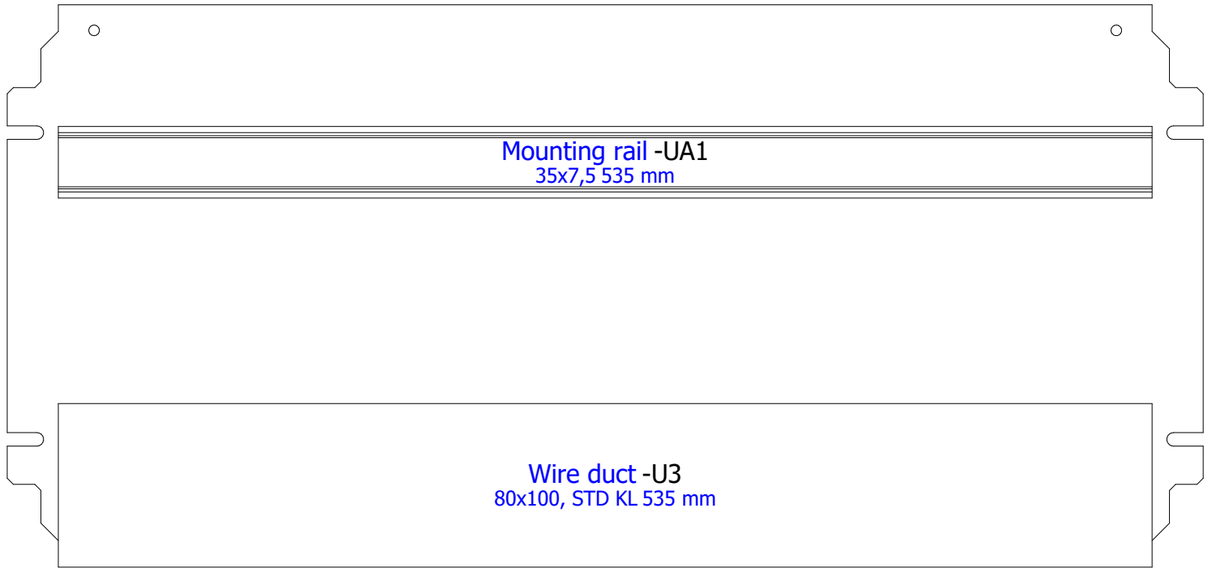

S1:Montageplatte

8

&EMA1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte	==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version				+LT01.X01	Page 9
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025	lower tool 1	Sheet 93 from 164

Terminal-strip overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F14_002_V01

Terminal strip	Function text	Terminals					Page of the terminal diagram
		first	last	Total PE	Total N	Total number	
-XD.21		1	3	0	0	3	==1005811=REPORT+LT01.X01&EMA2/1
-XD.22		1	3	0	0	3	==1005811=REPORT+LT01.X01&EMA2/2
-XD.24		1	2	0	0	2	==1005811=REPORT+LT01.X01&EMA2/3
-XD.25		1	2	0	0	2	==1005811=REPORT+LT01.X01&EMA2/4
-XEA.1		1	2	2	0	2	==1005811=REPORT+LT01.X01&EMA2/5

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XF01+LT01-WD2	12x0,25 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.X01-XD.21

Function:
Installation location: Terminal box lower tool 1

1	=GD24-WDB1	CLASSIC 110 7x2,5 mm²
2	=XF01+LT01-WD1	12x0,25 mm²
3		
4		
5		
6		
7		
8		
9		
10		

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZDU 2.5/4AN																				
GND											=PLC-KEC1	-X80:2	b	**1**	a				=XS+LT01-XS1	C1										1	=GD24&EFS/1.1
											=PLC-KE1	9A	c																		
											=PLC-KE11	9A	d																		
GND											=PLC-KE13	9A	b	**2**	a				=PLC-KE12	9A											=GD24&EFS/1.1
													c																		
													d																		
GND	BU										=XF01+.HS01-XD2	2	b	**3**	a				=XF01+.HS01-XD1	2									BU		=GD24&EFS/1.2
													c																		
													d																		

&EMA1/1

2

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.X01-XD.21	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+LT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 95 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=GQ+LT01-WDB4	3x0,25 mm² 5 m
2	=XF01+LT01-WD1	12x0,25 mm²
3	=XF01+LT01-WD2	12x0,25 mm²
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.X01-XD.22

Function:
Installation location: Terminal box lower tool 1

1	=GD24-WDB1	CLASSIC 110 7x2,5 mm²
2	=GQ+LT01-WDB2	3x0,25 mm² 5 m
3		
4		
5		
6		
7		
8		
9		
10		

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZDU 2.5/4AN																				
24Vdc Control voltage											=PLC-KEC1	-X80:1	b	**1**	a				=XS+LT01-XS1	C2										2	=GD24&EFS/1.1
											=PLC-KE1	L	c																		
											=PLC-KE11	L	d																		
24Vdc Control voltage	BN										=GQ+LT01-XDB1	1	b	**2**	a				=GQ+LT01-XDB1	1									BN		=GD24&EFS/1.1
		BN									=XF01+.HS01-XD1	1	c																		
			BN								=XF01+.HS01-XD2	1	d																		
24Vdc Control voltage													b	**3**	a																=GD24&EFS/1.2
													c																		
													d																		

1 3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.X01-XD.22	==1005811	=REPORT	&EMA2	
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Project-related evaluations	Terminal diagram	
				Drawing number 1005811	Version				+LT01.X01	Page 2	
Modification	Date	Name	Creator AK Andreas Krischker				last Editor AK Andreas Krischker	Date 25.09.2024	lower tool 1	Sheet 96 from 164	

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

Terminal diagram
==1005811+LT01.X01-XD.24

Function:
Installation location: Terminal box lower tool 1

1																						1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²
2																						2	
3																						3	
4																						4	
5																						5	
6																						6	
7																						7	
8																						8	
9																						9	
10																						10	
Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZDU 2.5/4AN																				
Emergency stop general											=PLC-KE12	L	b	**1**	a				=XS+LT01-XS1	C3										3	=GD24&EFS/1.4
													c																			
													d																			
Emergency stop general													b	**2**	a																=GD24&EFS/1.4
													c																			
													d																			

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.X01-XD.24	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+LT01.X01	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 97 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

Terminal diagram
==1005811+LT01.X01-XD.25

Function:
Installation location: Terminal box lower tool 1

1																						1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²
2																						2	
3																						3	
4																						4	
5																						5	
6																						6	
7																						7	
8																						8	
9																						9	
10																						10	
Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZDU 2.5/4AN																				
Emergency Stop LT01											=PLC-KE13	L	b	**1**	a				=XS+LT01-XS1	C4										4	=GD24&EFS/1.5
													c																			
													d																			
Emergency stop insert area													b	**2**	a																=GD24&EFS/1.6
													c																			
													d																			

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.X01-XD.25	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+LT01.X01	Page 4
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 98 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

Terminal diagram
==1005811+LT01.X01-XEA.1

Function:
Installation location: Terminal box lower tool 1

1																								=GD24-WDB1 CLASSIC 110 7x2,5 mm²
2																								
3																								
4																								
5																								
6																								
7																								
8																								
9																								
10																								
Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZPE 2.5/4AN																				
PE													b	1 ⏚	a				=XS+LT01-XS1	PE1										GNYE	=GD24&EFS/1.4
													c																		
													d																		
PE													b	2 ⏚	a																=GD24&EFS/1.4
													c																		
													d																		

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.X01-XEA.1	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+LT01.X01	Page 5
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 99 from 164

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
+LT01.X01 **-U1**	Bus enclosure KX 600x300x155, without gland plate	(==1005811+LT01.X01.S1)
+LT01.X01 **-U2**	Mounting plate KX 600x300 mm	(==1005811+LT01.X01.S1)
+LT01.X01 **-U3**	Wire duct 80x100, STD KL	(==1005811+LT01.X01.S1)
+LT01.X01 **-UA1**	Mounting rail 35x7,5	(==1005811+LT01.X01.S1)
=PLC+LT01.X01 **-KE1**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.2
=PLC+LT01.X01 **-KE2**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.2
=PLC+LT01.X01 **-KE3**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.3
=PLC+LT01.X01 **-KE4**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.4
=PLC+LT01.X01 **-KE5**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.4
=PLC+LT01.X01 **-KE6**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.5
=PLC+LT01.X01 **-KE7**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.6
=PLC+LT01.X01 **-KE8**	ET 200SP AI 4xRTD/TC 2-/4-WIRE HF	=PLC&EFS/1.6
=PLC+LT01.X01 **-KE9**	ET 200SP AI 4xRTD/TC 2-/4-WIRE HF	=PLC&EFS/1.7
=PLC+LT01.X01 **-KE10**	ET 200SP AI 4xU/I 2-WIRE ST	=PLC&EFS/1.8
=PLC+LT01.X01 **-KE11**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/2.1
=PLC+LT01.X01 **-KE12**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/2.2
=PLC+LT01.X01 **-KE13**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/2.2
=PLC+LT01.X01 **-KE14**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/2.3
=PLC+LT01.X01 **-KEC1**	ET 200SP IM 155-6PN ST incl. BA 2xRJ45	=+&EFA/1.4

device tag	Article designation	X-Ref

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
HAGER.BA7100080	1 pc	Wire duct 80x100, STD KL	BA7100080		1
LAPP.1119407	1 meter	ÖLFLEX CLASSIC 110 7G2,5	1119407		2
RIT.1612000	1 pc	Bus enclosure KX 600x300x155, without gland plate	KX.1612000		3
RIT.1570800	1 pc	Mounting plate KX 600x300 mm	KX.1570800		4
SIE.6ES7131-6BF01-0BA0	7 pc	ET 200SP DI 8x24VDC ST	6ES7131-6BF01-0BA0		5
SIE.6ES7193-6BP20-0DA0	4 pc	ET 200SP Baseunit Typ A0 BU15-P16+A10+2D	6ES7193-6BP20-0DA0		6
SIE.6ES7193-6BP20-0BA0	8 pc	ET 200SP Baseunit Typ A0 BU15-P16+A10+2B	6ES7193-6BP20-0BA0		7
SIE.6ES7134-6JD00-0CA1	2 pc	ET 200SP AI 4xRTD/TC 2-/4-WIRE HF	6ES7134-6JD00-0CA1		8

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
SIE.6ES7193-6BP00-0BA1	2 pc	ET 200SP Baseunit Typ A1 BU15-P16+A0+2B/T	6ES7193-6BP00-0BA1		9
SIE.6ES7134-6HD01-0BA1	1 pc	ET 200SP AI 4xU/I 2-WIRE ST	6ES7134-6HD01-0BA1		10
SIE.6ES7132-6BF01-0BA0	4 pc	ET 200SP DQ 8x24VDC 0,5A ST	6ES7132-6BF01-0BA0		11
SIE.6ES7155-6AA01-0BN0	1 pc	ET 200SP IM 155-6PN ST incl. BA 2xRJ45	6ES7155-6AA01-0BN0		12
WEI.TS 35X7.5	1 pc	Mounting rail 35x7,5	TS 35X7.5/LL 2M/ST/ZN		13
WEI.1608570000	10 pc	Feed-through serial terminal ZDU 2.5/4AN	ZDU 2.5/4AN		14
WEI.9540000000	6 pc	End stop ZEW 35	ZEW 35		15
WEI.1608800000	5 pc	End plate ZAP/TW 3	ZAP/TW 3		16

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
WEI.1608660000	2 pc	Modular PE terminal blocks ZPE 2.5/4AN	ZPE 2.5/4AN		17

connector overview

3CON Anlagenbau GmbH

Kleinfeld 16
A-6341 Ebbs

Plug designation	Function text	Plug					Page of plug diagram
		first	last	Total PE	Total N	Total number	
=EB-XS1		+	-	0	0	2	
=EB-XS2		+	-	0	0	2	
=EB-XS3		+	-	0	0	2	
=EB-XS4		+	-	0	0	2	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=EB-XS1			Device marking	1674760000	Weidmueller	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=EB-XS2			Device marking	1674760000	Weidmueller	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=EB-XS3			Device marking	1674760000	Weidmueller	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=EB-XS4			Device marking	1674760000	Weidmueller	

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
=XF01+LT01.HS01 **-XD1**	Passive sensor- / actuator-distributor 10xM8 3pol, 10IO	=XF01+LT01&EFS1/1.1
=XF01+LT01.HS01 **-XD2**	Passive sensor- / actuator-distributor 10xM8 3pol, 10IO	=XF01+LT01&EFS1/1.4
=M25+LT01.HS01 **-BGB1**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/2.2
=M25+LT01.HS01 **-BGB2**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/2.3
=M25+LT01.HS01 **-BGB3**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/2.4
=M25+LT01.HS01 **-BGB4**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/2.5
=M25+LT01.HS01 **-BGB5**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.0
=M25+LT01.HS01 **-BGB6**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.1
=M25+LT01.HS01 **-BGB7**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.2
=M25+LT01.HS01 **-BGB8**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.3
=M25+LT01.HS01 **-BGB9**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.4
=M25+LT01.HS01 **-BGB10**	Proximity sensor Cylinder, M8 3-pin, straight	=M25+LT01&EFS1/3.5
=M25+LT01.HS01 **-KHB1**	Single valve VUVG, P53C	=M25+LT01&EFS1/4.0
=M25+LT01.HS01 **-KHB2**	Single valve VUVG, P53C	=M25+LT01&EFS1/4.2
=M25+LT01.HS01 **-WX1**	Y-distributor T-coupler M8-male 3p/2x M8-female 3p	=M25+LT01&EFS1/2.2
=M25+LT01.HS01 **-WX2**	Y-distributor T-coupler M8-male 3p/2x M8-female 3p	=M25+LT01&EFS1/2.4
=M25+LT01.HS01 **-WX3**	Y-distributor T-coupler M8-male 3p/2x M8-female 3p	=M25+LT01&EFS1/3.0
=M25+LT01.HS01 **-WX4**	Y-distributor T-coupler M8-male 3p/2x M8-female 3p	=M25+LT01&EFS1/3.2
=M51+LT01.HS01 **-BGB11**	Proximity sensor Cylinder, M8 3-pin, straight	=M51+LT01&EFS1/3.0
=M51+LT01.HS01 **-BGB12**	Proximity sensor Cylinder, M8 3-pin, straight	=M51+LT01&EFS1/3.1
=M51+LT01.HS01 **-BGB13**	Proximity sensor Cylinder, M8 3-pin, straight	=M51+LT01&EFS1/3.2
=M51+LT01.HS01 **-BGB14**	Proximity sensor Cylinder, M8 3-pin, straight	=M51+LT01&EFS1/3.3
=M51+LT01.HS01 **-KHB3**	Single valve VUVG, P53C	=M51+LT01&EFS1/5.0
=M51+LT01.HS01 **-KHB4**	Single valve VUVG, P53C	=M51+LT01&EFS1/5.2

device tag	Article designation	X-Ref

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
BAL.BCC0K8C	14 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 5m	BCC M313-0000-10-001-PX0334-050-C003		1
BAL.BCC0KKP	8 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 10m	BCC M313-0000-10-001-PX0334-100-C003		2
FES.SV_VUVG_P53C	4 pc	Single valve VUVG, P53C			3
MURR.8000-80060-0000000	2 pc	Passive sensor- / actuator-distributor 10xM8 3pol, 10IO	8000-80060-0000000		4
MURR.7000-88621-0000000	4 pc	Y-distributor T-coupler M8-male 3p/2x M8-female 3p	7000-88621-0000000		5
MURR.7000-08325-0000000	4 pc	Cut clamp Pin M8 3pol straight, 0.25-0.5mm²	7000-08325-0000000		6
SMC.D-M9PSAPC-595	14 pc	Proximity sensor Cylinder, M8 3-pin, straight	D-M9PSAPC-595		7
SMR.AN10114500	4 pc	Compensation line Extension, NiCr-Ni Typ "K"	AN10114500		8

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
WEI.1674760000_1pcs	8 pc	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	1674760000		9

connector overview

3CON Anlagenbau GmbH

Kleinfeld 16
A-6341 Ebbs

Plug designation	Function text	Plug					Page of plug diagram
		first	last	Total PE	Total N	Total number	
=XS-XS1	Data	PE1	F2	2	0	40	
=XS-XS2	Heating system	PE1	F5	2	0	38	
=GQ-XDB1				0	0	0	
=GQ-XDB2				0	0	0	
=GQ-XDB3				0	0	0	
=GQ-XDB4				0	0	0	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS1	10011715		Hinged frame	09 14 024 0371	HARTING Technology Group	
	10010866		Pin module	09 14 002 3001	HARTING Technology Group	
	10010875	a	Pin module	09 15 004 3013	HARTING Technology Group	
	10010925	c	Pin module	09 14 008 2633	HARTING Technology Group	
	10010927	d;e	Pin module	09 14 012 2632	HARTING Technology Group	
	10011993	f	Pin module	09 14 002 2646	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=XS-XS2	10011715		Hinged frame	09 14 024 0371	HARTING Technology Group	
	10010925	a;b	Pin module	09 14 008 2633	HARTING Technology Group	
	10010868	c;d;e;f	Pin module	09 14 005 2616	HARTING Technology Group	
	10008757		Docking frame	09 30 024 1701	HARTING Technology Group	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB1	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB2	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB3	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Connector layout plan

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F01_Stecker_V01

Reference indicator	ERP-number	Placement	Designation	Type number	Manufacturer	Ordernumber supplier
=GQ-XDB4	10047254		Cut clamp	SACC-M 8MS-3QO-0,5-M	Phoenix Contact	

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
=EA+UT01 **-BTA1**	PT100 Contact resistance thermometer, moveable	=EA&EFS/1.0
=GQ+UT01 **-BGB1**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.0
=GQ+UT01 **-BGB2**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.1
=GQ+UT01 **-BGB3**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.2
=GQ+UT01 **-BGB4**	Pressure transmitter SPTE, 0-10V, 0--1bar	=GQ&EFS/1.4
=BA05+UT01 **-BGB1**	Measuring Amplifier Fiber optic, M8 4pin	=BA05&EFS/1.0
=BA05+UT01 **-BGB2**	Measuring Amplifier Fiber optic, M8 4pin	=BA05&EFS/1.1
=M25+UT01 **-BGB1**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/3.0
=M25+UT01 **-BGB2**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/3.1
=M25+UT01 **-BGB3**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/3.2
=M25+UT01 **-BGB4**	Inductive sensor IE5366, M8 3-pin	=M25&EFS1/3.3
=M25+UT01 **-BS1**	transmitter	=M25&EFS1/1.6
=M25+UT01 **-BS2**	transmitter	=M25&EFS1/2.6
=M25+UT01 **-MA1**	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	=M25&EFS1/1.0
=M25+UT01 **-MA2**	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	=M25&EFS1/2.0
=M51+UT01 **-BGB1**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.0
=M51+UT01 **-BGB2**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.1
=M51+UT01 **-BGB3**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.2
=M51+UT01 **-BGB4**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/1.3
=M51+UT01 **-BGB5**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.0
=M51+UT01 **-BGB6**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.1
=M51+UT01 **-BGB7**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.2
=M51+UT01 **-BGB8**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.3
=M51+UT01 **-BGB9**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.4

device tag	Article designation	X-Ref
=M51+UT01 **-BGB10**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.5
=M51+UT01 **-BGB11**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.6
=M51+UT01 **-BGB12**	Proximity sensor Cylinder, M8 3-pin, straight	=M51&EFS1/2.7
=M51+UT01 **-KHB1**	Single valve VUVG, P53C	=M51&EFS1/3.0
=M51+UT01 **-KHB2**	Single valve VUVG, P53C	=M51&EFS1/3.2
=M51+UT01 **-KHB3**	Single valve VUVG, P53C	=M51&EFS1/3.4

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
BAL.BCC0K8C	20 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 5m	BCC M313-0000-10-001-PX0334-050-C003		1
BAL.BCC0K8J	2 pc	M8 4pin straight Sensor-/Aktor-Leitungen, 5m	BCC M314-0000-10-003-PX0434-050-C003		2
BAL.BCC0KKP	6 pc	M8 3pin straight Sensor-/Aktor-Leitungen, 10m	BCC M313-0000-10-001-PX0334-100-C003		3
FES.571477	4 pc	Pressure transmitter SPTE, 0-10V, 0--1bar	SPTE-V1R-Q4-V-2.5K		4
FES.566661	4 pc	Valve cable	NEBV-H1G2-P-5-N-LE2		5
FES.SV_VUVG_P53C	3 pc	Single valve VUVG, P53C			6
HAGER.KN26N	1 pc	Quick-Connect terminal N-teminal 6x25mm², 20x4mm²	KN26N		7
HAGER.KN00A	1 pc	Quick-Connect terminal Adapter	KN00A		8

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
HAR.09 14 024 0371	2 pc	Hinged frame Size: 24 B, 6 Module a-f	09 14 024 0371		9
HAR.09 14 002 3001	1 pc	Pin module modular Quintax	09 14 002 3001		10
HAR.09 15 004 3013	1 pc	Pin module modular Quintax, 4pin, 10A, shielded, without crimp contacts	09 15 004 3013		11
HAR.09 14 008 2633	3 pc	Pin module modular, 8pin, 16A, Quick-Lock connection	09 14 008 2633		12
HAR.09 14 012 2632	2 pc	Pin module modular, 12pin, 10A, Quick-Lock connection	09 14 012 2632		13
HAR.09 14 002 2646	1 pc	Pin module modular, 2pin 70A, 6-16mm², axial screw connection	09 14 002 2646		14
HAR.09 30 024 1701	2 pc	Docking frame Size: 24 B	09 30 024 1701		15
HAR.09 14 005 2616	4 pc	Pin module modular, 5pin, 16A, cage clamp connection	09 14 005 2616		16

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
IFM.IE5366	4 pc	Inductive sensor IE5366, M8 3-pin	IEB3002BBPKG/V4A/AS		17
IKK.BM02111000111	2 meter	Brake motor cable Übersetzung fehlt	BM02111000111		18
IKK.AKXH101000000	2 meter	Encoder cable Übersetzung fehlt	AKXH101000000		19
JUM.TN 00635743	1 pc	PT100 Contact resistance thermometer, moveable	902550/99-378-1003-1-11-5000/315		20
KEY.FS-N11CP	2 pc	Measuring Amplifier Fiber optic, M8 4pin	FS-N11CP		21
KEY.FU-6F	2 pc	Fiber optic sensor	FU-6F		22
LAPP.1119303	2 meter	ÖLFLEX CLASSIC 110 3G1,5	1119303		23
MURR.7000-14541-7960500	1 pc	Ethernet M12, male, d-cod, open end, 5m	7000-14541-7960500		24

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
MURR.7000-08325-0000000	4 pc	Cut clamp Pin M8 3pol straight, 0.25-0.5mm²	7000-08325-0000000		25
PXC.SACC-M 8MS-3QO-0,5-M	4 pc	Cut clamp Pin M8 3pol straight, 0.25-0.5mm²	SACC-M 8MS-3QO-0,5-M		26
SEW.GEBER	2 pc	transmitter			27
SMC.D-M9PSAPC-595	12 pc	Proximity sensor Cylinder, M8 3-pin, straight	D-M9PSAPC-595		28
WEI.1674760000_1pcs	2 pc	Device marking ESG 9/17 K MC NE WS, Self-adhesive, 17 mm, PA 66, white	1674760000		29

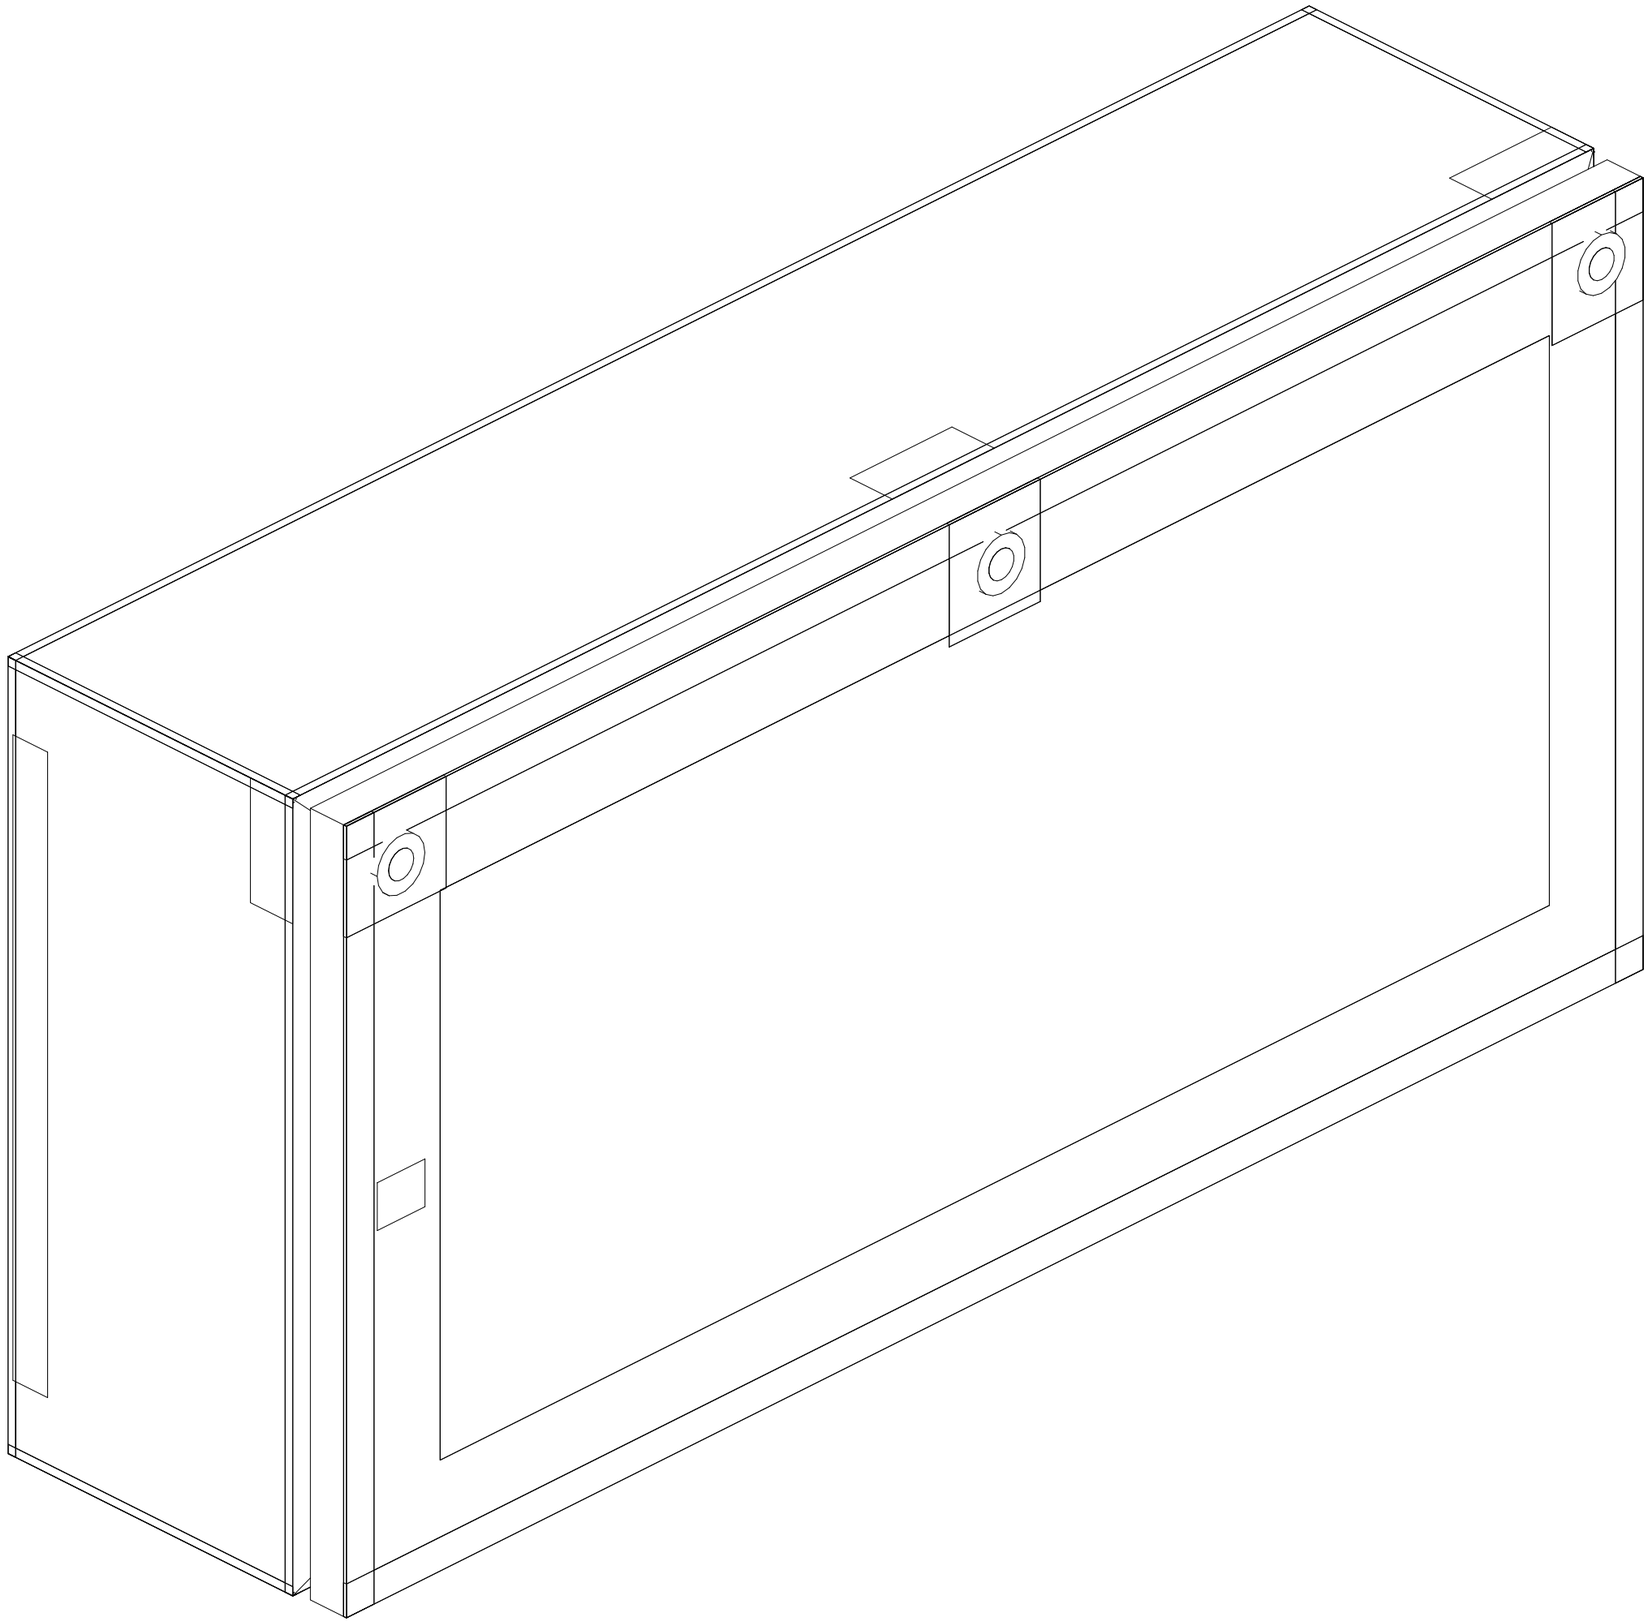

UT01.X01

+UT01&EPC1/4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	UT01.X01		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+UT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		Upper tool 1	Sheet 124 from 164

Enclosure legend

Item n.	Device tag	Type number
14	PLC-CFA1	pure.box 3
15	PLC-KFA1	RIF-0-RPT-24DC/21
16	PLC-KEC1	6ES7155-6AA01-0BN0
54	PLC-KE1	6ES7193-6BP20-0DA0
55	PLC-KE1	6ES7131-6BF01-0BA0
56	PLC-KE2	6ES7193-6BP20-0BA0
57	PLC-KE2	6ES7131-6BF01-0BA0
58	PLC-KE3	6ES7193-6BP20-0BA0
59	PLC-KE3	6ES7131-6BF01-0BA0
60	PLC-KE4	6ES7193-6BP00-0BA1
61	PLC-KE4	6ES7134-6JD00-0CA1
62	PLC-KE5	6ES7193-6BP20-0BA0
63	PLC-KE5	6ES7134-6HD01-0BA1
64	PLC-KE6	6ES7193-6BP20-0DA0
65	PLC-KE6	6ES7132-6BF01-0BA0
66	PLC-KE7	6ES7193-6BP20-0DA0
67	PLC-KE7	6ES7132-6BF01-0BA0
68	PLC-KE8	6ES7193-6BP20-0DA0
69	PLC-KE8	6ES7132-6BF01-0BA0

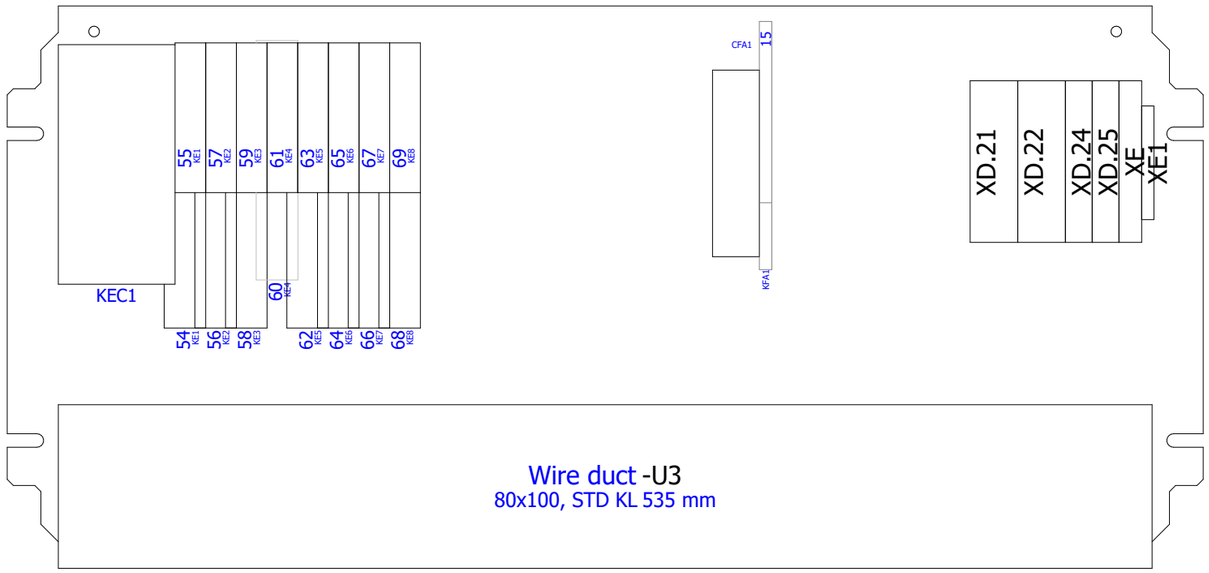

S1:Montageplatte

Enclosure legend

12			
Item number	BMK	Type number	Designation
12	-U3	BA7100080	Verdrahtungskanal 80x100, STD KL
13	-UA1	TS 35X7.5/LL 2M/ST/ZN	Tragschiene 35x7,5

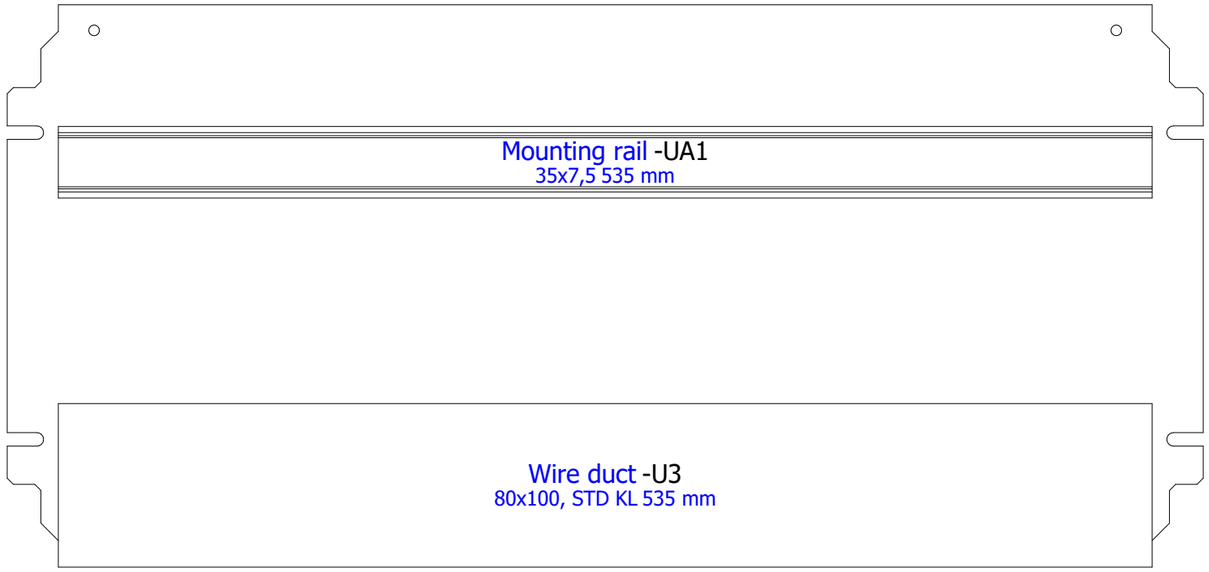

S1:Montageplatte

6

&EMA1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+UT01.X01	Page 7
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		Upper tool 1	Sheet 126 from 164

Terminal-strip overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F14_002_V01

Terminal strip	Function text	Terminals					Page of the terminal diagram
		first	last	Total PE	Total N	Total number	
-XD.21		1	3	0	0	3	==1005811=REPORT+UT01.X01&EMA2/1
-XD.22		1	3	0	0	3	==1005811=REPORT+UT01.X01&EMA2/2
-XD.24		1	1	0	0	1	==1005811=REPORT+UT01.X01&EMA2/3
-XD.25		1	1	0	0	1	==1005811=REPORT+UT01.X01&EMA2/4
-XE		1	1	1	0	1	==1005811=REPORT+UT01.X01&EMA2/5

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

Terminal diagram
==1005811+UT01.X01-XD.21

Function:
Installation location: Terminal box upper tool 1

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

Function text	1	2	3	4	5	6	7	8	9	10
GND										
GND										
GND										

1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²
2	
3	
4	
5	
6	
7	
8	
9	
10	

Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
ZDU 2.5/4AN																				
=PLC-KEC1	-X80:2	b	**1**	a				=XS+UT01-XS1	C1										1	=GD24&EFS/1.1
=PLC-KE1	9A	c																		
=PLC-KE6	9A	d																		
=PLC-KE8	9A	b	**2**	a				=PLC-KE7	9A											=GD24&EFS/1.1
		c																		
		d																		
		b	**3**	a				=PLC-CFA1	2											=GD24&EFS/1.2
		c																		
		d																		

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+UT01.X01-XD.21	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+UT01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	Upper tool 1	Sheet 128 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=GQ+UT01-WDB4	3x0,25 mm² 5 m
2	=GQ+UT01-WDB6	3x0,25 mm² 5 m
3	=GQ+UT01-WDB8	3x0,25 mm² 5 m
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+UT01.X01-XD.22

Function:
Installation location: Terminal box upper tool 1

1	=GD24-WDB1	CLASSIC 110 7x2,5 mm²
2	=GQ+UT01-WDB2	3x0,25 mm² 5 m
3		
4		
5		
6		
7		
8		
9		
10		

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											ZDU 2.5/4AN																				
24Vdc Control voltage											=PLC-KEC1	-X80:1	b	**1**	a				=XS+UT01-XS1	C2										2	=GD24&EFS/1.1
											=PLC-KE1	L	c																		
											=PLC-KE6	L	d																		
24Vdc Control voltage	BN										=GQ+UT01-XDB1	1	b	**2**	a				=GQ+UT01-XDB1	1									BN		=GD24&EFS/1.1
		BN									=GQ+UT01-XDB1	1	c																		
			BN								=GQ+UT01-XDB1	1	d																		
24Vdc Control voltage													b	**3**	a				=PLC-KFA1	11											=GD24&EFS/1.2
													c																		
													d																		

1 3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+UT01.X01-XD.22	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Project-related evaluations	Terminal diagram
				Drawing number 1005811	Version				+UT01.X01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker				last Editor AK Andreas Krischker	Date 04.09.2024	Upper tool 1	Sheet 129 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

Function text	1	2	3	4	5	6	7	8	9	10
Emergency stop general										

Terminal diagram
==1005811+UT01.X01-XD.24

Function:

Installation location: Terminal box upper tool 1

Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection
ZDU 2.5/4AN									
=PLC-KE7	L	b	**1**	a				=XS+UT01-XS1	C3
		c							
		d							

		10	9	8	7	6	5	4	3	2	1	Page / column
1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²											
2												
3												
4												
5												
6												
7												
8												
9												
10												
											3	=GD24&EFS/1.4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+UT01.X01-XD.24	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+UT01.X01	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	Upper tool 1	Sheet 130 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

Function text	1	2	3	4	5	6	7	8	9	10
Emergency stop insert area										

Terminal diagram
==1005811+UT01.X01-XD.25

Function:

Installation location: Terminal box upper tool 1

Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection
ZDU 2.5/4AN									
=PLC-KE8	L	b	**1**	a				=XS+UT01-XS1	C4
		c							
		d							

		10	9	8	7	6	5	4	3	2	1	Page / column
1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²											
2												
3												
4												
5												
6												
7												
8												
9												
10												
										4		=GD24&EFS/1.5

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

Terminal diagram
==1005811+UT01.X01-XE

Function:
Installation location: Terminal box upper tool 1

1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

Function text	1	2	3	4	5	6	7	8	9	10
PE										

Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection
ZPE 2.5/4AN									
		b	1 ⏚	a				=XS+UT01-XS1	PE1
		c							
		d							

1	=GD24-WDB1 CLASSIC 110 7x2,5 mm²
2	
3	
4	
5	
6	
7	
8	
9	
10	

10	9	8	7	6	5	4	3	2	1	Page / column
									GNYE	=GD24&EFS/1.4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+UT01.X01-XE	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Project-related evaluations	Terminal diagram
				Drawing number 1005811	Version				+UT01.X01	Page 5
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 04.09.2024	Upper tool 1	Sheet 132 from 164

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
+UT01.X01 **-U1**	Bus enclosure KX 600x300x155, without gland plate	(==1005811+UT01.X01.S1)
+UT01.X01 **-U2**	Mounting plate KX 600x300 mm	(==1005811+UT01.X01.S1)
+UT01.X01 **-U3**	Wire duct 80x100, STD KL	(==1005811+UT01.X01.S1)
+UT01.X01 **-UA1**	Mounting rail 35x7,5	(==1005811+UT01.X01.S1)
=PLC+UT01.X01 **-CFA1**	Web- and Applikationsserver	=+&EFA/2.7
=PLC+UT01.X01 **-KE1**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.2
=PLC+UT01.X01 **-KE2**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.2
=PLC+UT01.X01 **-KE3**	ET 200SP DI 8x24VDC ST	=PLC&EFS/1.3
=PLC+UT01.X01 **-KE4**	ET 200SP AI 4xRTD/TC 2-/4-WIRE HF	=PLC&EFS/1.4
=PLC+UT01.X01 **-KE5**	ET 200SP AI 4xU/I 2-WIRE ST	=PLC&EFS/1.4
=PLC+UT01.X01 **-KE6**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/1.5
=PLC+UT01.X01 **-KE7**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/1.6
=PLC+UT01.X01 **-KE8**	ET 200SP DQ 8x24VDC 0,5A ST	=PLC&EFS/1.6
=PLC+UT01.X01 **-KEC1**	ET 200SP IM 155-6PN ST incl. BA 2xRJ45	=+&EFA/2.7
=PLC+UT01.X01 **-KFA1**	Relais 6A 250Vac, 1 PDT ,24Vdc	=PLC&EFS/2.8

device tag	Article designation	X-Ref

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
HAGER.BA7100080	1 pc	Wire duct 80x100, STD KL	BA7100080		1
LAPP.1119407	1 meter	ÖLFLEX CLASSIC 110 7G2,5	1119407		2
LAPP.2170894	5,00 meter	ETHERLINE PN Cat.5 FD Profinet	2170894		3
PXC.2903370	1 pc	Relais 6A 250Vac, 1 PDT ,24Vdc	RIF-0-RPT-24DC/21		4
RIT.1612000	1 pc	Bus enclosure KX 600x300x155, without gland plate	KX.1612000		5
RIT.1570800	1 pc	Mounting plate KX 600x300 mm	KX.1570800		6
SIE.6ES7131-6BF01-0BA0	3 pc	ET 200SP DI 8x24VDC ST	6ES7131-6BF01-0BA0		7
SIE.6ES7193-6BP20-0DA0	4 pc	ET 200SP Baseunit Typ A0 BU15-P16+A10+2D	6ES7193-6BP20-0DA0		8

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
SIE.6ES7193-6BP20-0BA0	3 pc	ET 200SP Baseunit Typ A0 BU15-P16+A10+2B	6ES7193-6BP20-0BA0		9
SIE.6ES7134-6JD00-0CA1	1 pc	ET 200SP AI 4xRTD/TC 2-/4-WIRE HF	6ES7134-6JD00-0CA1		10
SIE.6ES7193-6BP00-0BA1	1 pc	ET 200SP Baseunit Typ A1 BU15-P16+A0+2B/T	6ES7193-6BP00-0BA1		11
SIE.6ES7134-6HD01-0BA1	1 pc	ET 200SP AI 4xU/I 2-WIRE ST	6ES7134-6HD01-0BA1		12
SIE.6ES7132-6BF01-0BA0	3 pc	ET 200SP DQ 8x24VDC 0,5A ST	6ES7132-6BF01-0BA0		13
SIE.6ES7155-6AA01-0BN0	1 pc	ET 200SP IM 155-6PN ST incl. BA 2xRJ45	6ES7155-6AA01-0BN0		14
WEI.TS 35X7.5	1 pc	Mounting rail 35x7,5	TS 35X7.5/LL 2M/ST/ZN		15
WEI.1608570000	8 pc	Feed-through serial terminal ZDU 2.5/4AN	ZDU 2.5/4AN		16

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
WEI.9540000000	6 pc	End stop ZEW 35	ZEW 35		17
WEI.1608800000	4 pc	End plate ZAP/TW 3	ZAP/TW 3		18
WEI.1608660000	1 pc	Modular PE terminal blocks ZPE 2.5/4AN	ZPE 2.5/4AN		19
WUT.50518	1 pc	Web- and Applikationsserver	pure.box 3		20

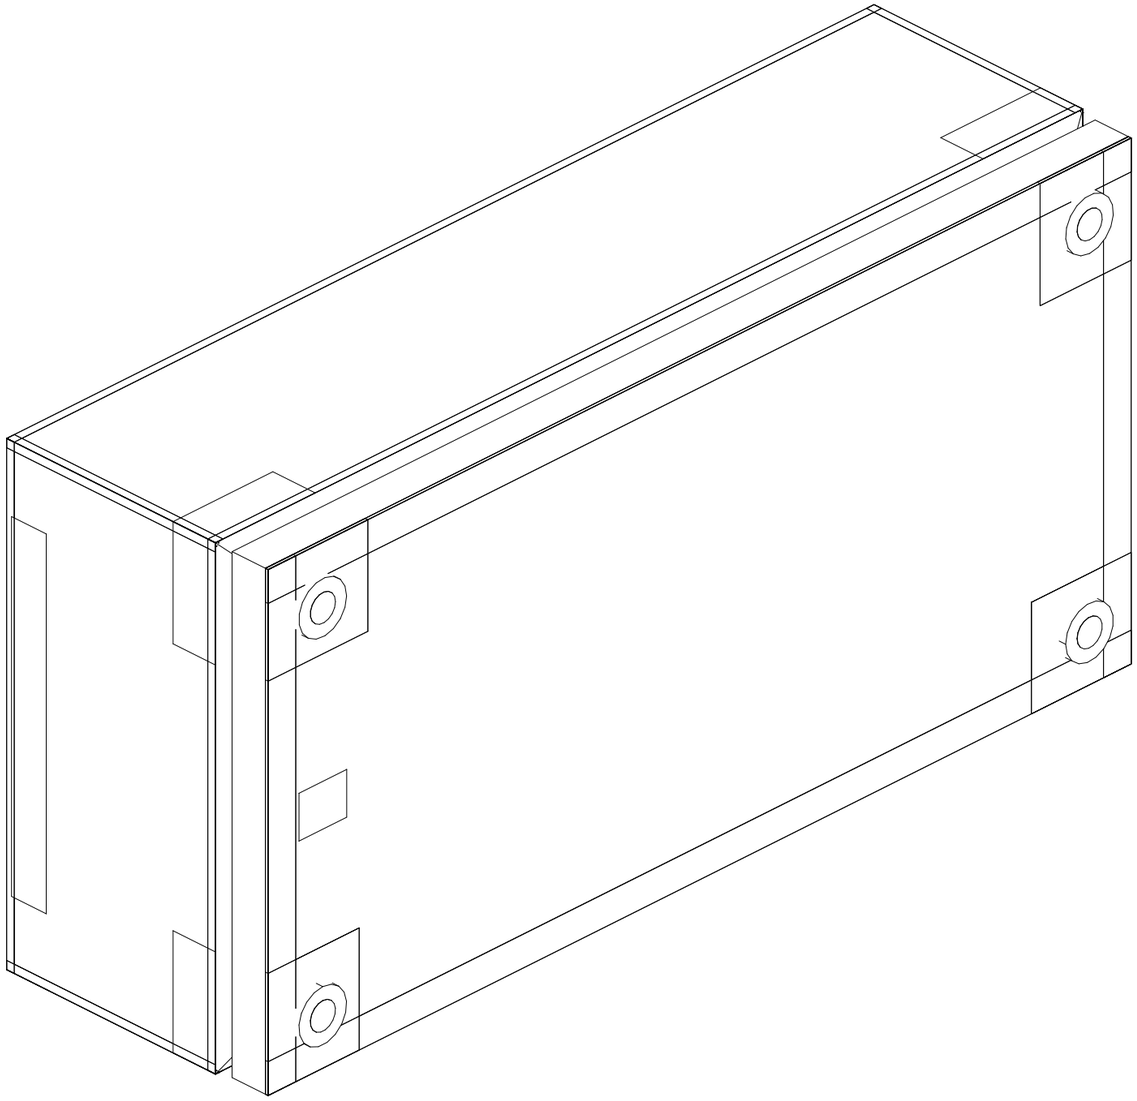

LT01.HS01.X01

+UT01.X01&EPC1/3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	LT01.HS01.X01		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.HS01.X01	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 137 from 164

S1:Montageplatte

1

4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.HS01.X01	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 138 from 164

Enclosure legend

9

Item number	BMK	Type number	Designation
15	-UA1	TS 35X7.5/LL 2M/ST/ZN	Tragschiene 35x7,5

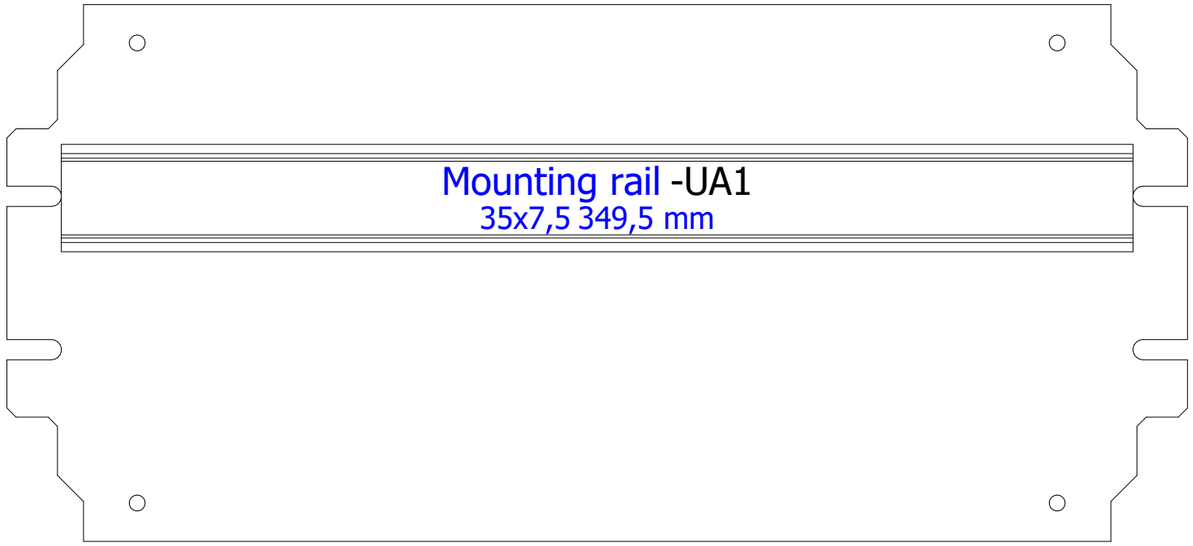

S1:Montageplatte

3

&EMA1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.HS01.X01	Page 4
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 139 from 164

Terminal-strip overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F14_002_V01

Terminal strip	Function text	Terminals					Page of the terminal diagram
		first	last	Total PE	Total N	Total number	
-XD.51		N	N60	60	61	181	==1005811=REPORT+LT01.HS01.X01&EMA2/1

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=GN+LT01-WDB2	H07V-K 1x16 mm²
2	=XS+LT01-WDB1	FD CLASSIC 810 25x1,5 mm²
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											2016-7114																				
	BU										=GN+LT01-X1	B	a	**N** (N)																	=EB+LT01.HS01&EFS/1.0
													b	**PE1** (⏚)	a																=EB+LT01.HS01&EFS/1.0
		1									=XS+LT01-XS2	B1	b	**1**	a				=EB+LT01.HS01-BTA1	1											=EB+LT01.HS01&EFS/1.0
													b	**N1** (N)	a				=EB+LT01.HS01-BTA1	2											=EB+LT01.HS01&EFS/1.0
													b	**PE2** (⏚)	a																=EB+LT01.HS01&EFS/1.0
		2									=XS+LT01-XS2	B2	b	**2**	a				=EB+LT01.HS01-BTA2	1											=EB+LT01.HS01&EFS/1.1
													b	**N2** (N)	a				=EB+LT01.HS01-BTA2	2											=EB+LT01.HS01&EFS/1.1
													b	**PE3** (⏚)	a																=EB+LT01.HS01&EFS/1.1
		3									=XS+LT01-XS2	B3	b	**3**	a				=EB+LT01.HS01-BTA3	1											=EB+LT01.HS01&EFS/1.1
													b	**N3** (N)	a				=EB+LT01.HS01-BTA3	2											=EB+LT01.HS01&EFS/1.1
													b	**PE4** (⏚)	a																=EB+LT01.HS01&EFS/1.1
		4									=XS+LT01-XS2	B4	b	**4**	a				=EB+LT01.HS01-BTA4	1											=EB+LT01.HS01&EFS/1.2
													b	**N4** (N)	a				=EB+LT01.HS01-BTA4	2											=EB+LT01.HS01&EFS/1.2
													b	**PE5** (⏚)	a																=EB+LT01.HS01&EFS/1.2
		5									=XS+LT01-XS2	B5	b	**5**	a				=EB+LT01.HS01-BTA5	1											=EB+LT01.HS01&EFS/1.2
													b	**N5** (N)	a				=EB+LT01.HS01-BTA5	2											=EB+LT01.HS01&EFS/1.2
													b	**PE6** (⏚)	a																=EB+LT01.HS01&EFS/1.2
		6									=XS+LT01-XS2	C1	b	**6**	a				=EB+LT01.HS01-BTA6	1											=EB+LT01.HS01&EFS/1.2
													b	**N6** (N)	a				=EB+LT01.HS01-BTA6	2											=EB+LT01.HS01&EFS/1.3
													b	**PE7** (⏚)	a																=EB+LT01.HS01&EFS/1.3
		7									=XS+LT01-XS2	C2	b	**7**	a				=EB+LT01.HS01-BTA7	1											=EB+LT01.HS01&EFS/1.3
													b	**N7** (N)	a				=EB+LT01.HS01-BTA7	2											=EB+LT01.HS01&EFS/1.3
													b	**PE8** (⏚)	a																=EB+LT01.HS01&EFS/1.3
		8									=XS+LT01-XS2	C3	b	**8**	a				=EB+LT01.HS01-BTA8	1											=EB+LT01.HS01&EFS/1.3

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB1 FD CLASSIC 810 25x1,5 mm²
2	
3	
4	
5	
6	
7	
8	
9	
10	

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N8** (N)	a				=EB+LT01.HS01-BTA8	2											=EB+LT01.HS01&EFS/1.4
													b	**PE9** (⏚)	a																=EB+LT01.HS01&EFS/1.4
	9										=XS+LT01-XS2	C4	b	**9**	a				=EB+LT01.HS01-BTA9	1											=EB+LT01.HS01&EFS/1.4
													b	**N9** (N)	a				=EB+LT01.HS01-BTA9	2											=EB+LT01.HS01&EFS/1.4
													b	**PE10** (⏚)	a																=EB+LT01.HS01&EFS/1.4
	10										=XS+LT01-XS2	C5	b	**10**	a				=EB+LT01.HS01-BTA10	1											=EB+LT01.HS01&EFS/1.4
													b	**N10** (N)	a				=EB+LT01.HS01-BTA10	2											=EB+LT01.HS01&EFS/1.5
													b	**PE11** (⏚)	a																=EB+LT01.HS01&EFS/1.5
	11										=XS+LT01-XS2	D1	b	**11**	a																=EB+LT01.HS01&EFS/1.5
													b	**N11** (N)	a																=EB+LT01.HS01&EFS/1.5
													b	**PE12** (⏚)	a																=EB+LT01.HS01&EFS/1.5
	12										=XS+LT01-XS2	D2	b	**12**	a																=EB+LT01.HS01&EFS/1.5
													b	**N12** (N)	a																=EB+LT01.HS01&EFS/1.6
													b	**PE13** (⏚)	a																=EB+LT01.HS01&EFS/1.6
	13										=XS+LT01-XS2	D3	b	**13**	a																=EB+LT01.HS01&EFS/1.6
													b	**N13** (N)	a																=EB+LT01.HS01&EFS/1.6
													b	**PE14** (⏚)	a																=EB+LT01.HS01&EFS/1.6
	14										=XS+LT01-XS2	D4	b	**14**	a																=EB+LT01.HS01&EFS/1.6
													b	**N14** (N)	a																=EB+LT01.HS01&EFS/1.6
													b	**PE15** (⏚)	a																=EB+LT01.HS01&EFS/1.7
	15										=XS+LT01-XS2	D5	b	**15**	a																=EB+LT01.HS01&EFS/1.7
													b	**N15** (N)	a																=EB+LT01.HS01&EFS/1.7
													b	**PE16** (⏚)	a																=EB+LT01.HS01&EFS/1.7
	16										=XS+LT01-XS2	E1	b	**16**	a																=EB+LT01.HS01&EFS/1.7

1 3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.HS01.X01-XD.51	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1	Drawing number 1005811	Version				Project-related evaluations	Terminal diagram
									+LT01.HS01.X01	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 142 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB1	FD CLASSIC 810 25x1,5 mm²
2	=XS+LT01-WDB2	FD CLASSIC 810 25x1,5 mm²
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N16**	a																=EB+LT01.HS01&EFS/1.7
													b	**PE17**	a																=EB+LT01.HS01&EFS/1.8
	17										=XS+LT01-XS2	E2	b	**17**	a																=EB+LT01.HS01&EFS/1.8
													b	**N17**	a																=EB+LT01.HS01&EFS/1.8
													b	**PE18**	a																=EB+LT01.HS01&EFS/1.8
	18										=XS+LT01-XS2	E3	b	**18**	a																=EB+LT01.HS01&EFS/1.8
													b	**N18**	a																=EB+LT01.HS01&EFS/1.8
													b	**PE19**	a																=EB+LT01.HS01&EFS/1.9
	19										=XS+LT01-XS2	E4	b	**19**	a																=EB+LT01.HS01&EFS/1.9
													b	**N19**	a																=EB+LT01.HS01&EFS/1.9
													b	**PE20**	a																=EB+LT01.HS01&EFS/1.9
	20										=XS+LT01-XS2	E5	b	**20**	a																=EB+LT01.HS01&EFS/1.9
													b	**N20**	a																=EB+LT01.HS01&EFS/1.9
													b	**PE21**	a																=EB+LT01.HS01&EFS/2.0
		1									=XS+LT01-XS3	1	b	**21**	a																=EB+LT01.HS01&EFS/2.0
													b	**N21**	a																=EB+LT01.HS01&EFS/2.0
													b	**PE22**	a																=EB+LT01.HS01&EFS/2.0
		2									=XS+LT01-XS3	2	b	**22**	a																=EB+LT01.HS01&EFS/2.1
													b	**N22**	a																=EB+LT01.HS01&EFS/2.1
													b	**PE23**	a																=EB+LT01.HS01&EFS/2.1
		3									=XS+LT01-XS3	3	b	**23**	a																=EB+LT01.HS01&EFS/2.1
													b	**N23**	a																=EB+LT01.HS01&EFS/2.1
													b	**PE24**	a																=EB+LT01.HS01&EFS/2.1
		4									=XS+LT01-XS3	4	b	**24**	a																=EB+LT01.HS01&EFS/2.2

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB2	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N24**	a																=EB+LT01.HS01&EFS/2.2
													b	**PE25**	a																=EB+LT01.HS01&EFS/2.2
	5										=XS+LT01-XS3	5	b	**25**	a																=EB+LT01.HS01&EFS/2.2
													b	**N25**	a																=EB+LT01.HS01&EFS/2.2
													b	**PE26**	a																=EB+LT01.HS01&EFS/2.2
	6										=XS+LT01-XS3	6	b	**26**	a																=EB+LT01.HS01&EFS/2.2
													b	**N26**	a																=EB+LT01.HS01&EFS/2.3
													b	**PE27**	a																=EB+LT01.HS01&EFS/2.3
	7										=XS+LT01-XS3	7	b	**27**	a																=EB+LT01.HS01&EFS/2.3
													b	**N27**	a																=EB+LT01.HS01&EFS/2.3
													b	**PE28**	a																=EB+LT01.HS01&EFS/2.3
	8										=XS+LT01-XS3	8	b	**28**	a																=EB+LT01.HS01&EFS/2.3
													b	**N28**	a																=EB+LT01.HS01&EFS/2.4
													b	**PE29**	a																=EB+LT01.HS01&EFS/2.4
	9										=XS+LT01-XS3	9	b	**29**	a																=EB+LT01.HS01&EFS/2.4
													b	**N29**	a																=EB+LT01.HS01&EFS/2.4
													b	**PE30**	a																=EB+LT01.HS01&EFS/2.4
	10										=XS+LT01-XS3	10	b	**30**	a																=EB+LT01.HS01&EFS/2.4
													b	**N30**	a																=EB+LT01.HS01&EFS/2.5
													b	**PE31**	a																=EB+LT01.HS01&EFS/2.5
	11										=XS+LT01-XS3	11	b	**31**	a																=EB+LT01.HS01&EFS/2.5
													b	**N31**	a																=EB+LT01.HS01&EFS/2.5
													b	**PE32**	a																=EB+LT01.HS01&EFS/2.5
	12										=XS+LT01-XS3	12	b	**32**	a																=EB+LT01.HS01&EFS/2.5

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB2	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N32**	a																=EB+LT01.HS01&EFS/2.6
													b	**PE33**	a																=EB+LT01.HS01&EFS/2.6
	13										=XS+LT01-XS3	13	b	**33**	a																=EB+LT01.HS01&EFS/2.6
													b	**N33**	a																=EB+LT01.HS01&EFS/2.6
													b	**PE34**	a																=EB+LT01.HS01&EFS/2.6
	14										=XS+LT01-XS3	14	b	**34**	a																=EB+LT01.HS01&EFS/2.6
													b	**N34**	a																=EB+LT01.HS01&EFS/2.6
													b	**PE35**	a																=EB+LT01.HS01&EFS/2.7
	15										=XS+LT01-XS3	15	b	**35**	a																=EB+LT01.HS01&EFS/2.7
													b	**N35**	a																=EB+LT01.HS01&EFS/2.7
													b	**PE36**	a																=EB+LT01.HS01&EFS/2.7
	16										=XS+LT01-XS3	16	b	**36**	a																=EB+LT01.HS01&EFS/2.7
													b	**N36**	a																=EB+LT01.HS01&EFS/2.7
													b	**PE37**	a																=EB+LT01.HS01&EFS/2.8
	17										=XS+LT01-XS3	17	b	**37**	a																=EB+LT01.HS01&EFS/2.8
													b	**N37**	a																=EB+LT01.HS01&EFS/2.8
													b	**PE38**	a																=EB+LT01.HS01&EFS/2.8
	18										=XS+LT01-XS3	18	b	**38**	a																=EB+LT01.HS01&EFS/2.8
													b	**N38**	a																=EB+LT01.HS01&EFS/2.8
													b	**PE39**	a																=EB+LT01.HS01&EFS/2.9
	19										=XS+LT01-XS3	19	b	**39**	a																=EB+LT01.HS01&EFS/2.9
													b	**N39**	a																=EB+LT01.HS01&EFS/2.9
													b	**PE40**	a																=EB+LT01.HS01&EFS/2.9
	20										=XS+LT01-XS3	20	b	**40**	a																=EB+LT01.HS01&EFS/2.9

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB3	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N40**	a																=EB+LT01.HS01&EFS/2.9
													b	**PE41**	a																=EB+LT01.HS01&EFS/3.0
	1										=XS+LT01-XS4	1	b	**41**	a				=EB+LT01.HS01-BTA11	1											=EB+LT01.HS01&EFS/3.0
													b	**N41**	a				=EB+LT01.HS01-BTA12	2											=EB+LT01.HS01&EFS/3.1
													b	**PE42**	a																=EB+LT01.HS01&EFS/3.1
	2										=XS+LT01-XS4	2	b	**42**	a				=EB+LT01.HS01-BTA13	1											=EB+LT01.HS01&EFS/3.1
													b	**N42**	a				=EB+LT01.HS01-BTA14	2											=EB+LT01.HS01&EFS/3.2
													b	**PE43**	a																=EB+LT01.HS01&EFS/3.2
	3										=XS+LT01-XS4	3	b	**43**	a				=EB+LT01.HS01-BTA15	1											=EB+LT01.HS01&EFS/3.2
													b	**N43**	a				=EB+LT01.HS01-BTA16	2											=EB+LT01.HS01&EFS/3.3
													b	**PE44**	a																=EB+LT01.HS01&EFS/3.3
	4										=XS+LT01-XS4	4	b	**44**	a				=EB+LT01.HS01-BTA17	1											=EB+LT01.HS01&EFS/3.3
													b	**N44**	a				=EB+LT01.HS01-BTA18	2											=EB+LT01.HS01&EFS/3.4
													b	**PE45**	a																=EB+LT01.HS01&EFS/3.4
	5										=XS+LT01-XS4	5	b	**45**	a				=EB+LT01.HS01-BTA19	1											=EB+LT01.HS01&EFS/3.4
													b	**N45**	a				=EB+LT01.HS01-BTA19	2											=EB+LT01.HS01&EFS/3.4
													b	**PE46**	a																=EB+LT01.HS01&EFS/3.4
	6										=XS+LT01-XS4	6	b	**46**	a				=EB+LT01.HS01-BTA20	1											=EB+LT01.HS01&EFS/3.4
													b	**N46**	a				=EB+LT01.HS01-BTA20	2											=EB+LT01.HS01&EFS/3.5
													b	**PE47**	a																=EB+LT01.HS01&EFS/3.5
	7										=XS+LT01-XS4	7	b	**47**	a				=EB+LT01.HS01-BTA21	1											=EB+LT01.HS01&EFS/3.5
													b	**N47**	a				=EB+LT01.HS01-BTA22	2											=EB+LT01.HS01&EFS/3.6
													b	**PE48**	a																=EB+LT01.HS01&EFS/3.6
	8										=XS+LT01-XS4	8	b	**48**	a				=EB+LT01.HS01-BTA23	1											=EB+LT01.HS01&EFS/3.6

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB3	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N48** (N)	a				=EB+LT01.HS01-BTA24	2											=EB+LT01.HS01&EFS/3.6
													b	**PE49** (⏚)	a																=EB+LT01.HS01&EFS/3.7
	9										=XS+LT01-XS4	9	b	**49**	a				=EB+LT01.HS01-BTA25	1											=EB+LT01.HS01&EFS/3.7
													b	**N49** (N)	a				=EB+LT01.HS01-BTA26	2											=EB+LT01.HS01&EFS/3.7
													b	**PE50** (⏚)	a																=EB+LT01.HS01&EFS/3.8
	10										=XS+LT01-XS4	10	b	**50**	a				=EB+LT01.HS01-BTA27	1											=EB+LT01.HS01&EFS/3.8
													b	**N50** (N)	a				=EB+LT01.HS01-BTA27	2											=EB+LT01.HS01&EFS/3.8
													b	**PE51** (⏚)	a																=EB+LT01.HS01&EFS/4.0
	11										=XS+LT01-XS4	11	b	**51**	a				=EB+LT01.HS01-BTA28	1											=EB+LT01.HS01&EFS/4.0
													b	**N51** (N)	a				=EB+LT01.HS01-BTA29	2											=EB+LT01.HS01&EFS/4.1
													b	**PE52** (⏚)	a																=EB+LT01.HS01&EFS/4.1
	12										=XS+LT01-XS4	12	b	**52**	a				=EB+LT01.HS01-BTA30	1											=EB+LT01.HS01&EFS/4.1
													b	**N52** (N)	a				=EB+LT01.HS01-BTA31	2											=EB+LT01.HS01&EFS/4.2
													b	**PE53** (⏚)	a																=EB+LT01.HS01&EFS/4.2
	13										=XS+LT01-XS4	13	b	**53**	a				=EB+LT01.HS01-BTA32	1											=EB+LT01.HS01&EFS/4.2
													b	**N53** (N)	a				=EB+LT01.HS01-BTA33	2											=EB+LT01.HS01&EFS/4.3
													b	**PE54** (⏚)	a																=EB+LT01.HS01&EFS/4.3
	14										=XS+LT01-XS4	14	b	**54**	a				=EB+LT01.HS01-BTA34	1											=EB+LT01.HS01&EFS/4.3
													b	**N54** (N)	a				=EB+LT01.HS01-BTA35	2											=EB+LT01.HS01&EFS/4.4
													b	**PE55** (⏚)	a																=EB+LT01.HS01&EFS/4.4
	15										=XS+LT01-XS4	15	b	**55**	a				=EB+LT01.HS01-BTA36	1											=EB+LT01.HS01&EFS/4.4
													b	**N55** (N)	a				=EB+LT01.HS01-BTA36	2											=EB+LT01.HS01&EFS/4.4
													b	**PE56** (⏚)	a																=EB+LT01.HS01&EFS/4.4
	16										=XS+LT01-XS4	16	b	**56**	a				=EB+LT01.HS01-BTA37	1											=EB+LT01.HS01&EFS/4.4

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB3	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X01-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N56** N	a				=EB+LT01.HS01-BTA37	2											=EB+LT01.HS01&EFS/4.5
													b	**PE57** ⏚	a																=EB+LT01.HS01&EFS/4.5
	17										=XS+LT01-XS4	17	b	**57**	a				=EB+LT01.HS01-BTA38	1											=EB+LT01.HS01&EFS/4.5
													b	**N57** N	a				=EB+LT01.HS01-BTA39	2											=EB+LT01.HS01&EFS/4.6
													b	**PE58** ⏚	a																=EB+LT01.HS01&EFS/4.6
	18										=XS+LT01-XS4	18	b	**58**	a				=EB+LT01.HS01-BTA40	1											=EB+LT01.HS01&EFS/4.6
													b	**N58** N	a				=EB+LT01.HS01-BTA40	2											=EB+LT01.HS01&EFS/4.6
													b	**PE59** ⏚	a																=EB+LT01.HS01&EFS/4.6
	19										=XS+LT01-XS4	19	b	**59**	a				=EB+LT01.HS01-BTA41	1											=EB+LT01.HS01&EFS/4.6
													b	**N59** N	a				=EB+LT01.HS01-BTA42	2											=EB+LT01.HS01&EFS/4.7
													b	**PE60** ⏚	a																=EB+LT01.HS01&EFS/4.7
	20										=XS+LT01-XS4	20	b	**60**	a				=EB+LT01.HS01-BTA43	1											=EB+LT01.HS01&EFS/4.7
													b	**N60** N	a				=EB+LT01.HS01-BTA44	2											=EB+LT01.HS01&EFS/4.8

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.HS01.X01-XD.51	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	Terminal diagram
					Drawing number 1005811	Version				+LT01.HS01.X01	Page 8
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 148 from 164

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
+LT01.HS01.X01 **-U1**	Terminal box KX 400x200x120, without gland plate	(==1005811+LT01.HS01.X01.S1)
+LT01.HS01.X01 **-U2**	Mounting plate KX 400x200 mm	(==1005811+LT01.HS01.X01.S1)
+LT01.HS01.X01 **-UA1**	Mounting rail 35x7,5	(==1005811+LT01.HS01.X01.S1)

device tag	Article designation	X-Ref

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
RIT.1504000	1 pc	Terminal box KX 400x200x120, without gland plate	KX.1504000		1
RIT.1564800	1 pc	Mounting plate KX 400x200 mm	KX.1564800		2
WAGO.2016-7114	1 pc	Neutral conductor terminal block 16mm²	2016-7114		3
WAGO.2003-7641	60 pc	Multilevel installation terminal block 2.5 mm², NT/L/PE, 24.0 A, gray	2003-7641		4
WEI.TS 35X7.5	1 pc	Mounting rail 35x7,5	TS 35X7.5/LL 2M/ST/ZN		5
WEI.9540000000	1 pc	End stop ZEW 35	ZEW 35		6

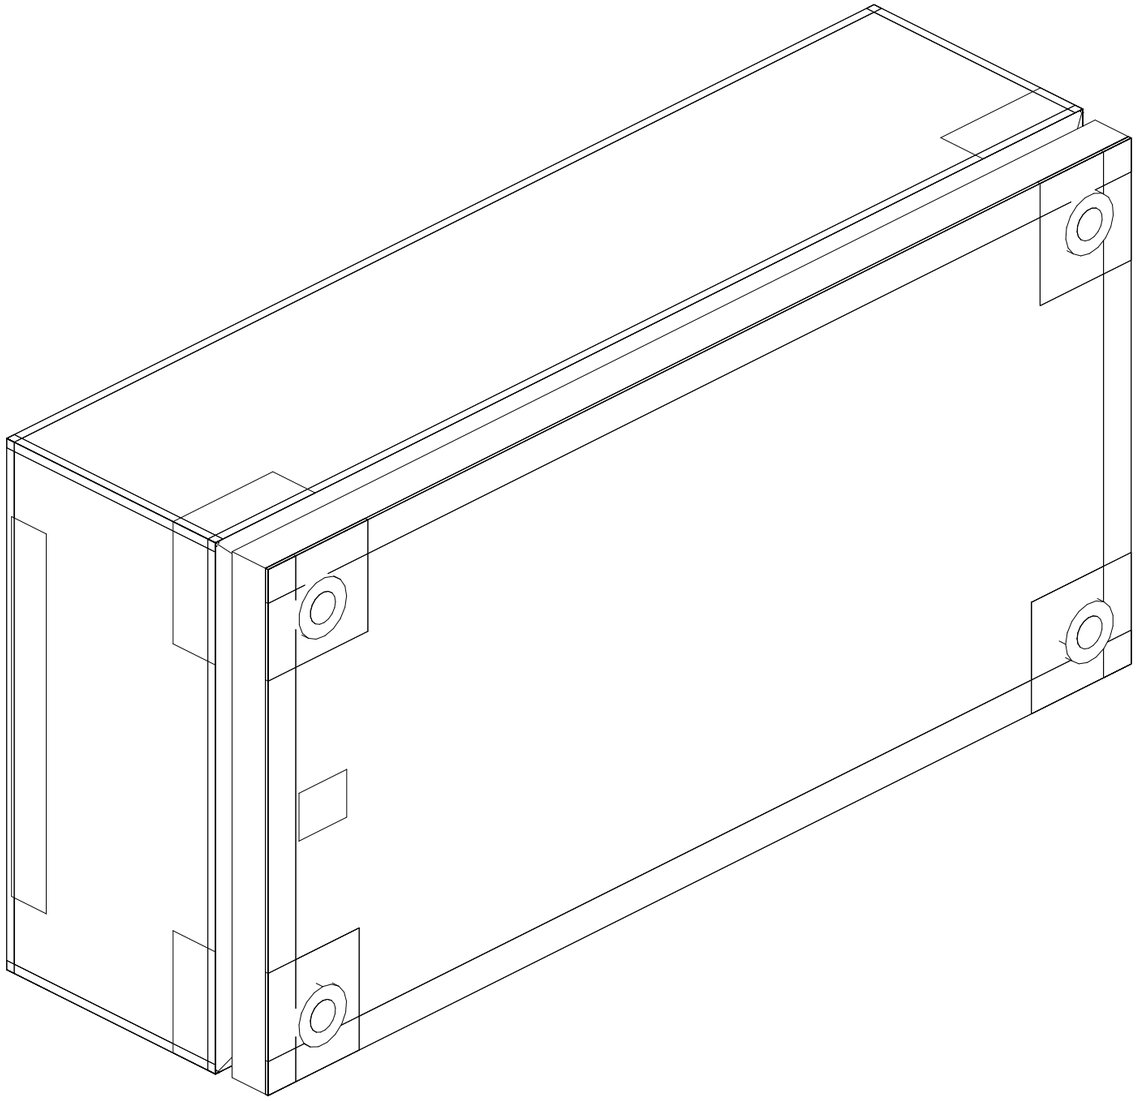

LT01.HS01.X02

+.HS01.X01&EPC1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	LT01.HS01.X02		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1							Project-related evaluations	In/on-equipment location
				Drawing number 1005811	Version					+LT01.HS01.X02	Page 1
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 151 from 164

S1:Montageplatte

1

3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.HS01.X02	Page 2
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 152 from 164

Enclosure legend

10

Item number	BMK	Type number	Designation
15	-UA1	TS 35X7.5/LL 2M/ST/ZN	Tragschiene 35x7,5

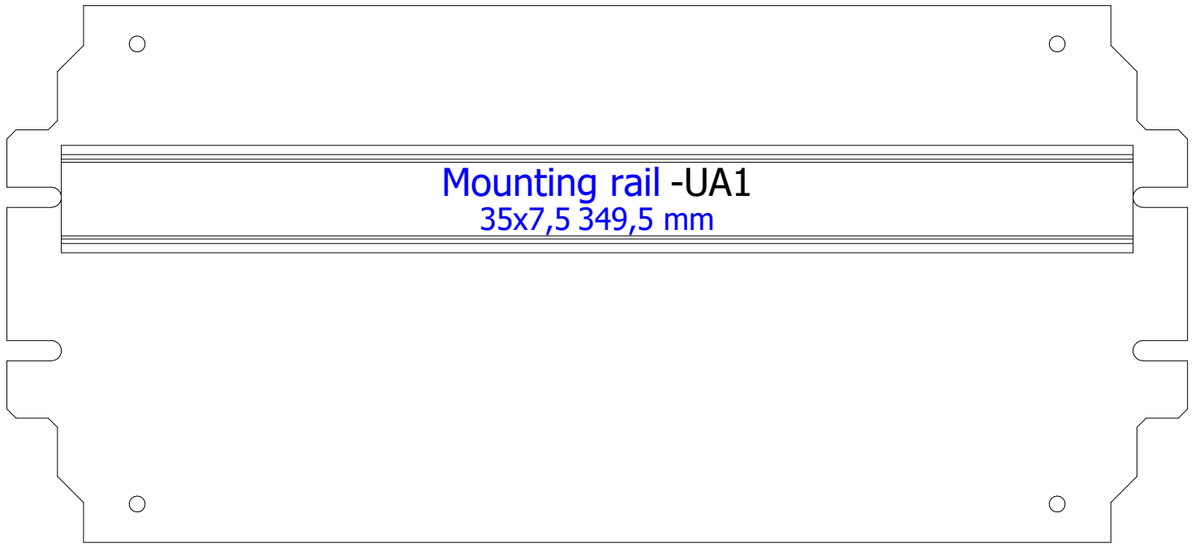

S1:Montageplatte

2

&EMA1/1

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH		Job number 1011002189	IEC	3CON Anlagenbau GmbH	S1:Montageplatte		==1005811	=REPORT	&ELU
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1								Project-related evaluations	In/on-equipment location
					Drawing number 1005811	Version					+LT01.HS01.X02	Page 3
Modification	Date	Name	Creator AK Andreas Krischker	Approved by				last Editor C.DEMIR	Date 16.01.2025		lower tool 1	Sheet 153 from 164

Terminal-strip overview

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F14_002_V01

Terminal strip	Function text	Terminals					Page of the terminal diagram
		first	last	Total PE	Total N	Total number	
-XD.51		N	N60	60	61	181	==1005811=REPORT+LT01.HS01.X02&EMA2/1

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=GN+LT01-WDB3	H07V-K 1x16 mm²
2	=XS+LT01-WDB4	FD CLASSIC 810 25x1,5 mm²
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
											2016-7114																				
	BU										=XS+LT01-XS5	A2	a	**N** (N)																	=EB+LT01.HS01&EFS/5.0
													b	**PE1** (⏚)	a																=EB+LT01.HS01&EFS/5.0
		1									=XS+LT01-XS5	B1	b	**1**	a				=EB+LT01.HS01-BTA45	1											=EB+LT01.HS01&EFS/5.0
													b	**N1** (N)	a				=EB+LT01.HS01-BTA45	2											=EB+LT01.HS01&EFS/5.0
													b	**PE2** (⏚)	a																=EB+LT01.HS01&EFS/5.0
		2									=XS+LT01-XS5	B2	b	**2**	a				=EB+LT01.HS01-BTA46	1											=EB+LT01.HS01&EFS/5.1
													b	**N2** (N)	a				=EB+LT01.HS01-BTA46	2											=EB+LT01.HS01&EFS/5.1
													b	**PE3** (⏚)	a																=EB+LT01.HS01&EFS/5.1
		3									=XS+LT01-XS5	B3	b	**3**	a				=EB+LT01.HS01-BTA47	1											=EB+LT01.HS01&EFS/5.1
													b	**N3** (N)	a				=EB+LT01.HS01-BTA47	2											=EB+LT01.HS01&EFS/5.1
													b	**PE4** (⏚)	a																=EB+LT01.HS01&EFS/5.1
		4									=XS+LT01-XS5	B4	b	**4**	a				=EB+LT01.HS01-BTA48	1											=EB+LT01.HS01&EFS/5.2
													b	**N4** (N)	a				=EB+LT01.HS01-BTA48	2											=EB+LT01.HS01&EFS/5.2
													b	**PE5** (⏚)	a																=EB+LT01.HS01&EFS/5.2
		5									=XS+LT01-XS5	B5	b	**5**	a				=EB+LT01.HS01-BTA49	1											=EB+LT01.HS01&EFS/5.2
													b	**N5** (N)	a				=EB+LT01.HS01-BTA49	2											=EB+LT01.HS01&EFS/5.2
													b	**PE6** (⏚)	a																=EB+LT01.HS01&EFS/5.2
		6									=XS+LT01-XS5	C1	b	**6**	a				=EB+LT01.HS01-BTA50	1											=EB+LT01.HS01&EFS/5.2
													b	**N6** (N)	a				=EB+LT01.HS01-BTA50	2											=EB+LT01.HS01&EFS/5.3
													b	**PE7** (⏚)	a																=EB+LT01.HS01&EFS/5.3
		7									=XS+LT01-XS5	C2	b	**7**	a				=EB+LT01.HS01-BTA51	1											=EB+LT01.HS01&EFS/5.3
													b	**N7** (N)	a				=EB+LT01.HS01-BTA51	2											=EB+LT01.HS01&EFS/5.3
													b	**PE8** (⏚)	a																=EB+LT01.HS01&EFS/5.3
		8									=XS+LT01-XS5	C3	b	**8**	a				=EB+LT01.HS01-BTA52	1											=EB+LT01.HS01&EFS/5.3

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB4	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N8** (N)	a				=EB+LT01.HS01-BTA52	2											=EB+LT01.HS01&EFS/5.4
													b	**PE9** (⏚)	a																=EB+LT01.HS01&EFS/5.4
	9										=XS+LT01-XS5	C4	b	**9**	a				=EB+LT01.HS01-BTA53	1											=EB+LT01.HS01&EFS/5.4
													b	**N9** (N)	a				=EB+LT01.HS01-BTA53	2											=EB+LT01.HS01&EFS/5.4
													b	**PE10** (⏚)	a																=EB+LT01.HS01&EFS/5.4
	10										=XS+LT01-XS5	C5	b	**10**	a				=EB+LT01.HS01-BTA54	1											=EB+LT01.HS01&EFS/5.4
													b	**N10** (N)	a				=EB+LT01.HS01-BTA54	2											=EB+LT01.HS01&EFS/5.5
													b	**PE11** (⏚)	a																=EB+LT01.HS01&EFS/5.5
	11										=XS+LT01-XS5	D1	b	**11**	a																=EB+LT01.HS01&EFS/5.5
													b	**N11** (N)	a																=EB+LT01.HS01&EFS/5.5
													b	**PE12** (⏚)	a																=EB+LT01.HS01&EFS/5.5
	12										=XS+LT01-XS5	D2	b	**12**	a																=EB+LT01.HS01&EFS/5.5
													b	**N12** (N)	a																=EB+LT01.HS01&EFS/5.6
													b	**PE13** (⏚)	a																=EB+LT01.HS01&EFS/5.6
	13										=XS+LT01-XS5	D3	b	**13**	a																=EB+LT01.HS01&EFS/5.6
													b	**N13** (N)	a																=EB+LT01.HS01&EFS/5.6
													b	**PE14** (⏚)	a																=EB+LT01.HS01&EFS/5.6
	14										=XS+LT01-XS5	D4	b	**14**	a																=EB+LT01.HS01&EFS/5.6
													b	**N14** (N)	a																=EB+LT01.HS01&EFS/5.6
													b	**PE15** (⏚)	a																=EB+LT01.HS01&EFS/5.7
	15										=XS+LT01-XS5	D5	b	**15**	a																=EB+LT01.HS01&EFS/5.7
													b	**N15** (N)	a																=EB+LT01.HS01&EFS/5.7
													b	**PE16** (⏚)	a																=EB+LT01.HS01&EFS/5.7
	16										=XS+LT01-XS5	E1	b	**16**	a																=EB+LT01.HS01&EFS/5.7

1 3

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.HS01.X02-XD.51	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1						Project-related evaluations	Terminal diagram
				Drawing number 1005811	Version				+LT01.HS01.X02	Page 2
Modification	Date	Name	Creator AK Andreas Krischker				last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 156 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB4	FD CLASSIC 810 25x1,5 mm²
2	=XS+LT01-WDB5	FD CLASSIC 810 25x1,5 mm²
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N16** (N)	a																=EB+LT01.HS01&EFS/5.7
													b	**PE17** (⏚)	a																=EB+LT01.HS01&EFS/5.8
	17										=XS+LT01-XS5	E2	b	**17**	a																=EB+LT01.HS01&EFS/5.8
													b	**N17** (N)	a																=EB+LT01.HS01&EFS/5.8
													b	**PE18** (⏚)	a																=EB+LT01.HS01&EFS/5.8
	18										=XS+LT01-XS5	E3	b	**18**	a																=EB+LT01.HS01&EFS/5.8
													b	**N18** (N)	a																=EB+LT01.HS01&EFS/5.8
													b	**PE19** (⏚)	a																=EB+LT01.HS01&EFS/5.9
	19										=XS+LT01-XS5	E4	b	**19**	a																=EB+LT01.HS01&EFS/5.9
													b	**N19** (N)	a																=EB+LT01.HS01&EFS/5.9
													b	**PE20** (⏚)	a																=EB+LT01.HS01&EFS/5.9
	20										=XS+LT01-XS5	E5	b	**20**	a																=EB+LT01.HS01&EFS/5.9
													b	**N20** (N)	a																=EB+LT01.HS01&EFS/5.9
													b	**PE21** (⏚)	a																=EB+LT01.HS01&EFS/6.0
		1									=XS+LT01-XS6	1	b	**21**	a																=EB+LT01.HS01&EFS/6.0
													b	**N21** (N)	a																=EB+LT01.HS01&EFS/6.0
													b	**PE22** (⏚)	a																=EB+LT01.HS01&EFS/6.0
		2									=XS+LT01-XS6	2	b	**22**	a																=EB+LT01.HS01&EFS/6.1
													b	**N22** (N)	a																=EB+LT01.HS01&EFS/6.1
													b	**PE23** (⏚)	a																=EB+LT01.HS01&EFS/6.1
		3									=XS+LT01-XS6	3	b	**23**	a																=EB+LT01.HS01&EFS/6.1
													b	**N23** (N)	a																=EB+LT01.HS01&EFS/6.1
													b	**PE24** (⏚)	a																=EB+LT01.HS01&EFS/6.1
		4									=XS+LT01-XS6	4	b	**24**	a																=EB+LT01.HS01&EFS/6.2

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB5	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N24** (N)	a																=EB+LT01.HS01&EFS/6.2
													b	**PE25** (⏚)	a																=EB+LT01.HS01&EFS/6.2
	5										=XS+LT01-XS6	5	b	**25**	a																=EB+LT01.HS01&EFS/6.2
													b	**N25** (N)	a																=EB+LT01.HS01&EFS/6.2
													b	**PE26** (⏚)	a																=EB+LT01.HS01&EFS/6.2
	6										=XS+LT01-XS6	6	b	**26**	a																=EB+LT01.HS01&EFS/6.2
													b	**N26** (N)	a																=EB+LT01.HS01&EFS/6.3
													b	**PE27** (⏚)	a																=EB+LT01.HS01&EFS/6.3
	7										=XS+LT01-XS6	7	b	**27**	a																=EB+LT01.HS01&EFS/6.3
													b	**N27** (N)	a																=EB+LT01.HS01&EFS/6.3
													b	**PE28** (⏚)	a																=EB+LT01.HS01&EFS/6.3
	8										=XS+LT01-XS6	8	b	**28**	a																=EB+LT01.HS01&EFS/6.3
													b	**N28** (N)	a																=EB+LT01.HS01&EFS/6.4
													b	**PE29** (⏚)	a																=EB+LT01.HS01&EFS/6.4
	9										=XS+LT01-XS6	9	b	**29**	a																=EB+LT01.HS01&EFS/6.4
													b	**N29** (N)	a																=EB+LT01.HS01&EFS/6.4
													b	**PE30** (⏚)	a																=EB+LT01.HS01&EFS/6.4
	10										=XS+LT01-XS6	10	b	**30**	a																=EB+LT01.HS01&EFS/6.4
													b	**N30** (N)	a																=EB+LT01.HS01&EFS/6.5
													b	**PE31** (⏚)	a																=EB+LT01.HS01&EFS/6.5
	11										=XS+LT01-XS6	11	b	**31**	a																=EB+LT01.HS01&EFS/6.5
													b	**N31** (N)	a																=EB+LT01.HS01&EFS/6.5
													b	**PE32** (⏚)	a																=EB+LT01.HS01&EFS/6.5
	12										=XS+LT01-XS6	12	b	**32**	a																=EB+LT01.HS01&EFS/6.5

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB5	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N32**	a																=EB+LT01.HS01&EFS/6.6
													b	**PE33**	a																=EB+LT01.HS01&EFS/6.6
	13										=XS+LT01-XS6	13	b	**33**	a																=EB+LT01.HS01&EFS/6.6
													b	**N33**	a																=EB+LT01.HS01&EFS/6.6
													b	**PE34**	a																=EB+LT01.HS01&EFS/6.6
	14										=XS+LT01-XS6	14	b	**34**	a																=EB+LT01.HS01&EFS/6.6
													b	**N34**	a																=EB+LT01.HS01&EFS/6.6
													b	**PE35**	a																=EB+LT01.HS01&EFS/6.7
	15										=XS+LT01-XS6	15	b	**35**	a																=EB+LT01.HS01&EFS/6.7
													b	**N35**	a																=EB+LT01.HS01&EFS/6.7
													b	**PE36**	a																=EB+LT01.HS01&EFS/6.7
	16										=XS+LT01-XS6	16	b	**36**	a																=EB+LT01.HS01&EFS/6.7
													b	**N36**	a																=EB+LT01.HS01&EFS/6.7
													b	**PE37**	a																=EB+LT01.HS01&EFS/6.8
	17										=XS+LT01-XS6	17	b	**37**	a																=EB+LT01.HS01&EFS/6.8
													b	**N37**	a																=EB+LT01.HS01&EFS/6.8
													b	**PE38**	a																=EB+LT01.HS01&EFS/6.8
	18										=XS+LT01-XS6	18	b	**38**	a																=EB+LT01.HS01&EFS/6.8
													b	**N38**	a																=EB+LT01.HS01&EFS/6.8
													b	**PE39**	a																=EB+LT01.HS01&EFS/6.9
	19										=XS+LT01-XS6	19	b	**39**	a																=EB+LT01.HS01&EFS/6.9
													b	**N39**	a																=EB+LT01.HS01&EFS/6.9
													b	**PE40**	a																=EB+LT01.HS01&EFS/6.9
	20										=XS+LT01-XS6	20	b	**40**	a																=EB+LT01.HS01&EFS/6.9

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB6	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N40** (N)	a																=EB+LT01.HS01&EFS/6.9
													b	**PE41** (⏚)	a																=EB+LT01.HS01&EFS/7.0
	1										=XS+LT01-XS7	1	b	**41**	a				=EB+LT01.HS01-BTA55	1											=EB+LT01.HS01&EFS/7.0
													b	**N41** (N)	a				=EB+LT01.HS01-BTA56	2											=EB+LT01.HS01&EFS/7.1
													b	**PE42** (⏚)	a																=EB+LT01.HS01&EFS/7.1
	2										=XS+LT01-XS7	2	b	**42**	a				=EB+LT01.HS01-BTA57	1											=EB+LT01.HS01&EFS/7.1
													b	**N42** (N)	a				=EB+LT01.HS01-BTA58	2											=EB+LT01.HS01&EFS/7.2
													b	**PE43** (⏚)	a																=EB+LT01.HS01&EFS/7.2
	3										=XS+LT01-XS7	3	b	**43**	a				=EB+LT01.HS01-BTA59	1											=EB+LT01.HS01&EFS/7.2
													b	**N43** (N)	a				=EB+LT01.HS01-BTA60	2											=EB+LT01.HS01&EFS/7.3
													b	**PE44** (⏚)	a																=EB+LT01.HS01&EFS/7.3
	4										=XS+LT01-XS7	4	b	**44**	a				=EB+LT01.HS01-BTA61	1											=EB+LT01.HS01&EFS/7.3
													b	**N44** (N)	a				=EB+LT01.HS01-BTA62	2											=EB+LT01.HS01&EFS/7.4
													b	**PE45** (⏚)	a																=EB+LT01.HS01&EFS/7.4
	5										=XS+LT01-XS7	5	b	**45**	a				=EB+LT01.HS01-BTA63	1											=EB+LT01.HS01&EFS/7.4
													b	**N45** (N)	a				=EB+LT01.HS01-BTA63	2											=EB+LT01.HS01&EFS/7.4
													b	**PE46** (⏚)	a																=EB+LT01.HS01&EFS/7.4
	6										=XS+LT01-XS7	6	b	**46**	a				=EB+LT01.HS01-BTA64	1											=EB+LT01.HS01&EFS/7.4
													b	**N46** (N)	a				=EB+LT01.HS01-BTA64	2											=EB+LT01.HS01&EFS/7.5
													b	**PE47** (⏚)	a																=EB+LT01.HS01&EFS/7.5
	7										=XS+LT01-XS7	7	b	**47**	a				=EB+LT01.HS01-BTA65	1											=EB+LT01.HS01&EFS/7.5
													b	**N47** (N)	a				=EB+LT01.HS01-BTA66	2											=EB+LT01.HS01&EFS/7.6
													b	**PE48** (⏚)	a																=EB+LT01.HS01&EFS/7.6
	8										=XS+LT01-XS7	8	b	**48**	a				=EB+LT01.HS01-BTA67	1											=EB+LT01.HS01&EFS/7.6

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB6	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N48** (N)	a				=EB+LT01.HS01-BTA68	2											=EB+LT01.HS01&EFS/7.6
													b	**PE49** (⏚)	a																=EB+LT01.HS01&EFS/7.7
	9										=XS+LT01-XS7	9	b	**49**	a				=EB+LT01.HS01-BTA69	1											=EB+LT01.HS01&EFS/7.7
													b	**N49** (N)	a				=EB+LT01.HS01-BTA70	2											=EB+LT01.HS01&EFS/7.7
													b	**PE50** (⏚)	a																=EB+LT01.HS01&EFS/7.8
	10										=XS+LT01-XS7	10	b	**50**	a				=EB+LT01.HS01-BTA71	1											=EB+LT01.HS01&EFS/7.8
													b	**N50** (N)	a				=EB+LT01.HS01-BTA71	2											=EB+LT01.HS01&EFS/7.8
													b	**PE51** (⏚)	a																=EB+LT01.HS01&EFS/8.0
	11										=XS+LT01-XS7	11	b	**51**	a				=EB+LT01.HS01-BTA72	1											=EB+LT01.HS01&EFS/8.0
													b	**N51** (N)	a				=EB+LT01.HS01-BTA73	2											=EB+LT01.HS01&EFS/8.1
													b	**PE52** (⏚)	a																=EB+LT01.HS01&EFS/8.1
	12										=XS+LT01-XS7	12	b	**52**	a				=EB+LT01.HS01-BTA74	1											=EB+LT01.HS01&EFS/8.1
													b	**N52** (N)	a				=EB+LT01.HS01-BTA75	2											=EB+LT01.HS01&EFS/8.2
													b	**PE53** (⏚)	a																=EB+LT01.HS01&EFS/8.2
	13										=XS+LT01-XS7	13	b	**53**	a				=EB+LT01.HS01-BTA76	1											=EB+LT01.HS01&EFS/8.2
													b	**N53** (N)	a				=EB+LT01.HS01-BTA77	2											=EB+LT01.HS01&EFS/8.3
													b	**PE54** (⏚)	a																=EB+LT01.HS01&EFS/8.3
	14										=XS+LT01-XS7	14	b	**54**	a				=EB+LT01.HS01-BTA78	1											=EB+LT01.HS01&EFS/8.3
													b	**N54** (N)	a				=EB+LT01.HS01-BTA79	2											=EB+LT01.HS01&EFS/8.4
													b	**PE55** (⏚)	a																=EB+LT01.HS01&EFS/8.4
	15										=XS+LT01-XS7	15	b	**55**	a				=EB+LT01.HS01-BTA80	1											=EB+LT01.HS01&EFS/8.4
													b	**N55** (N)	a				=EB+LT01.HS01-BTA80	2											=EB+LT01.HS01&EFS/8.4
													b	**PE56** (⏚)	a																=EB+LT01.HS01&EFS/8.4
	16										=XS+LT01-XS7	16	b	**56**	a				=EB+LT01.HS01-BTA81	1											=EB+LT01.HS01&EFS/8.4

			Job name DAG_BR 449_IP_VAC+EDGE+ITG+WELD+PUNCH	Job number 1011002189	IEC	3CON Anlagenbau GmbH	Klemmenplan ==1005811+LT01.HS01.X02-XD.51	==1005811	=REPORT	&EMA2
			BR 449_glove box_LHD/RHD_WELD_TOOL_1+1	Drawing number 1005811	Version				Project-related evaluations	Terminal diagram
									+LT01.HS01.X02	Page 7
Modification	Date	Name	Creator AK Andreas Krischker	Approved by			last Editor AK Andreas Krischker	Date 04.09.2024	lower tool 1	Sheet 161 from 164

Terminal diagram

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F13_001_V01

1	=XS+LT01-WDB6	FD CLASSIC 810 25x1,5 mm²
2		
3		
4		
5		
6		
7		
8		
9		
10		

Terminal diagram
==1005811+LT01.HS01.X02-XD.51

Function:
Installation location:

Function text	1	2	3	4	5	6	7	8	9	10	Target designation	Connection	Terminal connection	Terminal	Terminal connection	Saddle jumper	Wire bridges	PLC connection point	Target designation	Connection	10	9	8	7	6	5	4	3	2	1	Page / column
													b	**N56** (N)	a				=EB+LT01.HS01-BTA81	2											=EB+LT01.HS01&EFS/8.5
													b	**PE57** (⏚)	a																=EB+LT01.HS01&EFS/8.5
	17										=XS+LT01-XS7	17	b	**57**	a				=EB+LT01.HS01-BTA82	1											=EB+LT01.HS01&EFS/8.5
													b	**N57** (N)	a				=EB+LT01.HS01-BTA83	2											=EB+LT01.HS01&EFS/8.6
													b	**PE58** (⏚)	a																=EB+LT01.HS01&EFS/8.6
	18										=XS+LT01-XS7	18	b	**58**	a				=EB+LT01.HS01-BTA84	1											=EB+LT01.HS01&EFS/8.6
													b	**N58** (N)	a				=EB+LT01.HS01-BTA84	2											=EB+LT01.HS01&EFS/8.6
													b	**PE59** (⏚)	a																=EB+LT01.HS01&EFS/8.6
	19										=XS+LT01-XS7	19	b	**59**	a				=EB+LT01.HS01-BTA85	1											=EB+LT01.HS01&EFS/8.6
													b	**N59** (N)	a				=EB+LT01.HS01-BTA86	2											=EB+LT01.HS01&EFS/8.7
													b	**PE60** (⏚)	a																=EB+LT01.HS01&EFS/8.7
	20										=XS+LT01-XS7	20	b	**60**	a				=EB+LT01.HS01-BTA87	1											=EB+LT01.HS01&EFS/8.7
													b	**N60** (N)	a				=EB+LT01.HS01-BTA88	2											=EB+LT01.HS01&EFS/8.8

Equipment list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON_]F03_005_V01

[3CON_]F03_005_V01

device tag	Article designation	X-Ref
+LT01.HS01.X02 **-U1**	Terminal box KX 400x200x120, without gland plate	(==1005811+LT01.HS01.X02.S1)
+LT01.HS01.X02 **-U2**	Mounting plate KX 400x200 mm	(==1005811+LT01.HS01.X02.S1)
+LT01.HS01.X02 **-UA1**	Mounting rail 35x7,5	(==1005811+LT01.HS01.X02.S1)

device tag	Article designation	X-Ref

Summarized parts list

3CON Anlagenbau GmbH
Kleinfeld 16
A-6341 Ebbs

[3CON]_F02_002_V01

Article number	Quantity QU	Designation	Type number	Picture	Pos.
RIT.1504000	1 pc	Terminal box KX 400x200x120, without gland plate	KX.1504000		1
RIT.1564800	1 pc	Mounting plate KX 400x200 mm	KX.1564800		2
WAGO.2016-7114	1 pc	Neutral conductor terminal block 16mm²	2016-7114		3
WAGO.2003-7641	60 pc	Multilevel installation terminal block 2.5 mm², NT/L/PE, 24.0 A, gray	2003-7641		4
WEI.TS 35X7.5	1 pc	Mounting rail 35x7,5	TS 35X7.5/LL 2M/ST/ZN		5
WEI.9540000000	1 pc	End stop ZEW 35	ZEW 35		6