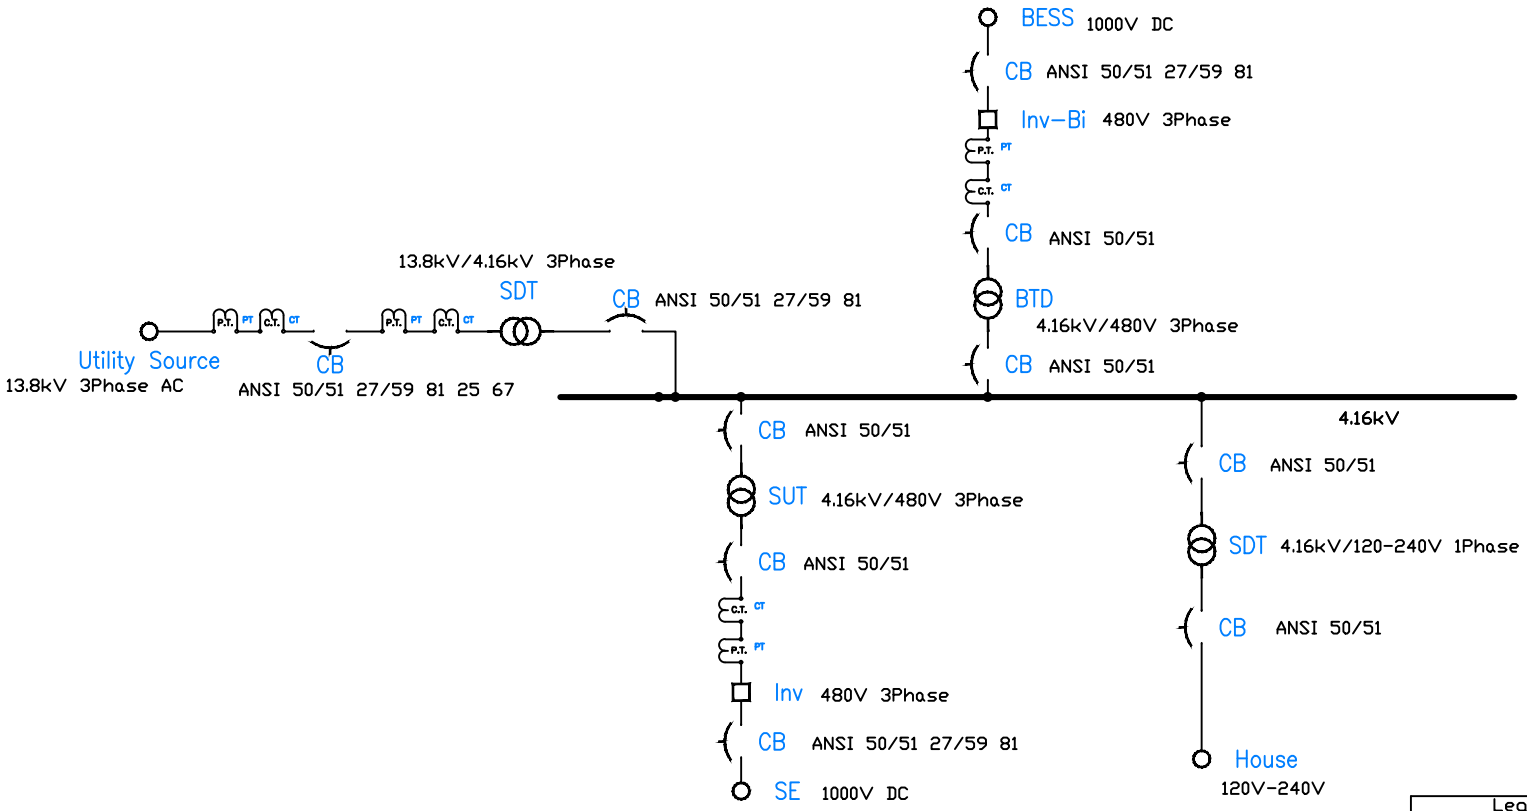


Equipment Data List				
Equipment	Voltage	Power	Configuration	Impedance
Utility line SDT	13.8kV/4.16kV	2.5MVA	3 phase Delta-Wye	5.75%
Solar line SUT	4.16kV/480V	2MVA	3 phase Delta-Wye	5.50%
BESS line BDT	4.16kV/480V	1.5MVA	3 phase Delta-Wye	5%
House line SDT	4.16kV/120-240 V	75kVA	1 phase split phase	2.50%
BESS line Inv-Bi	480V	1.5MVA	3 phase four - quadrant	N/A
Solar line Inv	480V	2MVA	3 phase grid tied	N/A

Legend	
CB	Circuit Breaker
PT	Potential Transformer
CT	Current Transformer
SDT	Step Down Transformer
SUT	Step Up Transformer
BTD	Bi Directional Transformer
Inv	Inverter (DC-AC)
Inv-Bi	Bi Directional Inverter
BESS	Battery Energy Storage System
SE	Solar Energy Production System

C:\USERS\HAMAY\DOCUMENTS\ACADE 2027\ADMIN\PROJ\OPERATIVE SKETCH\USED\HAMAY SIMULATION.DWG

Autodesk

Single Line Diagram Schematic

Hamari M

Hamari M

9/15/26

1

1 OF 1