


ROOF GAPS AND VENTILATION
CARE SHOULD BE TAKEN TO ENSURE THAT THE ROOF VENTILATION OPENINGS DO NOT ALLOW RAIN PENETRATION. GAPS BETWEEN ROOF TILES WITH SARKING (OR REFLECTIVE INSULATION AT RAFTER LEVEL) AND METAL SHEET ROOFING ARE NOT ACCEPTABLE METHODS OF PROVIDING ROOF SPACE VENTILATION.

ROOF TOP : 7.337

ROOF TOP : 6.216

THE CONTRACTOR SHALL TAKE ALL NECESSARY MEASUREMENTS AND DIMENSIONS ON SITE PRIOR TO MANUFACTURING AND INSTALLATION. THE CONTRACTOR SHALL PROVIDE SABS CERTIFICATES OF COMPLIANCE TO THE ENGINEER

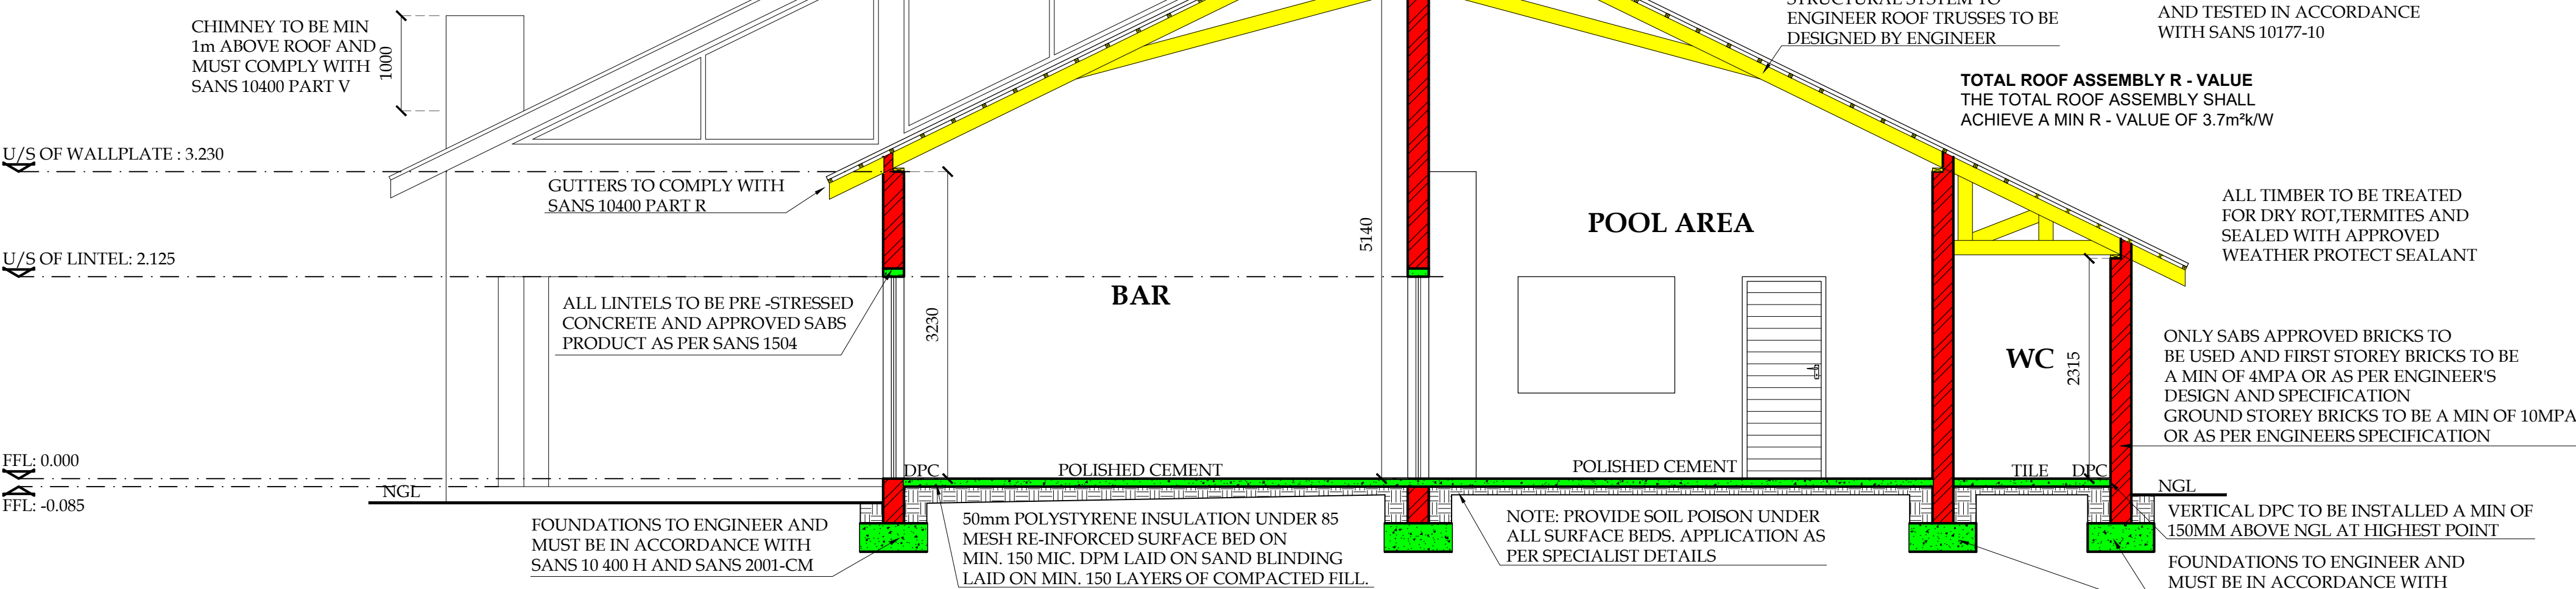

SLAB ON GROUND THERMAL RESISTANCE
WITH THE EXCEPTION OF ZONE 5, BUILDINGS WITH A FLOOR AREA OF LESS THAN 500 M², WITH A CONCRETE SLAB-ON-GROUND, SHALL HAVE INSULATION INSTALLED AROUND THE VERTICAL EDGE OF ITS PERIMETER WHICH SHALL HAVE AN R-VALUE OF NOT LESS THAN 1.0, RESIST WATER ABSORPTION IN ORDER TO RETAIN ITS THERMAL INSULATION PROPERTIES AND BE CONTINUOUS FROM THE ADJACENT FINISHED GROUND LEVEL TO A DEPTH OF NOT LESS THAN 300 MM OR FOR THE FULL DEPTH OF THE VERTICAL EDGE OF THE CONCRETE SLAB-ON-GROUND.

SHADING
WHERE SHADING IS USED, THE BUILDING SHALL HAVE A PERMANENT FEATURE SUCH AS A VERANDA, BALCONY, FIXED CANOPY, EAVES OR SHADING HOOD WHICH EXTENDS HORIZONTALLY ON BOTH SIDES OF THE GLAZING FOR THE SAME. PROJECTION DISTANCE OR PROVIDES THE EQUIVALENT SHADING WITH A REVEAL OR OTHER SHADING ELEMENT OR HAVE AN EXTERNAL SHADING DEVICE, SUCH AS A SHUTTER, BLIND, VERTICAL OR HORIZONTAL BUILDING SCREEN WITH BLADES, BATTENS OR SLATS, WHICH IS CAPABLE OF RESTRICTING AT LEAST 80 % OF SUMMER SOLAR RADIATION AND IF ADJUSTABLE, IS READILY OPERATED EITHER MANUALLY, MECHANICALLY OR ELECTRONICALLY BY THE BUILDING OCCUPANTS.

SABS APPROVED UNDER TILE/SHEETING MEMBRANE TO BE PROVIDED AS PER SANS 10400 L

ROOF TILES/SHEETING TO BE SABS APPROVED AND TESTED AS PER SANS 542

STRUCTURAL SYSTEM TO ENGINEER

TIMBER TO COMPLY WITH SANS 082

STRUCTURAL SYSTEM TO ENGINEER ROOF TRUSSES TO BE DESIGNED BY ENGINEER

INSULATION AS PER SANS 428 AND TESTED IN ACCORDANCE WITH SANS 10177-10

TOTAL ROOF ASSEMBLY R - VALUE
THE TOTAL ROOF ASSEMBLY SHALL ACHIEVE A MIN R - VALUE OF 3.7m²K/W

ALL TIMBER TO BE TREATED FOR DRY ROT, TERMITES AND SEALED WITH APPROVED WEATHER PROTECT SEALANT

ONLY SABS APPROVED BRICKS TO BE USED AND FIRST STOREY BRICKS TO BE A MIN OF 4MPA OR AS PER ENGINEER'S DESIGN AND SPECIFICATION GROUND STOREY BRICKS TO BE A MIN OF 10MPA OR AS PER ENGINEERS SPECIFICATION

VERTICAL DPC TO BE INSTALLED A MIN OF 150MM ABOVE NGL AT HIGHEST POINT

FOUNDATIONS TO ENGINEER AND MUST BE IN ACCORDANCE WITH SANS 10 400 H AND SANS 2001-CM

UNDER FLOOR HEATING
WHERE AN UNDER FLOOR HEATING SYSTEM IS INSTALLED, THE HEATER SHALL BE INSULATED UNDERNEATH THE SLAB WITH INSULATION THAT HAS A MINIMUM R-VALUE OF NOT LESS THEN 1.0.

GUTTER SIZE CALCULATIONS

$$\begin{aligned} \text{GUTTER SIZE} &= \sqrt{\text{AREA} \times \text{RAINFALL}} \\ &= \sqrt{(32.8 \times 9.49) \times 140} \\ &= \sqrt{43578.08} \\ \text{GUTTER SIZE} &= 208.75 \\ \text{THUS: USE 200mm GUTTERS} \end{aligned}$$

RAINWATER DOWN PIPE SIZE CALCULATIONS

$$\begin{aligned} \text{RWP SIZE} &= \sqrt{\text{AREA} \times 100} \\ &= \sqrt{(32.8 \times 9.49) \times 100} \\ &= \sqrt{31127.08} \\ &= 176.43 \\ \text{THUS: USE 175mm RAIN WATER DOWN PIPES} \end{aligned}$$

ROOF CALCULATIONS:

CLIMATE ZONE 1 DIRECTION OF AIR FLOW -UP

MIN REQUIRED R VALUE = 3.7MPK/W

THERMAL CONDUCTIVITY = K VALUE = W/MK

THERMAL CONDUCTIVITY
THICKNESS OF MATERIAL = U VALUE

$$\begin{aligned} U &= 1/R & R &= 1/U \\ \frac{0.040W/M^2K}{1M} &= 0.040W/M^2K \\ \frac{1}{0.040W/M^2K} &= 25M^2K/W \end{aligned}$$

TYPE OF ROOF : METAL ROOF WITH PLASTERED CEILING BOARD = 0.32MPK/W
3.7-0.32=3.38

$$\frac{3.38}{25} = 0.135M = 135MM$$

ADD 135MM AEROLITE THINK PINK INSULATION R VALUE = 3.38
TOTAL R VALUE = 3.70

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS, WALLS, GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

COPYRIGHT NOTICE

Copyright © 2011 (Open Studio Designs cc). Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.

This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (Open Studio Design cc).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution.

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.


SECTION A-A

SCALE 1:50

ROOF GAPS AND VENTILATION

CARE SHOULD BE TAKEN TO ENSURE THAT THE ROOF VENTILATION OPENINGS DO NOT ALLOW RAIN PENETRATION. GAPS BETWEEN ROOF TILES WITH SARKING (OR REFLECTIVE INSULATION AT RAFTER LEVEL) AND METAL SHEET ROOFING ARE NOT ACCEPTABLE METHODS OF PROVIDING ROOF SPACE VENTILATION.

THE CONTRACTOR SHALL TAKE ALL NECESSARY MEASUREMENTS AND DIMENSIONS ON SITE PRIOR TO MANUFACTURING AND INSTALLATION. THE CONTRACTOR SHALL PROVIDE SABS CERTIFICATES OF COMPLIANCE TO THE ENGINEER

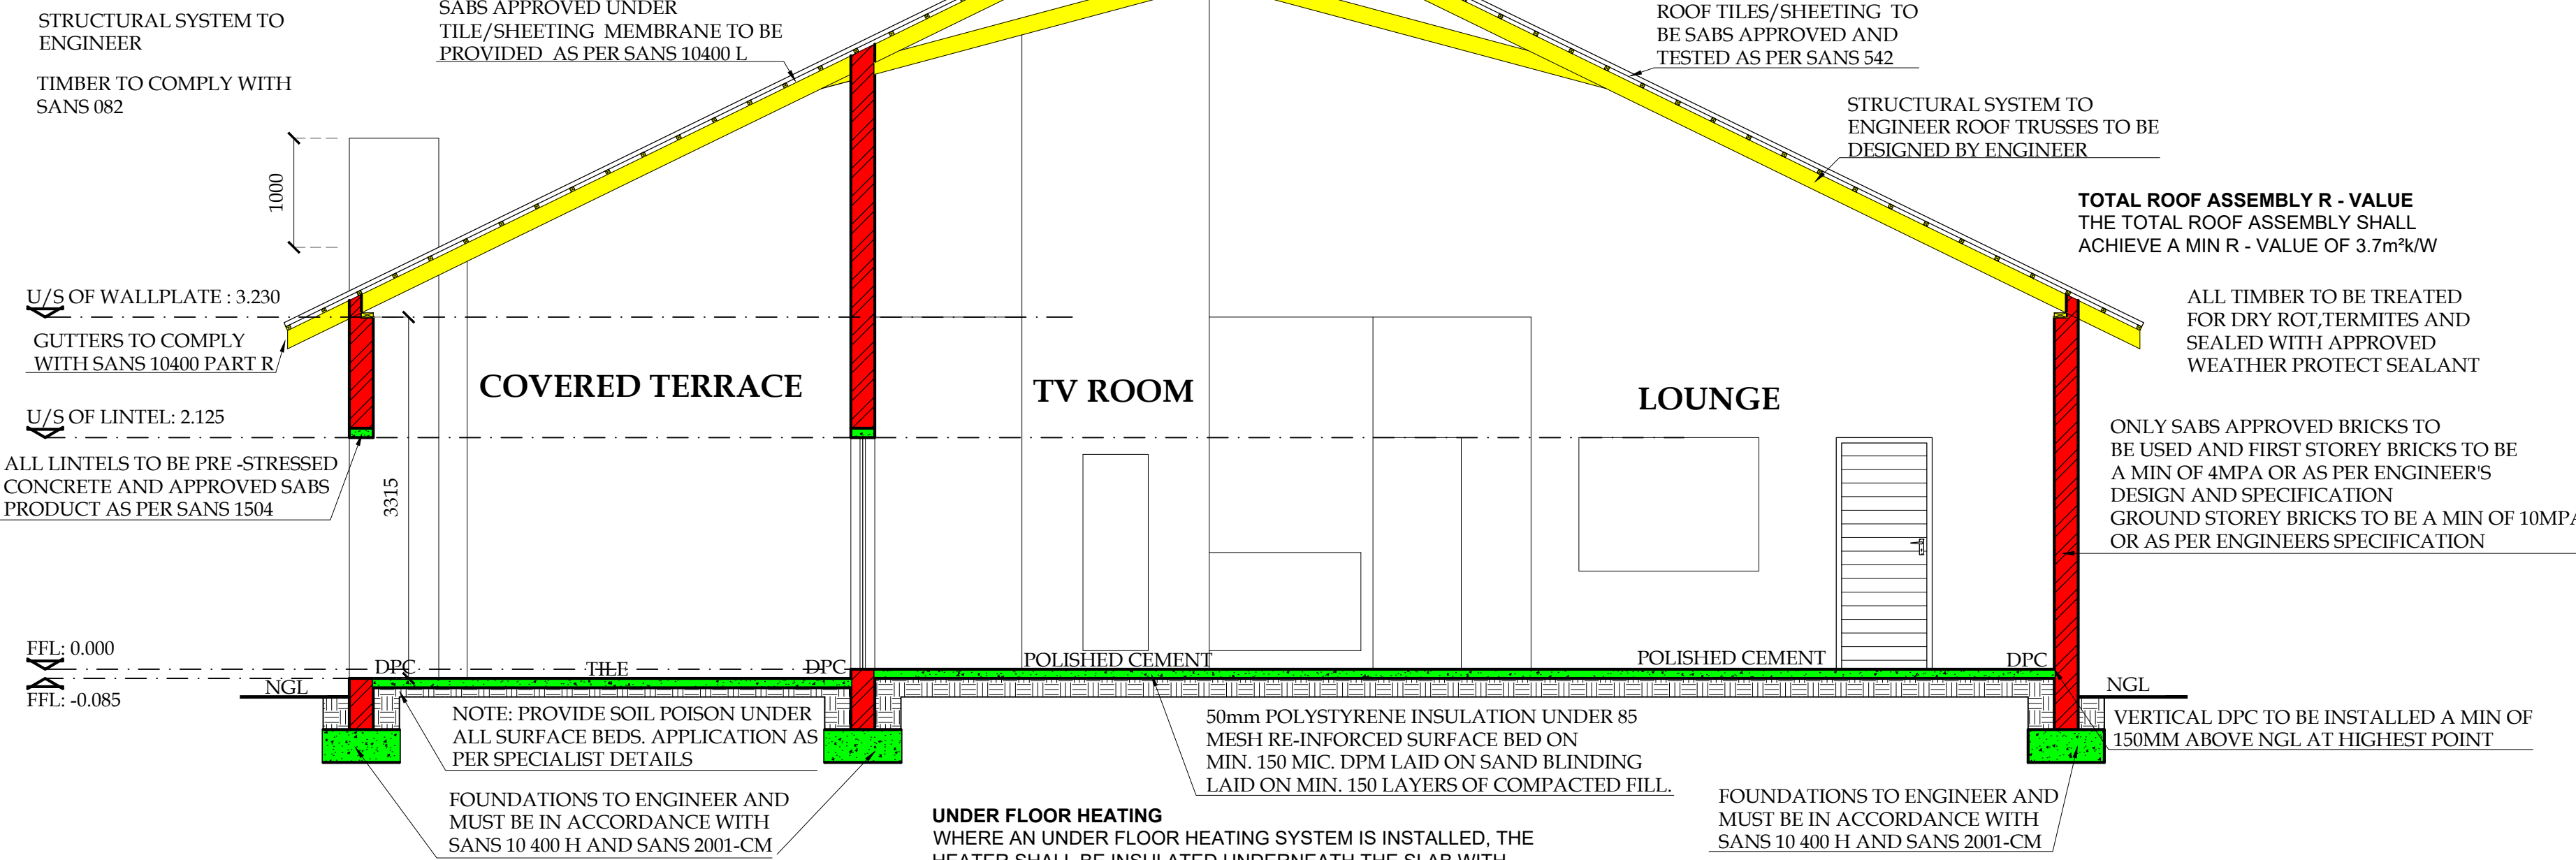

SLAB ON GROUND THERMAL RESISTANCE
WITH THE EXCEPTION OF ZONE 5, BUILDINGS WITH A FLOOR AREA OF LESS THAN 500 M², WITH A CONCRETE SLAB-ON-GROUND, SHALL HAVE INSULATION INSTALLED AROUND THE VERTICAL EDGE OF ITS PERIMETER WHICH SHALL HAVE AN R-VALUE OF NOT LESS THAN 1.0, RESIST WATER ABSORPTION IN ORDER TO RETAIN ITS THERMAL INSULATION PROPERTIES AND BE CONTINUOUS FROM THE ADJACENT FINISHED GROUND LEVEL TO A DEPTH OF NOT LESS THAN 300 MM OR FOR THE FULL DEPTH OF THE VERTICAL EDGE OF THE CONCRETE SLAB-ON-GROUND.

UNDER FLOOR HEATING
WHERE AN UNDER FLOOR HEATING SYSTEM IS INSTALLED, THE HEATER SHALL BE INSULATED UNDERNEATH THE SLAB WITH INSULATION THAT HAS A MINIMUM R-VALUE OF NOT LESS THEN 1.0.

FOUNDATIONS TO ENGINEER AND MUST BE IN ACCORDANCE WITH SANS 10 400 H AND SANS 2001-CM

ALL TIMBER TO BE TREATED FOR DRY ROT, TERMITES AND SEALED WITH APPROVED WEATHER PROTECT SEALANT

ONLY SABS APPROVED BRICKS TO BE USED AND FIRST STOREY BRICKS TO BE A MIN OF 4MPA OR AS PER ENGINEER'S DESIGN AND SPECIFICATION GROUND STOREY BRICKS TO BE A MIN OF 10MPA OR AS PER ENGINEERS SPECIFICATION

VERTICAL DPC TO BE INSTALLED A MIN OF 150MM ABOVE NGL AT HIGHEST POINT

REFERENCES

1. GENERAL

- THIS DRAWING IS NOT TO BE SCALED, USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE.
- THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO. 0124-1977 WITH SHELLDRITE TERMITEPROOF SOIL POISONER.
- TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL.
- BACKFILL TO FOUNDATIONS.
- TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL.
- 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL.
- 'GUNDLE' BRICKGRIP S.A.B.S. EMBOSSED D.P.C 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS.
- STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE.
- ELECTRICAL INSTALLATION SHALL BE 'HEINEMANN' EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD.
- ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.

2. FOUNDATIONS

- ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL STORMWATER DRAINAGE TO CIVIL ENG'S SPECIFICATIONS.
- ALL SOIL COMPACTION TO CIVIL ENG'S SPECIFICATIONS.
- ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.

3. FLOORS

- MIN. 75mm CONCRETE SURFACE BED.
- 25mm CEMENT SCREED TO ALL FLOORS.
- SKIRTING TO BE PROVIDED.

4. WALLS

- 220mm BRICK WALLS WITH GUNDLE BRICKGRIP DPC.
- BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS.
- ALL BRICKWORK MIN. 7 mPa CLASS II.
- WINDOWS BUILT IN WITH GUNDLE BRICKGRIP DPC.
- ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS.
- EXTERNAL TO PLAN INTERNAL-PLASTER AND PAINT.

ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE

5. ROOF A


- CONCRETE ROOF TILES @ 26° ON 38x38mm GRADED S.A. PINE TIMBER BATTENS @ 320mm C/C MAX ON 225x38mm PRE-FABRICATED, AS PER ENGINEER, S.A.PINE TRUSSES @ 760mm C/C MAX ON 114x38mm TIMBER WALL PLATES. TRUSSES TO BE ANCHORED WITH TWO STRANDS OF 25mm GALVANIZED STEEL WIRE BRED 300mm DEEP IN BRICK WALL. PROVIDE SABS APPROVED PLASTIC UNDERLAY AND ISALATION INSULATION.
- MIN.170mm CONCRETE SLAB TO ENGINEER'S DETAIL AND DESIGN.
- MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL.
- WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC.
- 1500 P.V.C. RAINWATER DOWNPIPES FROM FULLBORE OUTLETS.
- SKYLIGHTS TO MANUFACTURERS SPEC.
- GUTTERS: MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES.
- 3mm SKM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38x 38mm S.A. PINE BRANDING AT 450mm C/C FIXED TO TIE BEAMS.

6. WINDOWS AND DOORS

- ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137
- THICKNESS OF PANES IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137
- EXTERNAL SLIDING DOORS: STANDARD AS PER WINDOWS TO SCHEDULE.
- INTERNAL DOORS: STANDARD HARDWOOD FRAMES TO SCHEDULE
- WINDOWS: TO SCHEDULE
- SLIDING DOORS: DOORS TO SCHEDULE.

7. DRAINAGE NOTES

- 1000 uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60.
- 1000 OVP. AT HEAD OF DRAIN PIPE AS SHOWN.
- RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 25000 INTERVALS.
- INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL.
- DRAIN PIPE UNDER BUILDINGS TO BE PROTECTED AGAINST LOAD.
- ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS.
- ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED.
- ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTISYPHON VENTPIPES.
- RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY
- ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

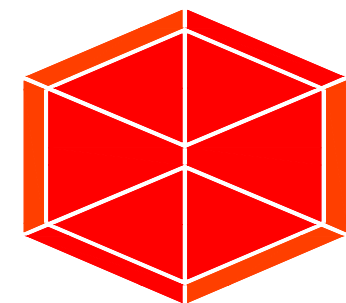

Open Studio Designs
Architectural & Interiors

Mobile 083-306-4315
Fax-086-543-8765
openstudio.design@gmail.com

STAND DESCRIPTION
NEW PROPOSED DWELLING ON
PTN 465 OF THE FARM
KROMDRAAI 560KQ
CLIENT:

WORKING DRAWINGS

TECHNOLOGISTS: W JUNG-KRUGER
ARCHITECT: W.R ELLIS

DATE: NOV 18 **DWG NO:**
DRAWN: WJK **SHEET:** 04 OF 10