

SOUTH WEST ELEVATION
SCALE 1:100


PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBC PART 3 6.6.6

NOTES TO ONE PIPE SYSTEM

- * 500 ELF BOTTLE TRAPS TO WB
- * 500 AAV'S TO SW & B
- * 1100 VV TO WC
- * MIN. INVERT LEVEL : -460mm
- * Ø110 UPVC OVP'S
- * FALL OF DRAIN: 1:60 MIN.
- * 1100 PVC SD LAID TO FALL TO MANHOLE - FALL MIN. 1:60

DRAINAGE NOTES:

1. NO DRAINAGE BENDS OR JUNCTIONS BELOW FLOORS.
2. BENDS AND JUNCTIONS IN DRAINS TO BE FITTED WITH C.E.'S AND IE'S WITH MARKED COVERS AT GROUND LEVEL.
3. DRAINS UNDER BUILDINGS TO BE ADEQUATELY PROTECTED AGAINST LOAD.
4. WASTE PIPES TO HAVE RESEAL TRAPS AND TO BE FULLY ACCESSIBLE OVER FULL LENGTH.
5. BATH WASTE 50mm INTERNAL DIAMETER BASIN WASTE 50MM INTERNAL DIAMETER.
6. GULLIES AT KITCHEN TO HAVE CW TAP OVER.
7. ALL SURFACE PLUMBING TO COMPLY WITH NBR'S
8. GULLY TO BE MIN 85mm ABOVE N.G.L. AND NO STORMWATER TO RUN IN OR TO BE DIRECTED TO GULLY
9. NO GULLY OR MANHOLE ALLOWED UNDER ANY COVERED AND ENCLOSED AREA
10. VENT PIPES WHERE NEW CLOSED AREAS ARE TO BE CONSTRUCTED MUST BE MOVED OR EXTENDED TO ABOVE THE ROOF IN OPEN VENTILATED AREA
11. ALL RE'S AND IE'S MUST BE ACCESSIBLE FROM N.G.L.

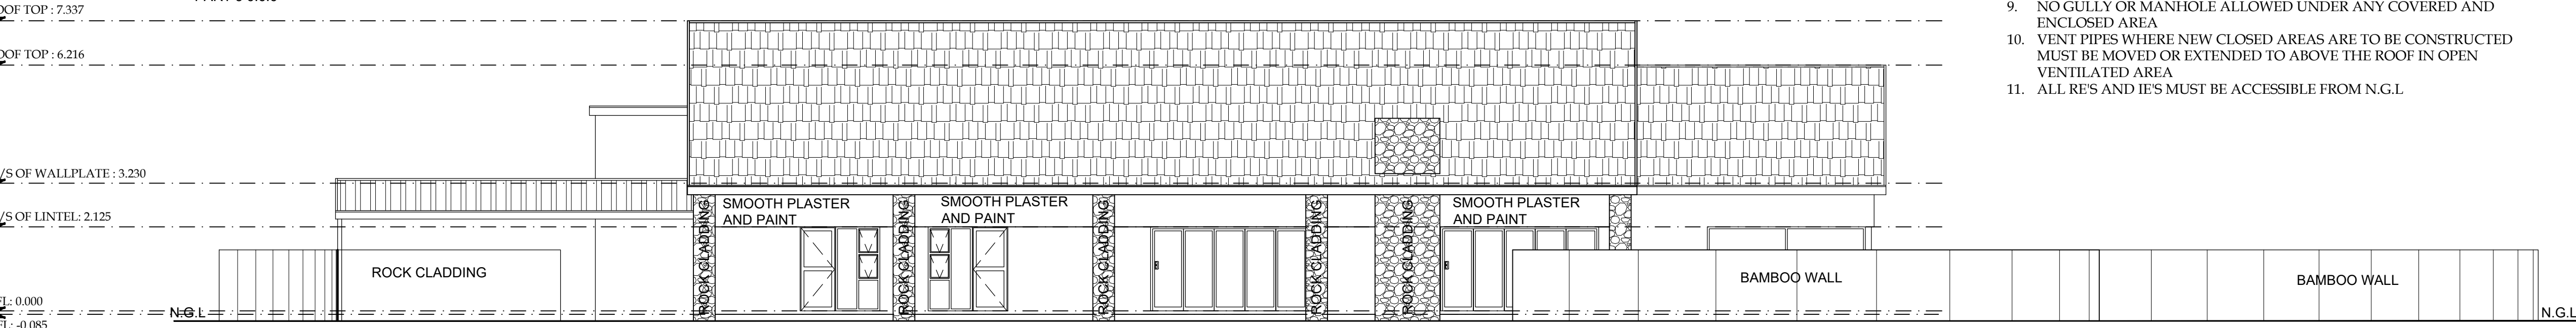


NORTH EAST ELEVATION
SCALE 1:100

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBC PART 3 6.6.6


NOTES TO ONE PIPE SYSTEM

- * 500 ELF BOTTLE TRAPS TO WB
- * 500 AAV'S TO SW & B
- * 1100 VV TO WC
- * MIN. INVERT LEVEL : -460mm
- * Ø110 UPVC OVP'S
- * FALL OF DRAIN: 1:60 MIN.
- * 1100 PVC SD LAID TO FALL TO MANHOLE - FALL MIN. 1:60

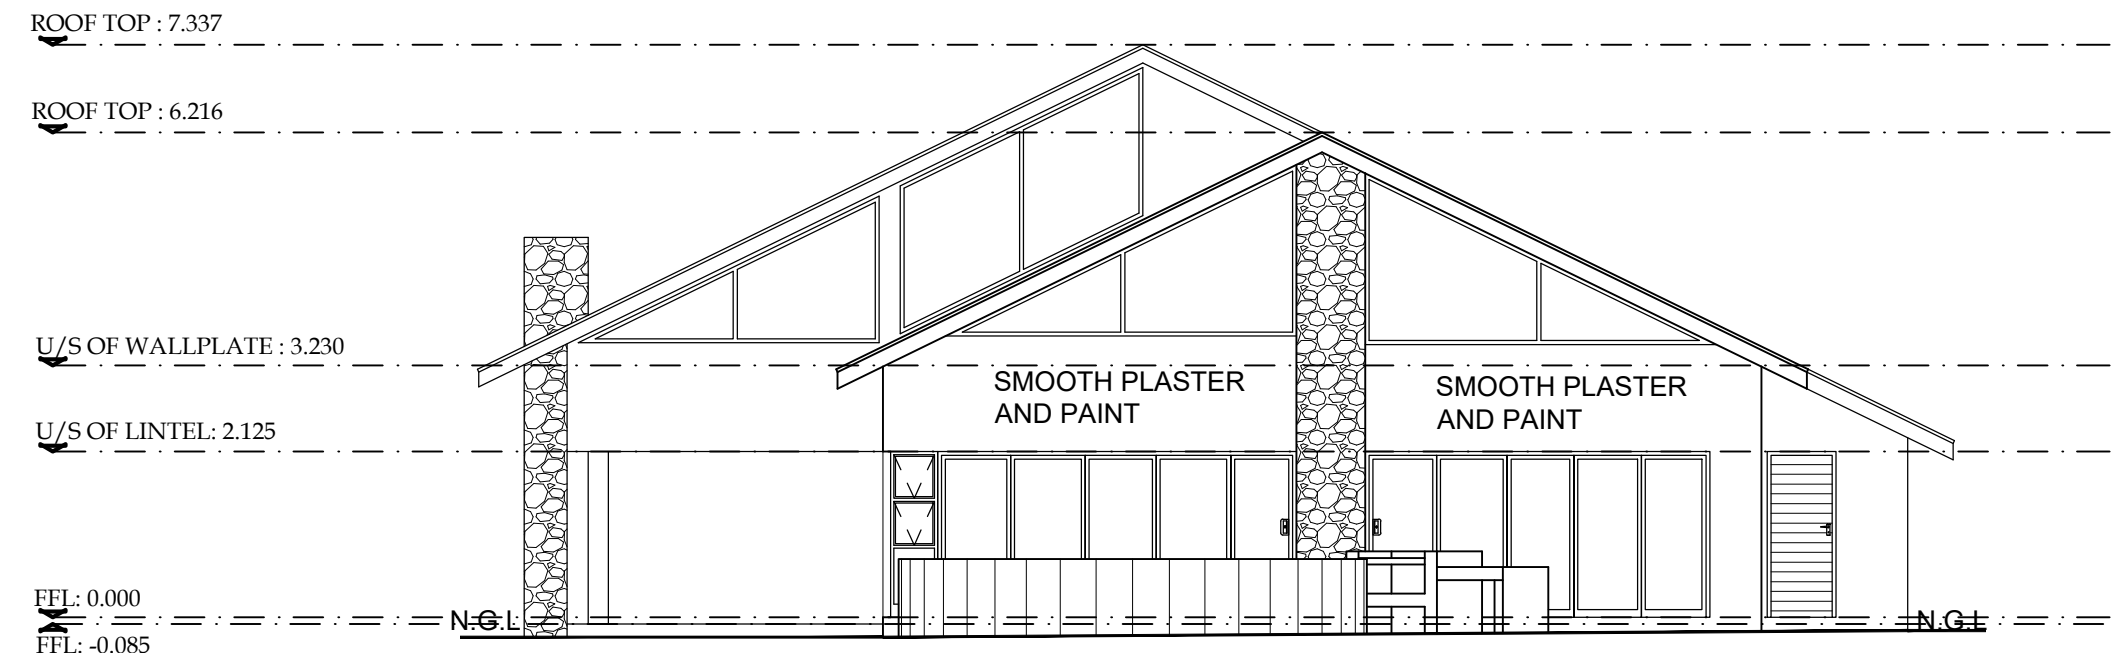

NORTH WEST ELEVATION
SCALE 1:100

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBC PART 3 6.6.6

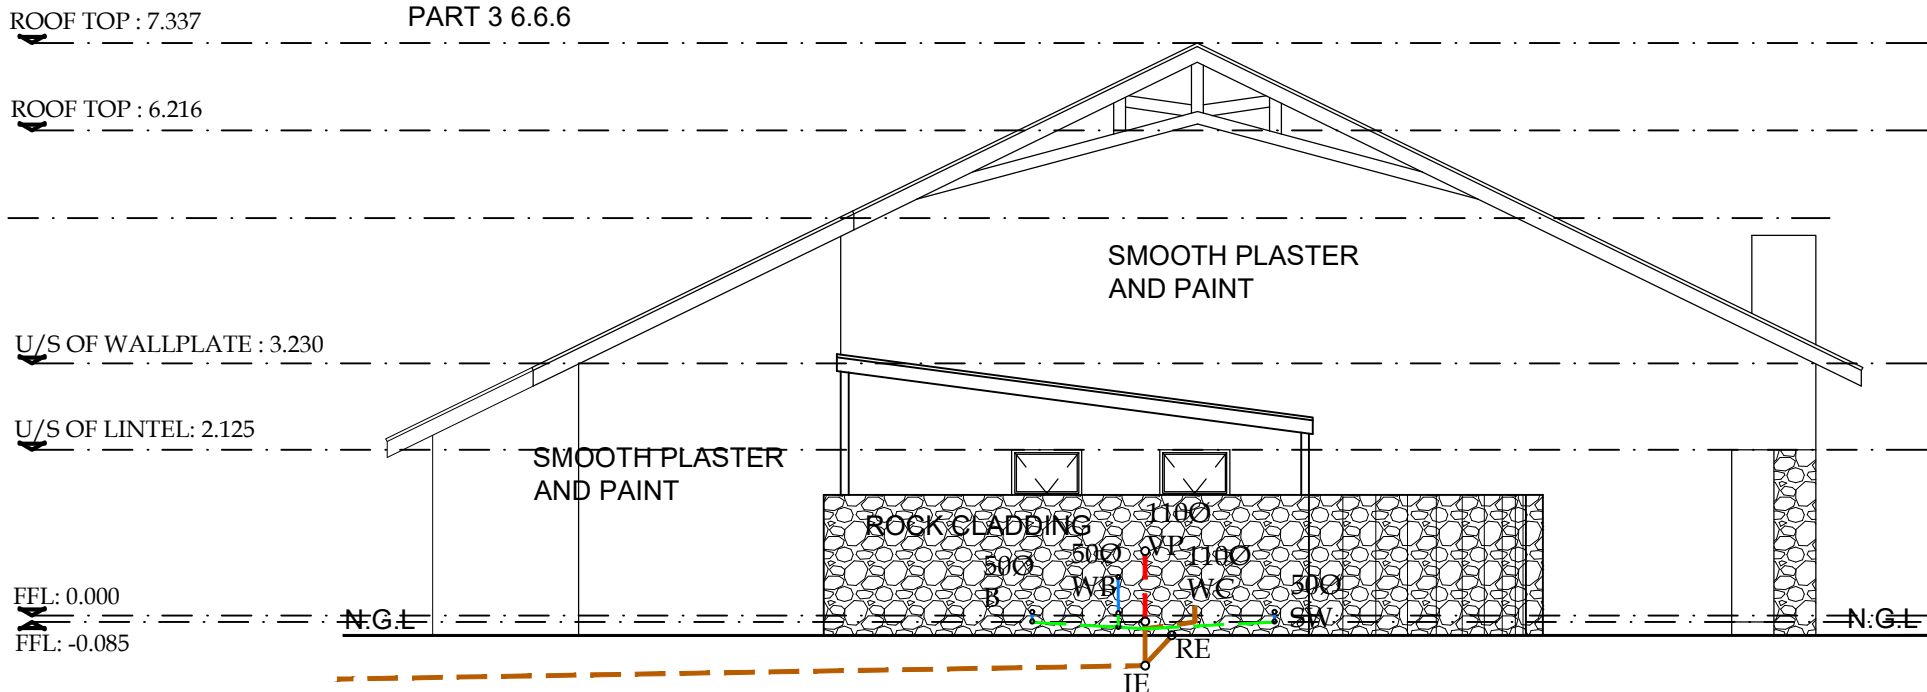

SOUTH EAST ELEVATION
SCALE 1:100

REQUIREMENTS

1. GENERAL

- 1.1 THIS DRAWING IS NOT TO BE SCALED, USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE.
- 1.2 THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO. 0124-1977 WITH SHELLDRITE TERMITEPURIFY SOIL POISONER.
- 1.3 TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL.
- 1.4 BACKFILL TO FOUNDATIONS.
- 1.5 TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL.
- 1.6 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL.
- 1.7 GUNDLER BRICKGRIP S.A.B.S. EMBOSSED D.P.C. 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS.
- 1.8 STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE.
- 1.9 ELECTRICAL INSTALLATION SHALL BE 'HEINEMANN' EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD.
- 1.10 ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.

2. FOUNDATIONS

- 2.1 ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL STORMWATER DRAINAGE TO CIVIL ENG'S SPECIFICATIONS.
- 2.2 ALL SOIL COMPACTION TO CIVIL ENG'S SPECIFICATIONS.
- 2.3 ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.

3. FLOORS

- 3.1 MIN. 75mm CONCRETE SURFACE BED.
- 3.2 25mm CEMENT SCREED TO ALL FLOORS.
- 3.3 SKIRTING TO BE PROVIDED.

4. WALLS

- 4.1 220mm BRICK WALLS WITH GUNDLER BRICKGRIP DPC.
- 4.2 BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS.
- 4.3 ALL BRICKWORK MIN. 7 mPa CLASS II.
- 4.4 WINDOWS BUILT IN WITH GUNDLER BRICKGRIP DPC.
- 4.5 ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS.
- 4.6 EXTERNAL TO PLAN INTERNAL PLASTER AND PAINT.

ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE

5. ROOF A


- 5.1 CONCRETE ROOF TILES @ 26° ON 38x38mm GRADED S.A. PINE TIMBER BATTENS @ 320mm C/C MAX ON 225x38mm PRE-FABRICATED, AS PER ENGINEER, S.A. PINE TRUSSES @ 760mm C/C MAX ON 114x38mm TIMBER WALL PLATES. TRUSSES TO BE ANCHORED WITH TWO STRANDS OF 25mm GALVANIZED STEEL WIRE FIXED 300mm DEEP IN BRICK WALL. PROVIDE SABS APPROVED PLASTIC UNDERLAY AND ISALATION INSULATION.
- 5.2 MIN. 170mm CONCRETE SLAB TO ENGINEER'S DETAIL AND DESIGN.
- 5.3 MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL.
- 5.4 WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC.
- 5.5 1500 P.V.C. RAINWATER DOWNPIPES FROM FULLBORE OUTLETS.
- 5.6 SKYLIGHTS TO MANUFACTURERS SPEC.
- 5.7 GUTTERS: MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES.
- 5.8 3mm SKIM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38x 38mm S.A. PINE BRANDING AT 450mm C/C FIXED TO TIE BEAMS.

6. WINDOWS AND DOORS

- 6.1 ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.2 THICKNESS OF PANES IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.3 EXTERNAL SLIDING DOORS: STANDARD AS PER WINDOWS TO SCHEDULE.
- 6.4 INTERNAL DOORS: STANDARD HARDWOOD FRAMES TO SCHEDULE
- 6.5 WINDOWS: TO SCHEDULE
- 6.6 SLIDING DOORS: DOORS TO SCHEDULE.

7. DRAINAGE NOTES

- 7.1 1000 uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60.
- 7.2 1000 OVP: AT HEAD OF DRAIN PIPE AS SHOWN.
- 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 25000 INTERVALS.
- 7.4 INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL.
- 7.5 DRAIN PIPE UNDER BUILDINGS TO BE PROTECTED AGAINST LOAD.
- 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS.
- 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED.
- 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTISYPHON VENTPIPES.
- 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY
- 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

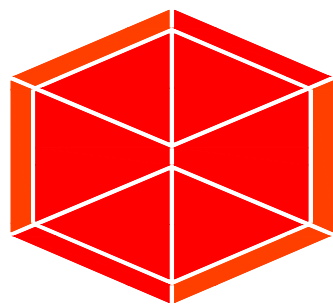

Open Studio Designs
Architectural & Interiors

Mobile 083-306-4315
Fax-086-543-8765
openstudio.design@gmail.com

STAND DESCRIPTION
NEW PROPOSED DWELLING ON
PTN 465 OF THE FARM
KROMDRAAI 560KQ
CLIENT:

WORKING DRAWINGS

TECHNOLOGISTS: W JUNG-KRUGER
ARCHITECT: W.R ELLIS

DATE: NOV 18
DRAWN: WJK

DWG NO:
SHEET: 07 OF 10

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS, WALLS, GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

COPYRIGHT NOTICE

Copyright © 2011 (Open Studio Designs cc). Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.

This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (Open Studio Design cc).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution.

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.