


SITE TO BE CLEARED OF ALL VEGETABLE
MATTER, TREE STUMPS, TIMBER AND
OTHER CELLULOSE MATERIAL, DEBRIS,
REFUSE OR CONTAMINATED FECAL
MATTER BEFORE LAYING
FOUNDATIONS.

PTN 465

PTN 453

SITE PLAN DETAIL

SCALE 1:200

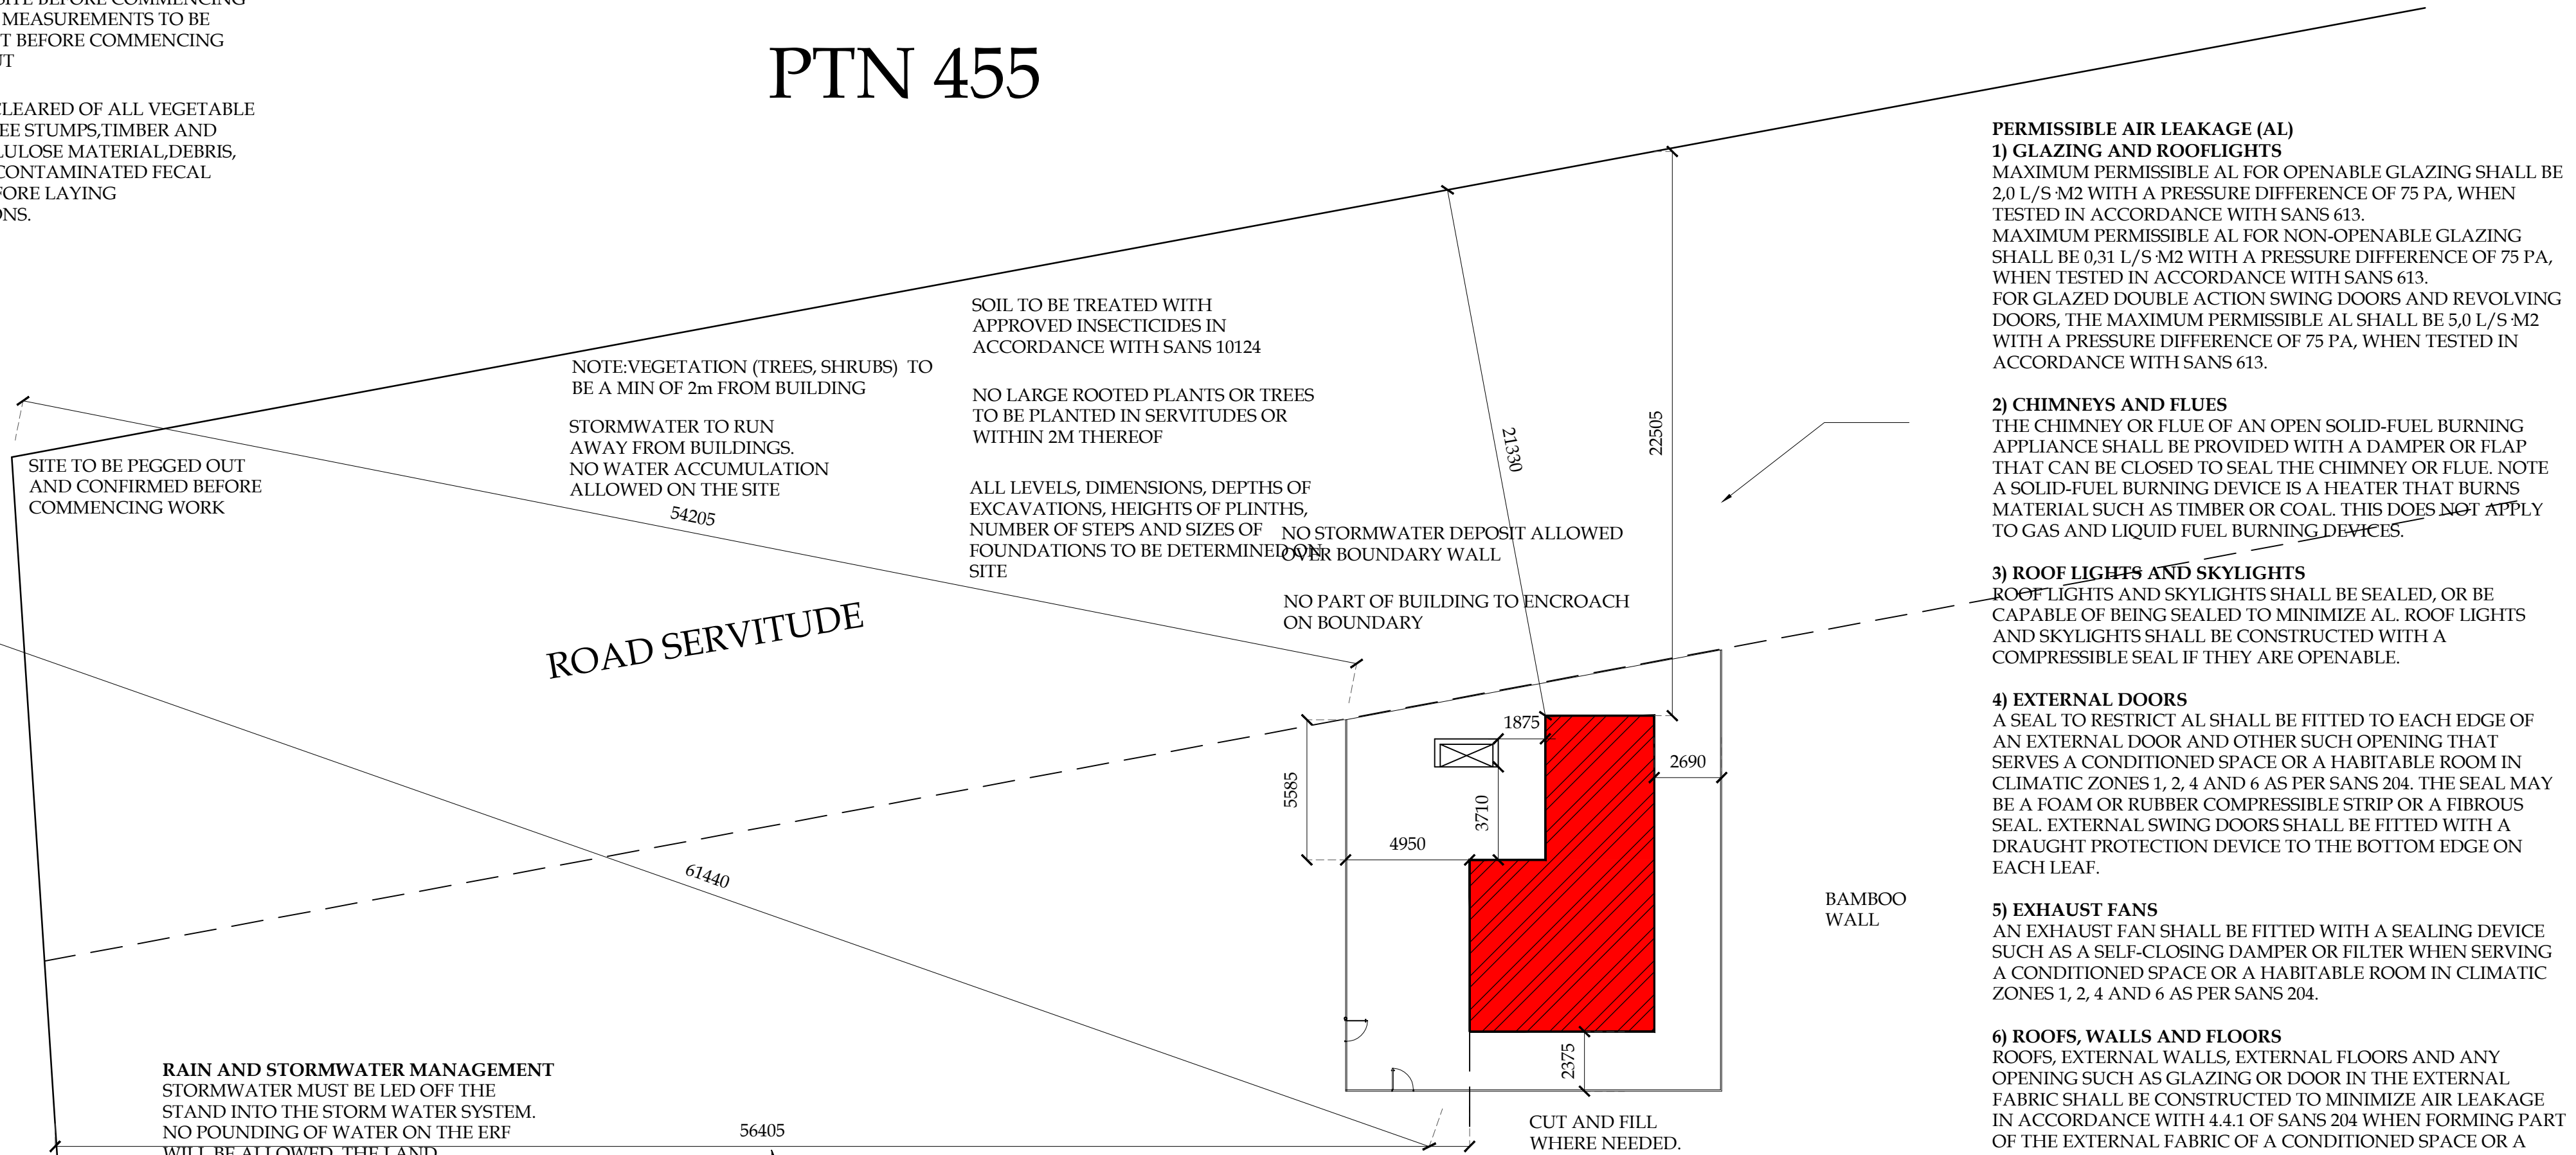

THERMAL INSULATION INSULATION SHALL COMPLY WITH MINIMUM REQUIRED R-VALUES AND BE INSTALLED SO THAT IT ABUTS OR OVERLAPS ADJOINING INSULATION OR IS SEALED, FORMS A CONTINUOUS BARRIER WITH CEILINGS, WALLS, BULKHEADS OR FLOORS THAT CONTRIBUTE TO THE THERMAL BARRIER AND DOES NOT AFFECT THE SAFE OR EFFECTIVE OPERATION OF ANY SERVICES, INSTALLATION, EQUIPMENT OR FITTINGS. THERMAL INSULATION MATERIAL SHALL BE EITHER NON-COMBUSTIBLE WHEN TESTED IN ACCORDANCE WITH SANS 10177-5 AND MAY BE INSTALLED IN ALL OCCUPANCY CLASSES OR CLASSIFIED AS COMBUSTIBLE IN ACCORDANCE WITH SANS 10177-5 AND SHALL BE TESTED AND CLASSIFIED IN ACCORDANCE WITH SANS 428 FOR ITS USE AND APPLICATION. REFLECTIVE INSULATION SHALL BE INSTALLED AND SUPPORTED WITH THE NECESSARY AIRSPACE IN ORDER TO ACHIEVE THE REQUIRED R-VALUE BETWEEN A REFLECTIVE SIDE OF THE REFLECTIVE INSULATION AND A BUILDING LINING OR CLADDING, WITH THE REFLECTIVE INSULATION TIGHTLY FITTED AND TAPED AGAINST ANY PENETRATION, DOOR OR WINDOW OPENING AND WITH EACH ADJOINING SHEET OF ROLL MEMBRANE BEING OVERLAPPED BY NOT LESS THAN 100 MM OR TAPED TOGETHER.	SPECIFICATIONS 1. GENERAL 1.1 THIS DRAWING IS NOT TO BE SCALED, USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE. 1.2 THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO.0124-1977 WITH 'SHIELDRITE' TERMITEPURFE SOIL POISONER. 1.3 TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL. 1.4 BACKFILL TO FOUNDATIONS. 1.5 TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL. 1.6 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL. 1.7 GUNDLER BRICKGRIP S.A.B.S. EMBOSSED P.P.C 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS. 1.8 STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE. 1.9 ELECTRICAL INSTALLATION SHALL BE 'HEINEMANN' EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD. 1.10 ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.
BUILDING ENVELOPE AIR SEALING ROOFS, EXTERNAL WALLS, AND FLOORS THAT FORM THE BUILDING ENVELOPE AND ANY OPENINGS SUCH AS WINDOWS AND DOORS IN THE EXTERNAL FABRIC SHALL BE CONSTRUCTED TO MINIMIZE AIR LEAKAGE. THE BUILDING SEALING CAN BE DONE BY METHODS SUCH AS CAULKING, OR ADDING SKIRTING, ARCHITRAVES, CORNICES OR ANY OTHER APPROVED METHOD.	2. FOUNDATIONS 2.1 ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL, STORMWATER DRAINAGE TO CIVIL ENGS SPECIFICATIONS. 2.2 ALL SOIL COMPACTED TO CIVIL ENGS SPECIFICATIONS. 2.3 ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.
AIR INFILTRATION AND LEAKAGE IN CLIMATIC ZONES 1, 2, 4 AND 6 THE CEILING VOIDS AND ATTICS SHALL BE DESIGNED SO AS TO MINIMIZE AIR INFILTRATION. ACCORDINGLY, WALL PLATE AND ROOF JOINTS SHALL BE SEALED. ALL TILE ROOFS IN THESE CLIMATIC ZONES SHALL HAVE A TILE UNDERLAY OR RADIANT BARRIER AND THE JOINTS SHALL BE SEALED. THE JOINTS IN SHEETED ROOFS SHALL ALSO BE SEALED.	3. FLOORS 3.1 MIN. 75mm CONCRETE SURFACE BED. 3.2 25mm CEMENT SCREED TO ALL FLOORS. 3.3 SKIRTINGS TO BE PROVIDED. 4. WALLS 4.1 120mm BRICK WALLS WITH GUNDLER BRICKGRIP DPC. 4.2 BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS 4.3 ALL BRICKWORK MIN. 7 Mpa CLASS II. 4.4 WINDOWS BUILT IN WITH GUNDLER BRICKGRIP DPC. 4.5 ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS. 4.6 EXTERNAL- TO PLAN INTERNAL- PLASTER AND PAINT.
GENERAL NOTES:	ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE
1. ALL WINDOW AREAS EXCEED 10% OF FLOOR AREA OF WHICH 50% READ FIGURED DIMENSIONS IN PREFERENCE TO SCALING. 2. ALL LEVELS DIMENSIONS, HEIGHTS OF PLINTHS, DEPTHS OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED AND DETERMINED BY CONTRACTOR ON SITE. 3. DRAWINGS PREPARED ON BASIS OF SURFACE EXAMINATION ON SITE. 4. RECOMMEND- AB'S OVER ALL WINDOWS AND DOORS WITHOUT FANLIGHTS. 5. RECOMMEND- 2AB'S TO W.C'S BATHROOMS, KITCHENS AND SERVANT'S ROOMS. 6. OBSCURE GLASS TO SERVANT'S ROOM W.C'S AND BATHROOMS. 7. ALL HANDRAILS TO BE MIN 1,000MM HIGH, BALUSTERS MAX 100 C/C	5. ROOF A 5.1 HARVEY TILE @ 30° PITCH ON 38X50mm S.A. PINE PURLINS @ 1200mm MAX C/C ON 152X38mm S.A. PINE, GRADE 6, PREFABRICATED TRUSSES @ 1200 C/C ON S.A. PINE 114X38mm WALL PLATES. TRUSSES TO BE TIED DOWN WITH HOOP IRONS THREADED THROUGH FOUR COURSES OF BRICKWORK. PROVIDE SABS APPROVED PLASTIC UNDERLAY AND SISALATION INSULATION. 5.2 MIN. 170mm CONCRETE SLAB TO ENCS DETAIL 5.3 MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL 5.4 WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC. 5.5 1500 P.V.C RAINWATER DOWNPIPES FROM FULLBORE OUTLETS. 5.6 SKYLIGHTS TO MANUFACTURERS SPEC. 5.7 GUTTERS : MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES. 5.7 3mmSKIM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38 X 38mm S.A. PINE BRANDEKING AT 450 C/C FIXED TO THE BEAMS.
6. WINDOWS AND DOORS 6.1a ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT A SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137 6.1b THICKNESS OF PANE IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137 6.2 EXTERNAL SLIDING DOORS : STANDARD AS PER WINDOWS TO SCHEDULE. 6.3 INTERNAL DOORS : STANDARD HARDWOOD FRAMES TO SCHEDULE 6.4 WINDOWS : ALUMINUM TOP-HUNG 6.5 SLIDING DOORS : STANDARD ALUMINUM SLIDING DOORS TO SCHEDULE.	6. WINDOWS AND DOORS 6.1a ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT A SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137 6.1b THICKNESS OF PANE IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137 6.2 EXTERNAL SLIDING DOORS : STANDARD AS PER WINDOWS TO SCHEDULE. 6.3 INTERNAL DOORS : STANDARD HARDWOOD FRAMES TO SCHEDULE 6.4 WINDOWS : ALUMINUM TOP-HUNG 6.5 SLIDING DOORS : STANDARD ALUMINUM SLIDING DOORS TO SCHEDULE.
7. DRAINAGE NOTES 7.1 1000 uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60. 7.2 1000 OVP. AT HEAD OF DRAIN PIPE AS SHOWN. 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 2500 INTERVALS. 7.4 INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL. 7.5 DRAIN PIPE UNDER BUILDING TO BE PROTECTED AGAINST LOAD. 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS. 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED. 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTI-SYPHON VENTPIPES. 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY OPEN GULLY. 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.	7. DRAINAGE NOTES 7.1 1000 uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60. 7.2 1000 OVP. AT HEAD OF DRAIN PIPE AS SHOWN. 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 2500 INTERVALS. 7.4 INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL. 7.5 DRAIN PIPE UNDER BUILDING TO BE PROTECTED AGAINST LOAD. 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS. 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED. 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTI-SYPHON VENTPIPES. 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY OPEN GULLY. 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

PROPOSED STAFF ROOMS
ON PTN 465
OF THE FARM KROMDRAAI 560KQ
CLIENT:

WORKING DRAWINGS

TECHNOLOGISTS:	W JUNG-KRUGER
ARCHITECT:	

DATE: OCT'18	DWG NO: H/KD
--------------	--------------

DRAWN: WJK	SHEET: 1 OF 6
------------	---------------

GENERAL NOTES:

QUALITY OF ALL MATERIALS AND WORKMANSHIP TO COMPLY WITH THE RELEVANT S.A.B.S. SPECIFICATION AND SHALL COMPLY WITH THE MINIMUM STANDARD SPECIFIED IN THE STANDARD PREAMBLES IN THE BILL OF QUANTITIES OR, IN THE ABSENCE OF A BILL OF QUANTITIES, AVAILABLE FOR PERUSAL AT THE OFFICES OF THE ARCHITECTS.

THE CONTRACTOR IS RESPONSIBLE FOR CORRECT SETTING OUT OF THE BUILDINGS, ALL EXTERNAL AND ALL INTERNAL WALLS WITH PARTICULAR REFERENCE TO BOUNDARIES, BUILDING LINES, ETC.

THE CONTRACTOR IS TO VERIFY LEVELS, HEIGHTS AND DIMENSIONS ON SITE AND TO CHECK SAME AGAINST THE DRAWINGS BEFORE PUTTING ANY WORK IN HAND. ANY DISCREPANCIES FROM THE THEORETICAL TO BE BROUGHT TO THE ARCHITECT'S ATTENTION.

THE CONTRACTOR AND ALL SUB-CONTRACTORS ARE TO CHECK THE DETAILS SHOWN ON THIS DRAWING FOR COMPLIANCE WITH STANDARDS OF BEST BUILDING PRACTICE (WHICH IS WHAT IS EXPECTED TO BE DELIVERED) WITH PARTICULAR REFERENCE TO SPECIAL REQUIREMENTS NECESSITATED BY LOCAL AND/OR ON SITE CONDITIONS AND TO REPORT ANY COMMENT TO THE ARCHITECTS.

THE CONTRACTOR IS TO LOCATE AND IDENTIFY EXISTING SERVICES ON SITE AND TO PROTECT THESE FROM DAMAGE THROUGHOUT THE DURATION OF THE WORKS.

ANY ERRORS, DISCREPANCIES OR OMISSIONS ON THIS DRAWING ARE TO BE REPORTED TO THE ARCHITECT IMMEDIATELY.

THE CONTRACTOR IS TO BUILD IN APPROVED DPCS, WHETHER OR NOT THESE ARE SHOWN ON DRAWINGS, TO ALL EXTERNAL WALLS AT EACH FLOOR, BEAM OR PARAPET LEVEL AND TO ALL WINDOWS, DOORS, GRILLES OR OTHER OPENING IN EXTERNAL WALLS. CAVITY WALLS TO HAVE STEPPED DPCS.

ANY QUERIES ARISING FROM THE ABOVE MUST BE REPORTED TO THE ARCHITECT FOR CLARIFICATION BEFORE ANY WORK IS PUT IN HAND.

THIS DRAWING IS NOT TO BE SCALED. FIGURES TO BE USED AT ALL TIMES. WHERE FIGURED DIMENSIONS ARE GIVEN, THIS MUST BE CONFIRMED BY THE ARCHITECT.

BURN'T CLAY BRICKS IN COMPLIANCE WITH THE RELEVANT S.A.B.S. CODE ONLY SHALL BE USED UNLESS SPECIFIC APPROVAL IS OBTAINED FROM THE ARCHITECT FOR THE USE OF ALTERNATIVE TYPE OF BRICK.

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS,WALLS,GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

Copyright © 2009, *Open Studio Designs cc*. Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.

This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (*Open Studio Design cc*).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution.

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.

BULKED INSULATION IN CEILINGS MAY NOT BE LESS THAN 50mm AGAINST THE WALL WHERE THERE IS NO INSULATION IN THE WALL

THERMAL INSULATION MATERIAL TO BE NON COMBUSTIBLE WHEN TESTED IN ACCORDANCE WITH SANS 10177/5 OR CLASSIFIED AS COMBUSTIBLE WITH SANS 10177/5 AND SHALL BE TESTED AND CLASSIFIED IN ACCORDANCE WITH SANS 428 FOR ITS USE AND APPLICATION

REFLECTIVE INSULATION TO BE TIGHTLY FITTED AND TAPED AGAINST ANY PENETRATION, DOOR OR WINDOW OPENING AND WITH EACH ADJOINING SHEET OF ROLL MEMBRANE BEING OVERLAPPED BY MIN 100mm OR TAPED TOGETHER.