


TO BE READ IN CONJUNCTION WITH RATIONAL DESIGN

Worst-case whole glazing element performance figures.				
1	2	3	4	5
Glass Description	Performance Values			
	Aluminium / Steel Framing		Timber / uPVC / *Aluminium Framing	
	Total U-value	SHGC	Total U-value	SHGC
Single – clear	7.9	0.81	5.6	0.77
Single – tinted	7.9	0.69	5.6	0.65
Single Low E	5.73	0.66	4.06	0.63
Clear Double (3/6/3)	4.23	0.72	3	0.68
Tinted Double	4.23	0.59	3	0.56
Clear Double Low E	3.4	0.66	2.41	0.62
Tinted Double Low E	3.4	0.54	2.41	0.51
			(*) Thermal Break Framing	

ALL WINDOWS AND DOORS TO BE CHECKED,COUNTED AND OPENINGS MEASURED BEFORE ORDERING


WINDOW SCHEDULE			
WINDOW NO.	W1	W2	W3
NO. REQUIRED	4	2	1
SIZE	2000x1200	600x900	1500x900
DESCRIPTION	AL. FRAME WINDOWS	AL. FRAME WINDOW	AL. FRAME WINDOW
LOCATION	GST: STAFF ROOMS	GST: BATHROOM	GST: NEW STAFF KITCHEN
GLAZING	SINGLE CLEAR 6MM LOW E GLAZING	OBSCURED DOUBLE GLAZING	CLEAR DOUBLE GLAZING
NOTES:	WHITE AL. FRAME WINDOWS TO MATCH EXISTING		
ADDITIONAL:	OBSCURED GLAZING TO ALL BATHROOM WINDOWS		

DOOR SCHEDULE		
DOOR NO.	D1	D2
NO. REQUIRED	1	5
DOOR	SOLID TIMBER DOOR WITH APPROVED WEATHER SEAL AND STEP	SOLID TIMBER DOOR WITH DETAIL TO CLIENT. PROVIDE APPROVED WEATHER SEAL AND STEP
FRAME	TIMBER FRAME TO MANUFACTURER	TIMBER FRAME TO MANUFACTURER
	REBATE: LH = 1 / RH = 2	REBATE: LH = 2 / RH = 4
LOCATION	GST: STAFF BATHROOM, KITCHEN PASSAGE	GST: NEW SCULLERY
GLAZING	NONE	NONE

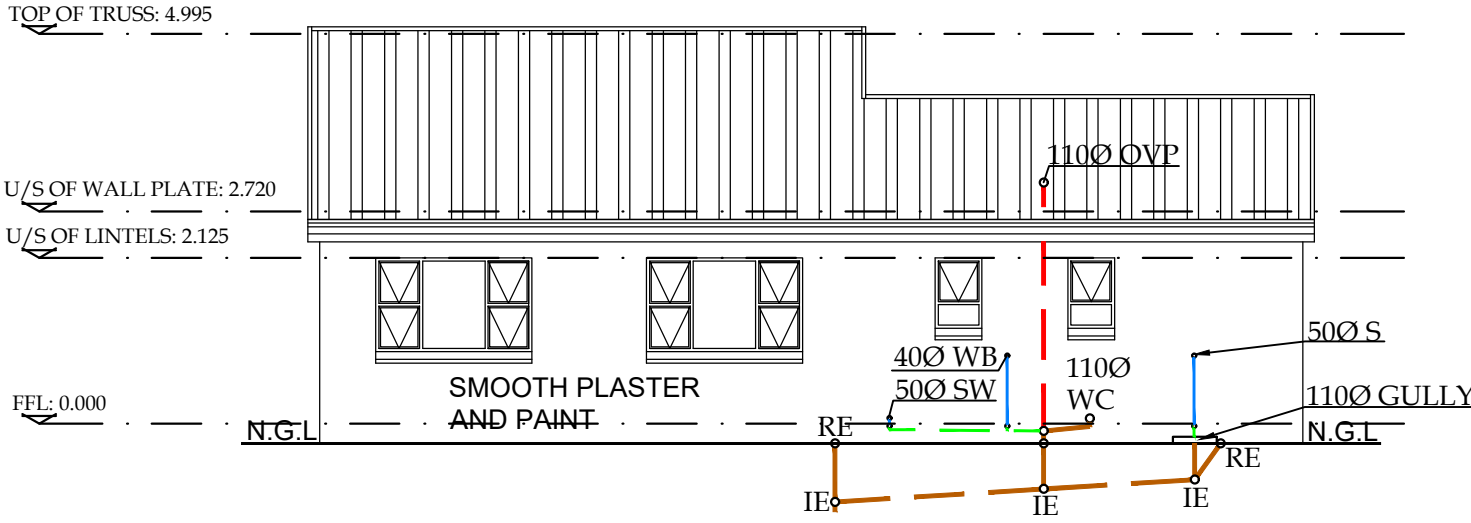


EAST ELEVATION
SCALE 1:100

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBRC PART 3 6.6.6

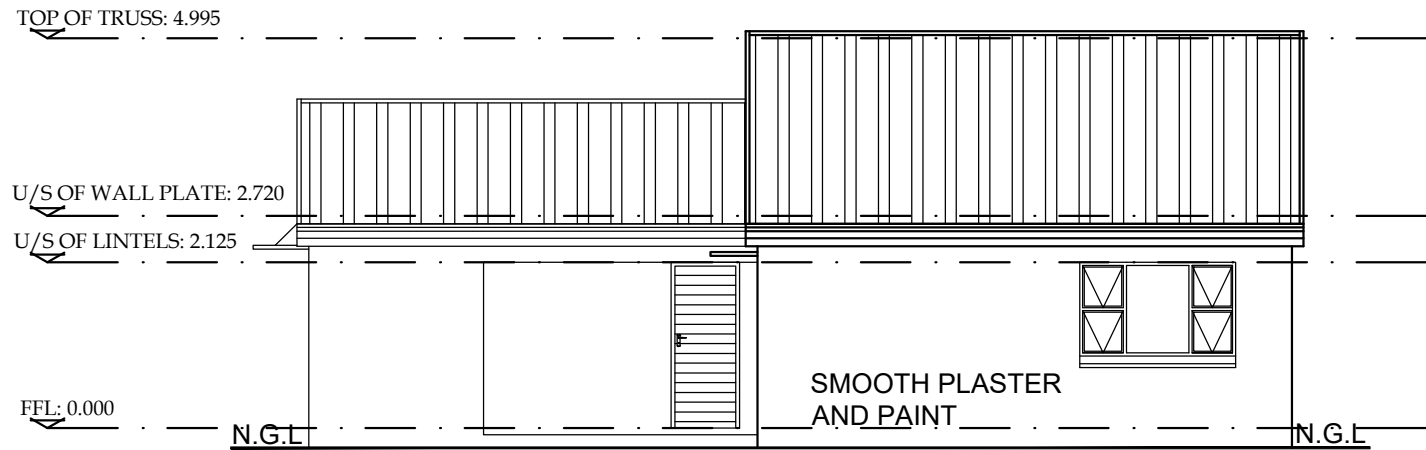

WEST ELEVATION
SCALE 1:100

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBRC PART 3 6.6.6

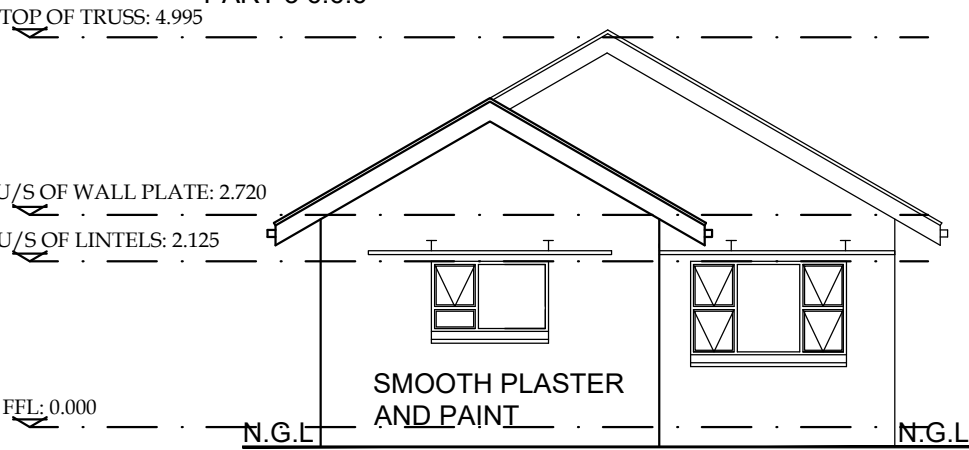

NORTH ELEVATION
SCALE 1:100

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBRC PART 3 6.6.6


NOTES TO ONE PIPE SYSTEM

- * 500 ELF BOTTLE TRAPS TO WB
- * 500 AAV'S TO SW & B
- * 1100 VV TO WC
- * MIN. INVERT LEVEL : -460mm
- * Ø110 UPVC OVPS
- * FALL OF DRAIN: 1:60 MIN.
- * 1100 PVC SD LAID TO FALL TO MANHOLE - FALL MIN. 1:60

DRAINAGE NOTES:

- NO DRAINAGE BENDS OR JUNCTIONS BELOW FLOORS.
- BENDS AND JUNCTIONS IN DRAINS TO BE FITTED WITH C.E.'S AND I.E.'S WITH MARKED COVERS AT GROUND LEVEL.
- DRAINS UNDER BUILDINGS TO BE ADEQUATELY PROTECTED AGAINST LOAD.
- WASTE PIPES TO HAVE RESEAL TRAPS AND TO BE FULLY ACCESSIBLE OVER FULL LENGTH.
- BATH WASTE: 50mm INTERNAL DIAMETER BASIN WASTE 50MM INTERNAL DIAMETER
- GULLIES AT KITCHEN TO HAVE CW TAP OVER.
- ALL SURFACE PLUMBING TO COMPLY WITH NBR'S
- GULLY TO BE MIN 85mm ABOVE N.G.L. AND NO STORMWATER TO RUN IN OR TO BE DIRECTED TO GULLY
- NO GULLY OR MANHOLE ALLOWED UNDER ANY COVERED AND ENCLOSED AREA
- VENT PIPES WHERE NEW CLOSED AREAS ARE TO BE CONSTRUCTED MUST BE MOVED OR EXTENDED TO ABOVE THE ROOF IN OPEN VENTILATED AREA
- ALL RE'S AND IE'S MUST BE ACCESSIBLE FROM N.G.L.

PLASTER SHALL NOT BE ALLOWED TO DRY OUT TOO QUICKLY AND SHALL BE DAMPENED BY MEANS OF A LIGHT SPRAY FOR A PERIOD OF NOT LESS THAN 3 DAYS. SUCCESSIVE COATS OF PLASTER SHALL NOT BE APPLIED DURING THIS PERIOD AND ONLY AFTER THE SUBSTRATE HAS HARDENED SUFFICIENTLY TO BEAR A NEW LAYER OR TO ENABLE A NEW LAYER TO ADHERE TO IT. NHBRC PART 3 6.6.6

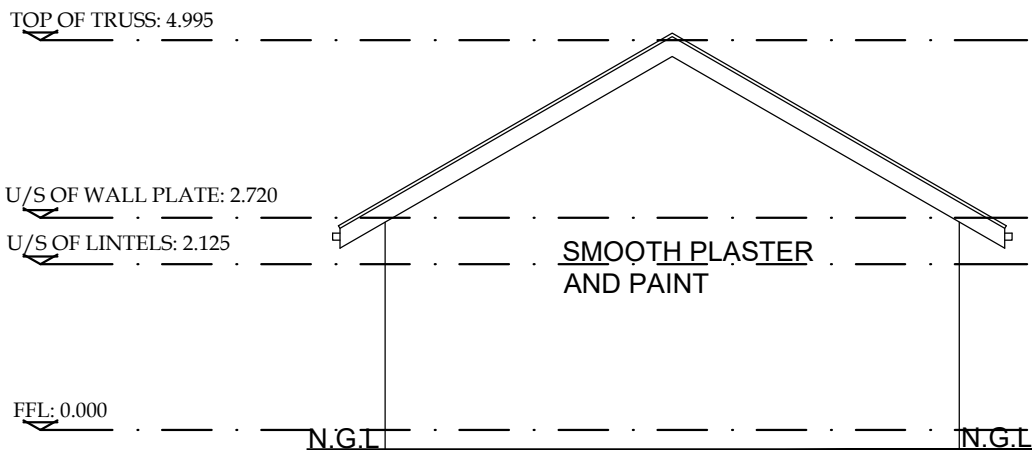

SOUTH ELEVATION
SCALE 1:100

SANS 20252-1 ABBREVIATIONS

MATERIALS	
ABS	Alkyl butal styrene
CI	Cast iron
CLPE	Cross-linked polyethylene
CONC	Concrete
COP	Copper
FC	Fibre cement
GMS	Galvanized mild steel
HDPE	High density polyethylene
LDPE	Low density polyethylene
PF	Pitch impregnated fibre
RC	Reinforced concrete
SS	Stainless steel
PVC-u	
FIXTURES AND FITTINGS	
BT	Tap (bath)
BIT	Bidet (taps and spouts)
FE	Fire extinguisher
ET	External tap
FH	Fire hydrant
FM	Fire main
FPC	Fire pump connection
FS	Fire switch

FV	Fire valve
HR	Hose reel
HSTO	Hot water storage tank
LCV	Lever control valve
NRV	Non-return valve
PCV	Pressure control valve
PRV	Pressure reducing valve
PS	pressure switch
PU	Pump
RBT	Registered break tank
RV	Reflux valve
ST	Tap (sink)
STO	Cold water storage tank
SWT	(taps and showerhead)
UA	Urinals-automatically controlled flushing device
UM	Urinals-manually operated flushing device
US	Urinals-sensor-operated flushing device
WCS	Water closet (cistern or automatic shut-off flush valve)
WBT	Tap (wash-hand basin)
WH	Water heater
WTT	Tap (wash trough)
V	Valve

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS,WALLS,GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

COPYRIGHT NOTICE

Copyright © 2011 (Open Studio Designs cc). Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.

This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (Open Studio Design cc).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution .

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.

1. GENERAL

- 1.1 THIS DRAWING IS NOT TO BE SCALED. USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE.
- 1.2 THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO.0124-1977 WITH SHELDRIE/ TERMITPRUFE SOIL.
- 1.3 TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL.
- 1.4 BACKFILL TO FOUNDATIONS.
- 1.5 TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL.
- 1.6 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL.
- 1.7 GUNDL: BRICKGRIP S.A.B.S. EMBOSSED D.P.C 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS.
- 1.8 STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE.
- 1.9 ELECTRICAL INSTALLATION SHALL BE 'HEINEMANN' EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD.
- 1.10 ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.

2. FOUNDATIONS
- 2.1 ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL STORMWATER DRAINAGE TO CIVIL ENG'S SPECIFICATIONS.
- 2.2 ALL SOIL COMPACTION TO CIVIL ENG'S SPECIFICATIONS.
- 2.3 ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.

3. FLOORS
- 3.1 MIN. 75mm CONCRETE SURFACE BED.
- 3.2 25mm CEMENT SCREED TO ALL FLOORS.
- 3.3 SKIRTINGS TO BE PROVIDED.


4. WALLS
- 4.1 220mm BRICK WALLS WITH GUNDL BRICKGRIP DPC.
- 4.2 BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS
- 4.3 ALL BRICKWORK MIN. 7 Mpa CLASS II.
- 4.4 WINDOWS BUILT IN WITH GUNDL BRICKGRIP DPC.
- 4.5 ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS.
- 4.6 EXTERNAL-TO PLAN INTERNAL-PLASTER AND PAINT.

ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE

5. ROOF A
- 5.1 CROMADEK SHEETING @ 30° PITCH- DARK DOLPHIN ON 38X50mm S.A. PINE PURLINS @ 1200mm MAX C/C. ON 152X38mm S.A.PINE. GRADE 6, PREFABRICATED TRUSSES @ 1200 C/C ON S.A. PINE 114X38mm WALL PLATES. TRUSSES TO BE TIED DOWN WITH HOOP IRONS THREADED THROUGH FOUR COURSES OF BRICKWORK. PROVIDE SABS APPROVED PLASTIC UNDERLAY AND SISALATION INSULATION.
- 5.2 MIN.170mm CONCRETE SLAB TO ENG'S DETAIL.
- 5.3 MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL.
- 5.4 WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC.
- 5.5 1500 P.V.C RAINWATER DOWNPIPES FROM FULLBORE OUTLETS.
- 5.6 SKYLIGHTS TO MANUFACTURERS SPEC.
- 5.7 GUTTERS : MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES.
- 5.7 3mmSKIM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38 X 38mm S.A. PINE BRANDING AT 450 C/C FIXED TO TIE BEAMS.

6. WINDOWS AND DOORS
- 6.1a ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT A SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.1b THICKNESS OF PANES IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.2 EXTERNAL SLIDING DOORS : STANDARD AS PER WINDOWS TO SCHEDULE.
- 6.3 INTERNAL DOORS : STANDARD HARDWOOD FRAMES TO SCHEDULE
- 6.4 WINDOWS : ALUMINUM TOP-HUNG
- 6.5 SLIDING DOORS :STANDARD ALUMINIUM SLIDING DOORS TO SCHEDULE.

7. DRAINAGE NOTES
- 7.1 1000 uPVC. SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60.
- 7.2 1000 OVP. AT HEAD OF DRAIN PIPE AS SHOWN.
- 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 25000 INTERVALS.
- 7.4 INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL.
- 7.5 DRAIN PIPE UNDER BUILDING TO BE PROTECTED AGAINST LOAD.
- 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS.
- 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED.
- 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTISYPHON VENTPIPES.
- 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY OPEN GULLY
- 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

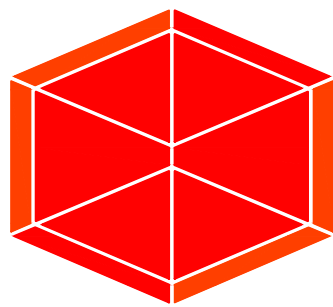

Open Studio Designs
Architectural & Interiors

Mobile 083-306-4315
Fax-086-543-8765
openstudio.design@gmail.com

PROPOSED STAFF ROOMS

ON PTN 465

OF THE FARM KROMDRAAI 560KQ

CLIENT:

WORKING DRAWINGS

TECHNOLOGISTS:	W JUNG-KRUGER
ARCHITECT:	

DATE: OCT'18

DWG NO: H/KD

DRAWN: WJK

SHEET : 4 OF 6