


- GENERAL NOTES:
1. ALL WINDOW AREAS EXCEED 10% OF FLOOR AREA OF WHICH 50%
 2. READ FIGURED DIMENSIONS IN PREFERENCE TO SCALING.
 3. ALL LEVELS DIMENSIONS, HEIGHTS OF PLINTHS, DEPTHS OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED AND DETERMINED BY CONTRACTOR ON SITE. DRAWINGS PREPARED ON BASIS OF SURFACE EXAMINATION ON SITE.
 4. RECOMMEND- AB'S OVER ALL WINDOWS AND DOORS WITHOUT FANLIGHTS.
 5. RECOMMEND- 2AB'S TO W.C'S BATHROOMS, KITCHENS AND SERVANTS ROOMS.
 6. OBSURE GLASS TO SERVANTS ROOM W.C'S AND BATHROOMS.
 7. ALL HANDRAILS TO BE MIN 1,000MM HIGH, BALUSTERS MAX 100 C/C
- AIR INFILTRATION AND LEAKAGE
- IN CLIMATIC ZONES 1, 2, 4 AND 6 THE CEILING VOIDS AND ATTICS SHALL BE DESIGNED SO AS TO MINIMIZE AIR INFILTRATION. ACCORDINGLY, WALL PLATE AND ROOF JUNCTIONS SHALL BE SEALED. ALL TILE ROOFS IN THESE CLIMATIC ZONES SHALL HAVE A TILE UNDERLAY OR RADIANT BARRIER AND THE JOINTS SHALL BE SEALED. THE JOINTS IN SHEETED ROOFS SHALL ALSO BE SEALED.
- ALL TIMBER TO BE TREATED FOR DRY ROT/TERMITES AND SEALED WITH APPROVED WEATHER PROTECT SEALANT
- BULKED INSULATION IN CEILINGS MAY NOT BE LESS THAT 50mm AGAINST THE WALL WHERE THE IS NO INSULATION IN THE WALL
- THERMAL INSULATION MATERIAL TO BE NON COMBUSTIBLE WHEN TESTED IN ACCORDANCE WITH SANS 10177/5 OR CLASSIFIED AS COMBUSTIBLE WITH SANS 10177/5 AND SHALL BE TESTED AND CLASSIFIED IN ACCORDANCE WITH SANS 428FOR ITS USE AND APPLICATION
- REFLECTIVE INSULATION TO BE TIGHTLY FITTED AND TAPED AGAINST ANY PENETRATION, DOOR OR WINDOW OPENING AND WITH EACH ADJOINING SHEET OF ROLL MEMBRANE BEEN OVERLAPPED BY MIN 100mm OR TAPED TOGETHER.
- BUILDING ENVELOPE AIR SEALING
- ROOFS, EXTERNAL WALLS, AND FLOORS THAT FORM THE BUILDING ENVELOPE AND ANY OPENING SUCH AS WINDOWS AND DOORS IN THE EXTERNAL FABRIC SHALL BE CONSTRUCTED TO MINIMIZE AIR LEAKAGE. THE BUILDING SEALING CAN BE DONE BY METHODS SUCH AS CAULKING, OR ADDING SKIRTING, ARCHITRAVES, CORNICES OR ANY OTHER APPROVED METHOD.

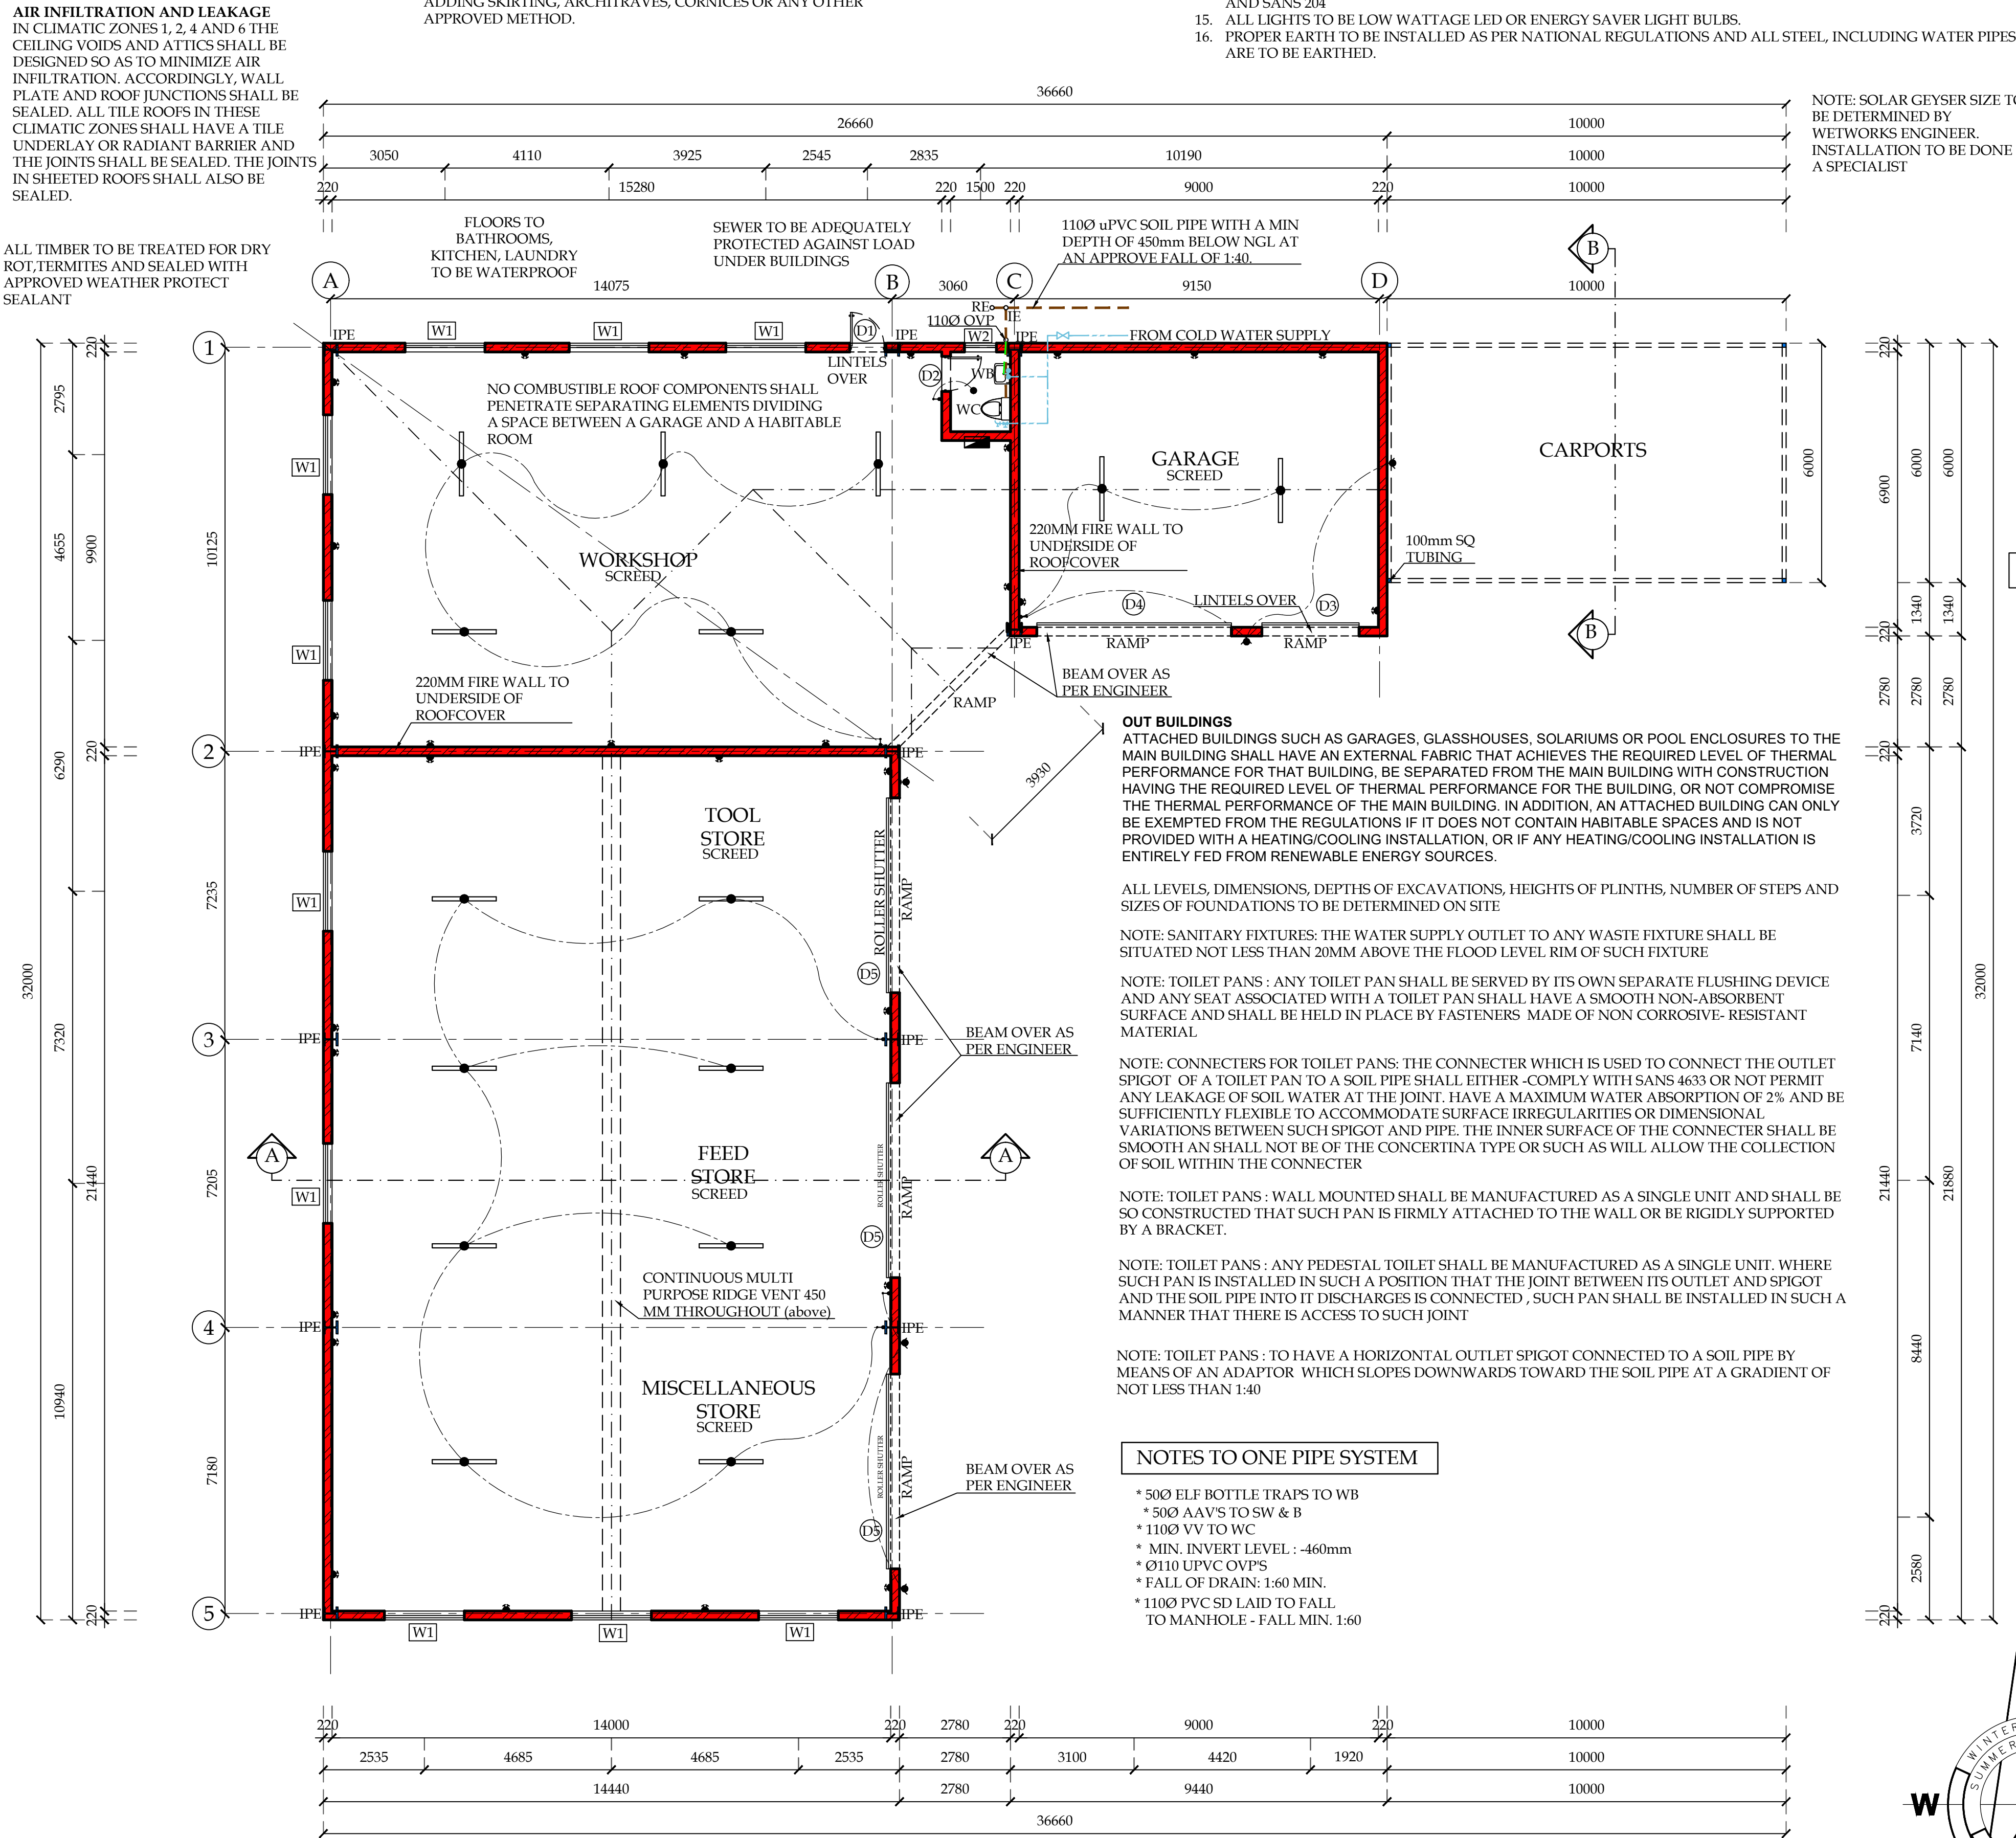

- ELECTRICAL NOTES:
1. 3 PHASE CONNECTION TO BE PROVIDED IF POSSIBLE.
 2. TELEPHONE ENTRY POINT TO BE PROVIDED AT SUITABLE POINT TO BE DISCUSSED WITH G.P.O.
 3. ALL TELEPHONE CONDUITS TO BE SUPPLIED WITH DRAW-WIRE.
 4. PROVIDE COVER PLATES TO 100x75 TELEPHONE OUTLETS.
 5. SABS APPROVED EARTH LEAKAGE UNIT TO BE PROVIDED.
 6. 100x100 T.V. OUTLET BOXES AT 220mm ABOVE FINISHED FLOOR OR AS OTHERWISE INDICATED, LINKED WITH 25mm CONDUIT IN SERIES TO OUTLET BOX ALONGSIDE PLUG OUTLET IN GARAGE.
 7. EXTEND CONDUIT TO AERIAL/SATELITE DISH IN POSITION TO BE DISCUSSED WITH ARCHITECT.
 8. 21mm SEPARATE EARTH CONDUIT FROM THAT POINT DOWN TO FLOOR AND THROUGH SURFACE BED TO OUTSIDE.
 9. THE ELECTRICAL CONTRACTOR MUST CALCULATE THE TOTAL LOAD AND MAKE ALL NECESSARY PROVISIONS FOR THE INSTALLATION.
 10. THE REQUIRED AMPS PER PHASE AND CIRCUIT MUST BE CALCULATED AND PROVIDE FOR.
 11. APPROVED RATED BREAKERS TO BE PROVIDED FOR EACH CIRCUIT.
 12. ALL ELECTRICAL INSTALLATIONS MUST BE SABS APPROVED AND BE DONE BY A REGISTERED AND QUALIFIED ELECTRICIAN.
 13. PROPER TESTING TO BE DONE AFTER INSTALLATION AND WIRING CERTIFICATE NEEDS TO BE ISSUED IF ALL IS IN ORDER.
 14. ALL INSTALLATIONS ARE TO BE AS ENERGY EFFICIENT AS POSSIBLE AND MUST COMPLY WITH SANS 10400XA AND SANS 204
 15. ALL LIGHTS TO BE LOW WATTAGE LED OR ENERGY SAVER LIGHT BULBS.
 16. PROPER EARTH TO BE INSTALLED AS PER NATIONAL REGULATIONS AND ALL STEEL, INCLUDING WATER PIPES ARE TO BE EARTHED.

- ELECTRICAL LEGEND
- SURFACE MOUNTED CEILING LIGHT LOW WATTAGE (1 OF)
 - RECESSED BULKHEAD LIGHT LOW WATTAGE
 - RECESSED INCANDESCENT CEILING LIGHT LOW WATTAGE
 - RECESSED LOW-WATTAGE LED DOWNLIGHTER
 - RECESSED LOW-WATTAGE WALL WASHER
 - WALL MOUNTED LIGHT POINT -LED LOW WATTAGE
 - WATERPROOF WALL MOUNTED FLUORESCENT BULB (5 OF)
 - SURFACE MOUNTED FLUORESCENT LIGHT
 - RECESSED FLUORESCENT LIGHT (15 OF)
 - LIGHTING TRACK LENGTH AS PER PLAN
 - WATERPROOF SPIKE LIGHT ON ARMOUR CABLE
 - LIGHT SWITCH
 - WATERTIGHT LIGHT SWITCH
 - DIMMER LIGHT SWITCH
 - 2 WAY LIGHT SWITCH
 - 15 AMP PLUG AT 220mm ABOVE F.F.L OR AS INDICATED
 - DOUBLE 15 AMP PLUG AT 220mm ABOVE F.F.L OR AS INDICATED (30 OF)
 - WATER PROOF DOUBLE 15 AMP PLUG AT 220mm OR AS INDICATED
 - SHAVER SOCKET / HAIR DRYER OUTLET
 - TELEVISION POINT AT 220mm ABOVE F.F.L OR AS INDICATED
 - GEYSER CONNECTION POINT CONNECTED TO SOLAR PANELS/ HEAT PUMP. GEYSER TO HAVE A SOLAR BLANKET.
 - TELEPHONE POINT AT 220mm ABOVE F.F.L OR AS INDICATED
 - INTERCOM POINT AT 220mm ABOVE F.F.L OR AS INDICATED
 - STOVE / OVEN CONNECTION POINT
 - STOVE / OVEN ISOLATOR SWITCH
 - BELL PUSH
 - BELL POINT
 - UNDERFLOOR HEATING THERMOSTAT
 - BATHROOM HEATER POINT
 - CEILING MOUNTED FAN
 - OUTLET FOR ELECTRICAL POINT AS SPECIFIED ON PLAN
 - DISTRIBUTION BOARD- TO SANS 10142-1
 - CHANDELIER LOW WATTAGE
 - EXTRACTOR FAN CONNECTED TO LIGHT SWITCH. AIR MAY NOT BE RECIRCULATED IN BATHROOMS & DRESSER
 - FLUORESCENT TUBELIGHT
 - WI-FI POINT

SANS 10252-1 WATER LEGEND

	Isolating valve (screwed ends) (manual control)
	Stop cock
	Mixer (two manual controls)
	Tap (internal)

ECO FLEX INSULATION TO HOT WATER PIPES TO SANS 10177-9 AND SANS 1077-10

ALL HOT WATER PIPES TO BE INSULATED TO ACHIEVE AN R VALUE OF 1

HOT WATER SYSTEM BE BE MAINTAINED IN ACCORDANCE WITH SANS 10252-1

SOLAR WATER HEATING SYSTEM TO SANS 1307 AND 10106. THERMAL PERFORMANCE TO BE DETERMINED IN ACCORDANCE WITH SANS 6211-1 AND 6211-2

INSTALLATION THEREOF WILL BE IN ACCORDANCE WITH SANS 10254

PIPING TO BE INSULATED INCLUDES ALL FLOW AND RETURN PIPING, COLD WATER SUPPLY PIPING WITHIN 1M OF THE CONNECTION TO THE HEATING OR COOLING SYSTEM AND PRESSURE RELIEF PIPING WITHIN 1M OF THE CONNECTION TO THE HEATING OR COOLING SYSTEM. WHERE POSSIBLE, LENGTH OF PIPE RUNS SHOULD BE MINIMIZED

50% of HOT WATER TO COME FROM ALTERNATIVE SOURCE. GEYSER TO BE MAINTAINED AT 60° C

HOT WATER VESSELS AND TANKS TO HAVE A MIN R VALUE OF 2

SPECIFICATION OF WATERPIPING MATERIAL:

PIPES > 75mm

CLASS 12 U PVC PIPES TO SABS 966 WITH FLEXIBLE JOINTS.

PIPES < 75mm

EITHER HDPE TYPE IV CLASS 12 TO SABS 533 WITH PLASSON JOINTS OR EQUAL (SUCH AS POLY PROPYLENE PIPE).

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS,WALLS,GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

COPYRIGHT NOTICE

Copyright © 2011 (Open Studio Designs cc). Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.


This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (Open Studio Design cc).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution.

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.

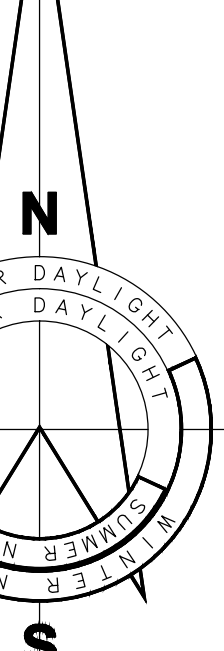

- SPECIFICATIONS
1. GENERAL
 - 1.1 THIS DRAWING IS NOT TO BE SCALED. USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE.
 - 1.2 THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO.0124-1977 WITH SHELLDRITE/ TERMITEPURFE SOIL POISONER
 - 1.3 TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL.
 - 1.4 BACKFILL TO FOUNDATIONS.
 - 1.5 TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL.
 - 1.6 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL.
 - 1.7 GUNDLER BRICKGRIP S.A.B.S. EMBOSSED D.P.C 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS.
 - 1.8 STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE.
 - 1.9 ELECTRICAL INSTALLATION SHALL BE HEINEMANN/ EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD.
 - 1.10 ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.
 2. FOUNDATIONS
 - 2.1 ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL STORMWATER DRAINAGE TO CIVIL ENG'S SPECIFICATIONS.
 - 2.2 ALL SOIL COMPACTION TO CIVIL ENG'S SPECIFICATIONS.
 - 2.3 ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.
 3. FLOORS
 - 3.1 MIN. 75mm CONCRETE SURFACE BED.
 - 3.2 25mm CEMENT SCREED TO ALL FLOORS.
 - 3.3 SKIRTINGS TO BE PROVIDED.
 4. WALLS
 - 4.1 220mm BRICK WALLS WITH GUNDLER BRICKGRIP DPC.
 - 4.2 BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS
 - 4.3 ALL BRICKWORK MIN. 7 MPa CLASS II.
 - 4.4 WINDOWS BUILT IN WITH GUNDLER BRICKGRIP DPC.
 - 4.5 ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS.
 - 4.6 EXTERNAL TO PLAN INTERNAL PLASTER AND PAINT.
 - ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE
 5. ROOF A
 - 5.1 CHROMADEK SHEETING @ 10° PITCH- DARK DOLPHIN ON STEEL PORTAL FRAME AS PER ENGINEER
 - 5.2 MIN. 170mm CONCRETE SLAB TO ENG'S DETAIL.
 - 5.3 MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL.
 - 5.4 WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC.
 - 5.5 1500 P.V.C RAINWATER DOWNPIPES FROM FULLBORE OUTLETS.
 - 5.6 SKYLIGHTS TO MANUFACTURERS SPEC.
 - 5.7 GUTTERS : MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES.
 - 5.8 3mm SKIM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38 X 38mm S.A. PINE BRANDING AT 450 C/C FIXED TO TIE BEAMS.
 6. WINDOWS AND DOORS
 - 6.1a ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT A SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137
 - 6.1b THICKNESS OF PANES IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137
 - 6.2 EXTERNAL SLIDING DOORS : STANDARD AS PER WINDOWS TO SCHEDULE.
 - 6.3 INTERNAL DOORS : STANDARD HARDWOOD FRAMES TO SCHEDULE
 - 6.4 WINDOWS : ALUMINUM TOP-HUNG
 - 6.5 SLIDING DOORS : STANDARD ALUMINUM SLIDING DOORS TO SCHEDULE.
 7. DRAINAGE NOTES
 - 7.1 1000 uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60.
 - 7.2 1000 OVP. AT HEAD OF DRAIN PIPE AS SHOWN.
 - 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 2500M INTERVALS.
 - 7.4 INSPECTION EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL.
 - 7.5 DRAIN PIPE UNDER BUILDING TO BE PROTECTED AGAINST LOAD.
 - 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS.
 - 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED.
 - 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTISYPHON VENTILES.
 - 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY OPEN GULLY.
 - 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

Open Studio Designs

Architectural & Interiors

Mobile 083-306-4315
Fax-086-543-8765
openstudio.design@gmail.com

PROPOSED WORKSHOP ON PTN 465 OF THE FARM KROMDRAAI 560KQ CLIENT:	
WORKING DRAWINGS	
TECHNOLOGISTS:	W JUNG-KRUGER
ARCHITECT:	
DATE: OCT'18	DWG NO: H/KD
DRAWN: WJK	SHEET : 3 OF 7