
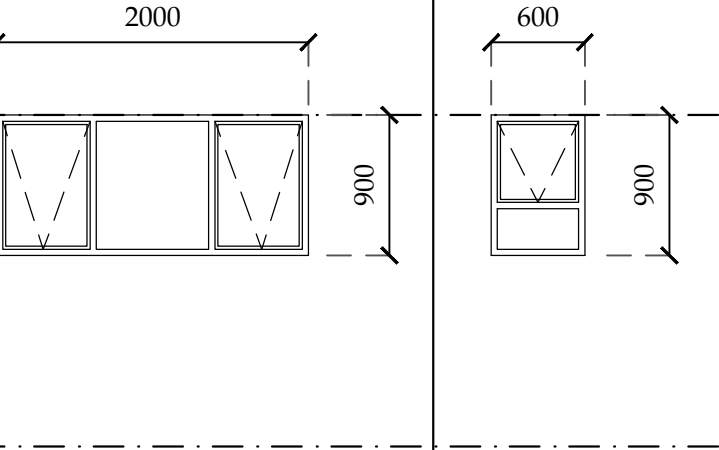
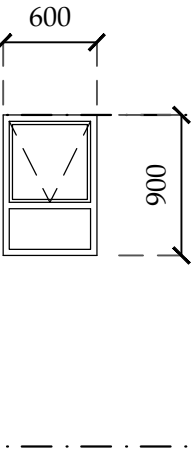
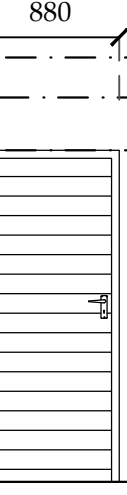
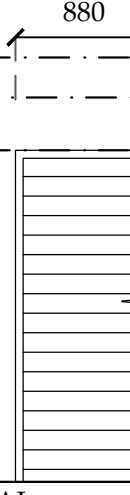
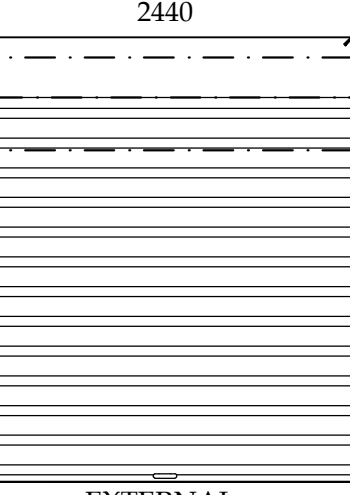
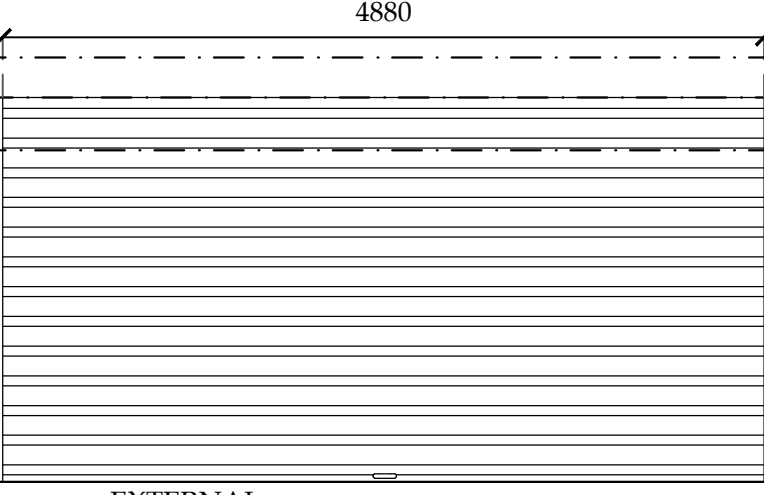
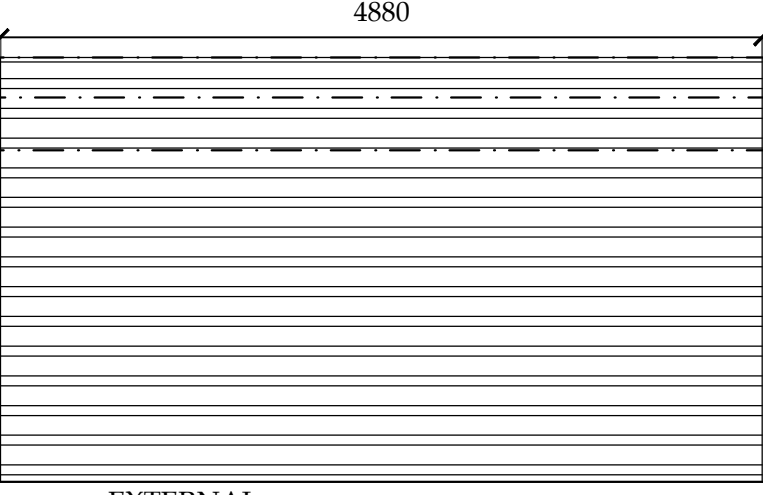


WINDOW SCHEDULE		
		
WINDOW NO.	W1	W2
NO. REQUIRED	10	1
SIZE	2000x900	600x900
DESCRIPTION	PTT209	PT169
LOCATION	GST: STORE ROOM AND WORKSHOP	GST: WORKSHOP WC
GLAZING	SINGLE GLAZED GLASS	SINGLE OBSCURED GLAZING
NOTES:	AL. FRAME WINDOWS	
ADDITIONAL:	OBSCURED GLAZING TO ALL BATHROOM WINDOWS	

ALL WINDOWS AND DOORS TO BE CHECKED,COUNTED
AND OPENINGS MEASURED BEFORE ORDERING

DOOR SCHEDULE					
					
	EXTERNAL	INTERNAL	EXTERNAL	EXTERNAL	EXTERNAL
DOOR NO.	D1	D2	D3	D4	D5
NO. REQUIRED	1	1	1	1	3
DOOR	SOLID TIMBER DOOR WITH DETAIL TO CLIENT. PROVIDE APPROVED WEATHER SEAL AND STEP	SOLID TIMBER DOOR WITH DETAIL TO CLIENT. PROVIDE APPROVED WEATHER SEAL AND STEP	2440x2125mm ROLLER SHUTTER DOOR	4880x2125mm ROLLER SHUTTER DOOR	4880x2465mm ROLLER SHUTTER DOOR
FRAME	TIMBER FRAME TO MANUFACTURER	TIMBER FRAME TO MANUFACTURER	FRAME AND GUIDES BY MANUFACTURER	FRAME AND GUIDES BY MANUFACTURER	FRAME AND GUIDES BY MANUFACTURER
	REBATE: LH = 0 / RH = 1	REBATE: LH = 0 / RH = 1	REBATE: ROLLER SHUTTER	REBATE: ROLLER SHUTTER	REBATE: ROLLER SHUTTER
LOCATION	GST: WORKSHOP	GST: WORKSHOP WC	GST: GARAGE	GST: GARAGE	GST: STORE ROOMS
GLAZING	NONE	NONE	NONE	NONE	NONE

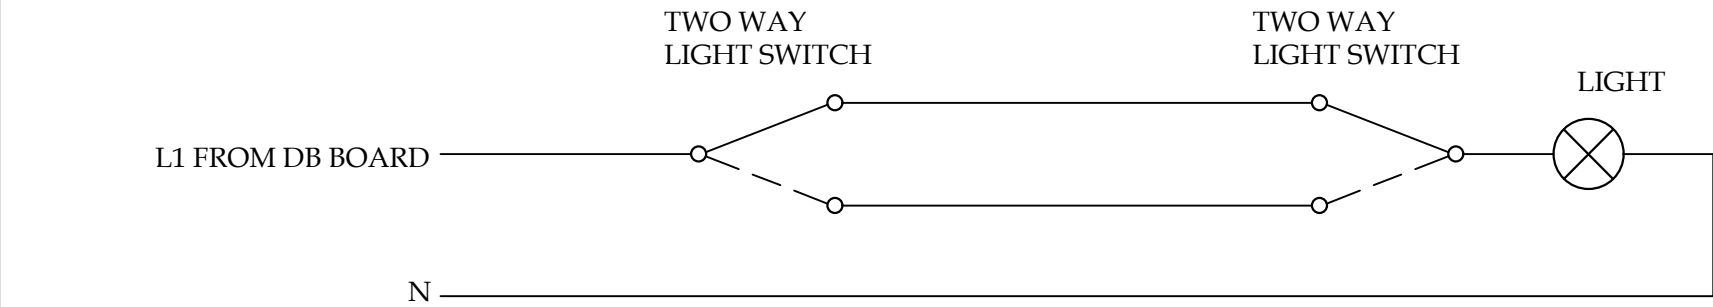

TWO WAY LIGHT SWITCHING SCHEMATIC DIAGRAM SCALE N.T.S

TABLE 5.1.9			
MINIMUM NUMBER OF COURSES	MAXIMUM ROOF SPAN		
	NO ROOF	LIGHT ROOF	HEAVY ROOF
85MM COURSE HEIGHT:	NOMINAL THICKNESS ≤ 140mm		
4	3.0	2.0	1.5
5	3.0	2.5	2.0
6	3.0	3.0	2.5
9	3.0	3.0	3.0
85MM COURSE HEIGHT:	NOMINAL THICKNESS < 190mm		
4	3.0	2.0	2.0
5	3.5	2.5	2.5
6	3.5	3.5	3.0
9	3.5	3.5	3.5
100MM COURSE HEIGHT:	NOMINAL THICKNESS < 140mm		
3	3.0	2.0	1.5
4	3.0	2.5	2.0
5	3.0	3.0	2.5
8	3.0	3.0	2.5
100MM COURSE HEIGHT:	NOMINAL THICKNESS < 190mm		
3	2.5	2.0	2.0
4	3.0	2.5	2.0
5	3.5	3.5	3.0
8	3.5	3.5	3.5


PRE-STRESSED CONCRETE LINTELS :
PRECAST CONCRETE LINTELS SHALL COMPLY WITH THE RELEVANT REQUIREMENTS OF SABS 1504 AND BE BUILT INTO WALLS COMPOSITELY WITH MASONRY. SUCH LINTELS SHALL BE CONSTRUCTED IN ACCORDANCE WITH TABLE 5.8 AND CONTAIN NOT LESS THAN THE NUMBER OF COURSES SET OUT IN TABLE 5.2 SECONDARY REINFORCEMENT IN ACCORDANCE WITH TABLE 5.1.5 SHALL BE PROVIDED IN UPPERMOST BED JOINTS. LINTELS SHALL BE SET IN CLASS ii MORTAR AND HAVE A MINIMUM BEARING OF:

* LINTELS SUPPORTING MASONRY ONLY =150mm
* LINTELS SUPPORTING ROOF TRUSSES
SPAN <1.5m =150mm
SPAN 1.5-2.5m=250mm
SPAN >2.5m =350mm

LINTELS SHALL BE CLEANED AND WETTED PRIOR TO RECEIVING MORTAR

LINTELS THAT SUPPORT ROOF TRUSSES TO BE BUILT INTO BRICKWORK:

1. LINTELS WITH A SPAN OF 1.5m OR LESS = 150MM
2. SPAN OF 1.5M - 2.5M = 250MM
3. SPAN GREATER THAN 2.5M = 350MM
LINTELS TO BE SUPPORTED ADEQUATELY FOR NOT LESS THAN 7 DAYS AFTER COMPLETION

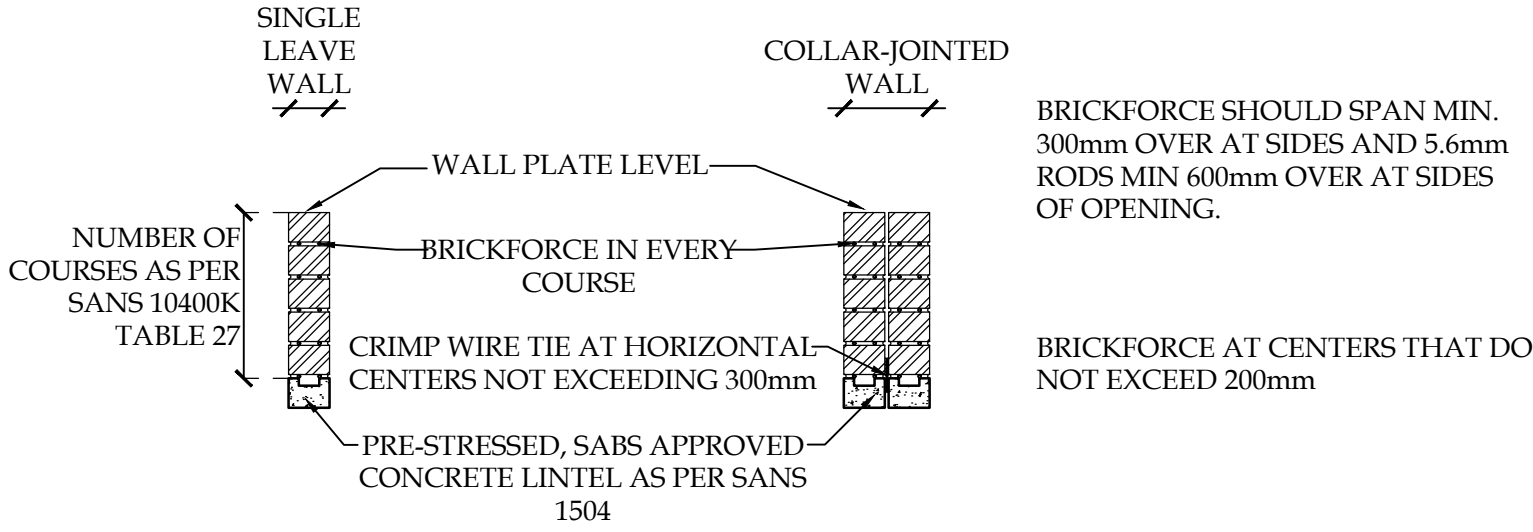

TYPICAL LINTEL DETAIL SCALE 1:20

PERMISSIBLE AIR LEAKAGE (AL)

1) GLAZING AND ROOFLIGHTS

MAXIMUM PERMISSIBLE AL FOR OPENABLE GLAZING SHALL BE 2.0 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.
MAXIMUM PERMISSIBLE AL FOR NON-OPENABLE GLAZING SHALL BE 0.31 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.
FOR GLAZED DOUBLE ACTION SWING DOORS AND REVOLVING DOORS, THE MAXIMUM PERMISSIBLE AL SHALL BE 5.0 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.

2) CHIMNEYS AND FLUES

THE CHIMNEY OR FLUE OF AN OPEN SOLID-FUEL BURNING APPLIANCE SHALL BE PROVIDED WITH A DAMPER OR FLAP THAT CAN BE CLOSED TO SEAL THE CHIMNEY OR FLUE. NOTE A SOLID-FUEL BURNING DEVICE IS A HEATER THAT BURNS MATERIAL SUCH AS TIMBER OR COAL. THIS DOES NOT APPLY TO GAS AND LIQUID FUEL BURNING DEVICES.

3) ROOF LIGHTS AND SKYLIGHTS

ROOF LIGHTS AND SKYLIGHTS SHALL BE SEALED, OR BE CAPABLE OF BEING SEALED TO MINIMIZE AL. ROOF LIGHTS AND SKYLIGHTS SHALL BE CONSTRUCTED WITH A COMPRESSIBLE SEAL IF THEY ARE OPENABLE.

4) EXTERNAL DOORS

A SEAL TO RESTRICT AL SHALL BE FITTED TO EACH EDGE OF AN EXTERNAL DOOR AND OTHER SUCH OPENING THAT SERVES A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204. THE SEAL MAY BE A FOAM OR RUBBER COMPRESSIBLE STRIP OR A FIBROUS SEAL. EXTERNAL SWING DOORS SHALL BE FITTED WITH A DRAUGHT PROTECTION DEVICE TO THE BOTTOM EDGE ON EACH LEAF.

5) EXHAUST FANS

AN EXHAUST FAN SHALL BE FITTED WITH A SEALING DEVICE SUCH AS A SELF-CLOSING DAMPER OR FILTER WHEN SERVING A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204.

6) ROOFS, WALLS AND FLOORS

ROOFS, EXTERNAL WALLS, EXTERNAL FLOORS AND ANY OPENING SUCH AS GLAZING OR DOOR IN THE EXTERNAL FABRIC SHALL BE CONSTRUCTED TO MINIMIZE AIR LEAKAGE IN ACCORDANCE WITH 4.4.1 OF SANS 204 WHEN FORMING PART OF THE EXTERNAL FABRIC OF A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204.

SPECIFICATIONS

- GENERAL
- 1.1 THIS DRAWING IS NOT TO BE SCALED. USE FIGURED DIMENSIONS ONLY. ALL DIMENSIONS AND HEIGHTS TO BE CHECKED AND VERIFIED BEFORE ANY WORK COMMENCES ON SITE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY. ALL LEVELS, HEIGHTS OF PLINTHS, DEPTH OF EXCAVATIONS AND NUMBER OF STEPS TO BE FINALLY CHECKED BY CONTRACTOR ON SITE.
- 1.2 THE SITE TO BE TREATED IN ACCORDANCE WITH S.A.B.S. CODE OF PRACTICE NO.0124-1977 WITH SHELLDRITE® TERMITEPURFE SOIL POISONER.
- 1.3 TOP OF FOUNDATIONS TO BE A MINIMUM OF 300mm BELOW NATURAL GROUND LEVEL.
- 1.4 BACKFILL TO FOUNDATIONS.
- 1.5 TOP OF 75mm CONCRETE SURFACE BED TO BE MINIMUM OF 150mm ABOVE FINISHED GROUND LEVEL.
- 1.6 75mm THICK CONCRETE SURFACE BED TO BE ON 'GUNPLAS' USB GREEN DAMP PROOF MEMBRANE ON SAND BINDING ON WELL COMPACTED FILL.
- 1.7 'GUNDLE' BRICKGRIP S.A.B.S. EMBOSSED D.P.C 375 MIC. UNDER ALL WALLS, WINDOW CILLS AND AT CHANGES IN FLOOR LEVELS.
- 1.8 STORMWATER SHALL BE REMOVED FROM DWELLING, YARD AND SITE.
- 1.9 ELECTRICAL INSTALLATION SHALL BE 'HEINEMANN' EARTH LEAKAGE SYSTEM IN DISTRIBUTION BOARD.
- 1.10 ALL BUILDING WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES BUILDING BY-LAWS AND REGULATIONS.

- FOUNDATIONS
- 2.1 ALL FOUNDATIONS, RETAINING WALLS, STRUCTURAL CONCRETE WORK AND SUB SOIL STORMWATER DRAINAGE TO CIVIL ENG'S SPECIFICATIONS.
- 2.2 ALL SOIL COMPACTION TO CIVIL ENG'S SPECIFICATIONS.
- 2.3 ALL FOUNDATIONS TO BE REINFORCED AS REQUIRED BY ENGINEER.

- FLOORS
- 3.1 MIN. 75mm CONCRETE SURFACE BED.
- 3.2 25mm CEMENT SCREED TO ALL FLOORS.
- 3.3 SKIRTINGS TO BE PROVIDED.

- WALLS
- 4.1 220mm BRICK WALLS WITH GUNDLE BRICKGRIP DPC.
- 4.2 BRICKFORCE EVERY 4 COURSES AND EVERY COURSE FOR 4 COURSES OVER OPENINGS
- 4.3 ALL BRICKWORK MIN. 7 Mpa CLASS II.
- 4.4 WINDOWS BUILT IN WITH GUNDLE BRICKGRIP DPC.
- 4.5 ALL PAINTWORK TO COMPLY WITH MANUFACTURER'S SPECIFICATIONS WITH NECESSARY UNDERCOATS.
- 4.6 EXTERNAL TO PLAN INTERNAL-PLASTER AND PAINT.


ALL LEVELS, DIMENSIONS, DEPTHS OF EXCAVATIONS, HEIGHTS OF PLINTHS, NUMBER OF STEPS AND SIZES OF FOUNDATIONS TO BE PLACED AT A HEIGHT OF EXISTING STRUCTURE

- ROOF A
- 5.1 CHROMADEK SHEETING @ 10° PITCH- DARK DOLPHIN ON STEEL PORTAL FRAME AS PER ENGINEER

- 5.2 MIN.170mm CONCRETE SLAB TO ENG'S DETAIL.
- 5.3 MIN. 55mm VEMICULITE INSULATING SCREED TO 1:60 FALL.
- 5.4 WATERPROOFING BY SPECIALIST TO MANUFACTURERS SPEC.
- 5.5 1500 P.V.C RAINWATER DOWNPIPES FROM FULLBORE OUTLETS.
- 5.6 SKYLIGHTS TO MANUFACTURERS SPEC.
- 5.7 GUTTERS : MARLEY STREAMLINE SQUARE PROFILE RAINWATER GUTTERS + DOWNPIPES.
- 5.7 3mmSKIM COAT RHINOLITE ON PLASTERBOARD CEILING FIXED TO 38 X 38mm S.A. PINE BRANDING AT 450 C/C FIXED TO TIE BEAMS.

- WINDOWS AND DOORS
- 6.1a ANY PANE OF GLASS WHICH IS TO BE INSTALLED WITHOUT A SUPPORT FRAME SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.1b THICKNESS OF PANES IN RELATION TO THEIR AREA SHALL BE IN ACCORDANCE WITH SABS 0137
- 6.2 EXTERNAL SLIDING DOORS : STANDARD AS PER WINDOWS TO SCHEDULE.
- 6.3 INTERNAL DOORS : STANDARD HARDWOOD FRAMES TO SCHEDULE
- 6.4 WINDOWS : ALUMINUM TOP-HUNG
- 6.5 SLIDING DOORS :STANDARD ALUMINIUM SLIDING DOORS TO SCHEDULE.

- DRAINAGE NOTES
- 7.1 1000ø uPVC SEWER PIPE DRAIN WITH A MIN. FALL OF 1:60.
- 7.2 1000ø OVP. AT HEAD OF DRAIN PIPE AS SHOWN.
- 7.3 RODDING EYES AT HEAD OF DRAIN, AT ALL CHANGES OF DIRECTION AND AT MAX. OF 25000 INTERVALS.
- 7.4 INSPECT EYES AT ALL JUNCTIONS OF DRAIN, AND TO HAVE MARKED COVERS AT GROUND LEVEL.
- 7.5 DRAIN PIPE UNDER BUILDING TO BE PROTECTED AGAINST LOAD.
- 7.6 ALL WASTE PIPE TO HAVE 65mm RE-SEAL TRAPS, ALL WASTE PIPES TO BE ACCESSIBLE OVER ENTIRE LENGTH FOR CLEANING AND REPAIRS.
- 7.7 ALL WASTE PIPES UNDER FLOOR SLAB TO BE SLEEVED.
- 7.8 ALL SOIL FITTINGS WITH VERTICAL DISCHARGE GREATER THAN 1220 TO HAVE ANTISYPHON VENTPIPES.
- 7.9 RAINWATER DOWNPIPES TO DISCHARGE A MIN. OF 2440 FROM ANY OPEN GULLY.
- 7.10 ALL DRAINAGE WORK TO BE CARRIED OUT IN ACCORDANCE WITH LOCAL AUTHORITIES DRAINAGE BY-LAWS AND REGULATIONS.

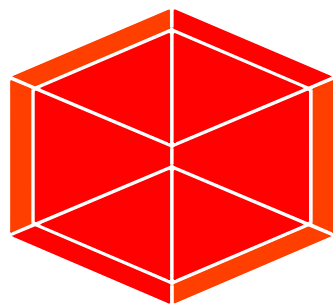

Open Studio Designs Architectural & Interiors

Mobile 083-306-4315
Fax-086-543-8765
openstudio.design@gmail.com

PROPOSED WORKSHOP ON PTN 465 OF THE FARM KROMDRAAI 560KQ CLIENT:

WORKING DRAWINGS

TECHNOLOGISTS:	W JUNG-KRUGER
ARCHITECT:	

DATE:OCT'18	DWG NO: H/KD
DRAWN: WJK	SHEET : 4 OF 7

ALL DIMENSIONS TO BE MEASURED OUT AND PEGGED ON SITE BEFORE COMMENCING WORK

ALL REINFORCED CONCRETE SLABS, FOUNDATIONS, COLUMN DETAILS, BEAMS, STAIRS AND RETAINING WALLS TO BE BUILT STRICTLY IN ACCORDANCE WITH ENGINEERS DETAIL AND UNDER HIS/HER SUPERVISION

BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

FLOORS,WALLS,GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS

COPYRIGHT NOTICE

Copyright © 2011 (Open Studio Designs cc). Copyright subsists in this drawing. The person or entity whose name appears in the title block of this drawing, is hereby granted a non-exclusive license to use, display, print and / or reproduce this drawing to the extent necessary to carry out and complete the project described in the title block of this drawing.

This license in respect of the copyright is expressly limited as aforesaid and the person and/or entity referred to above shall not be entitled to grant sub-licenses in respect of the copyright in this drawing to any other entity.

This license confers no ownership rights in the copyright vesting in the drawing and this drawing and the copyright subsisting therein will, at all times, remain the property of (Open Studio Design cc).

Any unauthorized reproduction, publication, transmission, adaptation and/or inclusion of this drawing in a cinematograph film or television broadcast is an act of copyright infringement which will render the doer of the act liable for civil law copyright infringement and may in certain circumstances render the doer liable to criminal prosecution .

Requests and enquiries concerning this drawing and the rights subsisting therein should be addressed to the copyright owner.

ACTS OF PARLIAMENT

All Contractors shall ensure that, before any work is put in hand, they comply with all the necessary Acts of Parliament of the Republic of South Africa.