


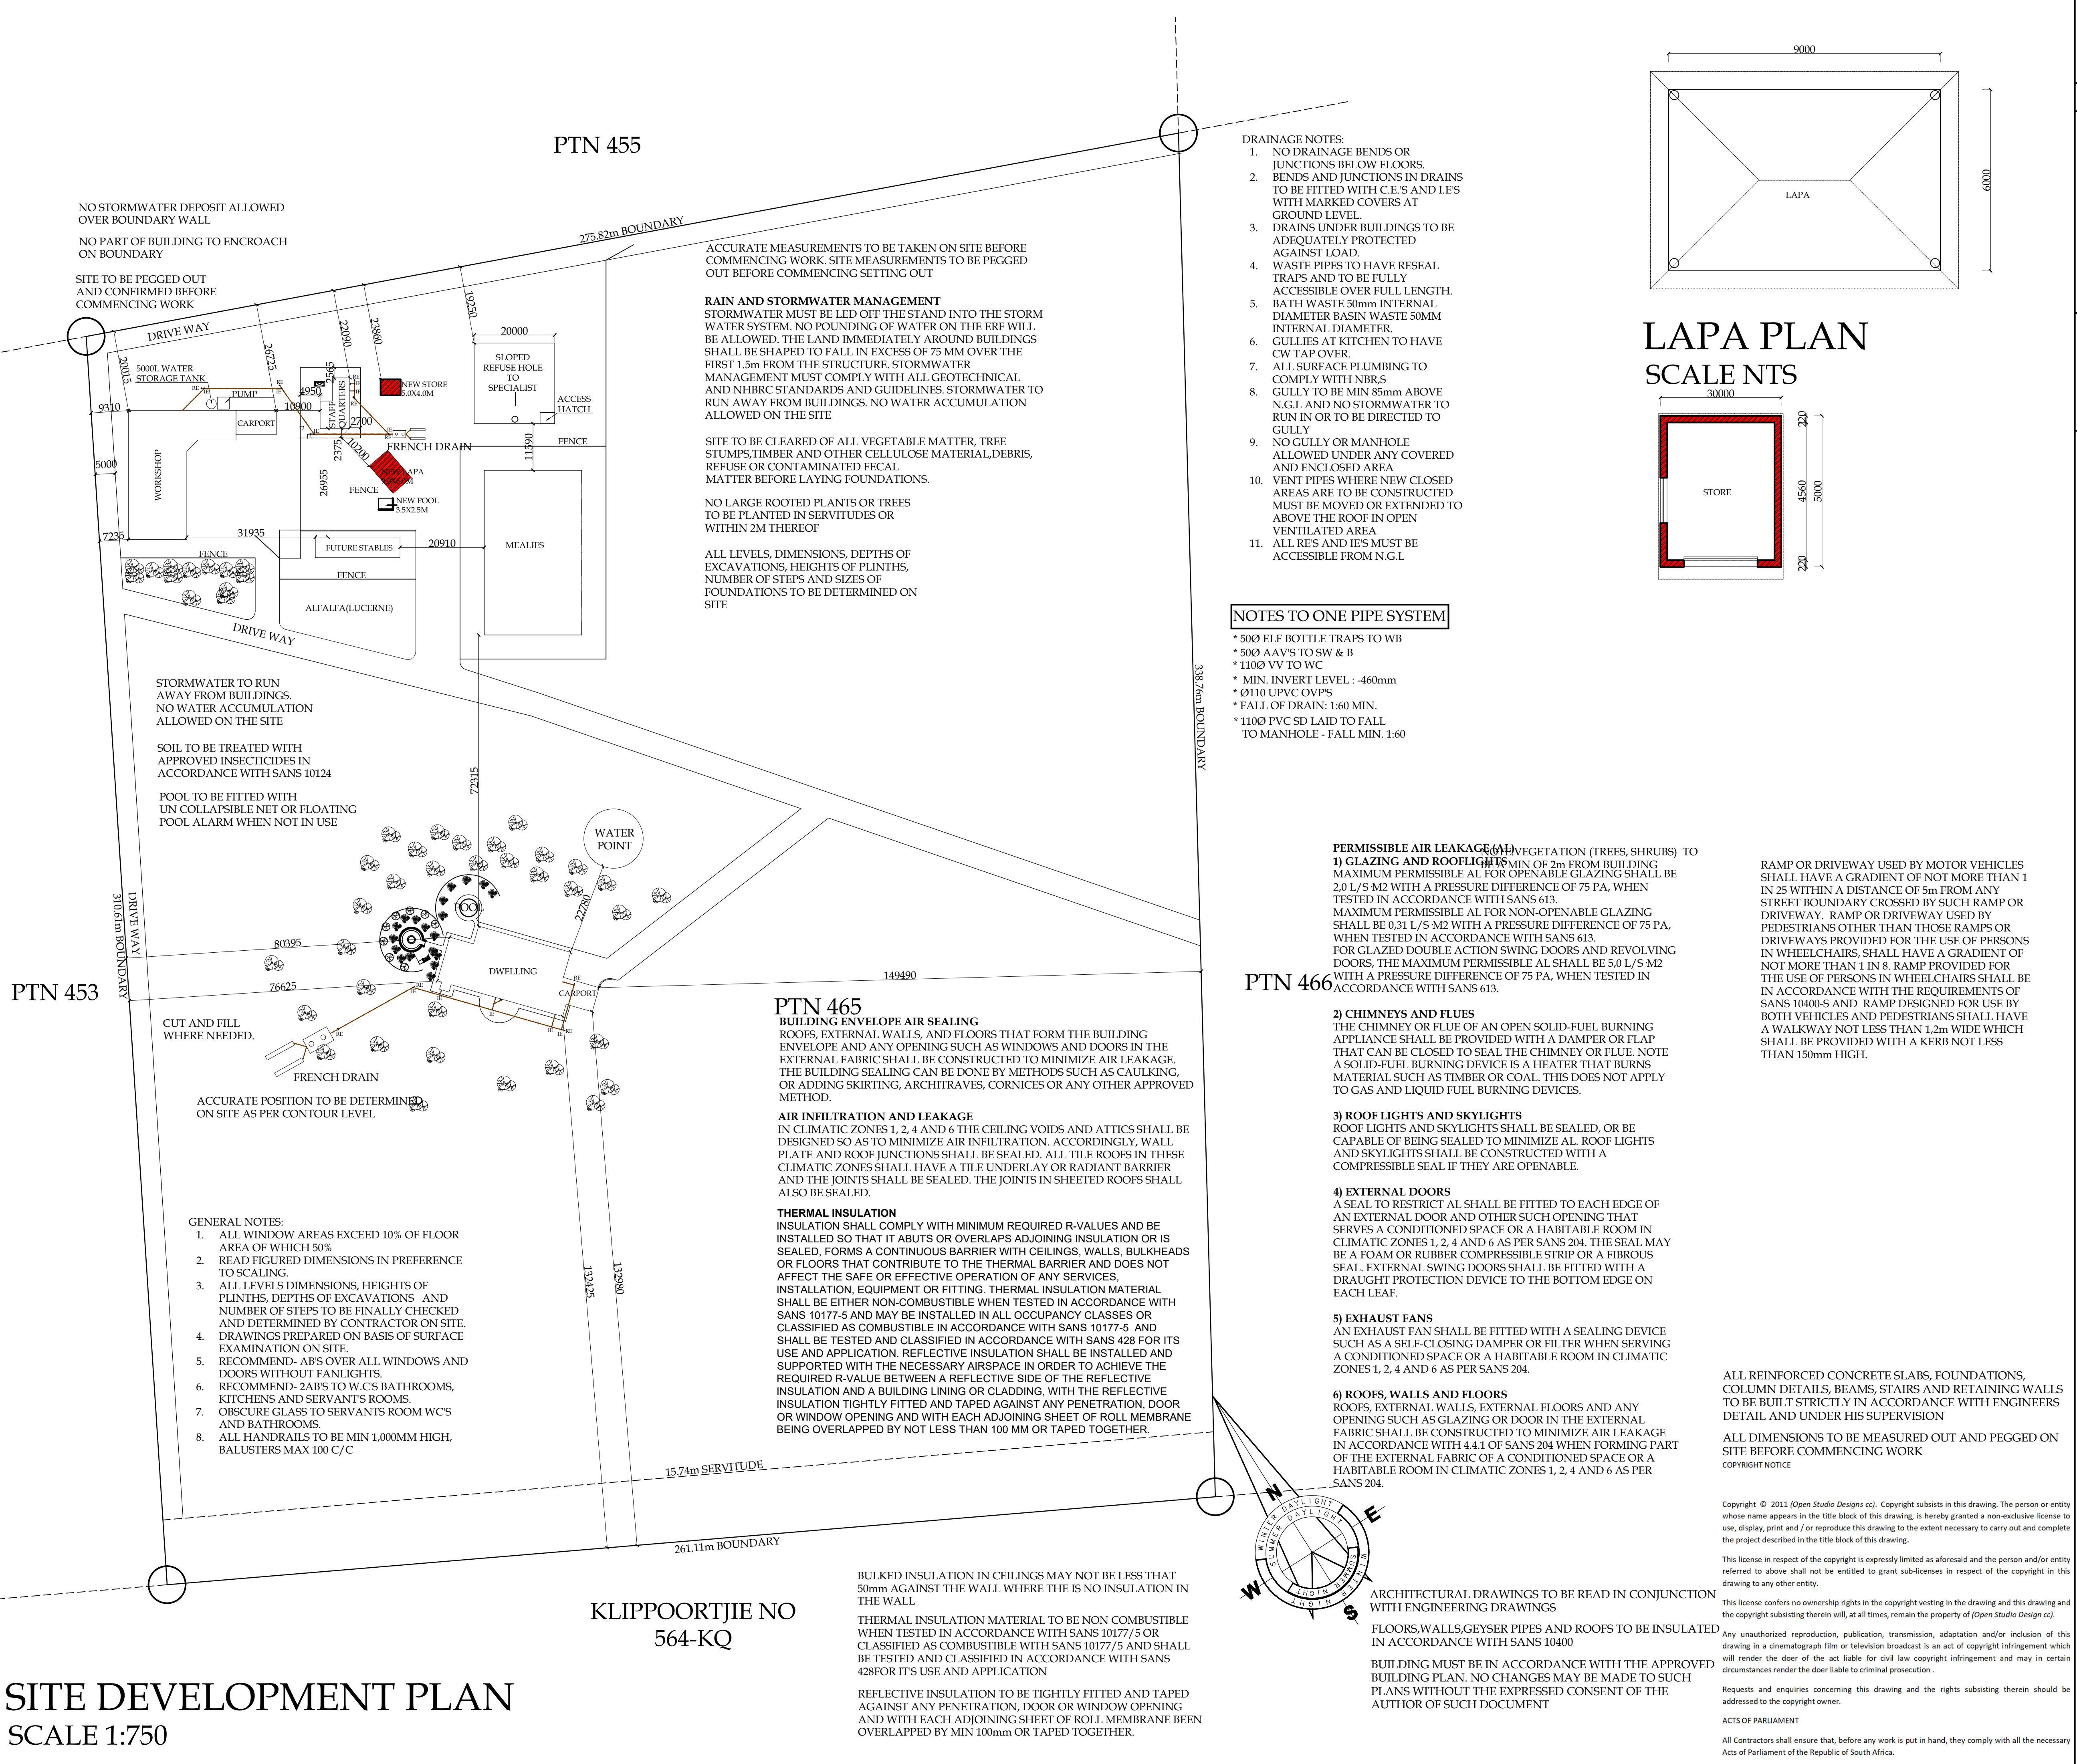

SITE AREA86 680m²

AREA SCHEDULE

GROUND STOREY:

DWELLING UNIT

WORKSHOP/STORE ROOMS

CARPORT

STAFF ROOMS

TOTAL GROUND STOREY:

NEW FLOOR AREA:

TOTAL NEW COVERAGE

NEW LAPA

NEW STORE

NEW ADDITIONS:

TOTAL NEW COVERAGE

COVERAGE:

PROVIDED

1.5%

FAR:

PROVIDED

0.015

GENERAL NOTES:

QUALITY OF ALL MATERIALS AND WORKMANSHIP TO COMPLY WITH THE RELEVANT S.A.B.S. SPECIFICATION AND SHALL COMPLY WITH THE MINIMUM STANDARD SPECIFIED IN THE STANDARD PREAMBLES IN THE BILL OF MATERIALS OR, IN THE ABSENCE OF A BILL OF MATERIALS, AVAILABLE FOR PERUSAL AT THE OFFICES OF THE ARCHITECTS. THE CONTRACTOR IS RESPONSIBLE FOR CORRECT SETTING OUT OF THE BUILDINGS, ALL EXTERNAL AND ALL INTERNAL WALLS WITH PARTICULAR REFERENCE TO BOUNDARIES, BUILDING LINES, ETC.

THE CONTRACTOR IS TO VERIFY LEVELS, HEIGHTS AND DIMENSIONS ON SITE AND TO CHECK SAME AGAINST THE DRAWINGS BEFORE PUTTING ANY WORK IN HAND. ANY DISCREPANCIES FROM THE THEORETICAL TO BE BROUGHT TO THE ARCHITECT'S ATTENTION.

THE CONTRACTOR AND ALL SUB-CONTRACTORS ARE TO CHECK THE DETAILS SHOWN ON THIS DRAWING FOR COMPLIANCE WITH STANDARDS OF BEST BUILDING PRACTICE (WHICH IS WHAT IS EXPECTED TO BE DELIVERED) WITH PARTICULAR REFERENCE TO SPECIAL REQUIREMENTS NECESSITATED BY LOCAL AND/OR ON SITE CONDITIONS AND TO REPORT ANY COMMENT TO THE ARCHITECTS.

THE CONTRACTOR IS TO LOCATE AND IDENTIFY EXISTING SERVICES ON SITE AND TO PROTECT THESE FROM DAMAGE THROUGHOUT THE DURATION OF THE WORKS.

ANY ERRORS, DISCREPANCIES OR OMISSIONS ON THIS DRAWING ARE TO BE REPORTED TO THE ARCHITECT IMMEDIATELY.

THE CONTRACTOR IS TO BUILD IN APPROVED DPC'S, WHETHER OR NOT THESE ARE SHOWN ON DRAWINGS, TO ALL EXTERNAL WALLS AT EACH FLOOR, BEAM OR PARAPET LEVEL AND TO ALL WINDOWS, DOORS, GRILLES OR OTHER OPENING IN EXTERNAL WALLS. CAVITY WALLS TO HAVE STEPPED DPC'S.

ANY QUERIES ARISING FROM THE ABOVE MUST BE REPORTED TO THE ARCHITECT FOR CLARIFICATION BEFORE ANY WORK IS PUT IN HAND.

THIS DRAWING IS NOT TO BE SCALED. FIGURES TO BE USED AT ALL TIMES. WHERE FIGURED DIMENSIONS ARE GIVEN, THIS MUST BE CONFIRMED BY THE ARCHITECT.

BURN'T CLAY BRICKS IN COMPLIANCE WITH THE RELEVANT S.A.B.S. CODE ONLY SHALL BE USED UNLESS SPECIFIC APPROVAL IS OBTAINED FROM THE ARCHITECT FOR THE USE OF ALTERNATIVE TYPE OF BRICK.

Open Studio Designs

Architectural & Interiors

Mobile 083-306-4315

Fax-086-543-8765

openstudio.design@gmail.com

PROPOSED REVISED

SITE PLAN ON

PTN 465 OF THE FARM

KROMDRAAI 560KQ

CLIENT:

TECHNOLOGIST:

REG. NO:

W JUNG-KRUGER


D 0573

DATE: JULY18


DWG NO:

DRAWN: WJK

SHEET : 1 OF 1

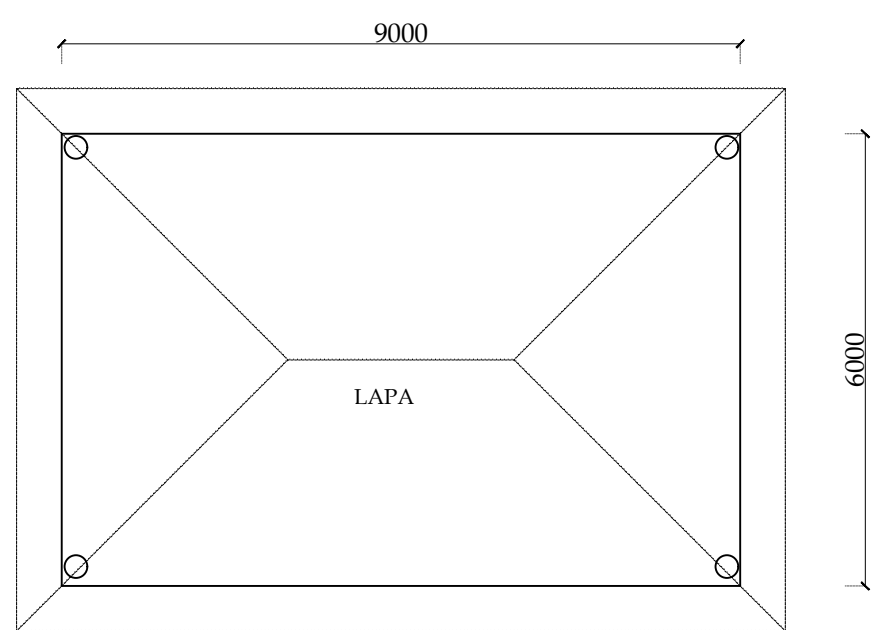

LAPA PLAN
SCALE NTS

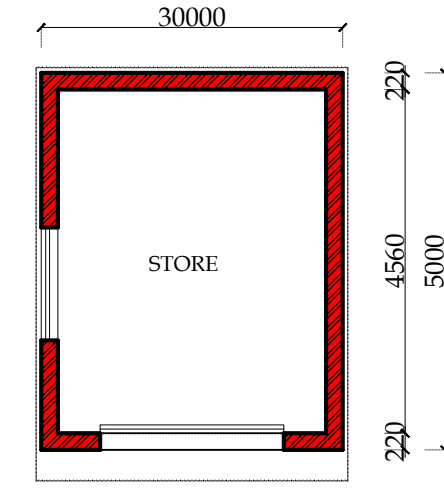

- DRAINAGE NOTES:
1. NO DRAINAGE BENDS OR JUNCTIONS BELOW FLOORS.
 2. BENDS AND JUNCTIONS IN DRAINS TO BE FITTED WITH C.E.'S AND I.E'S WITH MARKED COVERS AT GROUND LEVEL.
 3. DRAINS UNDER BUILDINGS TO BE ADEQUATELY PROTECTED AGAINST LOAD.
 4. WASTE PIPES TO HAVE RESEAL TRAPS AND TO BE FULLY ACCESSIBLE OVER FULL LENGTH.
 5. BATH WASTE 50mm INTERNAL DIAMETER BASIN WASTE 50MM INTERNAL DIAMETER.
 6. GULLIES AT KITCHEN TO HAVE CW TAP OVER.
 7. ALL SURFACE PLUMBING TO COMPLY WITH NBR.5
 8. GULLY TO BE MIN 85mm ABOVE N.G.L AND NO STORMWATER TO RUN IN OR TO BE DIRECTED TO GULLY
 9. NO GULLY OR MANHOLE ALLOWED UNDER ANY COVERED AND ENCLOSED AREA
 10. VENT PIPES WHERE NEW CLOSED AREAS ARE TO BE CONSTRUCTED MUST BE MOVED OR EXTENDED TO ABOVE THE ROOF IN OPEN VENTILATED AREA
 11. ALL RE'S AND IE'S MUST BE ACCESSIBLE FROM N.G.L

NOTES TO ONE PIPE SYSTEM

- * 50Ø ELF BOTTLE TRAPS TO WB
- * 50Ø AAV'S TO SW & B
- * 110Ø VV TO WC
- * MIN. INVERT LEVEL : -460mm
- * Ø110 UPVC OVP'S
- * FALL OF DRAIN: 1:60 MIN.
- * 110Ø PVC SD LAID TO FALL TO MANHOLE - FALL MIN. 1:60

PERMISSIBLE AIR LEAKAGE (AL) OF VEGETATION (TREES, SHRUBS) TO 1) GLAZING AND ROOFLIGHTS
MAXIMUM PERMISSIBLE AL FOR OPENABLE GLAZING SHALL BE 2,0 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.
MAXIMUM PERMISSIBLE AL FOR NON-OPENABLE GLAZING SHALL BE 0,31 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.
FOR GLAZED DOUBLE ACTION SWING DOORS AND REVOLVING DOORS, THE MAXIMUM PERMISSIBLE AL SHALL BE 5,0 L/S M2 WITH A PRESSURE DIFFERENCE OF 75 PA, WHEN TESTED IN ACCORDANCE WITH SANS 613.

2) CHIMNEYS AND FLUES
THE CHIMNEY OR FLUE OF AN OPEN SOLID-FUEL BURNING APPLIANCE SHALL BE PROVIDED WITH A DAMPER OR FLAP THAT CAN BE CLOSED TO SEAL THE CHIMNEY OR FLUE. NOTE A SOLID-FUEL BURNING DEVICE IS A HEATER THAT BURNS MATERIAL SUCH AS TIMBER OR COAL. THIS DOES NOT APPLY TO GAS AND LIQUID FUEL BURNING DEVICES.

3) ROOF LIGHTS AND SKYLIGHTS
ROOF LIGHTS AND SKYLIGHTS SHALL BE SEALED, OR BE CAPABLE OF BEING SEALED TO MINIMIZE AL. ROOF LIGHTS AND SKYLIGHTS SHALL BE CONSTRUCTED WITH A COMPRESSIBLE SEAL IF THEY ARE OPENABLE.

4) EXTERNAL DOORS
A SEAL TO RESTRICT AL SHALL BE FITTED TO EACH EDGE OF AN EXTERNAL DOOR AND OTHER SUCH OPENING THAT SERVES A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204. THE SEAL MAY BE A FOAM OR RUBBER COMPRESSIBLE STRIP OR A FIBROUS SEAL. EXTERNAL SWING DOORS SHALL BE FITTED WITH A DRAUGHT PROTECTION DEVICE TO THE BOTTOM EDGE ON EACH LEAF.

5) EXHAUST FANS
AN EXHAUST FAN SHALL BE FITTED WITH A SEALING DEVICE SUCH AS A SELF-CLOSING DAMPER OR FILTER WHEN SERVING A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204.

6) ROOFS, WALLS AND FLOORS
ROOFS, EXTERNAL WALLS, EXTERNAL FLOORS AND ANY OPENING SUCH AS GLAZING OR DOOR IN THE EXTERNAL FABRIC SHALL BE CONSTRUCTED TO MINIMIZE AIR LEAKAGE IN ACCORDANCE WITH 4.4.1 OF SANS 204 WHEN FORMING PART OF THE EXTERNAL FABRIC OF A CONDITIONED SPACE OR A HABITABLE ROOM IN CLIMATIC ZONES 1, 2, 4 AND 6 AS PER SANS 204.

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION WITH ENGINEERING DRAWINGS
FLOORS, WALLS, GEYSER PIPES AND ROOFS TO BE INSULATED IN ACCORDANCE WITH SANS 10400
BUILDING MUST BE IN ACCORDANCE WITH THE APPROVED BUILDING PLAN. NO CHANGES MAY BE MADE TO SUCH PLANS WITHOUT THE EXPRESSED CONSENT OF THE AUTHOR OF SUCH DOCUMENT

PTN 465
BUILDING ENVELOPE AIR SEALING
ROOFS, EXTERNAL WALLS, AND FLOORS THAT FORM THE BUILDING ENVELOPE AND ANY OPENING SUCH AS WINDOWS AND DOORS IN THE EXTERNAL FABRIC SHALL BE CONSTRUCTED TO MINIMIZE AIR LEAKAGE. THE BUILDING SEALING CAN BE DONE BY METHODS SUCH AS CAULKING, OR ADDING SKIRTING, ARCHITRAVES, CORNICES OR ANY OTHER APPROVED METHOD.

AIR INFILTRATION AND LEAKAGE
IN CLIMATIC ZONES 1, 2, 4 AND 6 THE CEILING VOIDS AND ATTICS SHALL BE DESIGNED SO AS TO MINIMIZE AIR INFILTRATION. ACCORDINGLY, WALL PLATE AND ROOF JUNCTIONS SHALL BE SEALED. ALL TILE ROOFS IN THESE CLIMATIC ZONES SHALL HAVE A TILE UNDERLAY OR RADIANT BARRIER AND THE JOINTS SHALL BE SEALED. THE JOINTS IN SHEETED ROOFS SHALL ALSO BE SEALED.

THERMAL INSULATION
INSULATION SHALL COMPLY WITH MINIMUM REQUIRED R-VALUES AND BE INSTALLED SO THAT IT ABUTS OR OVERLAPS ADJOINING INSULATION OR IS SEALED, FORMS A CONTINUOUS BARRIER WITH CEILINGS, WALLS, BULKHEADS OR FLOORS THAT CONTRIBUTE TO THE THERMAL BARRIER AND DOES NOT AFFECT THE SAFE OR EFFECTIVE OPERATION OF ANY SERVICES. INSTALLATION, EQUIPMENT OR FITTING. THERMAL INSULATION MATERIAL SHALL BE EITHER NON-COMBUSTIBLE WHEN TESTED IN ACCORDANCE WITH SANS 10177-5 AND MAY BE INSTALLED IN ALL OCCUPANCY CLASSES OR CLASSIFIED AS COMBUSTIBLE IN ACCORDANCE WITH SANS 10177-5 AND SHALL BE TESTED AND CLASSIFIED IN ACCORDANCE WITH SANS 428 FOR ITS USE AND APPLICATION. REFLECTIVE INSULATION SHALL BE INSTALLED AND SUPPORTED WITH THE NECESSARY AIRSPACE IN ORDER TO ACHIEVE THE REQUIRED R-VALUE BETWEEN A REFLECTIVE SIDE OF THE REFLECTIVE INSULATION AND A BUILDING LINING OR CLADDING, WITH THE REFLECTIVE INSULATION TIGHTLY FITTED AND TAPED AGAINST ANY PENETRATION, DOOR OR WINDOW OPENING AND WITH EACH ADJOINING SHEET OF ROLL MEMBRANE BEING OVERLAPPED BY NOT LESS THAN 100 MM OR TAPED TOGETHER.

BULKED INSULATION IN CEILINGS MAY NOT BE LESS THAN 50mm AGAINST THE WALL WHERE THERE IS NO INSULATION IN THE WALL

THERMAL INSULATION MATERIAL TO BE NON COMBUSTIBLE WHEN TESTED IN ACCORDANCE WITH SANS 10177/5 OR CLASSIFIED AS COMBUSTIBLE WITH SANS 10177/5 AND SHALL BE TESTED AND CLASSIFIED IN ACCORDANCE WITH SANS 428 FOR ITS USE AND APPLICATION

REFLECTIVE INSULATION TO BE TIGHTLY FITTED AND TAPED AGAINST ANY PENETRATION, DOOR OR WINDOW OPENING AND WITH EACH ADJOINING SHEET OF ROLL MEMBRANE BEING OVERLAPPED BY MIN 100mm OR TAPED TOGETHER.

