
Sensitivity and false-positive burden


Test200 | 15 methods | fixed validation-derived thresholds

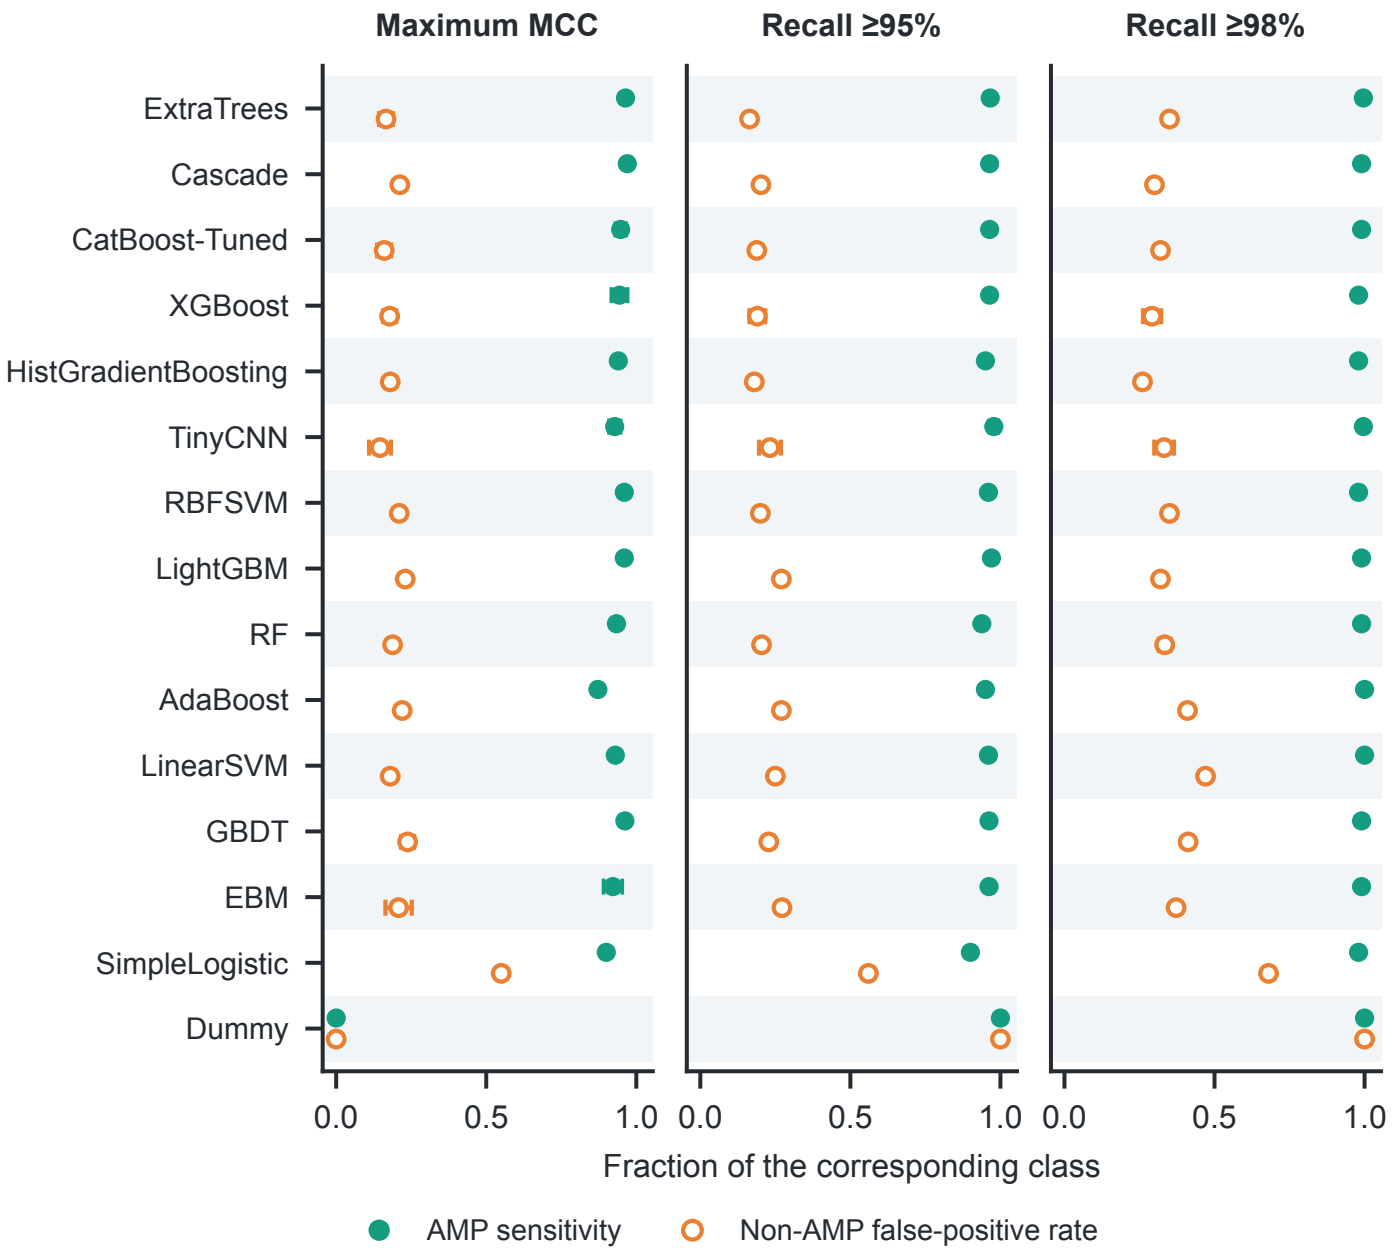

Mean ± SD across seeds 120–124; 100 AMP and 100 non-AMP.

Accuracy and CPU deployment cost

AMP AUPRC | 200-peptide batch | single CPU thread

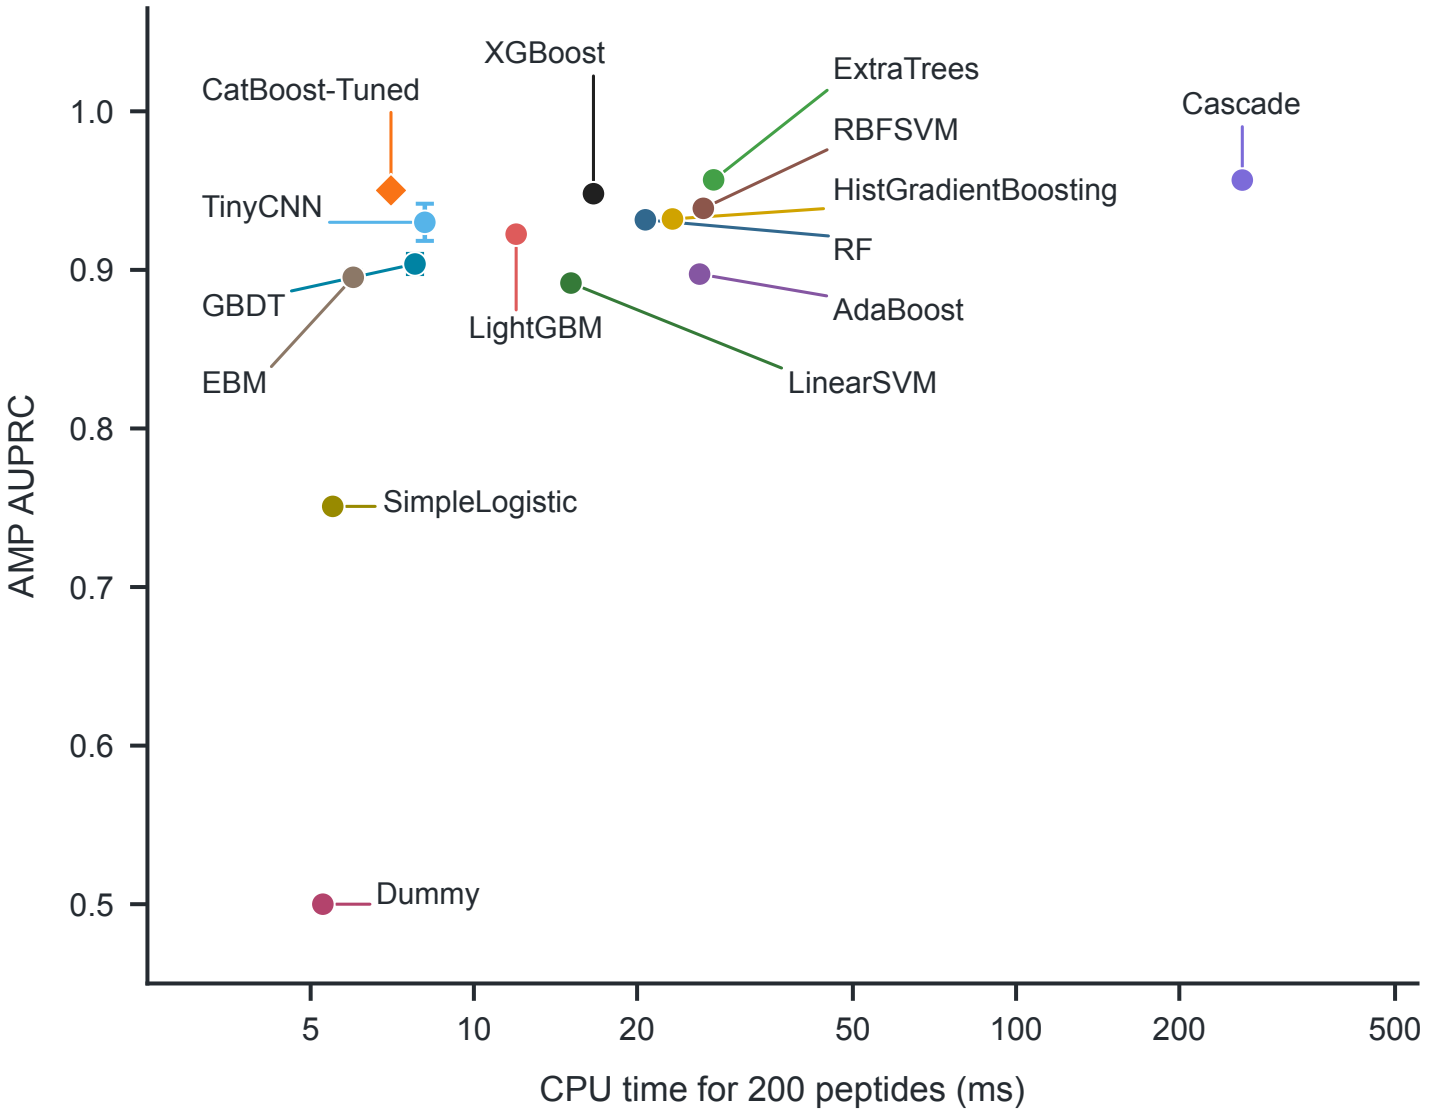

CPU latency: median of 30 repeats after 3 warm-ups; seed 123.

Raw-sequence features + inference + calibration; logarithmic time axis.

AUPRC: mean ± SD across seeds 120–124 on the fixed Test200.