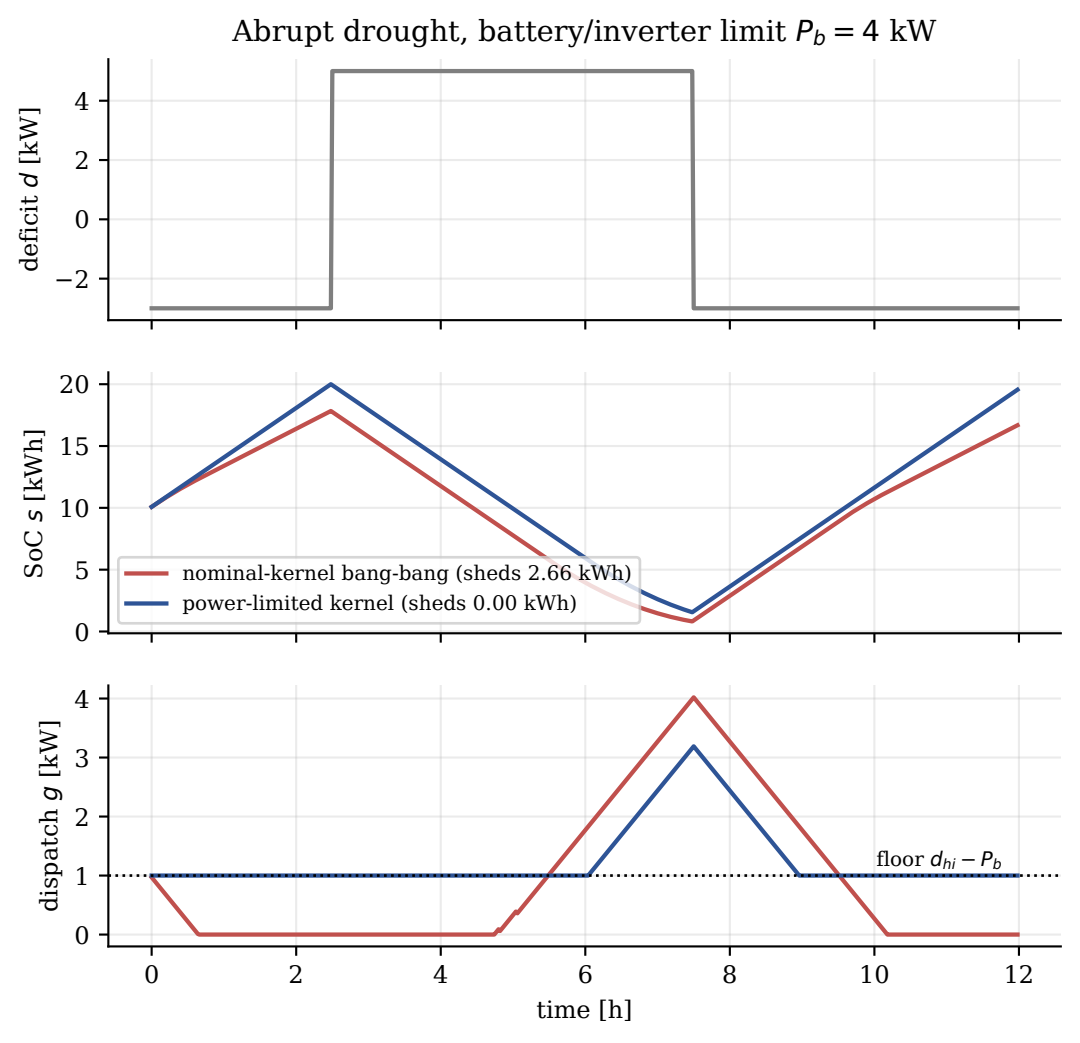
Abrupt drought, battery/inverter limit $P_b = 4$ kW
deficit d [kW]
4
2
0
−2
SoC s [kWh]
20
15
10
5
0
nominal-kernel bang-bang (sheds 2.66 kWh)
power-limited kernel (sheds 0.00 kWh)
dispatch g [kW]
4
3
2
1
0
floor $d_{hi} - P_b$
0
2
4
6
8
10
12
time [h]