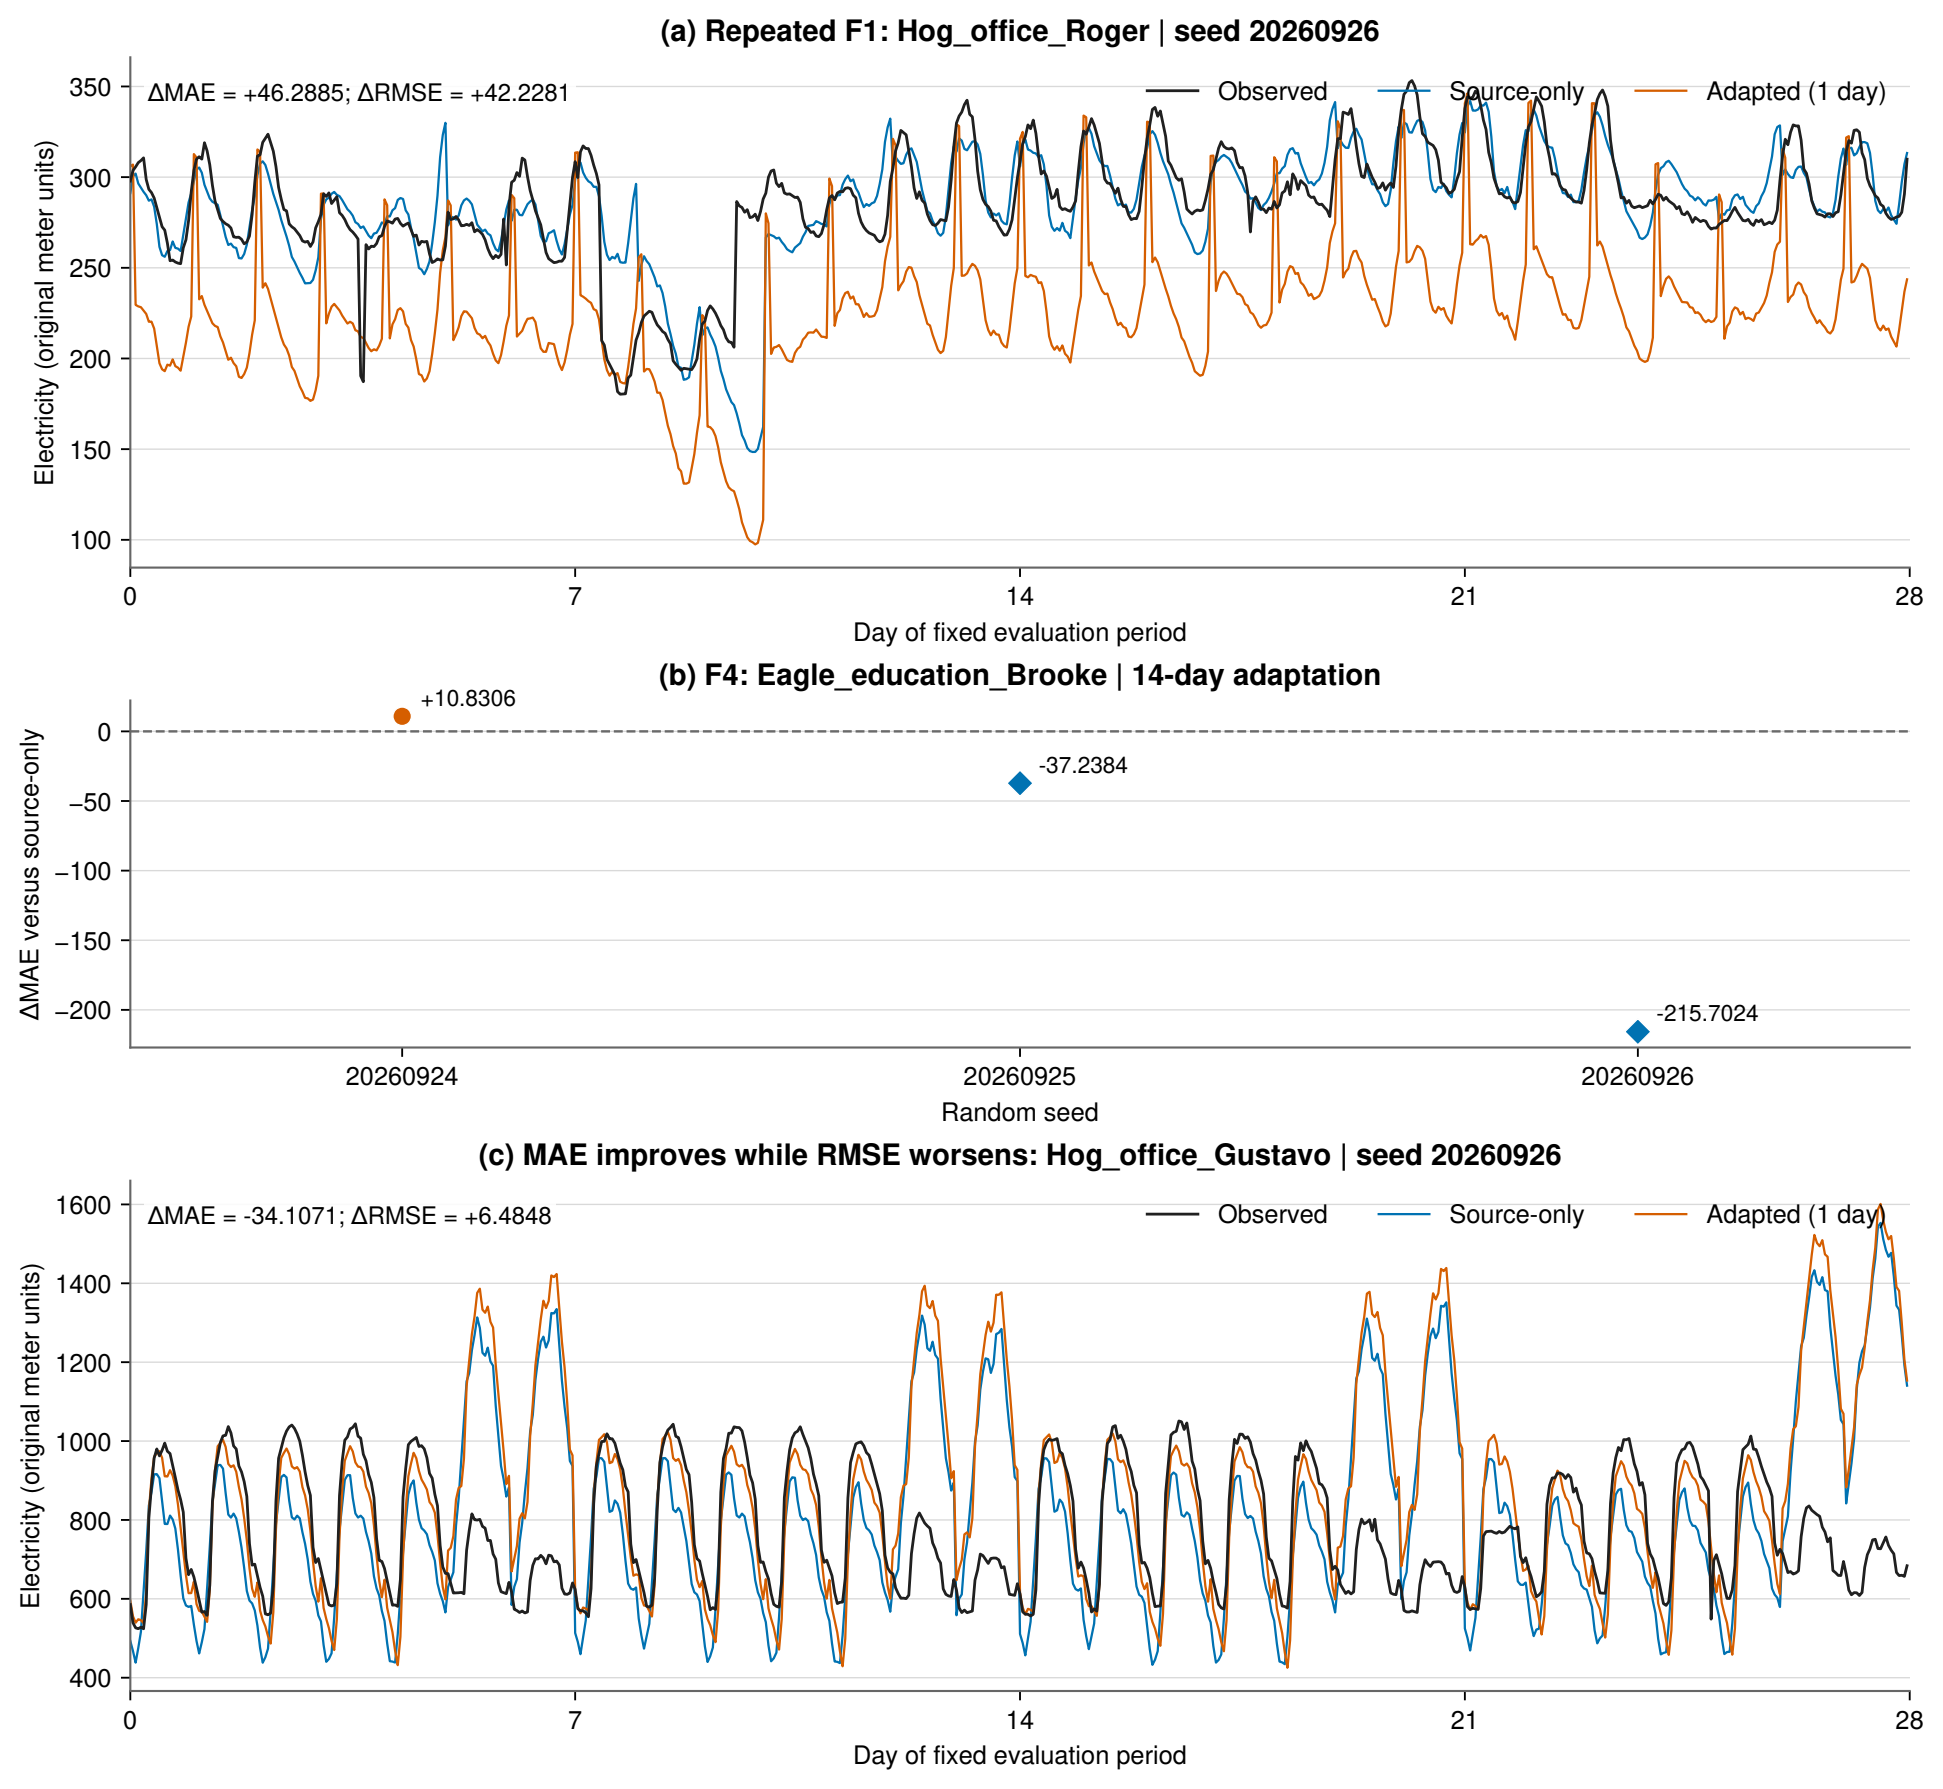
(a) Repeated F1: Hog_office_Roger | seed 20260926
ΔMAE = +46.2885; ΔRMSE = +42.2281
Observed
Source-only
Adapted (1 day)
Electricity (original meter units)
350
300
250
200
150
100
0
7
14
21
28
Day of fixed evaluation period
(b) F4: Eagle_education_Brooke | 14-day adaptation
+10.8306
-37.2384
-215.7024
ΔMAE versus source-only
0
−50
−100
−150
−200
20260924
20260925
20260926
Random seed
(c) MAE improves while RMSE worsens: Hog_office_Gustavo | seed 20260926
ΔMAE = -34.1071; ΔRMSE = +6.4848
Observed
Source-only
Adapted (1 day)
Electricity (original meter units)
1600
1400
1200
1000
800
600
400
0
7
14
21
28
Day of fixed evaluation period