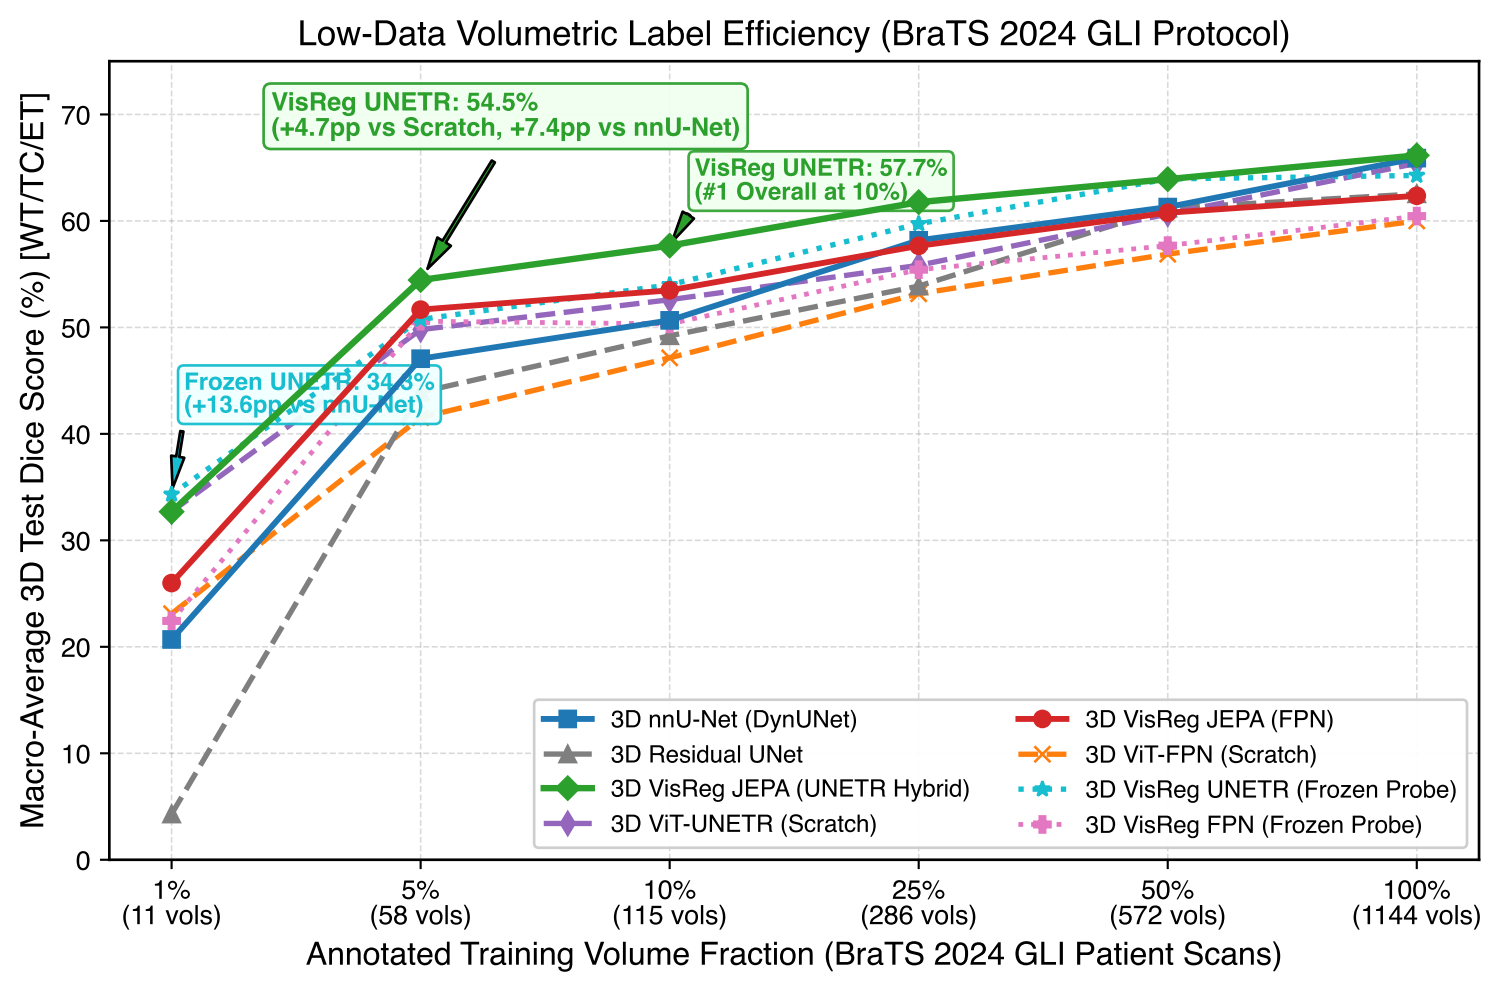
Low-Data Volumetric Label Efficiency (BraTS 2024 GLI Protocol)
VisReg UNETR: 54.5%
(+4.7pp vs Scratch, +7.4pp vs nnU-Net)
VisReg UNETR: 57.7%
(#1 Overall at 10%)
Frozen UNETR: 34.8%
(+13.6pp vs nnU-Net)
3D nnU-Net (DynUNet)
3D Residual UNet
3D VisReg JEPA (UNETR Hybrid)
3D ViT-UNETR (Scratch)
3D VisReg JEPA (FPN)
3D ViT-FPN (Scratch)
3D VisReg UNETR (Frozen Probe)
3D VisReg FPN (Frozen Probe)
Macro-Average 3D Test Dice Score (%) [WT/TC/ET]
0
10
20
30
40
50
60
70
1%
(11 vols)
5%
(58 vols)
10%
(115 vols)
25%
(286 vols)
50%
(572 vols)
100%
(1144 vols)
Annotated Training Volume Fraction (BraTS 2024 GLI Patient Scans)