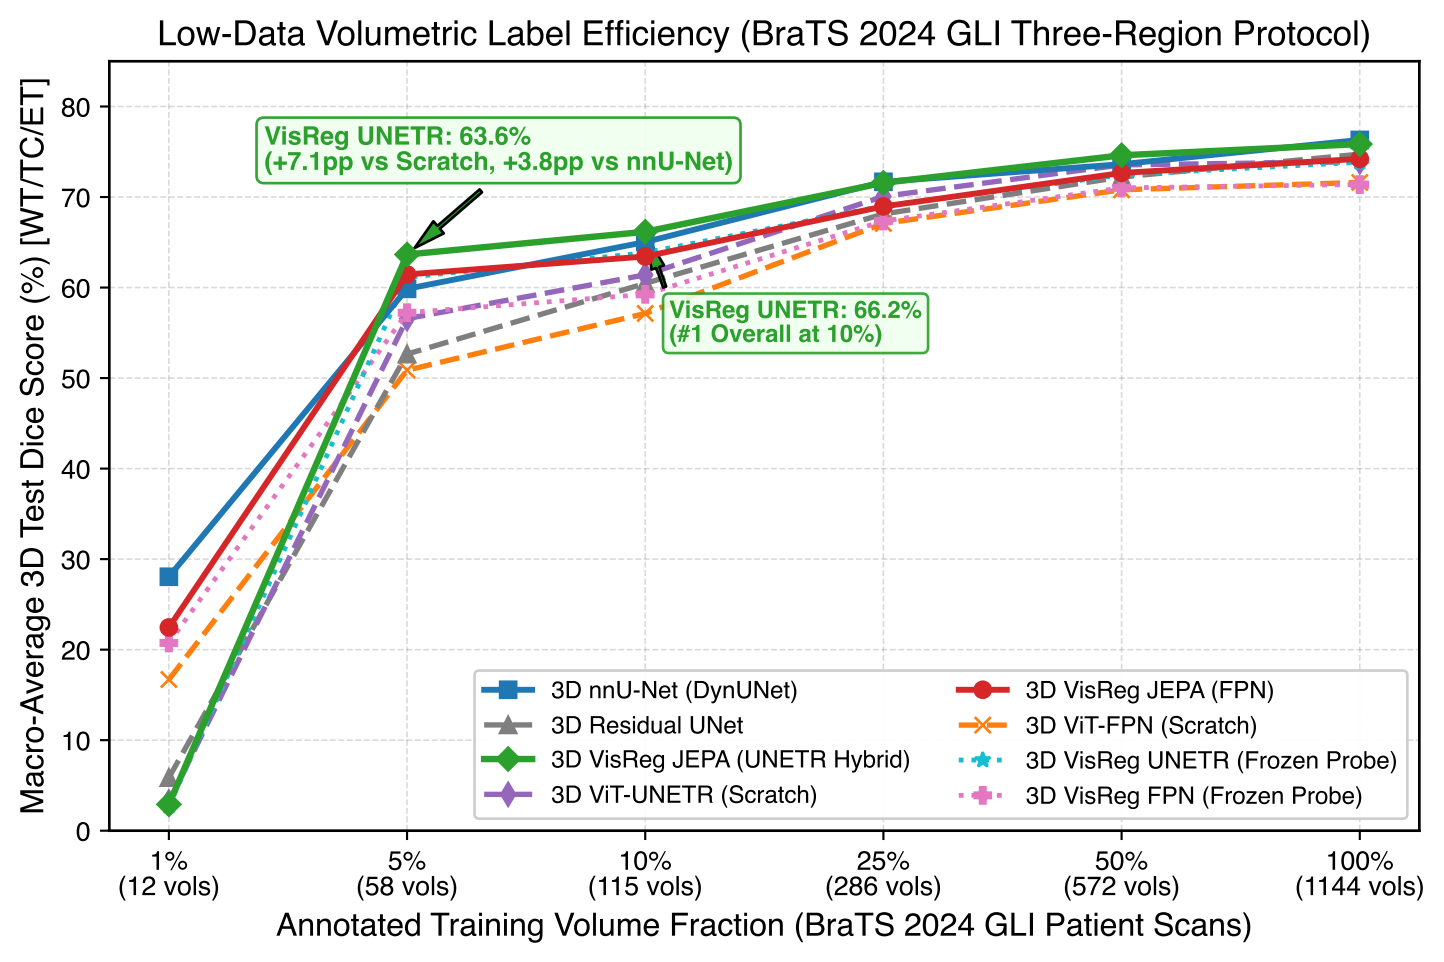
Low-Data Volumetric Label Efficiency (BraTS 2024 GLI Three-Region Protocol)
Macro-Average 3D Test Dice Score (%) [WT/TC/ET]
0
10
20
30
40
50
60
70
80
VisReg UNETR: 63.6%
(+7.1pp vs Scratch, +3.8pp vs nnU-Net)
VisReg UNETR: 66.2%
(#1 Overall at 10%)
3D nnU-Net (DynUNet)
3D Residual UNet
3D VisReg JEPA (UNETR Hybrid)
3D ViT-UNETR (Scratch)
3D VisReg JEPA (FPN)
3D ViT-FPN (Scratch)
3D VisReg UNETR (Frozen Probe)
3D VisReg FPN (Frozen Probe)
1%
(12 vols)
5%
(58 vols)
10%
(115 vols)
25%
(286 vols)
50%
(572 vols)
100%
(1144 vols)
Annotated Training Volume Fraction (BraTS 2024 GLI Patient Scans)