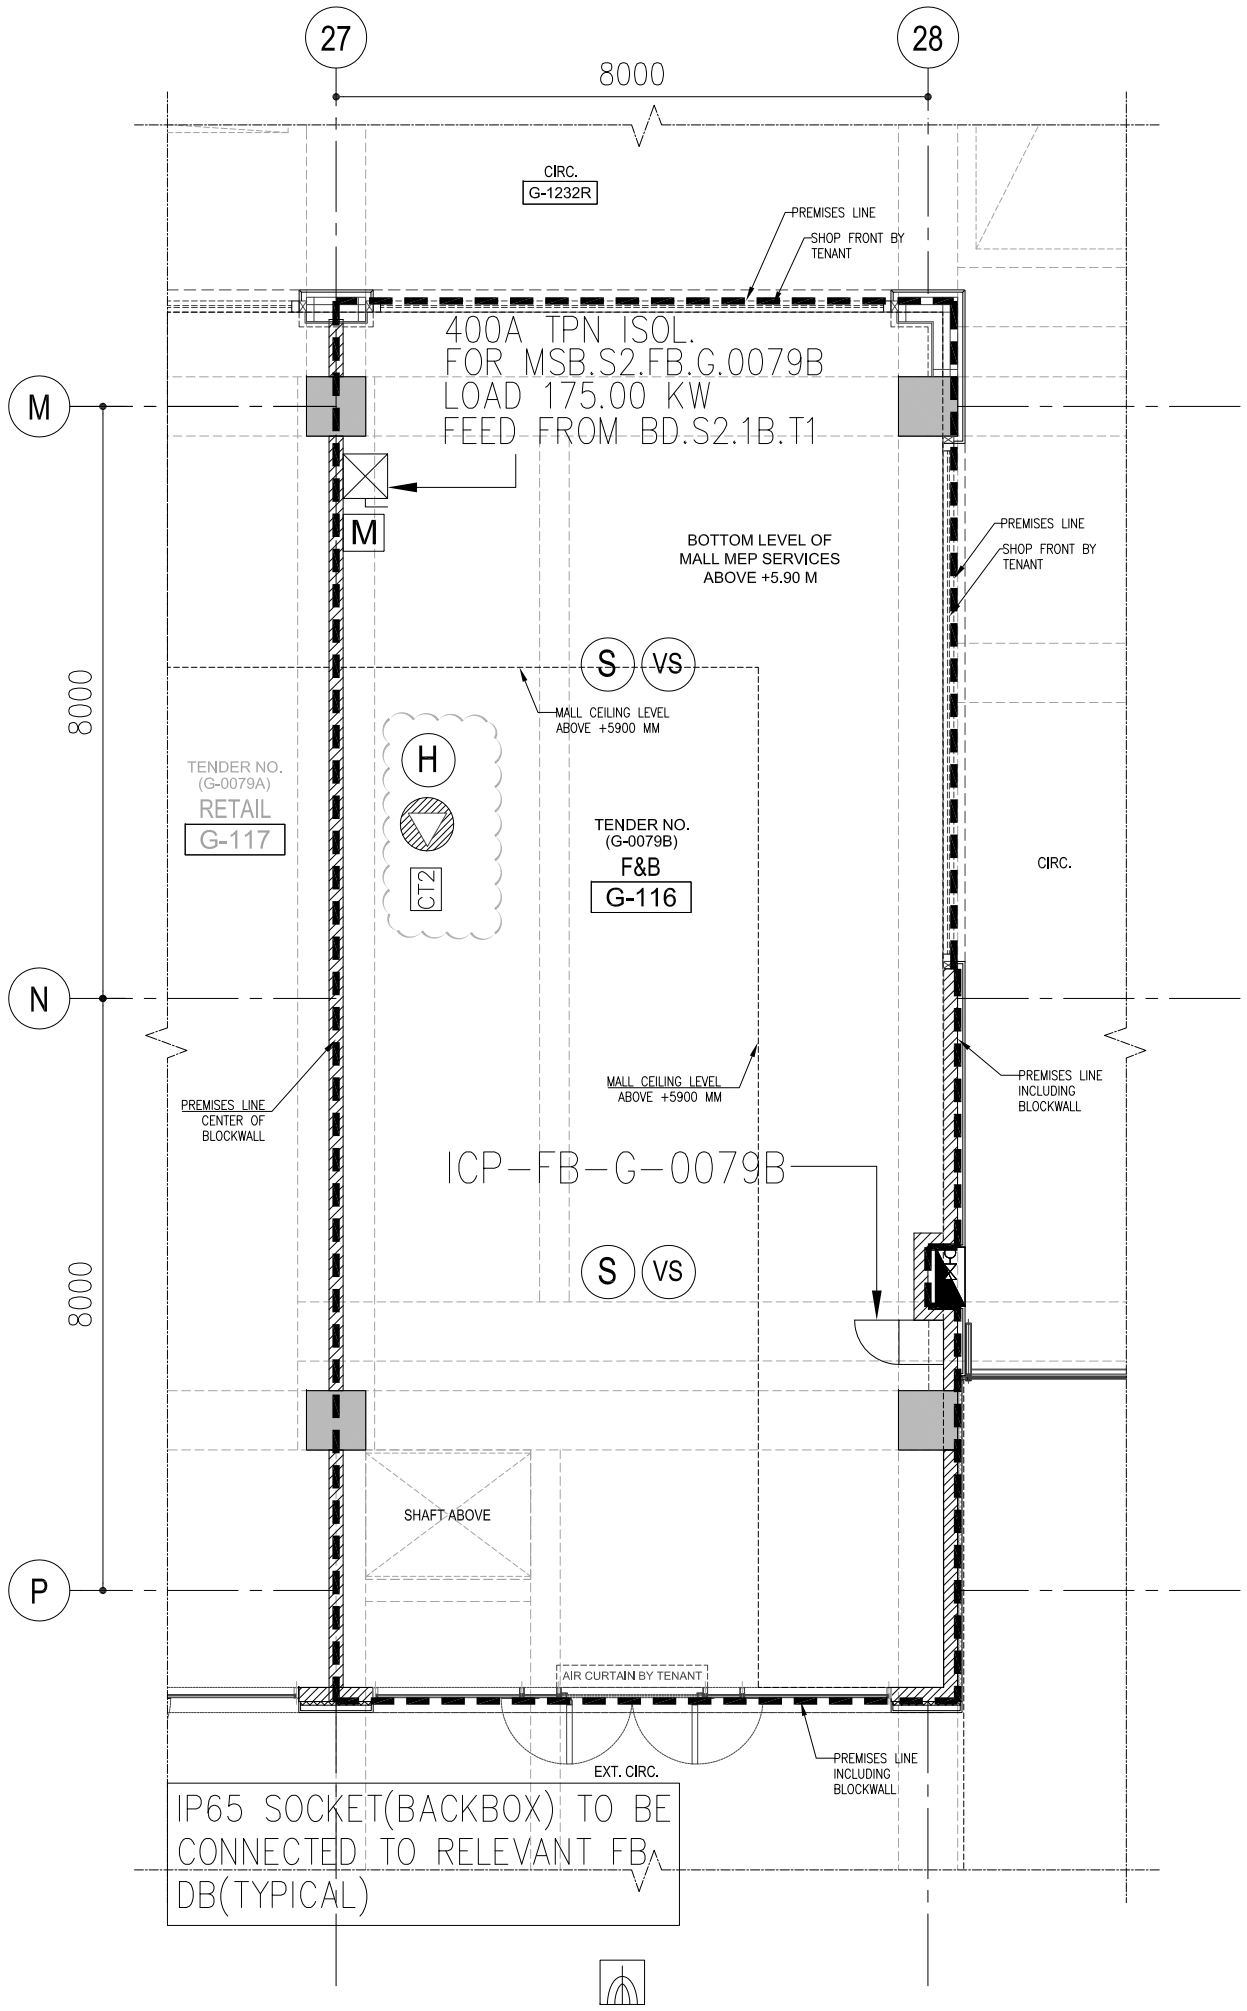

LEGEND:

SYMBOL	DESCRIPTION
	400 A TPN ISOLATING SWITCH
M	TANENT METER
	W/P SOCKET IN FLOOR BOX
S	SMOKE DETECTOR
VS	CEILING RECESSED VOICE EVACUATION SPEAKER
H	HEAT DETECTOR
	INTERFACE TO GAS DETECTION SYSTEM
CT2	DUAL INPUT MODULE FOR INTERFACE TO GAS DETECTION SYSTEM
	ICP DATA CABINET 12U WALL MOUNT

S.NO	DESCRIPTION	LOAD IN K.W	
1	LIGHT, POWER & EQUIPMENT		166.50 K.W
2	AHU-G-0079B	2.20 K.W	
	AHU-G-0079B.K	1.10 K.W	
	KEF-G-0079B	2.20 K.W	
	MUA-G-0079B	3.00 K.W	
			8.500 K.W
	TOTAL LOAD		175.00 K.W

GENERAL NOTES:

01. 25mmØ CONDUIT TO BE LAID FROM EACH F&B UNIT ELECTRICAL PANEL LOCATION TO KEF LOCATION ON ROOF FOR ELECTRICAL SUPPLY TO KEF.

02. 25mmØ CONDUIT WITH DRAW WIRE TO BE LAID FROM THE TENANT DB LOCATION TO BACK BOX PROVIDED IN OUT SIDE SEATING AREA FOR TENANT USE. BACKBOX PROVIDED IS FOR FUTURE SOCKET BY TENANT.

NOTES:

01. ISOLATOR WILL BE LOCATED AT HIGH LEVEL ABOVE FALSE CEILING

02. IDF SYSTEMS AS PER DESIGN DRAWINGS

KEY PLAN

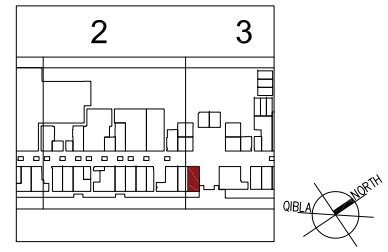

NOTES

1. DRAWINGS DIMENSIONS ARE TO BE READ NOT TO BE SCALED.
2. ARCHITECTURAL DRAWING MUST BE READ IN CONJUNCTION WITH ALL OTHER SERVICE DRAWINGS AND CONTRACT DOCUMENTS AND IN CASE OF ANY DISCREPANCIES ARISE BETWEEN THESE DRAWINGS AND ANY OF THE DOCUMENTS.THEY SHOULD BE IMMEDIATELY REPORTED TO THE ENGINEER BEFORE THE COMMENCEMENT OF ANY WORK ON SITE.
3. ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF ANY ITEM OF WORK ON THE SITE OR THE PREPARATION OF THE SHOP DRAWINGS.
4. THE INVESTOR'S EXTERNAL FACING SHOPFRONT SIGNAGE(IF ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND DIRECTIONS.
5. NO CHANGES AND/OR PENETRATIONS OF ANY DESCRIPTION WILL BE PERMITTED TO THE OWNER- PROVIDED EXTERNAL GLASS SHOP FRONTS.
6. SUPPLY, STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INVESTOR SPACES IS BY THE OWNER. INSTALLATION OF THE SAME WILL BE BY THE INVESTOR. SUPPLY AND INSTALLATION OF THE VAPOR BARRIER, FIRE BARRIER & INSULATION DRAPE ASSEMBLY WILL BE BY THE OWNER.
7. THIS DRAWING IS INDICATIVE ONLY (NOT TO BE USED FOR CONSTRUCTION) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
8. THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
9. IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THEMSELVES WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND /OR SUBSTITUTIONS.
10. IT IS THE RESPONSIBILITY OF THE INVESTOR TO UNDERTAKE AN ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING
11. TAMDEEN REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY OF ANY FORM FOR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THIS DRAWING
12. THE ANCHOR BOLT SIZE USED FOR ANY FLOORING SUPPORTING SYSTEM SHOULD NOT EXCEED MORE THAN 8mm DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE IMBEDDED PVC CONDUIT.

FOR REVIEW

OWNER

تمدين
TAMDEEN GROUP

PROJECT TITLE

Al Khiran Outlet Mall

CONSULTANTS

cracknell SSH

DESIGN ARCHTECT

CALLISONRTKL
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD

مجموعة الهندسة الدولية
OHA ENGINEERING CONSULTANT
P. O. Box 6249 HAWALLY CODE NO.32037 - KUWAIT
PHONE: 22420508 - 22420518 FAX: 22436511
E-mail: oha@daroha.com

MANAGED BY

تمدين
TAMDEEN MALL MANAGEMENT
TAMDEEN MALL MANAGEMENT CO. K.S.C.C
P.O. BOX: 29060 SAFAT 13151, KUWAIT
TEL: +965 25362330
FAX: +965 25362360
WWW.TAMDEENMALLS.COM

DRAWING TITLE:

GROUND FLOOR
RESTAURANT ELEC.PLAN

UNIT NO.	G-116	
USAGE.	RESTAURANT	
TRADE	SCALE	DATE
ELEC	1:50 @ A1	DEC 2020
DRAWN BY	CHECKED BY	APPROVED BY
- -	M.RAMADAN	- -
DRAWING No.	OF	REV.
E-01	05 OF 09	01