









## NOTES:

# FIRE ALARM & IDF SYSTEMS AS PER DESIGN DRAWINGSS


**LEGEND:**

SYMBOL	DESCRIPTION
	500 A TPN ISOLATING SWITCH
	TANENT METER
	W/P SOCKET IN FLOOR BOX
	SMOKE DETECTOR
	CEILING RECESSED VOICE EVACUATION SPEAKER
	HEAT DETECTOR
	INTERFACE TO GAS DETECTION SYSTEM
	ICP DATA CABINET 12U WALL MOUNT

S.NO	DESCRIPTION	LOAD IN K.W
1	LIGHT, POWER & EQUIPMENT	189.700 K.W
2	AHU-G-0078A AHU-G-0078A.K MUA-G-0078A KEF-G-0078A	2.20 K.W 1.10 K.W 4.00 K.W 3.00 K.W
	TOTAL LOAD	10.300 K.W 200.00 K.W


## GENERAL NOTES:

01. 25mmØ CONDUIT TO BE LAID FROM EACH F&B UNIT ELECTRICAL PANEL LOCATION TO KEF LOCATION ON ROOF FOR ELECTRICAL SUPPLY TO KEF.
02. 25mmØ CONDUIT WITH DRAW WIRE TO BE LAID FROM THE TENANT DB LOCATION TO BACK BOX PROVIDED IN OUT SIBD SEATING AREA FOR TENANT USE. BACKBOX PROVIDED IS FOR FUTURE SOCKET BY TENANT.

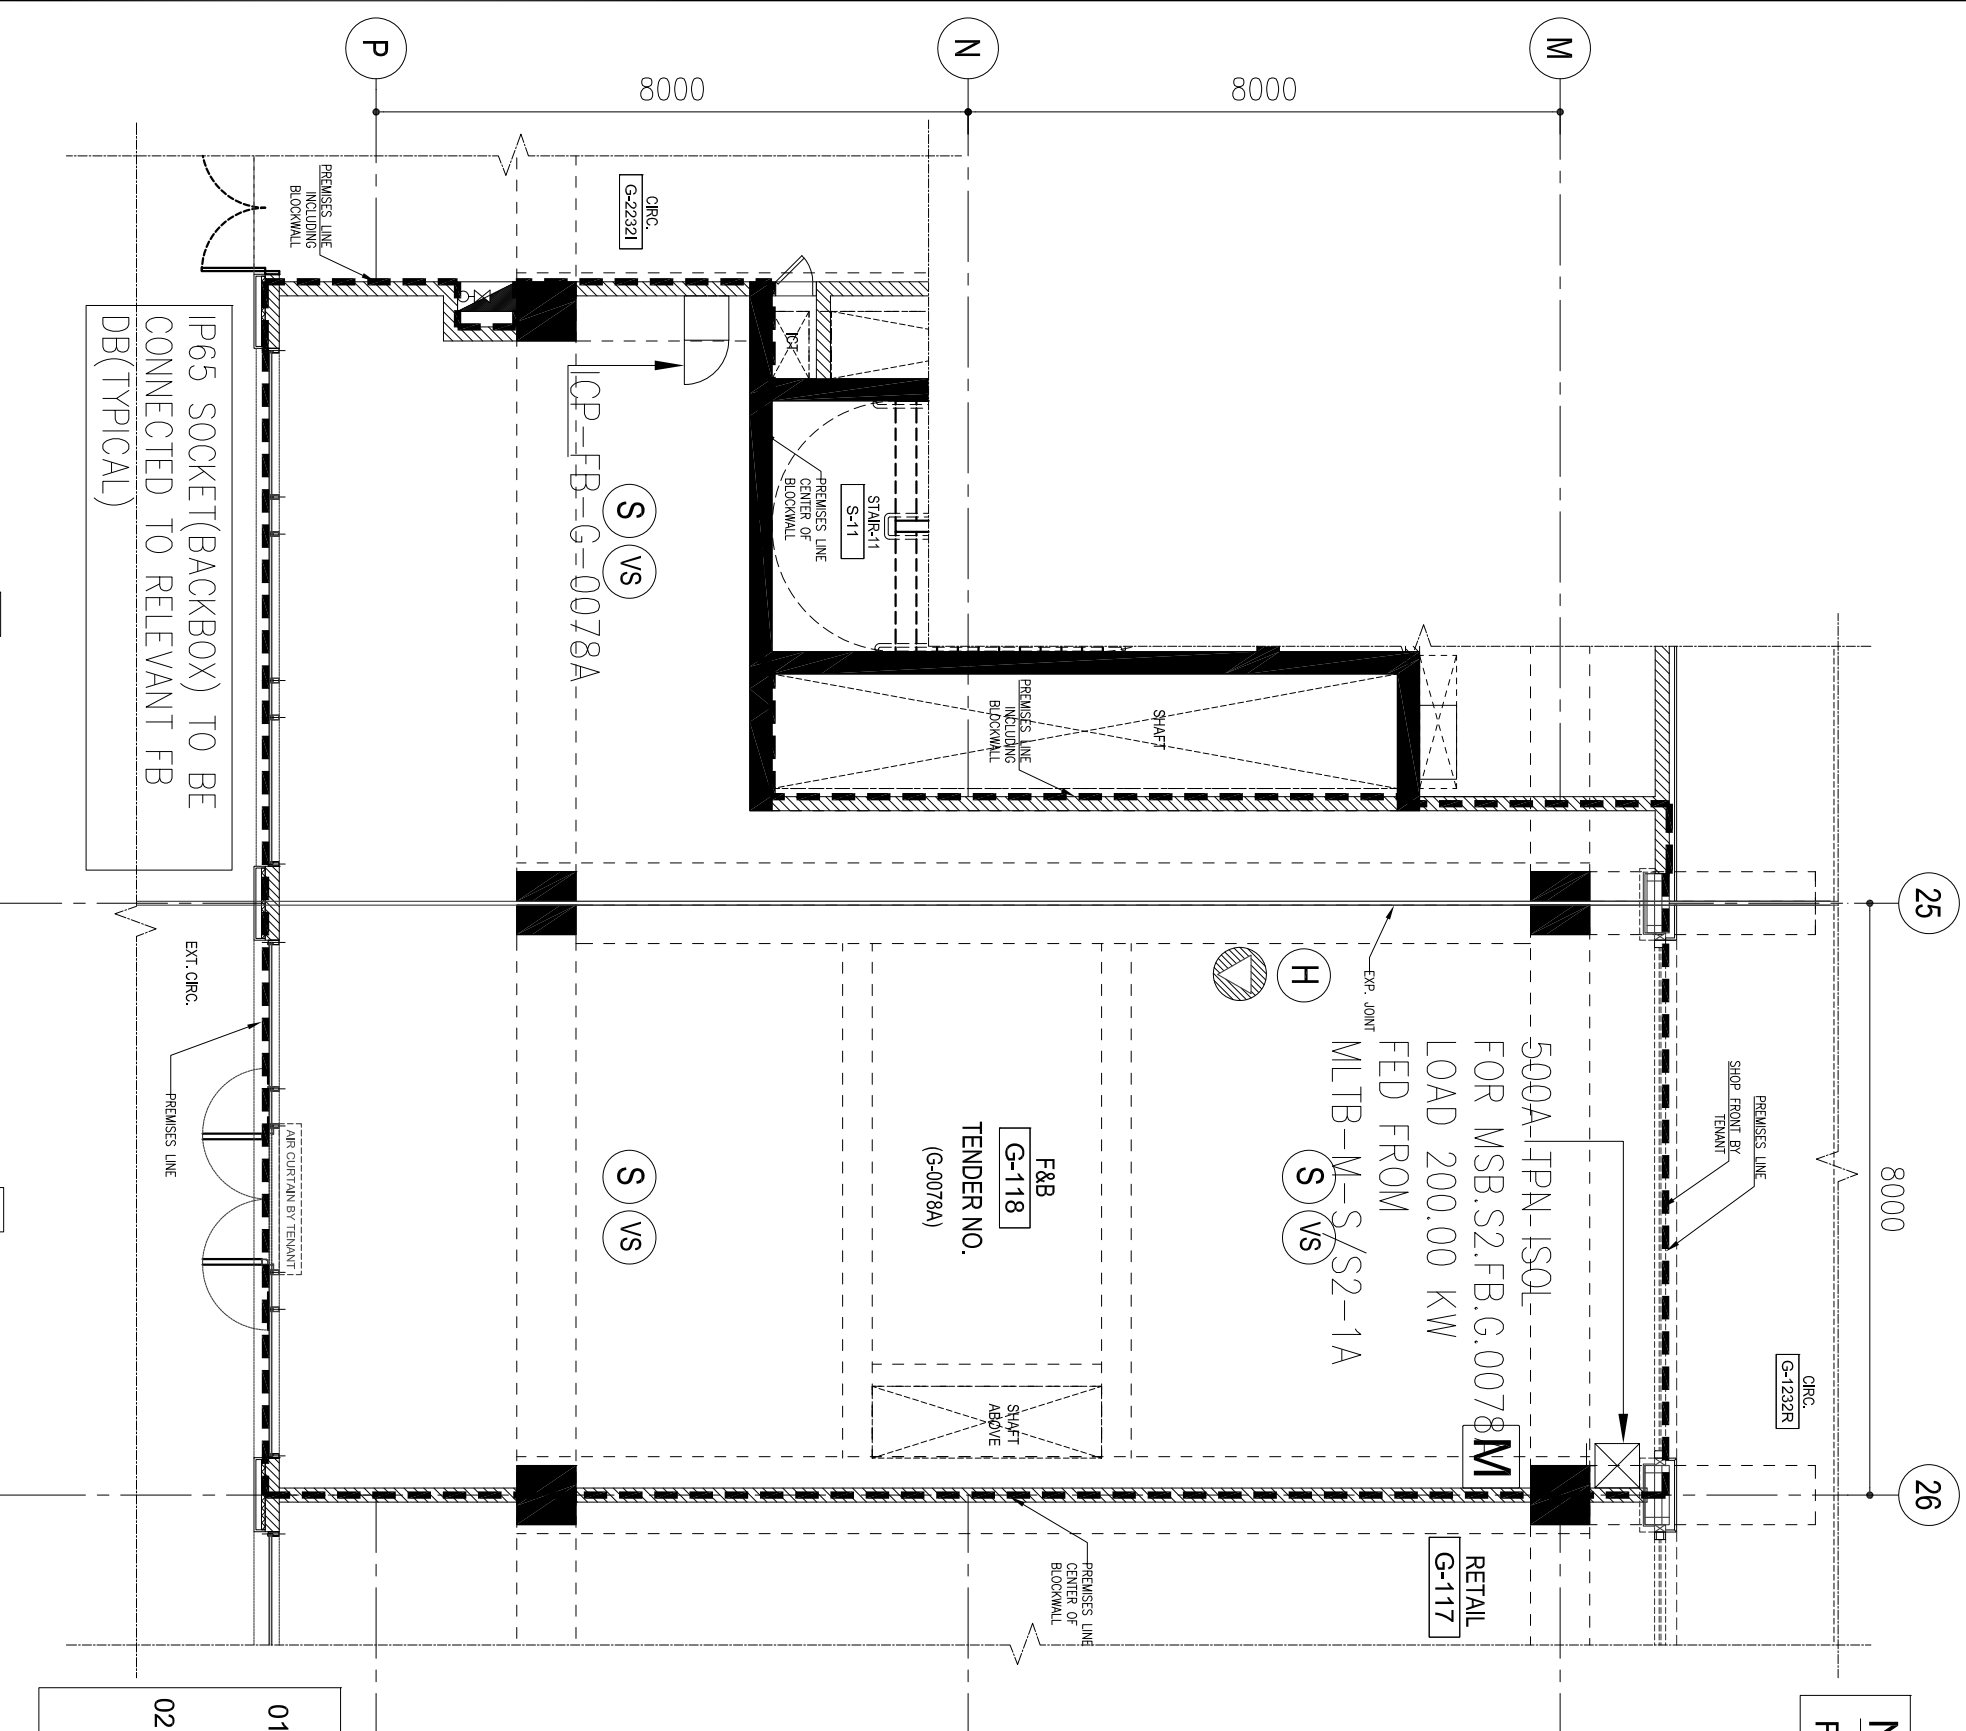

## KEY PLAYS

2  
3



## NOTES:

1. DRAWING DIMENSIONS ARE TO BE READ IN CONJUNCTION WITH ALL OTHER SPECIFICATIONS AND CONTRACT DOCUMENTS AND IN CONJUNCTION WITH THE WORKMAN'S KNOWLEDGE OF THE WORK. DIMENSIONS OF ANY DISCREPANCIES ARE BETWEEN THESE DRAWINGS REFERRED TO THE ENGINEER BEFORE THE COMMENCEMENT OF ANY WORK ON SITE.
2. ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF THE SHOP FRAMING WORK ON THE SITE OR THE PREPARATION OF THE SHOP FRAMES.
3. THE ENGINEER'S EXTERNAL FACING SHEETPILING SPECIFIC (ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND PRECISIONS.
4. NO CHANGES AND/OR ALTERATIONS OF ANY DESCRIPTION WILL BE PERMITTED TO THE OWNER- PROVIDED EXTERNAL GLASS SHOP FRONTS.
5. SUPPLY, STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INTERIOR SPACES MUST BE THE OWNER'S RESPONSIBILITY. THE JOINTS MUST BE PROTECTED BY AN APPROPRIATE INSULATION TO PREVENT THE ENTRY OF DUST, DEBRIS & INSULATION DROVE NECESSARY WILL BE BY THE OWNER.
6. THIS DRAWING IS VALID FOR ONE (1) NOT TO BE USED FOR CONSTRUCTION ) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
7. THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
8. IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THEMSELVES WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND/OR SUBSTITUTIONS.
9. ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING.
10. THIS IS THE RESPONSIBILITY OF THE INSPECTOR TO UNDERTAKE AN INDEPENDENT MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING.
11. FURNISH REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY FOR THE DRAWING OR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THE DRAWING.
12. THE ANCHOR ANCHOR SIZE USED FOR ANY FLOORING SUPERIMPOSITION SHALL NOT EXCEED MORE THAN 10MM DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE UNDERBED PVC CONDUIT.

## FOR REVIEW

OWNER



PROJECT TITLE

**Al Khiran Outlet Mall**

CONSULTANT:

cracknell SSH

DESIGN ARCH

**CALLISONRTKL**  
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD



TAMDEN  
 MAIL MANAGEMENT  
 P.O. BOX 29060 SAFAT 13151, KUWAIT  
 TEL: +965 25362330  
 FAX: +965 25362360  
 WWW.TAMDENNMALLS.COM

DRAWING TITLE

# GROUND FLOOR RESTAURANT - ELEC PLAN

UNIT NO. G-118

## RESTAURANT USAGE.

TRADE	SCALE	DATE
ELEC	1:50 @ A1	APRIL 2020
DRAWN BY	CHECKED BY	APPROVED BY
--	M.RAMADAN	--
DRAWING NO.	OF	REV.
E-01	05 OF 09	00