


NOTES:

FIRE ALARM & IDF SYSTEMS AS PER DESIGN DRAWINGS

LEGEND:

SYMBOL	DESCRIPTION
	40A TPN ISOLATING SWITCH
	TANENT METER
	SMOKE DETECTOR
	CEILING RECESSED VOICE EVACUATION SPEAKER
	ICP DATA CABINET 12U WALL MOUNT

S.NO	DESCRIPTION	LOAD IN K.W
1	LIGHT, POWER & EQUIPMENT	15.800 K.W
2	AHU-G-0074	2.200 K.W
TOTAL LOAD		18.000 K.W

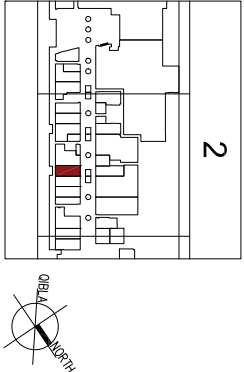

NOTES

1. DRAWINGS DIMENSIONS ARE TO BE READ NOT TO BE SCALED.
2. ARCHITECTURAL DRAWING MUST BE READ IN CONJUNCTION WITH ALL OTHER SERVICE DRAWINGS AND CONTROL DOCUMENTS AND IN CONJUNCTION WITH THE PROJECT MANUAL, SPECIFICATIONS AND ANY OF THE DOCUMENTS HERE SHOULD BE IMMEDIATELY REPORTED TO THE ENGINEER BEFORE THE COMMENCEMENT OF ANY WORK ON SITE.
3. ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF THE WORK ON THE SITE OR THE PREPARATION OF THE SHOP DRAWINGS.
4. THE INVESTOR'S EXTERNAL FACING SHOPFRONT SIGNAGE (IF ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND DIRECTIONS.
5. NO CHANGES AND/OR PENETRATIONS OF ANY DESCRIPTION WILL BE PERMITTED TO THE OWNER- PROVIDED EXTERNAL GLASS SHOP FRONTS.
6. SUPPLY, STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INTERIOR SPACES IS BY THE OWNER. INSTALLATION OF THE SAME WILL BE BY THE INVESTOR. SUPPLY AND INSTALLATION OF THE VAPOR BARRIER, FIRE BARRIER & INSULATION DROPE ASSEMBLY WILL BE BY THE OWNER.
7. THIS DRAWING IS INDICATIVE ONLY ( NOT TO BE USED FOR CONSTRUCTION ) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
8. THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
9. IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THE SKELETONS WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND /OR SUBSTITUTIONS.
10. IT IS THE RESPONSIBILITY OF THE INVESTOR TO UNDERLINE AN ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING.
11. TANGDEEN REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY OF ANY KIND FOR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THIS DRAWING.
12. THE ANCHOR BOLT SIZE USED FOR ANY FLOORING SUPPORTING SYSTEM SHOULD NOT EXCEED MORE THAN 8mm DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE IMBEDDED PVC CONDUIT.

FOR REVIEW

OWNER

تجارت  
TANGDEEN  
GROUP

PROJECT TITLE  
Al Khiran Outlet Mall

CONSULTANTS

cracknell SSH

DESIGN ARCHITECT

CALLISONRTKL  
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD



تجارت  
OHA ENGINEERING CONSULTANT  
P.O. BOX 99444, J. COOR 10, 2007 - KUWAIT  
PHONE: 2242686 - 2242618 FAX: 2243611  
Email: oha@oha-engineer.com

MANAGED BY

تجارت  
TANGDEEN  
P.O. BOX: 20060 SAHAF 13151, KUWAIT  
TEL: +965 25342310  
FAX: +965 25342310  
WWW.TANGDEENMALLS.COM

DRAWING TITLE:

GROUND FLOOR  
RETAIL ELEC.PLAN

UNIT NO.	G-122		
USAGE.	RETAIL		
TRADE	SCALE	DATE	
ELEC	1:50 @ A1	JULY 2020	
DRAWN BY	CHECKED BY	APPROVED BY	
--	M.RAMADAN	--	
DRAWING No.	OF	REV.	