


NOTES:

FIRE ALARM & IDF SYSTEMS AS PER DESIGN DRAWINGS


7.00 KW  
32A TPN ISOL.FOR DB.S2.R.G.0073B  
FED FROM  
BD.S2.1B.T1/MLTB-M-S/S2-1B

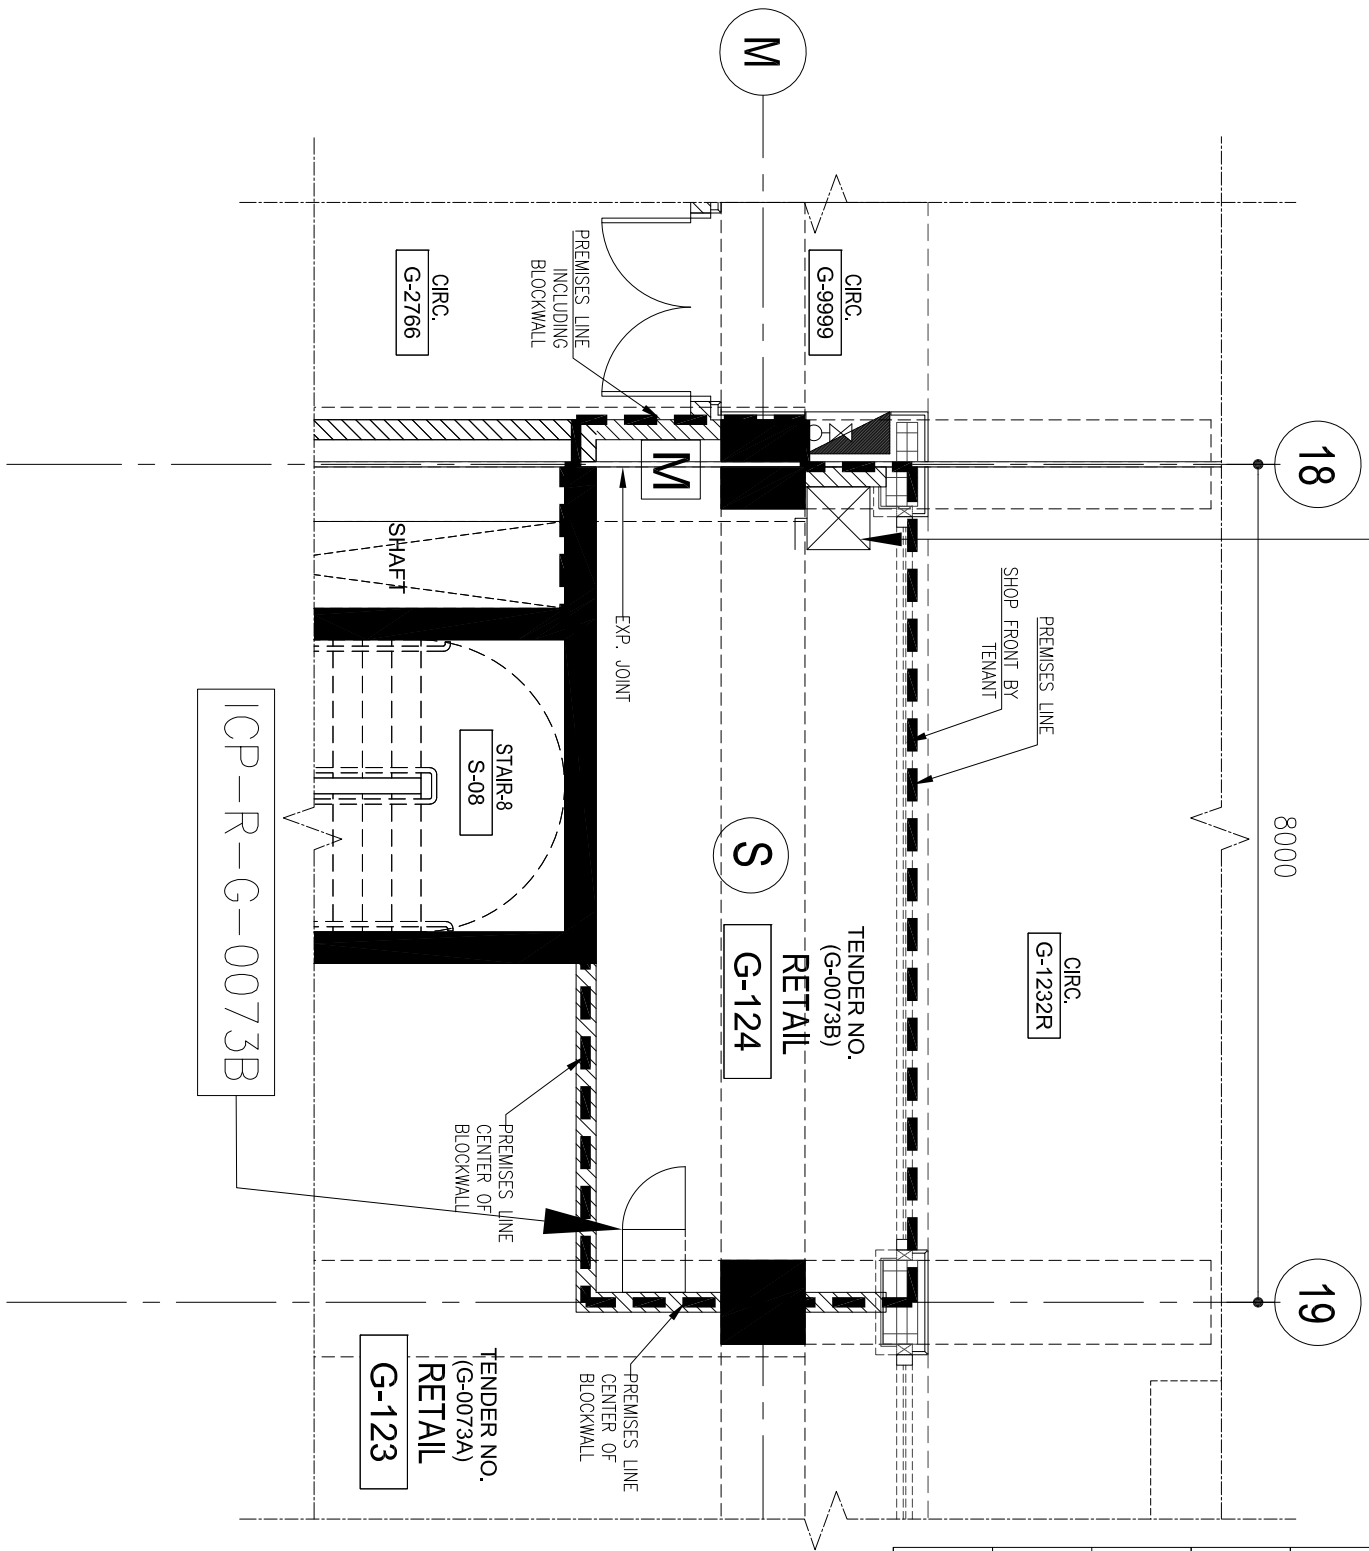

LEGEND:

SYMBOL	DESCRIPTION
	32A TPN ISOLATING SWITCH
	TANENT METER
	SMOKE DETECTOR
	ICP DATA CABINET 12U WALL MOUNT

S.NO	DESCRIPTION	LOAD IN K.W
1	LIGHT, POWER & EQUIPMENT	6.955 K.W
2	FCU-G-0073B	0.045 K.W
TOTAL LOAD		7.000 K.W



NOTES

- DRAWINGS DIMENSIONS ARE TO BE READ NOT TO BE SCALED.
- ARCHITECTURAL DRAWING MUST BE READ IN CONJUNCTION WITH ALL OTHER SERVICE DRAWINGS AND CONTRACT DOCUMENTS AND IN CASE OF ANY DISCREPANCIES ARGE BETWEEN THESE DRAWINGS THE ARCHITECTURAL DRAWING SHALL PREVAIL.
- ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF ANY ITEM OF WORK ON THE SITE OR THE PREPARATION OF THE SHOP DRAWINGS.
- THE INVESTOR'S EXTERNAL FACING SHOPFRONT SQUARE(FE ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND DIRECTIONS.
- NO CHANGES AND/OR PENETRATIONS OF ANY DESCRIPTION WILL BE ALLOWED WITHOUT THE WRITTEN APPROVAL OF THE OWNER'S FRONTS.
- SUPPLY STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INSPECTOR SPACES IS BY THE OWNER. INSTALLATION OF THE SAME WILL BE BY THE INVESTOR. SUPPLY AND INSTALLATION OF THE VAPOR BARRIER, FIRE BARRIER & INSULATION DRAPE ASSEMBLY WILL BE BY THE OWNER.
- THIS DRAWING IS INDICATIVE ONLY ( NOT TO BE USED FOR CONSTRUCTION ) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
- THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
- IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THEMSELVES WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND /OR SUBSTITUTIONS.
- IT IS THE RESPONSIBILITY OF THE INVESTOR TO UNDERPINE AN ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING.
- TAMDEEN REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY OF ANY FORM FOR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THIS DRAWING.
- THIS DRAWING NOT BE USED FOR ANY FLOORING SUPPORTING STRUCTURE NOT EXCEED MORE THAN 100MM DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE MBERDED PVC CONDUIT.

FOR REVIEW

OWNER

تamdēen  
TAMDEEN  
GROUP

PROJECT TITLE

Al Khitran Outlet Mall

CONSULTANTS

cracknell SSH

DESIGN ARCHITECT

CALLISONRTKL  
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD



OHAEENGINEERINGCONSULTANT  
P.O.Box 628 RUMAILY CODE 102007-KUWAIT  
PHONE: 2420208 - 2420218 FAX: 2438511  
E-mail: oha@ohae.com

MANAGED BY

تamdēen  
TAMDEEN  
MAIL MANAGEMENT WWW.TAMDEENMALLS.COM

DRAWING TITLE:

GROUND FLOOR  
RETAIL ELEC.PLAN

UNIT NO.		G-124	
USAGE.		RETAIL	
TRADE	SCALE	DATE	
ELEC	1:50 @ A2	JULY 2020	
DRAWN BY	CHECKED BY	APPROVED BY	
--	M.RAMADAN	--	
DRAWING NO.	OF	REV.	
E-01	06 OF 09	00	