


LEGEND:

SYMBOL	DESCRIPTION
	80 A TPN ISOLATING SWITCH
	TANENT METER
	SMOKE DETECTOR
	CEILING RECESSED VOICE EVACUATION SPEAKER
	ZONE INTERFACE SWITCH (ZIM) @ 3.0 MTR. F.F.L AT BOH
	ICP DATA CABINET 12U WALL MOUNT

NOTES:

1.ALL ISOLATORS WILL BE LOCATED AT HIGH LEVEL ABOVE FALSE CEILING

S.NO	DESCRIPTION	LOAD IN K.W
1	LIGHT, POWER & EQUIPMENT	27.68 K.W
2	AHU-G-0072A FCU-G-0072B	2.200 K.W 0.120 K.W 2.32 K.W
TOTAL LOAD		30.00 K.W

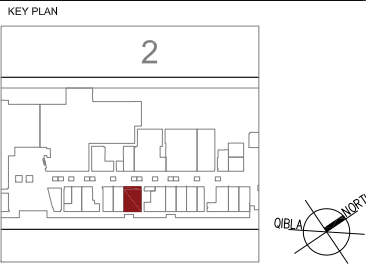

- NOTES
- DRAWINGS DIMENSIONS ARE TO BE READ NOT TO BE SCALED.
  - ARCHITECTURAL DRAWING MUST BE READ IN CONJUNCTION WITH ALL OTHER SERVICE DRAWINGS AND CONTRACT DOCUMENTS AND IN CASE OF ANY DISCREPANCIES ARISE BETWEEN THESE DRAWINGS AND ANY OF THE DOCUMENTS.THEY SHOULD BE IMMEDIATELY REPORTED TO THE ENGINEER BEFORE THE COMMENCEMENT OF ANY WORK ON SITE.
  - ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF ANY ITEM OF WORK ON THE SITE OR THE PREPARATION OF THE SHOP DRAWINGS.
  - THE INVESTOR'S EXTERNAL FACING SHOPFRONT SIGNAGE(IF ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND DIRECTIONS.
  - NO CHANGES AND/OR PENETRATIONS OF ANY DESCRIPTION WILL BE PERMITTED TO THE OWNER- PROVIDED EXTERNAL GLASS SHOP FRONTS.
  - SUPPLY, STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INVESTOR SPACES IS BY THE OWNER. INSTALLATION OF THE SAME WILL BE BY THE INVESTOR. SUPPLY AND INSTALLATION OF THE VAPOR BARRIER, FIRE BARRIER & INSULATION DRAPE ASSEMBLY WILL BE BY THE OWNER.
  - THIS DRAWING IS INDICATIVE ONLY ( NOT TO BE USED FOR CONSTRUCTION ) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
  - THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
  - IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THEMSELVES WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND /OR SUBSTITUTIONS.
  - IT IS THE RESPONSIBILITY OF THE INVESTOR TO UNDERTAKE AN ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING
  - TAMDEEN REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY OF ANY FORM FOR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THIS DRAWING
  - THE ANCHOR BOLT SIZE USED FOR ANY FLOORING SUPPORTING SYSTEM SHOULD NOT EXCEED MORE THAN 8mm DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE IMBEDDED PVC CONDUIT.

FOR REVIEW



PROJECT TITLE  
Al Khiran Outlet Mall

CONSULTANTS  
cracknell SSH

DESIGN ARCHTECT  
CALLISORTKL  
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD  
OHA ENGINEERING CONSULTANT  
P.O. Box 6249 HAWALLI, CODE NO.3037 - KUWAIT  
PHONE: 22420508 - 22420518 FAX: 22438511  
E-mail: oha@oharoha.com

MANAGED BY  
TAMDEEN MALL MANAGEMENT CO. K.S.C.C  
P.O. BOX: 29060 SAFAT 13151, KUWAIT  
TEL: +965 25362330  
FAX: +965 25362360  
MALL MANAGEMENT WWW.TAMDEENMALLS.COM

DRAWING TITLE:  
GROUND FLOOR  
RETAIL-ELEC PLAN

UNIT NO.	G-125 & G-126	
USAGE.	RETAIL	
TRADE	SCALE	DATE
ELEC	1:50 @ A1	OCT 2021
DRAWN BY	CHECKED BY	APPROVED BY
- -	M.RAMADAN	- -
DRAWING No.	OF	REV.
E-01	05 OF 08	00