



Equipment Tag Number.	Qty	Area Served			2 Stage Kitchen Exhaust Unit					Electrical Data			REMARKS
		Floor	Room ID	Space	Exhaust Rate (l/s)	ESP (Pa)	Speed	rpm	Fan Motor Power (kW)	Volt	Phase	Hz	
KEF-G-0068B	1	GROUND FLOOR	G-0068 B	F&B KITCHEN	3368	300	Constant	1450	3.00	415	3	50	BY TENANT

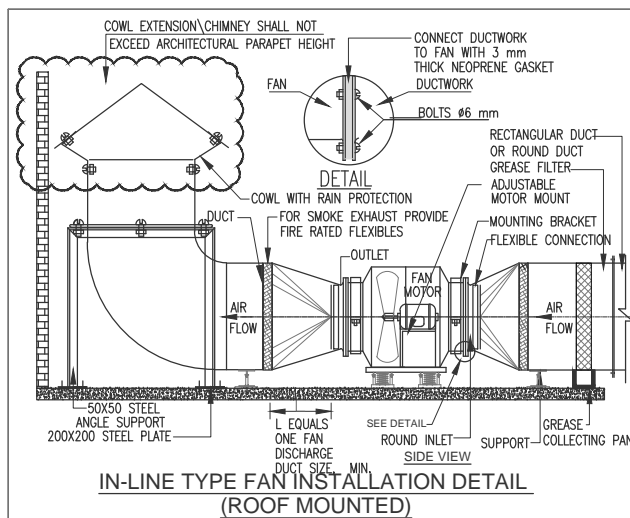

NOTE : THERMOSTAT LOCATION BY TENANT


- \* STARTER PANEL WILL BE LOCATED AT HIGH LEVEL
- \* 15M THERMOSTAT CABLE LENGTH WILL BE PROVIDED AS PER CONTRACT.
- \* EXHAUST FAN WILL BE LOCATED AT ROOF BETWEEN AXIS 11-12 & N-P
- \* KITCHEN EXHAUST DUCT IS SIZED TO MAXIMUM EXPECTED HOOD EXHAUST.THE VALUE SHOWN IN SCHEDULE IS BASED ON KITCHEN EXHAUST FLOW RATE EQUAL TO 35ACH BASED ON ASHRAE RECOMMENDATION.
- \* MAXIMUM RECOMMENDED VELOCITY FOR KITCHEN EXHAUST DUCT IS 1450 FPM
- \* MAXIMUM RECOMMENDED VELOCITY FOR FRESH AIR DUCT IS 1400 FPM
- \* COWL EXTENSION/CHIMNEY SHALL NOT EXCEED THE ARCHITECTURAL PARAPET HEIGHT

NON TREATED FRESH AIR DUCT PROVISION  
FAN WILL BE INSTALLED BY THE TENANT IF REQUIRED.

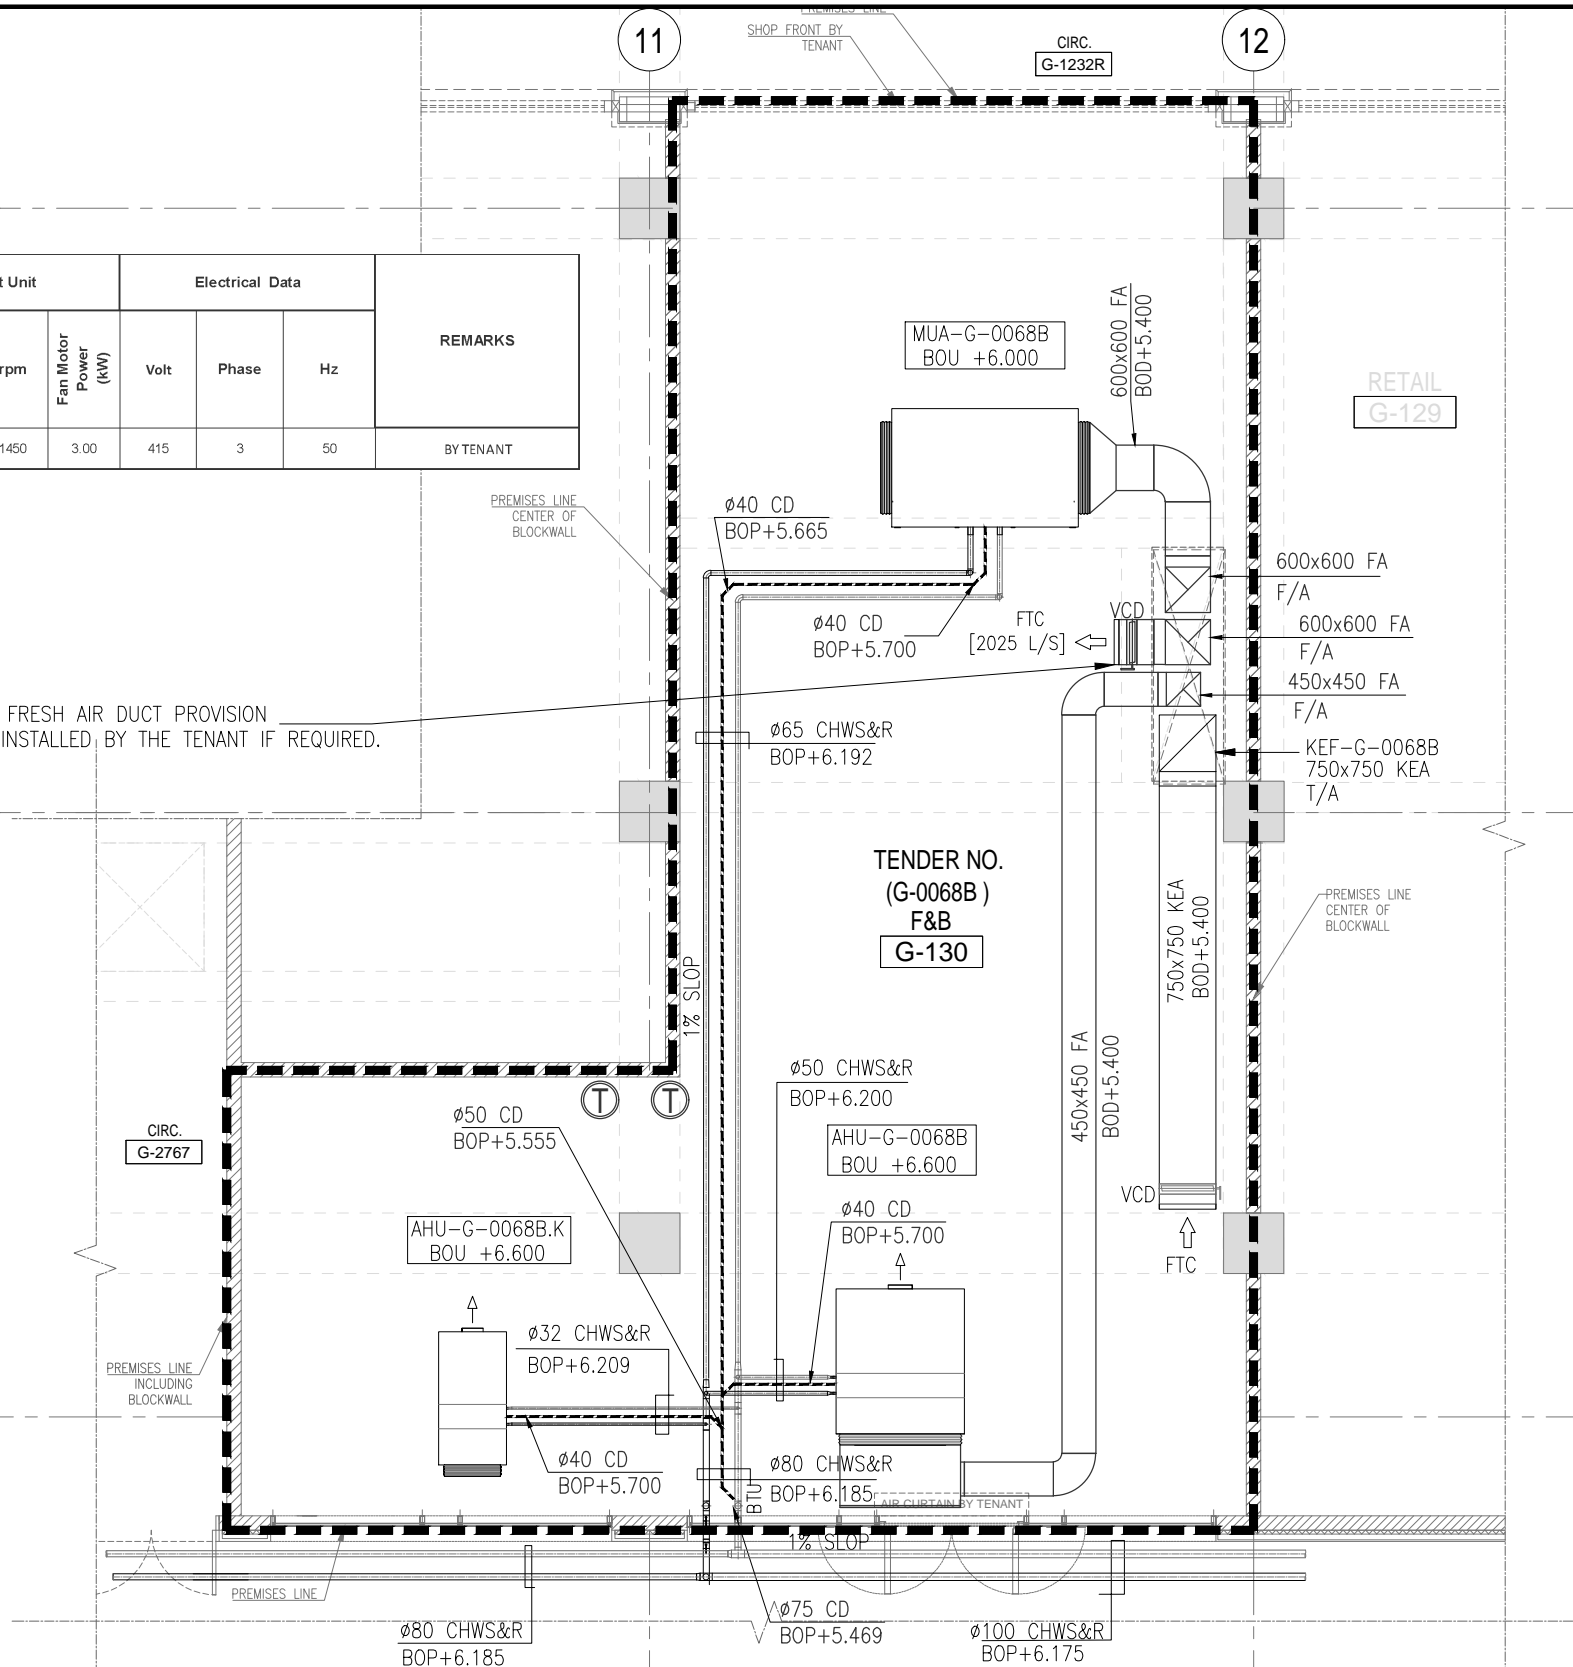

Equipment Tag Number.	Qty	Area Served			Supply Air Fan								Cooling Coil								Electrical Data			REMARKS
		Floor	Space	MEW ACTIVITY	FA /UNIT (l/s)	EA /UNIT (l/s)	HRU	SA/Unit (l/s)	RA/Unit (l/s)	ESP (Pa)	Fan Motor Power/Unit (kW)	Speed Control	On Coil		Off Coil		TC (kW)	SC (kW)	CHW Flow (l/s)	Pipe Connection (mm)	Volt	Phase	Hz	
													DB (°C)	WB (°C)	DB (°C)	WB (°C)								
AHU-G-0068B	1	GROUND FLOOR	F&B DINNING	RESTURANT DINING	468	0		1647	1179	250	2.200	constant	33.1	24.4	13.1	12.5	73.0	39.6	1.937	50	415	3	50	PACKAGE AHU
AHU-G-0068 B.K	1	GROUND FLOOR	F&B KITCHEN SUPPLY	KITCHEN	0	0		691	691	250	1.100	constant	26.5	19.2	13.1	12.4	15.7	11.2	0.418	32	415	3	50	PACKAGE AHU REFER KEF SCH.

Equipment Tag Number.	Qty	Area Served			Supply Air Fan								Cooling Coil				Electrical Data			REMARKS
		Floor	Space	MEW ACTIVITY	FA (l/s)	ESP (Pa)	Fan Motor Power/Unit (kW)	Speed Control	On Coil		Off Coil		TC (kW)	SC (kW)	CHW Flow (l/s)	Pipe Connection (mm)	Volt	Phase	Hz	
									DB (°C)	WB (°C)	DB (°C)	WB (°C)								
MUA-G-0068B	1	GROUND FLOOR	F&B KITCHEN	KITCHENS	2694	200	3.000	Constant	47.4	31.8	26.7	25.3	96.98	66.81	2.574	65	415	3	50	

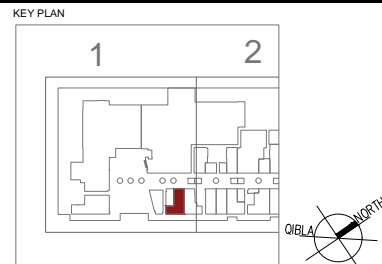

- NOTES
1. DRAWINGS DIMENSIONS ARE TO BE READ NOT TO BE SCALED.
  2. ARCHITECTURAL DRAWING MUST BE READ IN CONJUNCTION WITH ALL OTHER SERVICE DRAWINGS AND CONTRACT DOCUMENTS AND IN CASE OF ANY DISCREPANCIES ARISE BETWEEN THESE DRAWINGS AND ANY OF THE DOCUMENTS THEY SHOULD BE IMMEDIATELY REPORTED TO THE ENGINEER BEFORE THE COMMENCEMENT OF ANY WORK ON SITE.
  3. ALL THE LEVELS AND DIMENSIONS MUST BE CHECKED AND VERIFIED BY THE MAIN CONTRACTOR BEFORE THE COMMENCEMENT OF ANY ITEM OF WORK ON THE SITE OR THE PREPARATION OF THE SHOP DRAWINGS.
  4. THE INVESTOR'S EXTERNAL FACING SHOPFRONT SIGNAGE (IF ANY) MUST STRICTLY COMPLY WITH THE OWNER'S REQUIREMENTS AND DIRECTIONS.
  5. NO CHANGES AND/OR PENETRATIONS OF ANY DESCRIPTION WILL BE PERMITTED TO THE OWNER- PROVIDED EXTERNAL GLASS SHOP FRONTS.
  6. SUPPLY, STORAGE AND PROTECTION OF EXPANSION JOINT COVERS AND RELATED ACCESSORIES INSIDE ALL INVESTOR SPACES IS BY THE OWNER. INSTALLATION OF THE SAME WILL BE BY THE INVESTOR. SUPPLY AND INSTALLATION OF THE VAPOR BARRIER, FIRE BARRIER & INSULATION DRAPE ASSEMBLY WILL BE BY THE OWNER.
  7. THIS DRAWING IS INDICATIVE ONLY ( NOT TO BE USED FOR CONSTRUCTION ) AND IS ACCURATE AS AT THE DATE SHOWN ON THE DRAWING.
  8. THIS DRAWING IS SUBJECT TO CHANGE AS PLANNING, DEVELOPMENT AND CONSTRUCTION CONTINUES THROUGH UNTIL OPENING OF THE CENTRE.
  9. IT IS THE RESPONSIBILITY OF THE RECIPIENT OF THIS DRAWING TO UPDATE THEMSELVES WITH ANY SUBSEQUENT REVIEWS, UPDATES, ADDITIONS, DELETIONS AND /OR SUBSTITUTIONS.
  10. IT IS THE RESPONSIBILITY OF THE INVESTOR TO UNDERTAKE AN ON-SITE MEASURE TO VERIFY ALL DIMENSIONS SHOWN ON THIS DRAWING.
  11. TAMDEEN REAL ESTATE CO. DOES NOT ACCEPT ANY LIABILITY OF ANY FORM FOR THE RECIPIENT'S USE AND/OR INTERPRETATION OF THIS DRAWING.
  12. THE ANCHOR BOLT SIZE USED FOR ANY FLOORING SUPPORTING SYSTEM SHOULD NOT EXCEED MORE THAN 8mm DEPTH TO AVOID ANY DAMAGE THAT MAY CAUSED IN THE IMBEDDED PVC CONDUIT.

## FOR REVIEW

OWNER

تمدين  
TAMDEEN  
GROUP

PROJECT TITLE

Al Khiran Outlet Mall

CONSULTANTS

cracknell SSH

DESIGN ARCHITECT

CALLISONRTKL  
A DESIGN CONSULTANCY OF ARCADIS

ENGINEER OF RECORD

مهندسة مكارم الدرسية  
OHA ENGINEERING CONSULTANT  
P.O. BOX: 29060 SAFAT 13151, KUWAIT  
TEL: +965 25362330  
FAX: +965 25362360  
E-mail: oha@daroha.com

MANAGED BY

تمدين  
TAMDEEN  
MALL MANAGEMENT  
TAMDEEN MALL MANAGEMENT CO. K.S.C.C  
P.O. BOX: 29060 SAFAT 13151, KUWAIT  
TEL: +965 25362330  
FAX: +965 25362360  
WWW.TAMDEENMALLS.COM

DRAWING TITLE:

GROUND FLOOR  
RESTAURANT - HVAC PLAN

UNIT NO.	G-130	
USAGE.	RESTAURANT	
TRADE	SCALE	DATE
HVAC	1:50 @ A1	JAN 2021
DRAWN BY	CHECKED BY	APPROVED BY
--	--	--
DRAWING No.	OF	REV.
AC-01	04 OF 09	01