

TANFINET- BLOCK SAMPLE SITE -Thathaiyangarpet-Trichy



Tanfinet allocated room



Tanfinet allocated room



Electrical wiring from main box to Tanfinet ACDB



Electrical connection taken from Main Box



ACDB& UPS DB wiring



LED 20W Tube light wiring



Earth Rods Erection in earth pits for UPS neutral earth and General earth pits



Providing Salt with charkcoal in earth pits



The minimum distance between two earthing electrodes should be nine feet






32U Rack Movement & installation



Installation of 6 kva UPS ,batteries with battery breaker& battery cable connection in UPS



Power cable terminations ,Batteries interlink connections in UPS

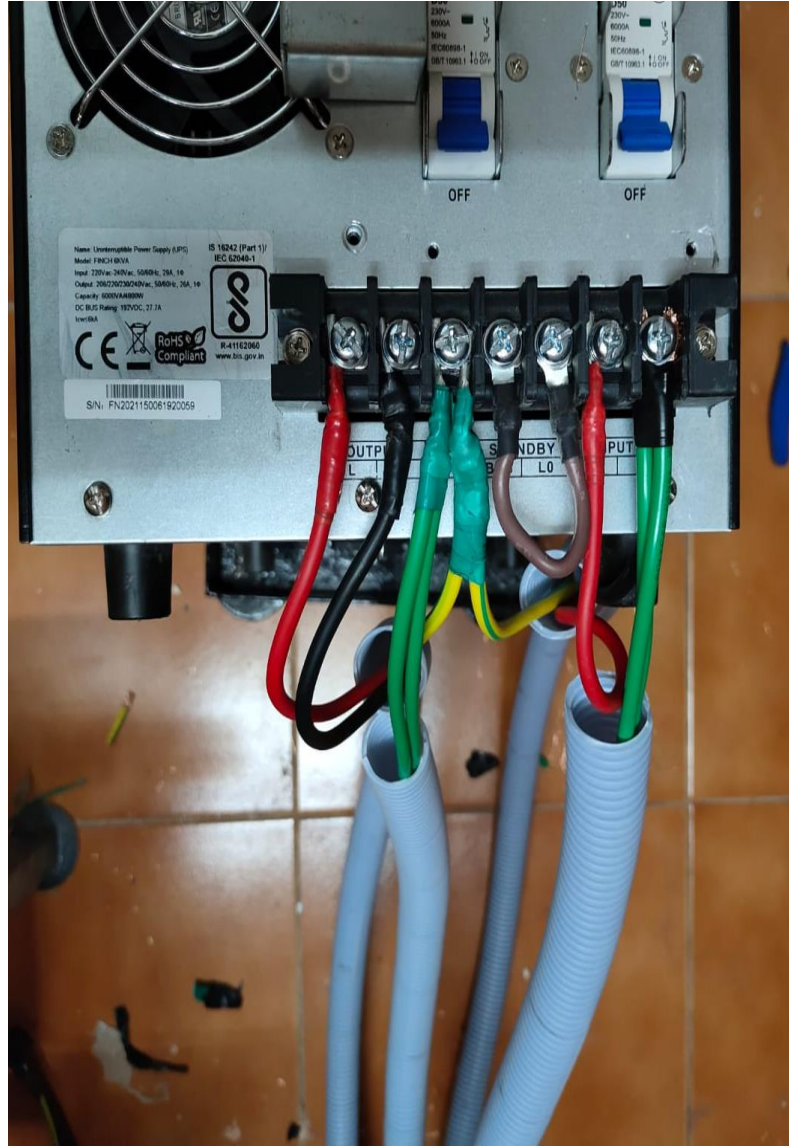

Finishing of the site

