

CHUNK 01

— RCCB without Integral Overcurrent Protection

Product

Residual Current Circuit Breaker (RCCB)

Description

An RCCB detects residual/leakage current in an electrical installation and disconnects the circuit when the leakage exceeds the specified operating value. It is principally intended to protect people against electric-shock hazards and can also provide protection against certain fire hazards caused by persistent earth faults.

Applicable IS

IS 12640 (Part 1):2024 / IEC 61008-1:2013

Standard title

Residual Current Operated Circuit-Breakers without Integral Overcurrent Protection for Household and Similar Uses (RCCBs) — Part 1: General Rules

Scope

The standard applies to RCCBs for household and similar uses, up to 440 V AC and rated current up to 125 A. They do not incorporate overcurrent protection.

Certification status — August 2026

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

The BIS Scheme-I list places IS 12640 Part 1 under the electrical QCO framework.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories
(Quality Control) Order, 2003, with subsequent amendments listed by BIS.

Current 2026 standard

□ 2024 revision is current.

BIS's implementation circular states that the last date for implementation of IS 12640 Part 1:2024 was 25 January 2025.

Product Manual

PM/IS 12640 (Part 1)/IEC 61008-1/4/Jan 2025

The official manual contains:

sampling guidelines

grouping guidelines

sample size

test equipment

Scheme of Inspection & Testing

possible tests in a day

licence scope.

Testing

The BIS LIMS currently lists laboratories testing against the 2024 standard. Tests include operating characteristics, mechanical/electrical endurance, short-circuit performance and EMC-related testing.

Documents / application

The applicant follows the BIS Scheme-I certification procedure and the requirements of the product manual/SIT.

Product-specific documents: use the Product Manual rather than inventing a universal checklist.

Marking

BIS Standard Mark / ISI Mark under the BIS licence.

2026 note

⚠ The database must store IS 12640 Part 1:2024 as current, while older 2016 records should be retained only as historical/legacy information.

Official sources

BIS Scheme-I list

BIS RCCB Product Manual

BIS RCCB 2024 implementation guideline

BIS LIMS — IS 12640

CHUNK 02

— RCCB with Integral Overcurrent Protection

Product

Residual Current Circuit Breaker with Integral Overcurrent Protection — RCBO

Description

An RCBO combines residual-current protection with overcurrent protection in one device. It can therefore detect leakage current while also protecting the circuit against specified overload/short-circuit conditions.

Applicable IS

IS 12640 (Part 2):2016 / IEC 61009-1:2012

Standard title

Residual Current Operated Circuit-Breakers with Integral Overcurrent Protection for Household and Similar Uses (RCBOs) — Part 2: General Rules

Scope

The standard covers RCBOs for household/similar applications, including devices rated up to 440 V AC and rated current up to 125 A, within the specified standard conditions.

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

BIS's current Scheme-I list places Part 2 directly after Part 1 under the same electrical QCO.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories (Quality Control) Order, 2003, with listed amendments.

2026 status

□ BIS continues to list the product under compulsory Scheme-I.

Product Manual

BIS's Product Manual database contains:

IS 12640 (Part 2):2016 / IEC 61009-1:2012

The manual is used for product-specific certification requirements including testing, sampling and licence scope.

Testing

Testing covers the two essential functions:

residual-current operation

overcurrent protection

along with applicable electrical safety, endurance, short-circuit and construction requirements.

Documents / application

BIS Scheme-I application + manufacturing/QC/testing evidence + product-specific Product Manual/SIT requirements.

Marking

BIS Standard Mark / ISI Mark

Official sources

BIS Scheme-I list

BIS Product Manuals

BIS Know Your Standard

CHUNK 03

— AC Watt-Hour Meters

Product

AC Watt-hour Meter

Description

An AC watt-hour meter measures the amount of electrical energy consumed by an AC electrical installation. These meters are commonly used for electricity measurement and billing.

IS

IS 13010:2002

Standard title

AC Watt-hour Meters — Class 0.5, 1 and 2

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

BIS's current compulsory list identifies this product as IS 13010, Classes 0.5, 1 and 2.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO, 2003 + amendments.

2026 status

☐ Current BIS Scheme-I product.

Product Manual

BIS lists:

IS 13010:2002 — AC Watt-hour Meters Class 0.5, 1 and 2

in its Product Manual database.

Testing

Product conformity involves metering accuracy and applicable electrical/environmental requirements specified by the standard and Product Manual.

Documents / application

BIS Scheme-I application and product-specific manufacturing, QC and testing information.

Marking

Applicable BIS Standard Mark / ISI Mark.

Official sources

BIS Scheme-I list

BIS Product Manuals

BIS Know Your Standard

CHUNK 04

— AC Static Watt-Hour Meters

Product

AC Static Watt-hour Meter

Description

A static watt-hour meter electronically measures electrical energy rather than using the traditional electromechanical rotating-disc mechanism. It is used for measurement of AC energy consumption.

IS

IS 13779:1999

Standard title

AC Static Watt-hour Meters — Class 1 & 2

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO, 2003 + amendments.

2026 status

□ Current compulsory-certification listing.

Product Manual

BIS lists the Product Manual for:

IS 13779:1999 — AC Static Watthour Meters Class 1 & 2.

Testing

Testing covers applicable metering accuracy, electrical characteristics, insulation, environmental and endurance requirements.

Documents / application

BIS Scheme-I application + product-specific Product Manual/SIT and manufacturing/testing capability.

Marking

BIS Standard Mark / ISI Mark

Official sources

BIS Scheme-I list

BIS Product Manuals

CHUNK 05 — Transformer-operated Watt-hour & VAR-hour Meters

Product

AC Static Transformer-operated Watt-hour and VAR-hour Meter

Description

These meters measure active electrical energy and, for applicable models, reactive energy using transformer-operated measurement arrangements. They are used where the electrical current/voltage requires instrument-transformer interfacing.

IS

IS 14697:2021

Standard title

AC Static Transformer Operated Watthour Meters and Var-Hour Meters —
Specification

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

BIS's current list specifically identifies Classes 0.2S and 0.5S.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO framework.

2026 status

□ Current standard listed by BIS.

Product Manual

BIS lists the Product Manual for IS 14697:2021.

Testing

Includes applicable:

accuracy

electrical performance

insulation

environmental conditions

endurance

metering performance

Documents / application

Scheme-I application + Product Manual/SIT + evidence of manufacturing and testing capability.

Marking

BIS Standard Mark / ISI Mark

Official sources

BIS Scheme-I list

BIS Product Manuals — IS 14697

CHUNK 06

— Self-Ballasted Lamps

Product

Self-ballasted Lamps for General Lighting Services

Description

Self-ballasted lamps contain the components required for operation directly from the electrical supply. They are designed for general lighting applications and include lamp types covered by the relevant safety and performance requirements.

IS

IS 15111 (Part 1 & 2):2002

Standard

Part 1 — Safety Requirements

Part 2 — Performance Requirements

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO, 2003 + amendments.

2026 status

□ Current BIS compulsory product listing.

Product Manual

PM/IS 15111 (Part 1&2)/1/January 2019

The official manual specifies:

sampling

grouping

sample size

test equipment

SIT

possible tests/day

licence scope

For example, the manual specifies 30 lamps for sampling under its stated scheme.

Testing

BIS LIMS shows testing including:

marking

protection against electric shock

insulation resistance

electric strength

mechanical strength

cap temperature rise

resistance to heat

resistance to flame/ignition

fault conditions

lamp efficacy

power factor

applicable EMC tests.

Documents / application

BIS Scheme-I application + Product Manual/SIT requirements.

Marking

BIS Standard Mark / ISI Mark and applicable product marking required by the standard.

Important note

The standard has multiple amendments; the official Product Manual records amendments for both Part 1 and Part 2.

Official sources

BIS Self-ballasted Lamp Product Manual

BIS Scheme-I list

BIS LIMS testing information

CHUNK 07

— Electric Iron

Product

Electric Iron

Description

An electric iron is a household heating appliance used to press and smooth textiles. BIS requirements focus on protection against electrical shock, excessive temperatures, fire and abnormal operating conditions.

IS

IS 302 (Part 2/Sec 3):2024 / IEC 60335-2-3:2022

Standard

Household and Similar Electrical Appliances — Safety — Part 2: Particular Requirements — Section 3: Electric Irons

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical appliance / household electrical appliance QCO framework.

2026 status

□ 2024 edition is current.

BIS's Product Manual database lists the 2024/IEC 2022 edition.

Product Manual

BIS lists the Product Manual for the current standard.

Testing

The applicable standard/Product Manual covers safety testing such as:

protection against electric shock

heating

leakage

electric strength

abnormal operation

mechanical strength

construction

resistance to heat/fire

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark plus the product markings required by the applicable standard.

Official sources

BIS Product Manual — Electric Iron

BIS Scheme-I list

CHUNK 08

— Electric Immersion Water Heater

Product

Electric Immersion Water Heater

Description

An immersion water heater heats water by placing an electrical heating element directly into the water. The appliance requires strong electrical-insulation and thermal-safety controls because the heating element operates in direct contact with water.

IS

IS 302 (Part 2/Sec 201):2008

Standard

Safety of Household and Similar Electrical Appliances — Part 2: Particular Requirements — Section 201: Electric Immersion Water-Heaters

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Appliances for Domestic Water Heating (Quality Control) Order, 2023, with subsequent amendments/implementation provisions.

BIS's current guidance specifically identifies the revised product-manual framework for IS 368:2014 and IS 302-2-201:2008.

2026 status

□ Current compulsory product.

Product Manual

BIS provides revised product-manual guidance for this product family.

Testing

Applicable safety tests include:

protection against electric shock

leakage

insulation

electric strength

heating

abnormal operation

mechanical/construction safety

Documents / application

Scheme-I application + product-specific Product Manual/SIT +
manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark.

Official sources

BIS Scheme-I specific guidelines

BIS Scheme-I list

CHUNK 09

— Electric Stoves

Product

Electric Stove

Description

An electric stove uses electrical heating elements to generate heat for cooking. BIS requirements are aimed at controlling electrical, thermal and fire hazards during normal and abnormal use.

IS

IS 302 (Part 2/Sec 202)

Standard

Safety of Household and Similar Electrical Appliances — Part 2: Particular Requirements — Section 202: Electric Stoves

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Applicable electrical/household appliance QCO framework.

2026 status

☐ Current BIS compulsory product listing.

Product Manual / SIT

The product-specific BIS certification documentation determines:

sample requirements

testing

inspection

SIT

licence scope

Testing

Applicable safety testing includes:

heating

electric strength

leakage

insulation

abnormal operation

mechanical/construction safety

resistance to heat/fire where applicable

Documents / application

Scheme-I application + product-specific Product Manual/SIT requirements.

Marking

BIS Standard Mark / ISI Mark and applicable product markings.

Official sources

BIS Scheme-I product list

CHUNK 10

— Room Heaters

Product

Electric Room Heater

Description

An electric room heater is an appliance designed to heat indoor spaces using electrical energy. Its safety requirements address electrical shock, excessive temperature, fire and abnormal operating conditions.

IS

IS 302 (Part 2/Sec 30)

Standard

Safety of Household and Similar Electrical Appliances — Part 2: Particular Requirements — Section 30: Room Heaters

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Applicable electrical/household appliance QCO.

2026 status

□ Current compulsory BIS product listing.

Product Manual / SIT

Product-specific Product Manual/SIT determines the applicable sampling and inspection/testing requirements.

Testing

Applicable testing includes:

heating

temperature rise

leakage

insulation

electric strength

abnormal operation

mechanical/construction safety

fire/heat resistance

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark.

Official sources

BIS Scheme-I product list

BIS Product Manuals

CHUNK 11

— Domestic Switches

Product

Switches for Domestic and Similar Purposes

Description

Domestic switches are fixed electrical switching devices used to control electrical circuits in homes and similar installations. They need to withstand repeated switching, electrical loading and specified environmental/mechanical conditions.

IS

 Current revised standard: IS 3854:2023

Standard

Switches for Domestic and Similar Purposes

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO.

2026 status

□ IS 3854:2023 is the revised standard.

BIS issued implementation guidelines for the revised standard on 17 January 2024.

Product Manual

BIS issued product-manual/implementation guidance for IS 3854:2023.

Older BIS material references IS 3854:1997, so our database must explicitly mark the older edition as historical rather than treating it as the current standard.

SIT / Testing

Applicable tests cover characteristics such as:

electrical performance

temperature rise

mechanical endurance

electrical endurance

insulation

electric strength

resistance to heat/fire

construction requirements

Documents / application

Scheme-I application + revised Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark and standard-required switch ratings/markings.

Official sources

BIS 2023 revision implementation guideline

BIS Scheme-I product list

CHUNK 12

— Tungsten Filament General-Service Electric Lamps

Product

Tungsten Filament General-Service Electric Lamps

Description

These are traditional incandescent lamps that generate visible light by heating a tungsten filament. BIS specifies requirements governing construction, electrical characteristics, safety and performance for the covered lamp types.

IS

IS 418

Standard title

Tungsten Filament General Service Electric Lamps — up to 100 W

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

BIS's current Scheme-I list specifically identifies tungsten filament general-service lamps up to 100 W.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO framework.

2026 status

☐ Current BIS Scheme-I product listing.

Product Manual

BIS's Product Manual system provides product-specific certification documentation; the current public listing should be checked against the exact IS edition before loading a revision into the production database.

Testing

Applicable testing concerns:

electrical characteristics

lamp performance

dimensions/construction

marking

safety

endurance where specified

Documents / application

Scheme-I application + product-specific BIS certification documentation/SIT.

Marking

BIS Standard Mark / ISI Mark plus required lamp markings.

Official source

BIS Scheme-I list

BIS Product Manuals

CHUNK 13

— PVC-insulated Electric Cables

Product

PVC-insulated Electrical Cables/Cords

Description

These cables use PVC as insulation and may be unsheathed or sheathed, with rigid or flexible conductors. They are intended for electrical applications at working voltages up to and including 1100 V.

IS

IS 694:2010

Standard title

Polyvinyl Chloride Insulated Unsheathed and Sheathed Cables/Cords with Rigid and Flexible Conductor for Rated Voltages up to and Including 1100 V

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO.

2026 status

□ Current BIS compulsory product.

Product Manual

BIS maintains a Product Manual for IS 694:2010. It contains the applicable certification framework, including SIT/grouping guidance. BIS specifically issued a revised Product Manual incorporating SIT and grouping guidelines for IS 694.

Testing

The applicable Product Manual/SIT governs tests covering:

conductor characteristics

insulation

dimensions

electrical resistance

voltage/electrical strength

ageing

mechanical properties

marking

other applicable cable requirements

Documents / application

Scheme-I application + manufacturing process/QC information + testing capability + Product Manual/SIT evidence.

Marking

BIS Standard Mark / ISI Mark together with applicable cable identification/ratings.

Official sources

BIS Product Manual — IS 694

BIS SIT/Product Manual clarification

BIS Scheme-I list

CHUNK 14

— Circuit Breakers for Overcurrent Protection

Product

Circuit Breakers for Overcurrent Protection

Description

These circuit breakers automatically interrupt an electrical circuit when current exceeds specified limits due to overload or short-circuit conditions. They are intended for household and similar electrical installations.

IS

IS 8828

⚠ BIS's current Scheme-I page explicitly notes:

IS 8828 has since been revised as IS/IEC 60898.

Standard

Electrical Accessories — Circuit Breakers for Overcurrent Protection for Household and Similar Installations

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO.

2026 status

⚠ Revision relationship must be preserved.

Do not store simply:

IS 8828 = current standard

Instead:

Historical/listed IS → IS 8828

Revision → IS/IEC 60898

The exact current edition should be resolved through BIS Know Your Standard before treating IS/IEC 60898 as the production-standard identifier.

Product Manual

Use BIS's Product Manual/Know Your Standard record for the applicable current standard and certification scope.

Testing

Applicable circuit-breaker tests include:

overload characteristics

short-circuit performance

electrical/mechanical endurance

temperature rise

insulation

electric strength

construction

tripping characteristics

Documents / application

Scheme-I application + current Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark plus required ratings and product identification.

Official sources

BIS Scheme-I list

BIS Know Your Standard

CHUNK 15

— Elastomer-insulated Cables

Product

Elastomer-insulated Cables — Part 1

Description

These cables use elastomeric insulating materials to provide electrical insulation around the conductor. They are designed for electrical applications up to and including the specified 1100 V working-voltage range.

IS

IS 9968 (Part 1)

Standard title

Elastomer Insulated Cables — Part 1: For Working Voltages up to and Including 1100 V

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark

BIS's current Scheme-I list identifies this product under the compulsory electrical framework.

QCO

Electrical Wires, Cables, Appliances and Protection Devices and Accessories QCO.

2026 status

□ Current BIS Scheme-I product listing.

Product Manual / SIT

BIS's product-specific documentation/SIT governs:

sampling

grouping

testing

inspection

manufacturing/QC requirements

licence scope

BIS has previously issued revised product-manual/SIT guidance covering IS 9968 alongside IS 694 and other cable standards.

Testing

Applicable cable testing covers properties such as:

conductor resistance

insulation properties

electrical strength
mechanical properties
ageing
dimensions
marking
applicable thermal/environmental characteristics
Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing capability.

Marking

BIS Standard Mark / ISI Mark with applicable cable ratings and identification.

Official sources

BIS Scheme-I list

BIS Product Manual information

BIS Know Your Standard

CHUNK 16

— Multi-purpose Dry Batteries

Product

Multi-purpose Dry Batteries

Description

Dry batteries are self-contained electrochemical power sources used in portable electrical and electronic equipment. Multi-purpose batteries are intended for general-purpose applications such as toys, torches, clocks and other low-power devices.

Applicable IS

IS 8144:2018

Standard

Primary Batteries — Multi-purpose Rechargeable?

⚠ For the final database, we should use the exact BIS standard title from the current Know Your Standard record rather than manually expanding the title.

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

The product is covered under the applicable BIS compulsory-certification framework for primary batteries.

2026 Status

☐ Current BIS-listed product.

Product Manual / SIT

The applicable BIS Product Manual/SIT establishes:

sampling

grouping

test requirements

testing equipment

inspection

licence scope

Testing

Battery conformity involves applicable requirements for:

electrical performance

discharge characteristics

capacity

leakage

safety

dimensions/construction

marking

The exact test schedule should be taken from the current Product Manual/SIT.

Documents / application

BIS Scheme-I application + manufacturing/QC/testing information specified by the applicable Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark with the applicable battery identification and ratings.

Official source

BIS Scheme-I Product List

CHUNK 17 — PVC-insulated Heavy-duty Cable up to 1.1 kV

Product

PVC-insulated Heavy-duty Electric Cable

Description

These cables use PVC insulation and are designed for electrical power distribution and installation. This product family covers cables intended for rated voltages up to and including 1.1 kV.

Applicable IS

IS 1554 (Part 1):1988

Standard

PVC Insulated (Heavy Duty) Electric Cables — Part 1: For Working Voltages up to and Including 1100 V

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Cables (Quality Control) Order, 2020, with applicable amendments.

BIS's current Scheme-I list places this product under the cable QCO framework.

2026 Status

□ Current BIS compulsory-certification product listing.

Product Manual / SIT

The applicable Product Manual establishes:

conductor/grouping requirements

sampling

tests

test equipment

inspection

licence scope.

Testing

Typical product conformity testing includes:

conductor resistance

insulation resistance

high-voltage/electrical strength

dimensions

mechanical properties

ageing

flame-related properties where applicable

marking.

Documents / application

Scheme-I application + manufacturing/QC/testing evidence + applicable Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark with cable identification, voltage, size and other standard-required information.

Official sources

BIS Product Manuals

CHUNK 18

— PVC-insulated Heavy-duty Cable, 3.3–11 kV

Product

PVC-insulated Heavy-duty Electric Cable — Medium Voltage

Description

These cables are designed for higher-voltage electrical distribution systems than ordinary low-voltage PVC cables. They use PVC insulation and are intended for the voltage range covered by the standard.

Applicable IS

IS 1554 (Part 2):1988

Standard

PVC Insulated (Heavy Duty) Electric Cables — Part 2: For Working Voltages from 3.3 kV up to and Including 11 kV

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Cables (Quality Control) Order, 2020 and applicable amendments.

2026 Status

☐ Current BIS-listed compulsory product.

Product Manual / SIT

Product-specific BIS certification documentation establishes:

sampling

grouping

testing

inspection

test equipment

licence scope.

Testing

Applicable testing covers:

conductor properties

insulation

high-voltage performance

electrical strength

dimensional requirements

mechanical/thermal characteristics

ageing.

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing and testing capability information.

Marking

BIS Standard Mark / ISI Mark + required cable identification.

Official source

CHUNK 19

— XLPE-insulated Cable up to 1.1 kV

Product

XLPE-insulated Electrical Cable

Description

XLPE cables use cross-linked polyethylene as the electrical insulation material. Compared with conventional PVC insulation, XLPE provides characteristics suitable for applications requiring higher thermal and electrical performance.

Applicable IS

IS 7098 (Part 1):1988

Standard

Crosslinked Polyethylene Insulated Thermoplastic Sheathed Cables — Part 1: For Working Voltages up to and Including 1100 V

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Cables QCO, 2020 + applicable amendments.

2026 Status

□ Current compulsory BIS listing.

Product Manual / SIT

Applicable Product Manual/SIT covers:

sampling

grouping

testing

test equipment

inspection

licence scope.

Testing

Includes applicable:

conductor resistance

insulation

voltage/electrical strength

dimensions

ageing

mechanical properties

thermal characteristics

marking.

Documents / application

BIS Scheme-I application + product-specific technical/QC/testing documentation.

Marking

BIS Standard Mark / ISI Mark and standard-required cable identification.

Official source

CHUNK 20

— XLPE Cable, 3.3–33 kV

Product

XLPE-insulated Power Cable — 3.3 kV to 33 kV

Description

These are medium-voltage power cables using XLPE insulation. They are used in electrical distribution systems where higher voltage insulation performance is required.

Applicable IS

IS 7098 (Part 2):2011

Standard

Crosslinked Polyethylene Insulated Thermoplastic Sheathed Cables — Part 2: For Working Voltages from 3.3 kV up to and Including 33 kV

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Cables QCO, 2020 + amendments.

2026 Status

□ Current BIS product listing.

Product Manual / SIT

Applicable BIS Product Manual/SIT establishes testing and inspection requirements.

Testing

Includes applicable:

conductor

insulation

voltage

partial discharge/electrical characteristics where specified

dimensional

mechanical

ageing

thermal

sheath requirements.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark + cable voltage/size/identification.

Official source

CHUNK 21

— XLPE Cable, 66–220 kV

Product

XLPE-insulated High-voltage Power Cable

Description

These cables are intended for high-voltage electrical power transmission/distribution applications. XLPE insulation allows the cable to operate at substantially higher electrical stresses than ordinary low-voltage cables.

Applicable IS

IS 7098 (Part 3):1993

Standard

Crosslinked Polyethylene Insulated Thermoplastic Sheathed Cables — Part 3: For Working Voltages from 66 kV up to and Including 220 kV

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Cables QCO framework.

2026 Status

□ BIS compulsory-certification listing.

Product Manual / SIT

The applicable BIS Product Manual/SIT defines the exact certification/testing regime.

Testing

High-voltage cable testing includes applicable:

insulation

electrical strength

high-voltage performance

conductor

sheath

dimensional

thermal

ageing

mechanical requirements.

Documents / application

BIS Scheme-I application + applicable product-specific technical/QC/testing documents.

Marking

BIS Standard Mark / ISI Mark and required cable identification.

Official source

CHUNK 22

— Aerial Bunched Cables

Product

Aerial Bunched Cable

Description

Aerial bunched cables consist of insulated conductors bundled together for overhead electrical distribution. They provide a more compact and protected arrangement compared with conventional bare overhead conductors.

Applicable IS

IS 14255:1995

Standard

Aerial Bunched Cables — For Working Voltages up to and Including 1100 V

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Applicable cable QCO framework.

2026 Status

□ Current BIS Scheme-I listing.

Product Manual

BIS product-specific documentation includes sampling/grouping and SIT requirements for IS 14255.

Testing

Applicable tests include:

conductor

insulation

voltage

mechanical

dimensional

ageing

electrical performance

marking.

Documents / application

Scheme-I application + applicable Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark + applicable cable identification.

Official source

BIS Product Manuals

CHUNK 23

— Elastomer-insulated Cable, 3.3–33 kV

Product

Elastomer-insulated Power Cable

Description

These cables use elastomeric insulation for medium-voltage electrical applications. They are designed to provide electrical insulation and mechanical/thermal performance within the specified voltage range.

Applicable IS

IS 9968 (Part 2):2002

Standard

Elastomer Insulated Cables — Part 2: For Working Voltages from 3.3 kV up to and Including 33 kV

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Applicable cable QCO.

2026 Status

□ Current BIS product listing.

Product Manual / SIT

Applicable BIS product-specific documentation governs:

sampling

testing

inspection

test equipment

licence scope.

Testing

Applicable testing includes:

conductor resistance

insulation

electrical strength

mechanical properties

ageing

dimensions

thermal characteristics

sheath requirements.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark.

Official source

CHUNK 24

— Solar DC Cable

Product

Solar DC Cable

Description

Solar DC cables are specifically designed to connect components in photovoltaic power systems. They are intended to withstand the electrical, environmental and operating conditions associated with solar installations.

Applicable IS

IS 17293:2020

Standard

Electric Cables for Photovoltaic Systems — Rated Voltage 1.5 kV DC

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Solar DC Cable and Fire Survival Cable (Quality Control) Order, 2023

BIS's current list associates IS 17293:2020 with this QCO.

2026 Status

☐ Current compulsory product.

Product Manual / SIT

Product-specific BIS Product Manual/SIT applies.

Testing

Applicable tests cover:

electrical characteristics

insulation

conductor

high-voltage performance

environmental/thermal ageing

mechanical characteristics

flame/fire-related properties where specified

marking.

Documents / application

Scheme-I application + product-specific Product Manual/SIT + manufacturing/testing evidence.

Marking

BIS Standard Mark / ISI Mark + applicable cable identification and photovoltaic ratings.

Official source

CHUNK 25

— Fire Survival Cable

Product

Fire Survival Cable

Description

Fire-survival cables are designed to maintain electrical circuit functionality for a specified period under defined fire conditions. They are important for systems where continued operation during a fire is necessary.

Applicable IS

IS 17505 (Part 1):2021

Standard

Electric Cables — Fire Resistant/Fire Survival requirements — Part 1

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Solar DC Cable and Fire Survival Cable QCO, 2023.

2026 Status

□ Current compulsory BIS product.

Product Manual / SIT

Product-specific Product Manual/SIT applies.

Testing

Testing focuses particularly on:

fire-survival performance

circuit integrity

insulation

electrical strength

conductor

mechanical characteristics

ageing

marking.

Documents / application

Scheme-I application + manufacturing/QC/testing capability + product-specific Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark and required cable/fire-survival identification.

Official source

CHUNK 26

— Boxes & Enclosures for Electrical Accessories

Product

Boxes and Enclosures for Electrical Accessories

Description

These boxes and enclosures provide mechanical and environmental protection for electrical accessories and connections. They are used in fixed electrical installations to safely house or protect electrical components.

Applicable IS

IS 14772:2020

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Accessories (Quality Control) Order, 2023

2026 status

☐ Current.

⚠ BIS records a 2026 amendment — S.O. 187(E), 13 January 2026 to the Electrical Accessories QCO.

Product Manual / SIT

Applicable BIS Product Manual/SIT establishes the specific sampling, testing and inspection requirements.

Testing

Applicable requirements include:

construction

mechanical strength

protection

electrical safety

heat/fire resistance where applicable

dimensions

marking.

Documents / application

Scheme-I application + product-specific Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark.

Official source

CHUNK 27

— Cable Trunking & Ducting Systems

Product

Cable Trunking and Cable Ducting Systems

Description

Cable trunking and ducting provide protected pathways for electrical cables. They help organize wiring and protect cables from mechanical/environmental damage in fixed installations.

Applicable IS

IS 14927 (Part 2):2001

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Accessories QCO, 2023 + applicable amendments.

2026 Status

☐ Current BIS-listed product.

Product Manual / SIT

Applicable Product Manual/SIT determines sampling and conformity requirements.

Testing

Applicable testing addresses:

mechanical strength

impact

heat

electrical safety where applicable

dimensions

construction

fire-related characteristics

marking.

Documents / application

Scheme-I application + applicable Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark.

Official source

CHUNK 28

— Bayonet Lamp Holders

Product

Bayonet Lamp Holders

Description

Bayonet lamp holders provide the mechanical mounting and electrical connection for compatible bayonet-base lamps. They are used in household and similar lighting installations.

Applicable IS

IS 1258:2005

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Accessories QCO, 2023.

2026 Status

☐ Current BIS compulsory listing.

Product Manual / SIT

Applicable Product Manual/SIT governs sampling, inspection and testing.

Testing

Applicable requirements include:

electrical contact

insulation

electric strength

mechanical strength

temperature rise

endurance

construction

heat/fire resistance.

Documents / application

Scheme-I application + product-specific Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark and applicable ratings/identification.

Official source

CHUNK 29

— Switch-Socket-Outlets

Product

Switch-Socket-Outlets

Description

Switch-socket-outlets combine switching and socket functions in an electrical accessory used in household and similar installations. They provide a controlled connection between electrical equipment and the supply.

Applicable IS

IS 15787:2008

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Accessories QCO, 2023.

2026 Status

☐ Current BIS-listed product.

Product Manual / SIT

Applicable Product Manual/SIT governs:

sampling

testing

grouping

inspection

licence scope.

Testing

Applicable testing includes:

electrical performance

temperature rise

insulation

electric strength

mechanical endurance

switching endurance

construction

resistance to heat/fire.

Documents / application

Scheme-I application + product-specific Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark + applicable ratings and identification.

Official source

CHUNK 30

— Live-working Insulating Gloves

Product

Insulating Gloves for Live Working

Description

Electrical insulating gloves are personal protective equipment used during specified live electrical work. Their primary purpose is to provide electrical insulation between the worker's hands and energized electrical equipment.

Applicable IS

IS 13774:2021

Standard

Live Working — Electrical Insulating Gloves

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Accessories QCO, 2023.

2026 Status

□ Current BIS compulsory product listing.

Product Manual / SIT

Applicable BIS Product Manual/SIT establishes the certification requirements, including sampling and testing.

Testing

The applicable standard/product documentation covers properties such as:

electrical insulation

dielectric strength

leakage/current characteristics

physical/mechanical properties

dimensions

resistance to environmental/ageing effects

marking.

Documents / application

Scheme-I application + product-specific Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark plus applicable glove class/size/identification markings required by the standard.

CHUNK 31 — Insulating Mats for Electrical Purposes

Product

Electrical Insulating Mats

Description

Electrical insulating mats are placed around electrical equipment and work areas to provide an additional layer of electrical insulation between a person and the ground. They are particularly relevant around switchboards, panels and electrical installations.

Applicable IS

IS 15652:2006

Standard title

Insulating Mats for Electrical Purposes — Specification

BIS's current Product Manual/clarification database identifies IS 15652:2006 with this title.

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

The Electrical Accessories QCO specifically includes IS 15652:2006.

QCO

Electrical Accessories (Quality Control) Order, 2023

The order makes the listed products subject to conformity with their corresponding IS and requires the Standard Mark under BIS Scheme-I.

2026 status

☐ Current BIS-listed product.

The 2026 amendment to the Electrical Accessories QCO removed IS 7809 Part 3/Sec 1, but did not remove IS 15652 from the listed electrical accessories.

Product Manual

BIS maintains product-specific documentation for IS 15652:2006.

Testing

The BIS testing records show requirements including:

physical properties

thermal properties

extreme-low-temperature performance

electrical insulation-related characteristics

dimensions/construction

marking

The exact acceptance criteria should be taken from the Product Manual/SIT.

Documents / application

Scheme-I application + manufacturing/QC information + product-specific Product Manual/SIT and testing evidence.

Marking

BIS Standard Mark / ISI Mark with the applicable product identification required by the standard.

Official sources

BIS Electrical Accessories QCO

BIS Product Manual information

BIS 2026 Electrical Accessories Amendment

CHUNK 32 — PVC Electrical Insulating Tape

Product

Pressure-sensitive PVC Electrical Insulating Tape

Description

This is a pressure-sensitive insulating tape made from plasticized PVC and used for electrical insulation and protection. It is commonly applied around electrical connections, conductors and joints where insulation/protection is required.

Applicable IS

IS 7809 (Part 3/Sec 1):1986

Standard title

Pressure Sensitive Adhesive Insulating Tapes for Electrical Purposes — Part 3:
Requirements or Individual Materials — Section 1: Plasticized Polyvinylchloride
Tapes with Non-Thermosetting Adhesive

BIS's Product Manual database identifies this exact standard and title.

⚠ 2026 status

🚫 Important — removed from the Electrical Accessories QCO

This is a major correction to our earlier list.

The Electrical Accessories (Quality Control) Amendment Order, 2026 — S.O. 187(E), dated 13 January 2026 explicitly removes IS 7809 (Part 3/Sec 1):1986 from the 2023 Electrical Accessories QCO.

Therefore:

Do NOT mark this product as currently mandatory under the Electrical Accessories QCO in your 2026 database.

Standard status

The Indian Standard itself exists, and BIS continues to maintain product/testing information for it. But:

IS exists ≠ current compulsory BIS certification under that QCO.

Product Manual

BIS has a Product Manual entry for the standard.

Testing

BIS LIMS records testing for the standard, including marking and material/property-related requirements.

Documents / application

Because the product was removed from the QCO in January 2026, we should not automatically present the Scheme-I compulsory-certification application requirements as current mandatory requirements.

Marking

Do not tell users that BIS ISI marking is currently mandatory for this product solely on the basis of the old 2023 QCO.

2026 database flag

IS_EXISTS = YES

CURRENT_QCO_MANDATORY = NO

2026_CHANGE = Removed from Electrical Accessories QCO

AMENDMENT = S.O. 187(E), 13 January 2026

Official sources

BIS — Electrical Accessories Amendment Order 2026

BIS — Product Manual information

CHUNK 33

— Poly-laminated Aluminium Cable Wrap

Product

Poly-laminated Aluminium Cable Wrap

Description

Poly-laminated aluminium cable wrap is a cable component/material used to provide a protective and functional layer around electrical cables. It forms part of cable construction rather than being an ordinary consumer electrical accessory.

Applicable IS

IS 16012:2012

Standard title

Poly-laminated Aluminium Cable Wrap

Certification

□ Mandatory BIS certification under the applicable Electrical Accessories QCO framework

The BIS Scheme-I list includes IS 16012:2012 under Electrical Accessories.

QCO

Electrical Accessories (Quality Control) Order, 2023, subject to the 2026 amendment.

2026 status

□ Still listed in the current BIS Electrical Accessories product list.

The January 2026 amendment specifically removed IS 7809 from the table; IS 16012 was not the entry removed by that amendment.

Product Manual / SIT

Applicable BIS Product Manual/SIT determines:

sampling

inspection

testing

test equipment

licence scope.

Testing

Applicable product testing addresses relevant:

material properties

dimensional requirements

mechanical characteristics

electrical/cable-related performance

environmental/ageing characteristics

marking

as specified by the applicable standard/SIT.

Documents / application

Scheme-I application + manufacturing/QC/testing information + Product Manual/SIT requirements.

Marking

BIS Standard Mark / ISI Mark under a valid BIS licence.

Official sources

BIS Scheme-I Product List

BIS Electrical Accessories QCO

CHUNK 34

— Unitary Room Air Conditioner

Product

Unitary Room Air Conditioner

Description

A unitary room air conditioner is a self-contained AC system designed to cool an indoor room/space. The BIS requirements cover construction, safety and specified performance/energy-related characteristics.

Applicable IS

IS 1391 (Part 1):2017

Standard title

Room Air Conditioners — Specification — Part 1: Unitary Air Conditioners

The official BIS/Government QCO identifies this exact standard and product.

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Air Conditioner and its Related Parts, Hermetic Compressor and Temperature Sensing Controls (Quality Control) Order, 2019

with subsequent amendments.

2026 status

☐ Current BIS compulsory product.

2026 amendment

The Government issued:

Air Conditioner and its Related Parts, Hermetic Compressor and Temperature Sensing Controls (Quality Control) Amendment Order, 2026

S.O. 2324(E), 8 May 2026.

Product Manual / testing

BIS LIMS currently shows testing against IS 1391 Part 1, including relevant construction/safety/performance testing.

Testing

Testing includes applicable:

construction

electrical safety

refrigerant circuit

cooling capacity

power consumption

ISEER/energy performance where applicable

heating performance for applicable models

sound

leakage

insulation/high-voltage safety

marking.

Components

BIS guidance says components covered by QCOs, such as applicable cables, capacitors, motors, heat exchangers and compressors, need appropriate BIS conformity.

Documents / application

Scheme-I application + manufacturing/QC/testing capability + product-specific Product Manual/SIT.

Marking

BIS Standard Mark / ISI Mark.

Official sources

BIS current Scheme-I list

2026 AC QCO Amendment

BIS Air Conditioner QCO

BIS LIMS — AC testing

CHUNK 35

— Split Room Air Conditioner

Product

Split Room Air Conditioner

Description

A split AC separates the indoor evaporator unit and outdoor condensing unit. It is one of the most common room-air-conditioning configurations and is covered by specific BIS safety and performance requirements.

Applicable IS

IS 1391 (Part 2):2018

Standard title

Room Air Conditioners — Specification — Part 2: Split Air Conditioners

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Air Conditioner and Related Parts QCO, 2019 + amendments.

2026 status

☐ Current compulsory product.

The current BIS Scheme-I page lists IS 1391 Part 2.

2026 amendment

S.O. 2324(E), 8 May 2026 amended the applicable AC QCO.

Product Manual / Testing

BIS LIMS currently lists testing for IS 1391 Part 2 including:

construction
refrigerant circuit
electrical charged parts
grounding
temperature sensing controls
hermetic compressor
motors
heat exchanger
leakage current
ISEER
cooling capacity
heating capacity
sound
marking.
Documents / application

Scheme-I application + product-specific technical/QC/testing information.

Marking

BIS Standard Mark / ISI Mark + applicable rating/energy/product information.

Official sources

BIS Scheme-I list

BIS 2026 AC QCO Amendment

BIS LIMS — IS 1391 Part 2

CHUNK 36

— Ducted & Package Air Conditioner

Product

Ducted and Package Air Conditioner

Description

These systems are designed for larger or centralized air-conditioning applications where conditioned air may be distributed through ducts. Package systems integrate major refrigeration components into a packaged arrangement.

Applicable IS

IS 8148:2018

Standard title

Ducted and Package Air Conditioners — Specification

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Air Conditioner and Related Parts QCO, 2019 + amendments.

2026 status

□ Current BIS-listed compulsory product.

2026 amendment

Applicable QCO was amended by S.O. 2324(E), 8 May 2026.

Testing

BIS laboratory records include tests such as:

construction

cooling performance

heating performance where applicable

power consumption

sound

electrical safety

leakage

capacity/performance

marking.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark.

Official sources

BIS Scheme-I list

BIS Air Conditioner QCO

BIS LIMS

CHUNK 37

— Finned-type Heat Exchanger

Product

Finned-type Heat Exchanger for Room Air Conditioners

Description

A finned heat exchanger transfers heat between the refrigerant and air in an air-conditioning system. Fins increase the effective surface area and improve heat-transfer performance.

Applicable IS

IS 11329:2018

Standard title

Finned Type Heat Exchanger for Room Air Conditioner

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Air Conditioner and Related Parts QCO, 2019 + amendments.

2026 status

☐ Current compulsory product.

BIS's official major-consumer-product list includes this product and standard.

Testing

Applicable conformity testing addresses:

construction

dimensions

material

pressure/leakage

heat-transfer related requirements

mechanical integrity

applicable performance requirements.

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark.

Important AC-system requirement

BIS's AC certification guidance explicitly identifies IS 11329 heat exchangers as a component requiring conformity where applicable.

Official sources

BIS Major Consumer Products list

BIS AC certification guidance

CHUNK 38

— Hermetic Compressor

Product

Hermetic Compressor for Air-conditioning/Refrigeration

Description

A hermetic compressor houses the compressor mechanism and motor in a sealed enclosure. It compresses refrigerant and is a fundamental component of many refrigeration and air-conditioning systems.

Applicable IS

IS 10617:2018

Standard title

Hermetic Compressors — Specification

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Air Conditioner and Related Parts, Hermetic Compressor and Temperature Sensing Controls QCO, 2019 + amendments.

2026 status

☐ Current BIS-listed product.

The current BIS Scheme-I list includes IS 10617:2018.

2026 amendment

The applicable QCO was amended through S.O. 2324(E), 8 May 2026.

Testing

Applicable compressor conformity testing covers relevant:

electrical safety

pressure/refrigerant-related performance

insulation

leakage

endurance

operating performance

construction

marking.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark.

Important note

BIS specifically requires applicable hermetic compressors used in AC certification to conform to IS 10617.

Official sources

BIS Scheme-I list

BIS AC certification guidance

2026 AC QCO Amendment

CHUNK 39

— Plugs & Socket-Outlets

Product

Plugs and Socket-Outlets

Description

Plugs and socket-outlets provide detachable electrical connections between appliances and the electrical supply. They are among the most common household electrical accessories.

 Current IS

IS 1293:2019

This is the Fourth Revision according to BIS's Product Manual listing.

Standard title

Plugs and Socket-Outlets for Household and Similar Purposes of Rated Voltage up to and Including 250 V and Rated Current up to and Including 16 A — Specification

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Plugs and Socket-Outlets and AC Direct Connected Static Prepayment Meters for Active Energy QCO, with the 2019/2020 orders superseded by the 2021 QCO framework.

The current BIS Scheme-I page records this QCO history.

2026 status

□ Current compulsory product.

Testing

BIS LIMS currently records testing for IS 1293:2019, including:

ratings

classification

marking

dimensions

electrical characteristics

insulation

electric strength

mechanical requirements

heat/fire resistance.

Product Manual

BIS Product Manual information identifies IS 1293:2019.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing capability.

Marking

BIS Standard Mark / ISI Mark + applicable voltage/current/type identification.

Official sources

BIS Product Manual — IS 1293:2019

BIS Scheme-I list

BIS LIMS — IS 1293:2019

CHUNK 40

— AC Direct-connected Static Prepayment Meter

Product

Alternating Current Direct Connected Static Prepayment Meter for Active Energy

Description

A prepayment electricity meter measures energy consumption while incorporating a payment/credit mechanism. Consumers can use electricity against available prepaid credit, with the meter managing the supply according to the applicable payment and load-switching functions.

Applicable IS

IS 15884:2010

Standard title

Alternating Current Direct Connected Static Prepayment Meters for Active Energy —
Class 1 and 2

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Plugs and Socket-Outlets and AC Direct Connected Static Prepayment Meters for
Active Energy QCO framework.

BIS's current Scheme-I list explicitly associates IS 15884:2010 with this product
family.

2026 status

☐ Current BIS compulsory product.

Product Manual / Testing

BIS LIMS currently lists multiple laboratories with IS 15884:2010 testing capability.

Testing includes:

accuracy
electrical characteristics
insulation
impulse voltage
electromagnetic compatibility
environmental tests
load-switch operation
charging functions
consumption-based charging
time-based charging
emergency-credit functions where applicable
load-switch capability
mechanical requirements
functional requirements
marking.

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing/QC/testing information.

Marking

BIS Standard Mark / ISI Mark + meter ratings, identification and applicable connection/terminal information.

Official sources

BIS Scheme-I list

CHUNK 41

— Stationary Storage-type Electric Water Heater
Product

Stationary Storage-type Electric Water Heater

Description

A stationary storage water heater heats water electrically and stores it inside an insulated tank for later use. It is commonly used for domestic hot-water supply.

 Current IS

IS 302 (Part 2/Sec 21):2024 / IEC 60335-2-21:2022

This is a major correction from our earlier entry.

BIS's current Product Manual listing identifies the 2024 edition as the Third Revision.

Standard title

Household and Similar Electrical Appliances — Safety — Part 2: Particular Requirements — Section 21: Stationary Storage Type Electric Water Heaters

Certification

☐ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Appliances for Domestic Water Heating (Quality Control) Order, 2023, with applicable amendments/transition provisions.

2026 status

□ IS 302 Part 2/Sec 21:2024 is the current revision.

BIS LIMS shows testing facilities for the 2024 edition with entries becoming effective during 2025 and 2026. One current laboratory record specifically shows inclusion from 11 August 2026.

Testing

BIS LIMS lists tests including:

general requirements

classification

marking/instructions

protection against access to live parts

power input/current

heating

leakage current

electric strength

moisture resistance

endurance

abnormal operation
mechanical strength
construction
internal wiring
supply connections
earthing
screws/connections
clearances/creepage/solid insulation
resistance to heat and fire
resistance to rusting.

Product Manual

BIS has a current Product Manual entry for IS 302 Part 2/Sec 21:2024.

Documents / application

Scheme-I application + current Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark and applicable water-heater ratings/instructions.

Official sources

BIS Product Manual — IS 302 Part 2/Sec 21:2024

BIS LIMS — Storage Water Heater testing

BIS Scheme-I list

CHUNK 42

— Instantaneous Electric Water Heater

Product

Electric Instantaneous Water Heater

Description

An instantaneous water heater heats water as it passes through the appliance rather than storing a large volume of hot water. Because water and electricity operate within the same appliance, electrical insulation, leakage and thermal safety are critical.

Applicable IS

IS 302 (Part 2/Sec 35):2017

Standard title

Safety of Household and Similar Electrical Appliances — Part 2: Particular Requirements — Section 35: Electric Instantaneous Water Heaters

Certification

□ Mandatory BIS certification

Scheme: Scheme-I / ISI Mark.

QCO

Electrical Appliances for Domestic Water Heating QCO framework.

2026 status

□ Current BIS-listed standard/product.

BIS LIMS currently has laboratories testing against IS 302 Part 2/Sec 35:2017.

Testing

Current BIS LIMS records tests including:

classification

marking/instructions

protection against access to live parts

power input/current

heating

leakage current

electric strength

moisture resistance

endurance

abnormal operation

stability/mechanical hazards

mechanical strength

construction

internal wiring

terminals

earthing

clearances/creepage

heat/fire resistance

rusting

radiation/toxicity where applicable.

Product Manual / SIT

Applicable BIS Product Manual/SIT governs sampling, testing and certification.

Documents / application

Scheme-I application + Product Manual/SIT + manufacturing/QC/testing evidence.

Marking

BIS Standard Mark / ISI Mark + applicable ratings and instructions.

Official sources

BIS LIMS — IS 302 Part 2/Sec 35

BIS Scheme-I list

CHUNK 43

— General Safety Standard for Household, Commercial & Similar Electrical Appliances

Product

General Electrical Appliance Safety — IS 302 Part 1

Important

This one is not really a single physical product like an electric iron or AC.

It is the general safety standard forming the foundation for a huge family of electrical appliances.

Description

IS 302 Part 1 establishes general safety requirements for household, commercial and similar electrical appliances. Product-specific Part 2 standards add requirements for particular appliance types.

Applicable IS

IS 302 (Part 1):2024 / IEC 60335-1:2020

Standard title

Household and Similar Electrical Appliances — Safety — Part 1: General Requirements

Seventh Revision.

Certification

☐ Mandatory for products brought within the applicable QCO scope

Scheme: Scheme-I / ISI Mark.

QCO

This is where the 2026 development becomes extremely important.

BIS currently lists:

Safety of Household, Commercial and Similar Electrical Appliances (Quality Control) Order, 2024

S.O. 4098(E), 20 September 2024

plus:

2025 QCO — S.O. 2232(E), 19 May 2025

2026 QCO — S.O. 1739(E), 6 April 2026

Transition Facilitation QCO — S.O. 3417(E), 25 June 2026

2026 status

□ Extremely important/current regulatory area.

The current BIS list covers a large range of appliance families, including:

vacuum cleaners

water suction cleaning appliances

spin extractors

cooking ranges

hobs

ovens

hair clippers
tumble dryers
warming plates
frying pans
deep-fat fryers
liquid-heating appliances
steam cookers
insect killers
coffee makers
food processors
grain grinders
dishwashers
food-waste disposers
heating appliances
commercial kitchen equipment
air-cleaning appliances
humidifiers
vaporizers
beauty-care appliances
battery-operated appliances
personal e-transporters
electrically motorized furniture
commercial vacuum packaging appliances
and many other appliance families.

Product-specific standard relationship

This is critical for our database:

Electric Iron

↓

IS 302 Part 1:2024

+

IS 302 Part 2/Sec 3:2024

Water Heater

↓

IS 302 Part 1:2024

+

IS 302 Part 2/Sec 21:2024

So Part 1 should not replace the relevant Part 2 standard.

Testing

BIS LIMS currently shows extensive testing against IS 302 Part 1:2024, including:

classification

general requirements

marking/instructions

protection against live parts

heating

power input/current

moisture resistance

leakage current/electric strength

transient overvoltage

abnormal operation

endurance

mechanical strength

construction
internal wiring
external cords
terminals
earthing
screws/connections
clearances/creepage/solid insulation
heat/fire
rusting
radiation/toxicity
applicable EMC testing.

Product Manual

BIS's Product Manual system contains product-specific manuals and implementation guidance for the relevant appliance standards.

Documents / application

Scheme-I application + applicable Product Manual/SIT + manufacturing/QC/testing capability.

Marking

BIS Standard Mark / ISI Mark and all applicable appliance-specific markings/instructions.


2026 database rule

Do not create one "IS 302 Part 1 product" record and stop there.

Instead:

STANDARD

IS 302 Part 1:2024

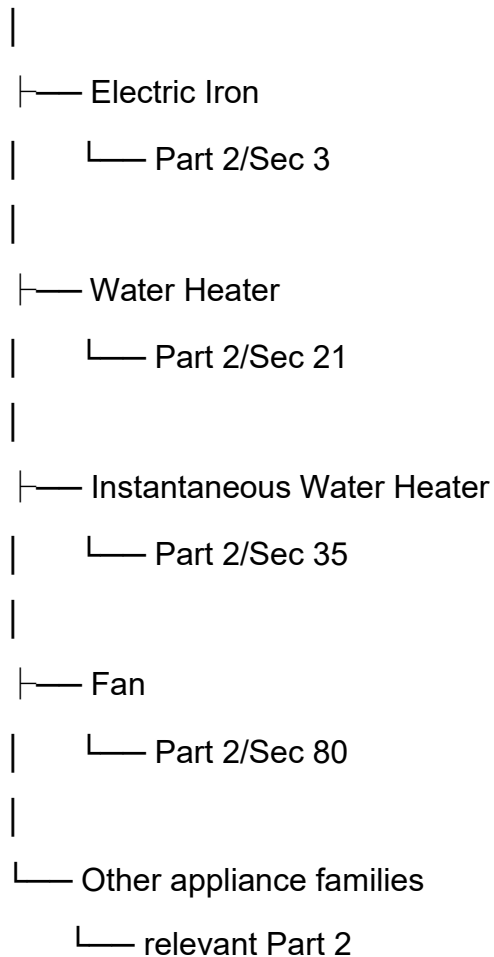

That relationship will be very important for your AI assistant.

Official sources

BIS current Scheme-I Electrical Appliances list

BIS LIMS — IS 302 Part 1:2024

BIS Product Manual information

