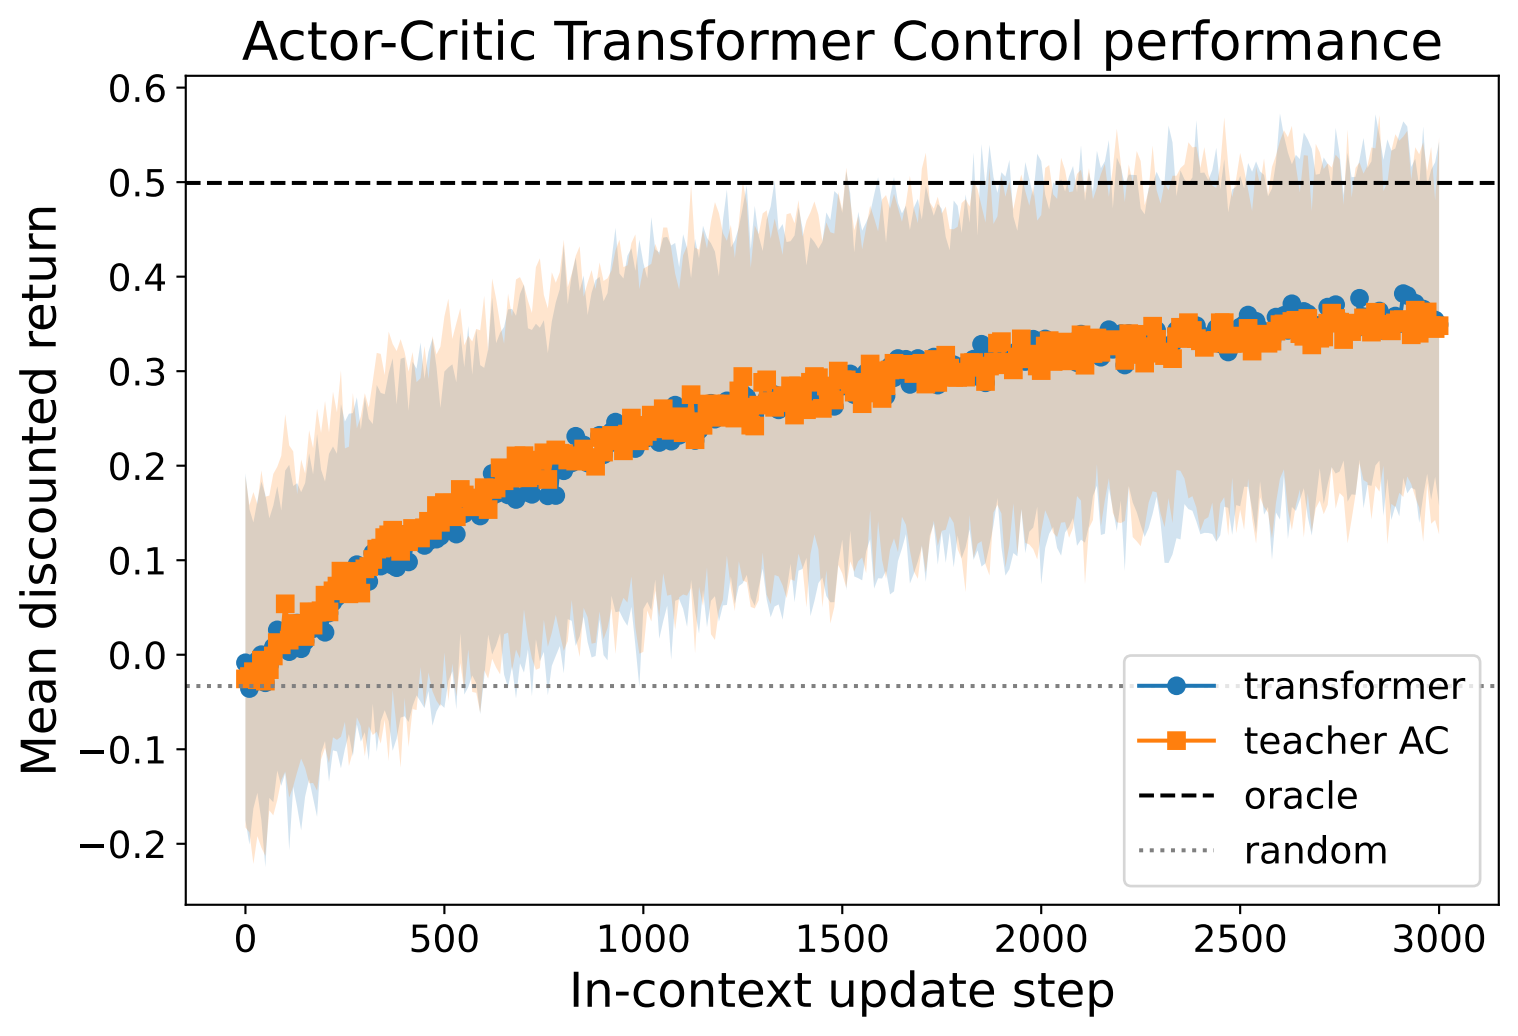
Actor-Critic Transformer Control performance
Mean discounted return
0.6
0.5
0.4
0.3
0.2
0.1
0.0
−0.1
−0.2
0
500
1000
1500
2000
2500
3000
In-context update step
transformer
teacher AC
oracle
random