

ENGINEERING PROJECT — C2

CONTRACT DOCUMENT

Generated at runtime: 2026-06-15 13:17:43 UTC

CONTRACT NUMBER: VG-000000-INF-SPC-VGL-00003

DOCUMENT TITLE: Instrumentation Design Basis Specification

REVISION NUMBER: Rev A

ISSUE PURPOSE: IFR — Issued for Review

SECURITY CLASSIFICATION: Company Use

DOCUMENT TYPE: SPC — Specification


DISCIPLINE CODE: INF — Instrumentation

DOCUMENT DATE: 15 June 2026

FROM ORGANISATION: VGL — Venture Global LNG

TO ORGANISATION: PRJ — Project Owner

PROJECT: Engineering Project — C2 EPC-BOP

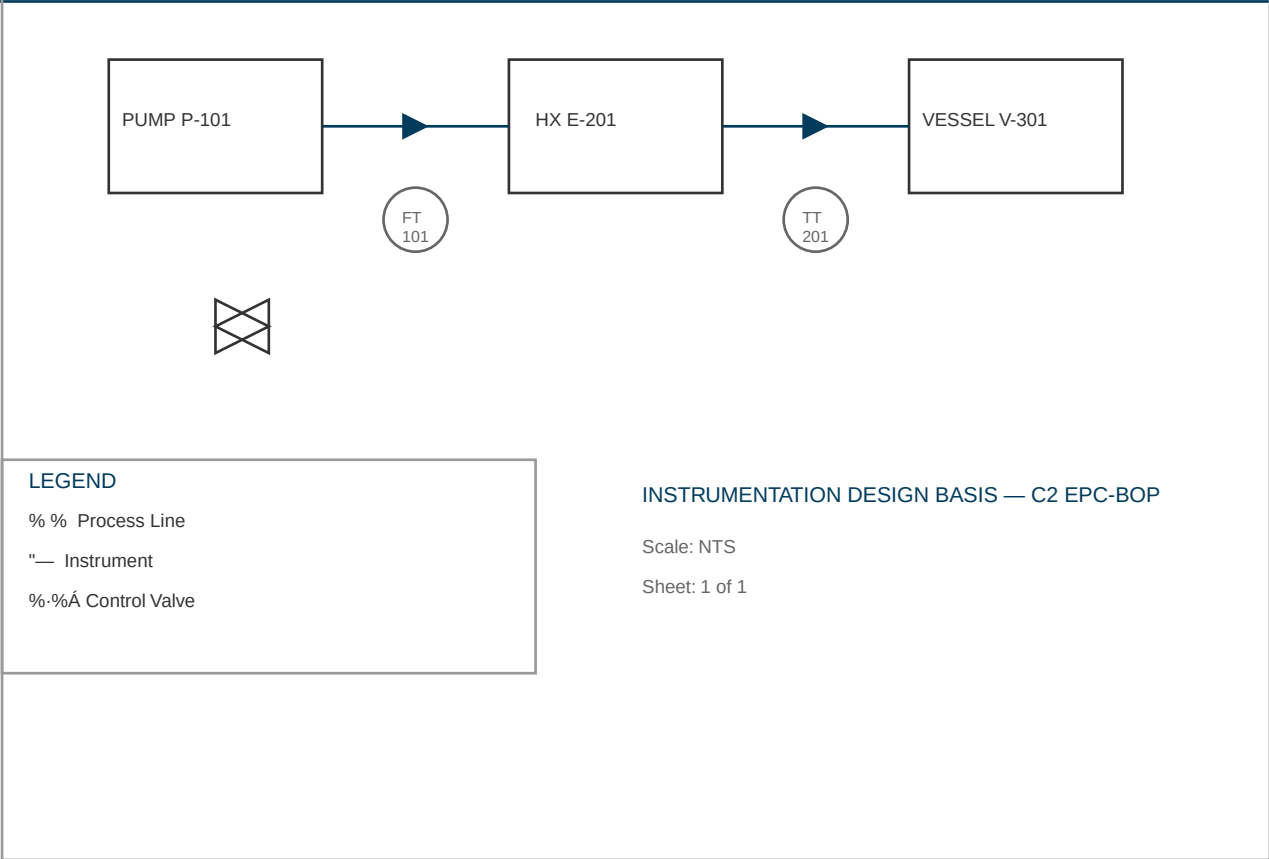

ENGINEERING PROJECT — C2

DOCUMENT CONTROL INFORMATION

SECOND COVER PAGE — DOCUMENT CONTROL INFORMATION

SDx Project Area: C2
Contract Reference: C2 EPC-BOP
Transmittal Reference: TRN-C2-VGL-2026-0003
Previous Revision: — (First Issue)
Page Count: 4 pages
Language: English
File Name: VG-000000-INF-SPC-VGL-00003_RevA.pdf

APPROVAL SIGNATURES

Prepared by: S. Jones Date: 15-Jun-2026
Reviewed by: R. Patel Date: 15-Jun-2026
Approved by: M. Brennan Date: 15-Jun-2026

REVISION HISTORY

Rev	Date	Description	Author
% % %	% % % % %	% % % % %	% % % % %
A	15-Jun-2026	First Issue – Issued for Review	S. Jones

1. SCOPE

This specification defines the instrumentation design basis applicable to all process units within the C2 EPC-BOP scope of the Engineering Project facility. All instrumentation and control systems shall be designed, procured, and installed in accordance with this document.

2. REFERENCES

- ISA 5.1 — Instrumentation Symbols and Identification
- IEC 61511 — Functional Safety, Safety Instrumented Systems
- IEC 61508 — Functional Safety of E/E/PE Systems
- Project Specification VGL-INF-STD-001
- Process Hazard Analysis Report VGL-HSE-HAZ-0001

3. DESIGN BASIS

All SIL-rated loops shall be designed and verified per IEC 61511. Safety Integrity Level targets per the SIL determination study. DCS shall be Emerson DeltaV. SIS shall be Triconex Tricon CX. Field instrumentation to be NAMUR compliant.

4. ACCEPTANCE CRITERIA

Loop accuracy: $\pm 0.5\%$ of span for process measurements. Control valve seat leakage: Class IV per ANSI/FCI 70-2. Pressure transmitters: HART 7 protocol, 4-20mA output.
