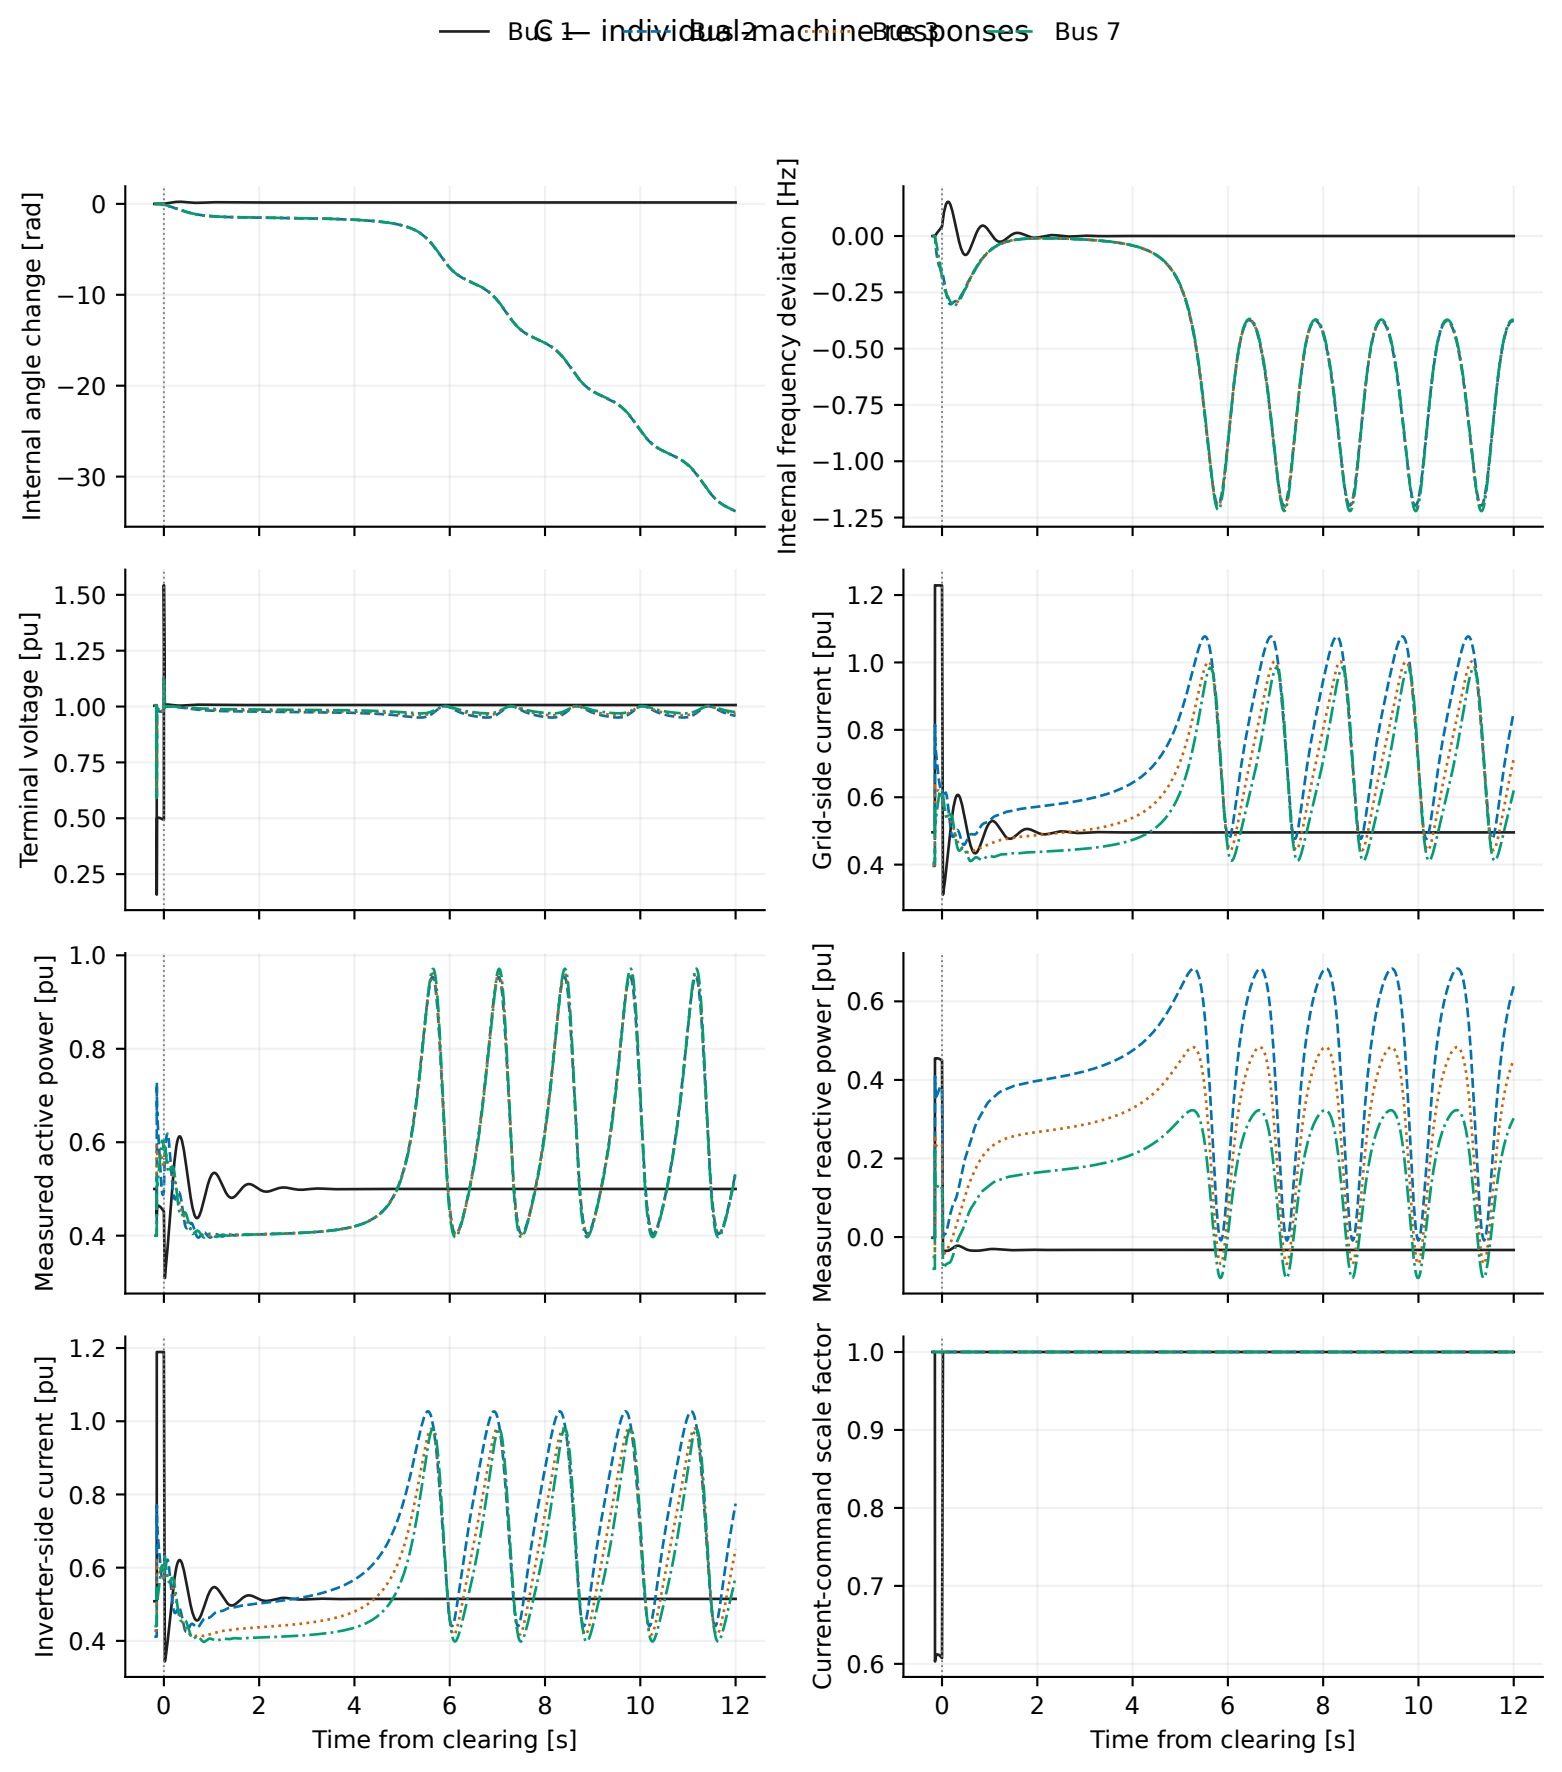
G 1 — individual machine responses
Bus 1
Bus 2
Bus 3
Bus 7
Internal angle change [rad]
Internal frequency deviation [Hz]
Terminal voltage [pu]
Grid-side current [pu]
Measured active power [pu]
Measured reactive power [pu]
Inverter-side current [pu]
Current-command scale factor
Time from clearing [s]
Time from clearing [s]