A post 0s

Saved dynamic state, t = 1.15 s | Droop: tau_p=0.02 s, mp=5% | Bus6 = 1 pu ∠0°

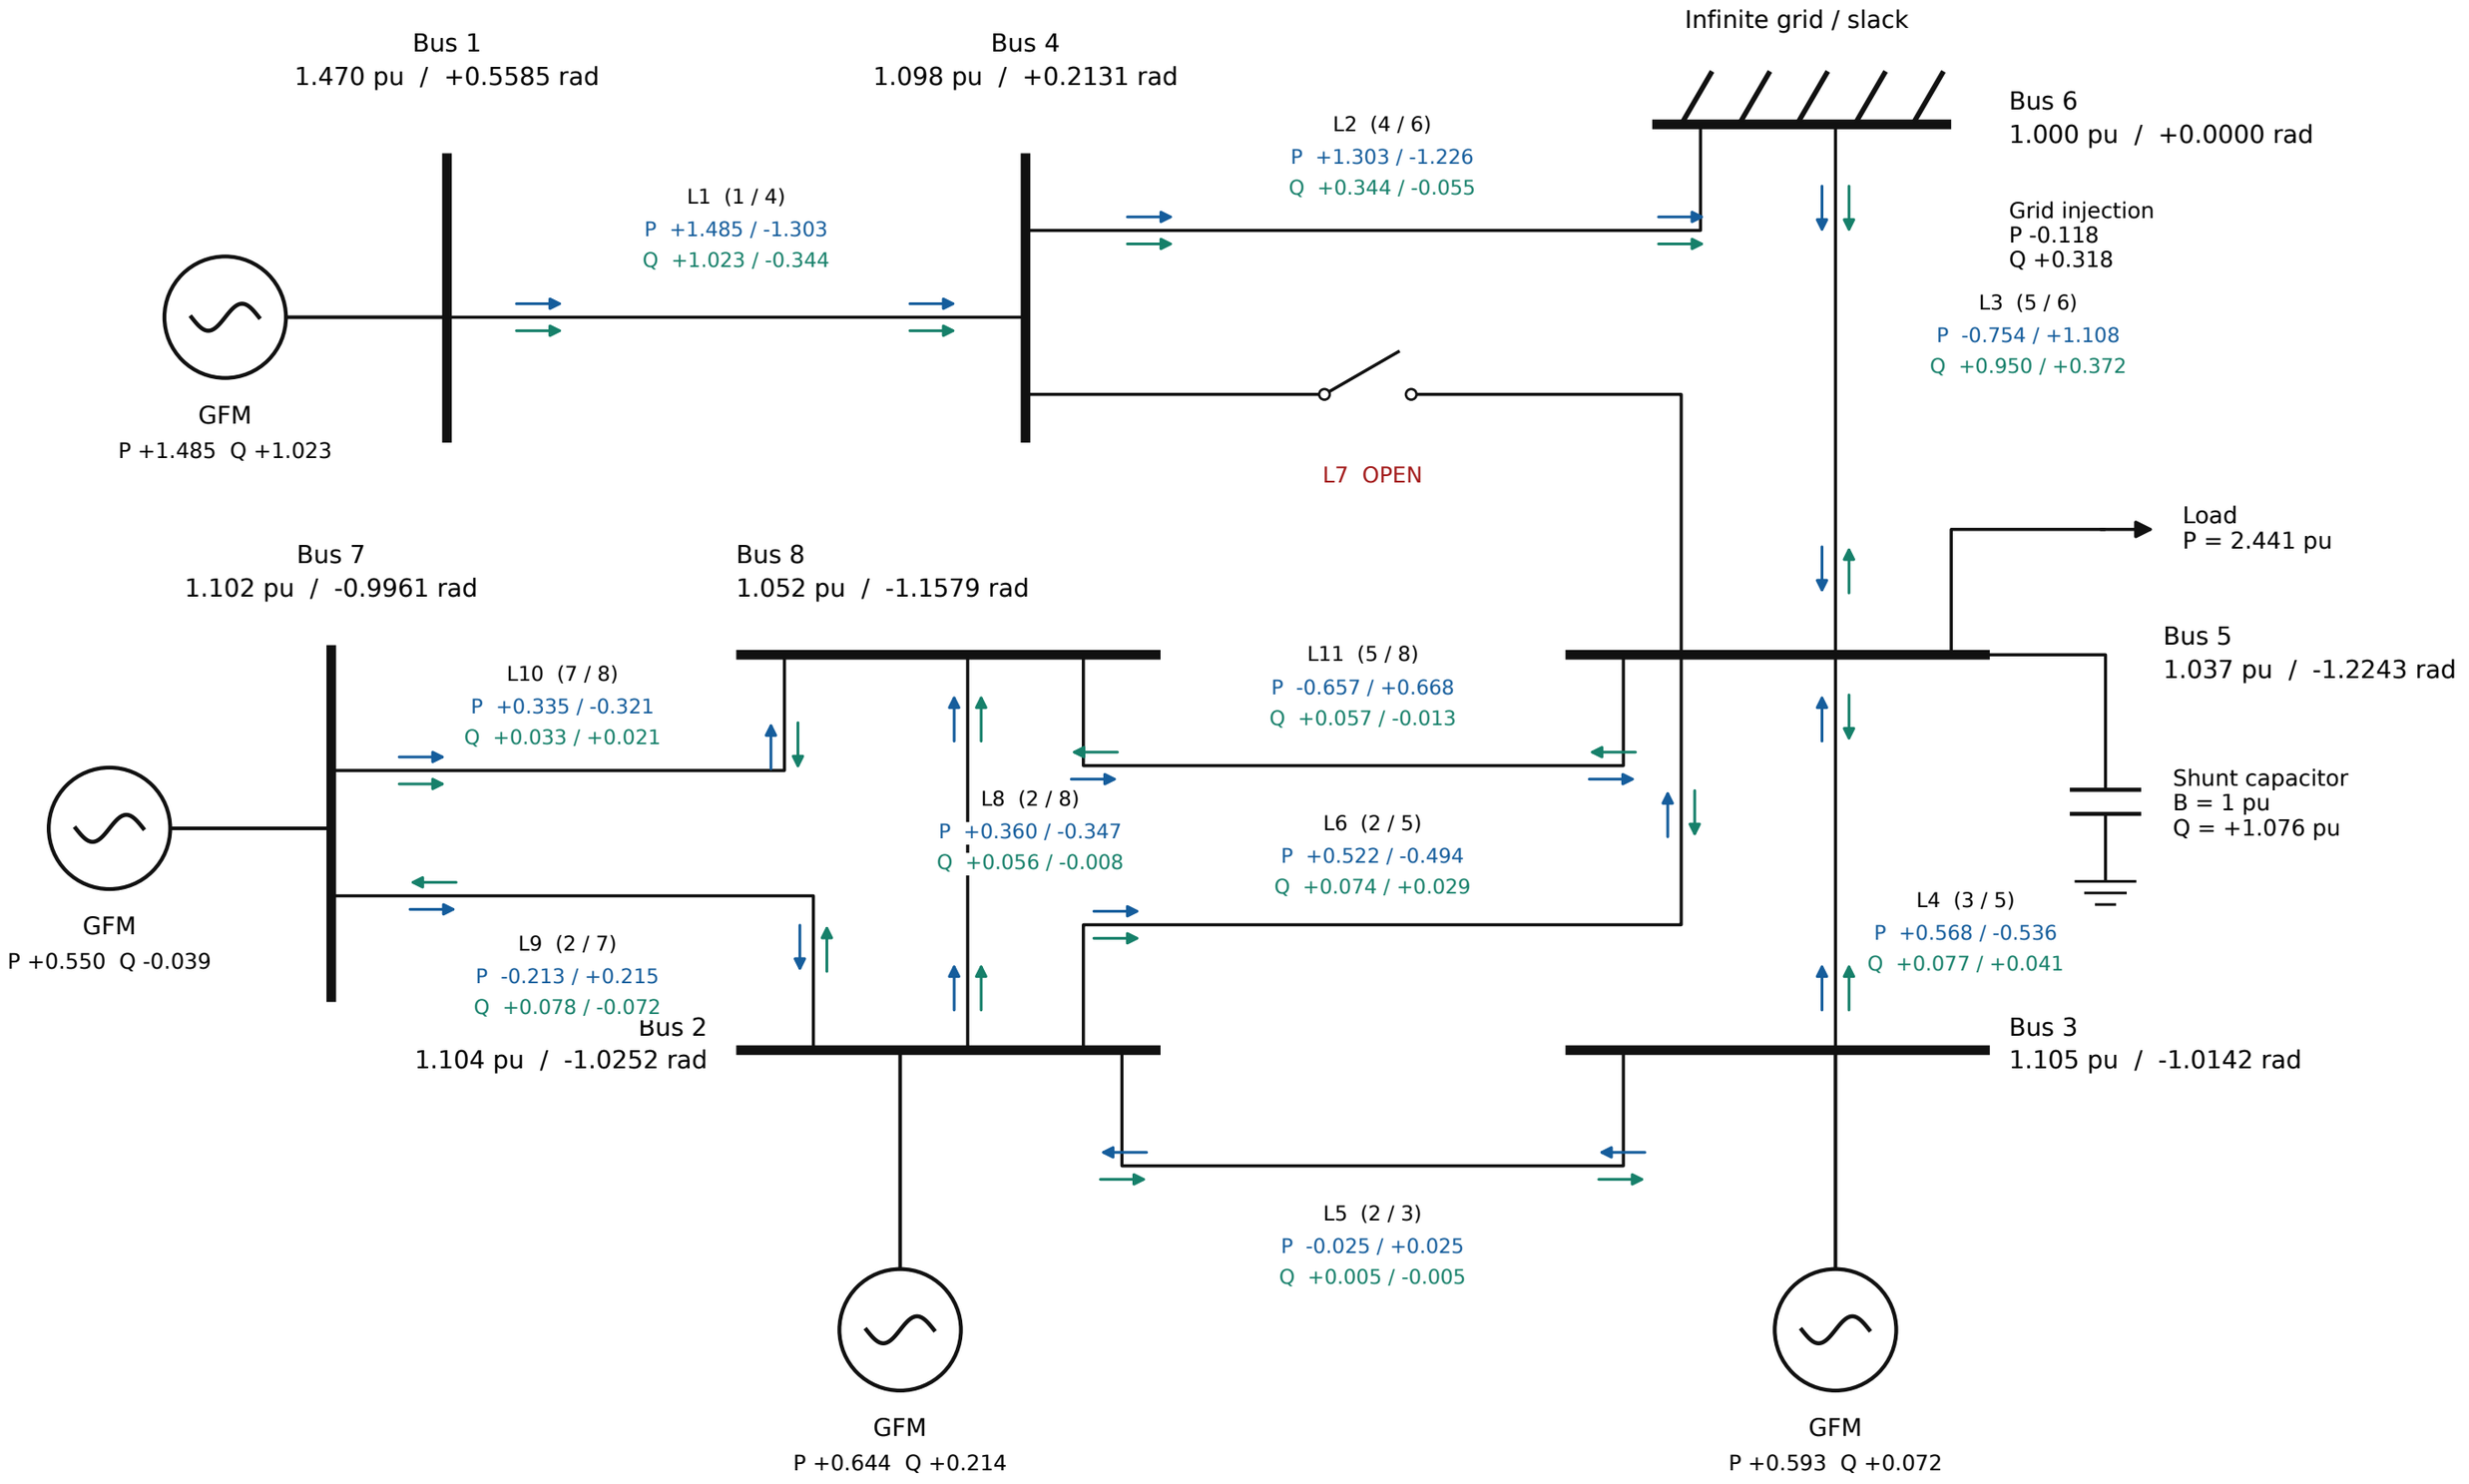

P: blue arrows Q: green arrows Line labels (a / b): signed power from each bus into the line [pu].

Two positive terminal Q values mean reactive absorption along the line. Device P/Q: positive injection into the network.

GFM 3.272 + grid -0.118 = load 2.441 + fault 0.000 + line losses 0.714 pu