Case C: 1.00 s after fault clearing

Saved dynamic state, t = 2.15 s | VSM: H=2.5 s, mp=5%, D1=0, D2=100 | Bus6 = 1 pu ∠0°

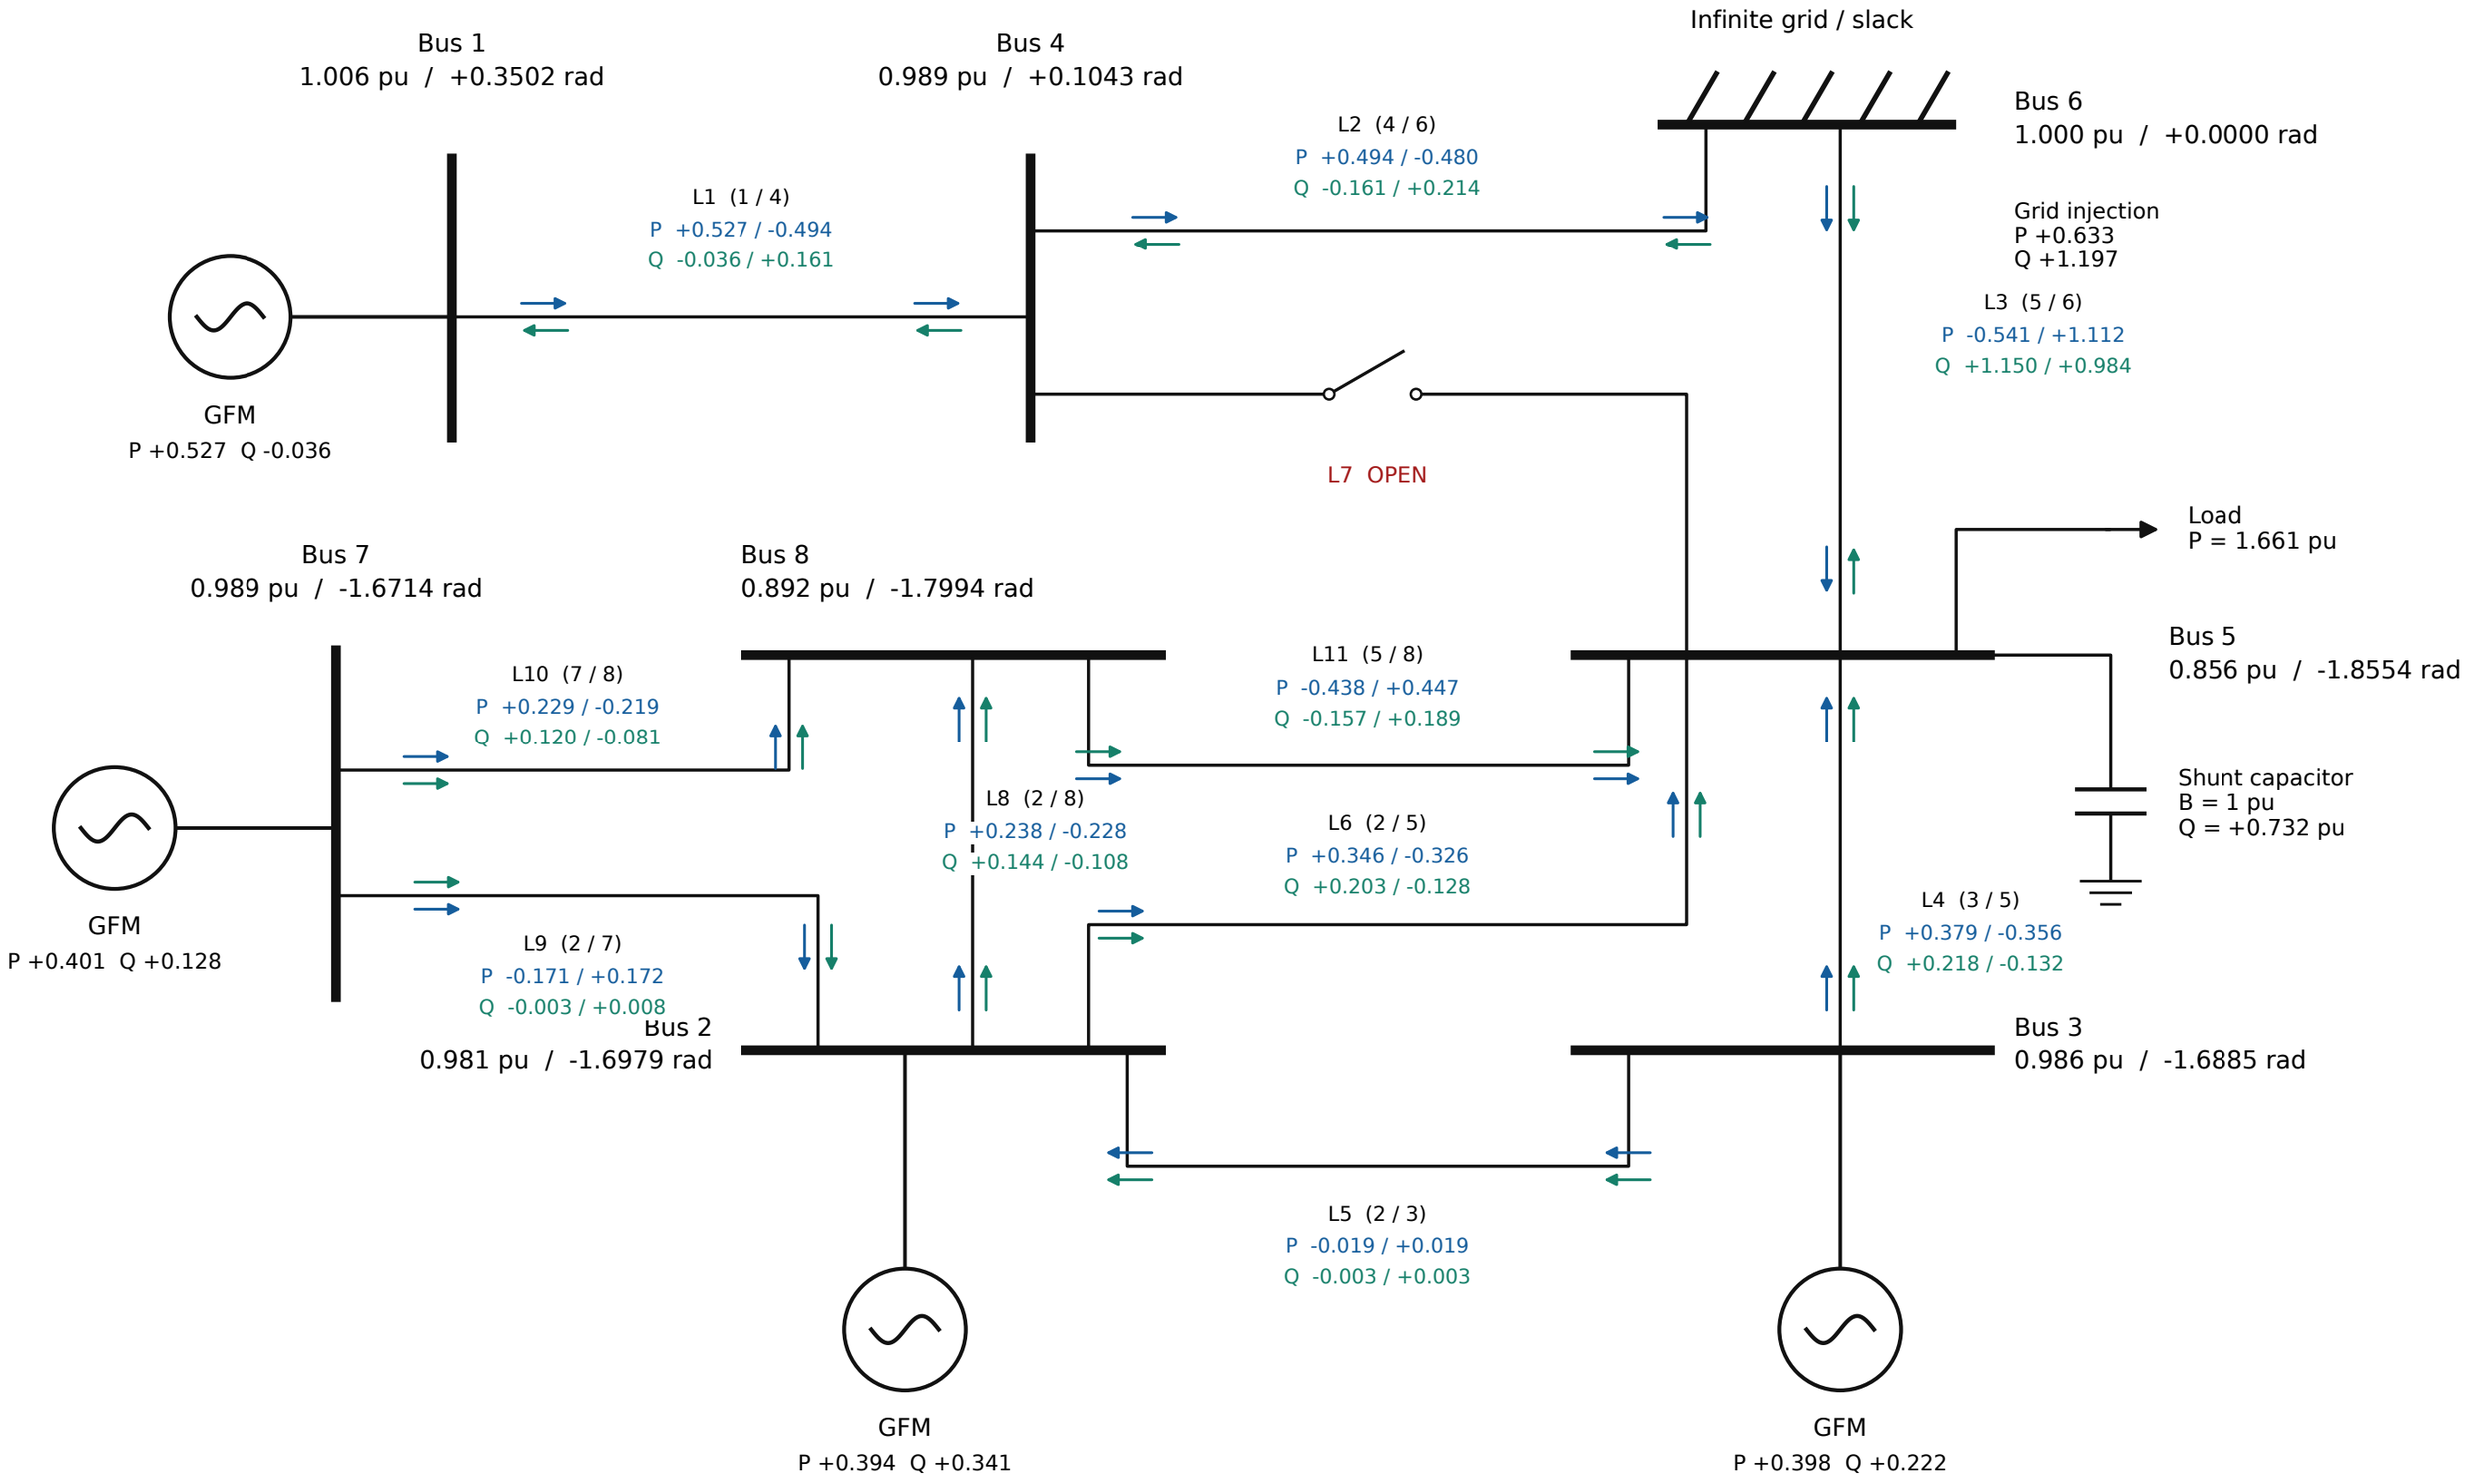

P: blue arrows Q: green arrows Line labels (a / b): signed power from each bus into the line [pu].

Two positive terminal Q values mean reactive absorption along the line. Device P/Q: positive injection into the network.

GFM 1.720 + grid +0.633 = load 1.661 + fault 0.000 + line losses 0.692 pu