Case C: pre-fault equilibrium (t = 0.00 s)

Equilibrium | VSM: H=2.5 s, mp=5%, D1=0, D2=100 | Bus6 = 1 pu ∠0°

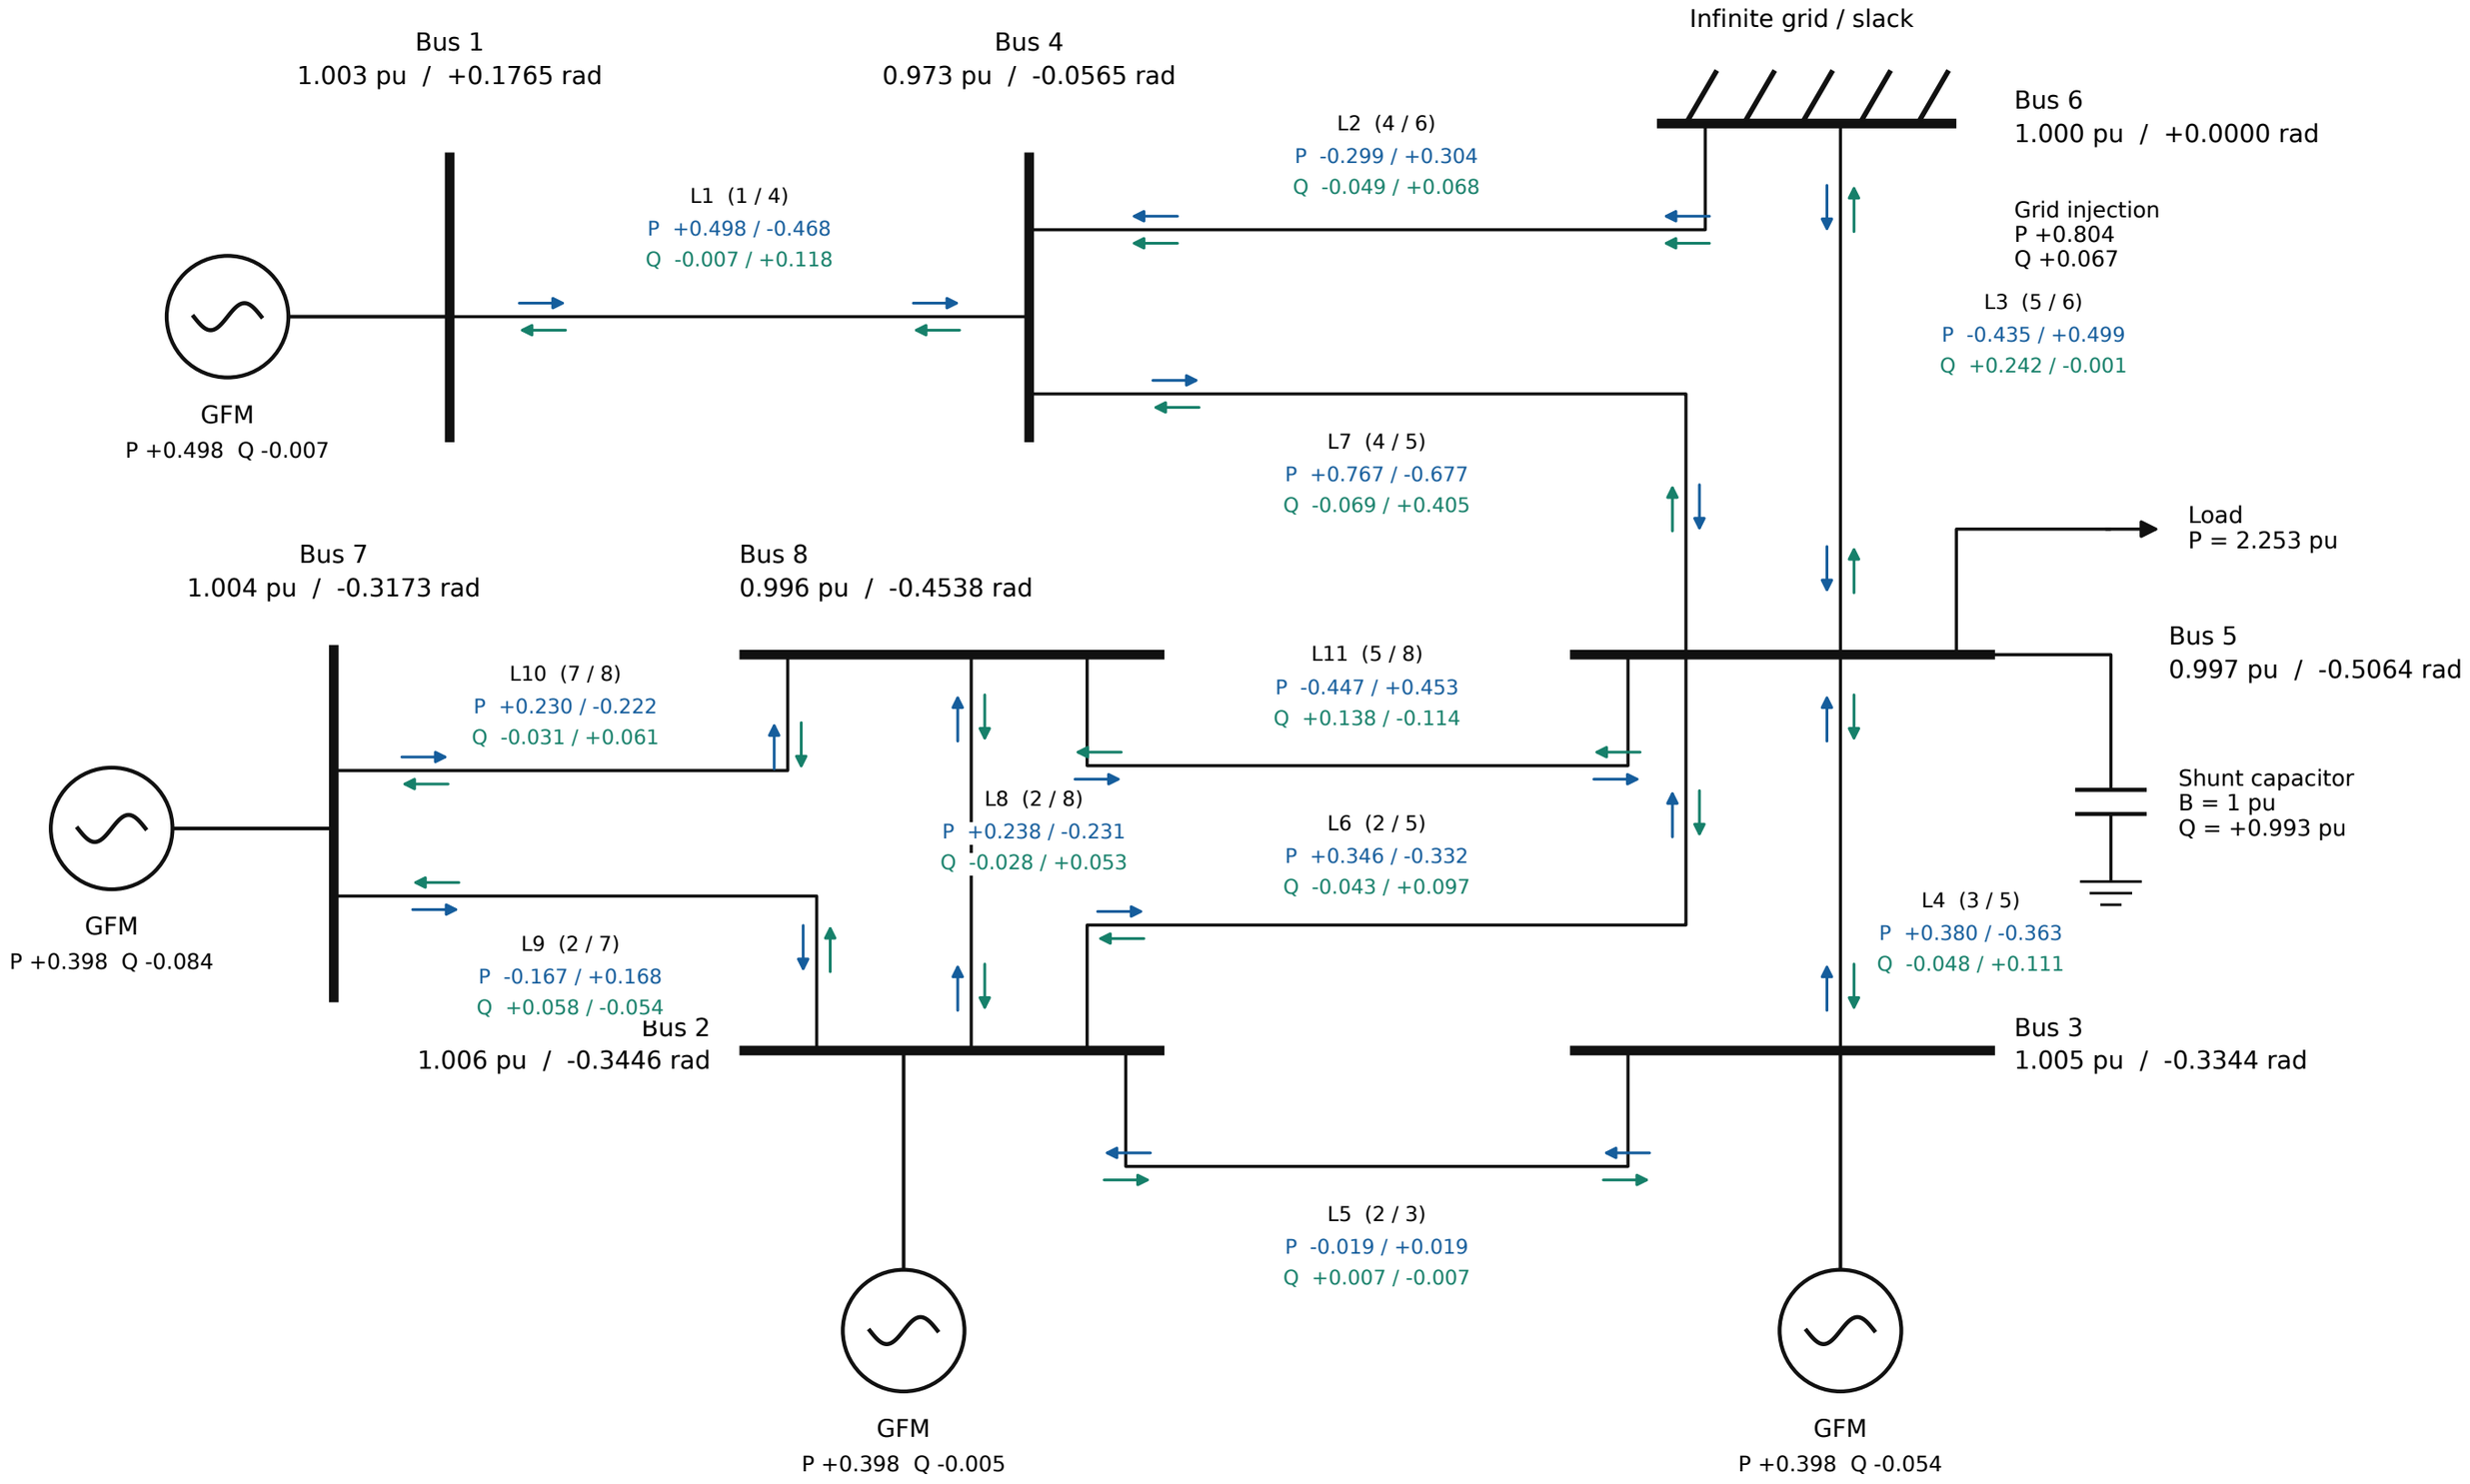

P: blue arrows Q: green arrows Line labels (a / b): signed power from each bus into the line [pu].

Two positive terminal Q values mean reactive absorption along the line. Device P/Q: positive injection into the network.

GFM 1.693 + grid +0.804 = load 2.253 + fault 0.000 + line losses 0.244 pu