D1 10 post t5

Saved dynamic state, t = 6.15 s | H = 2.5 s, D₁ = 10, D₂ = 100 | Bus6 = 1 pu ∠0°

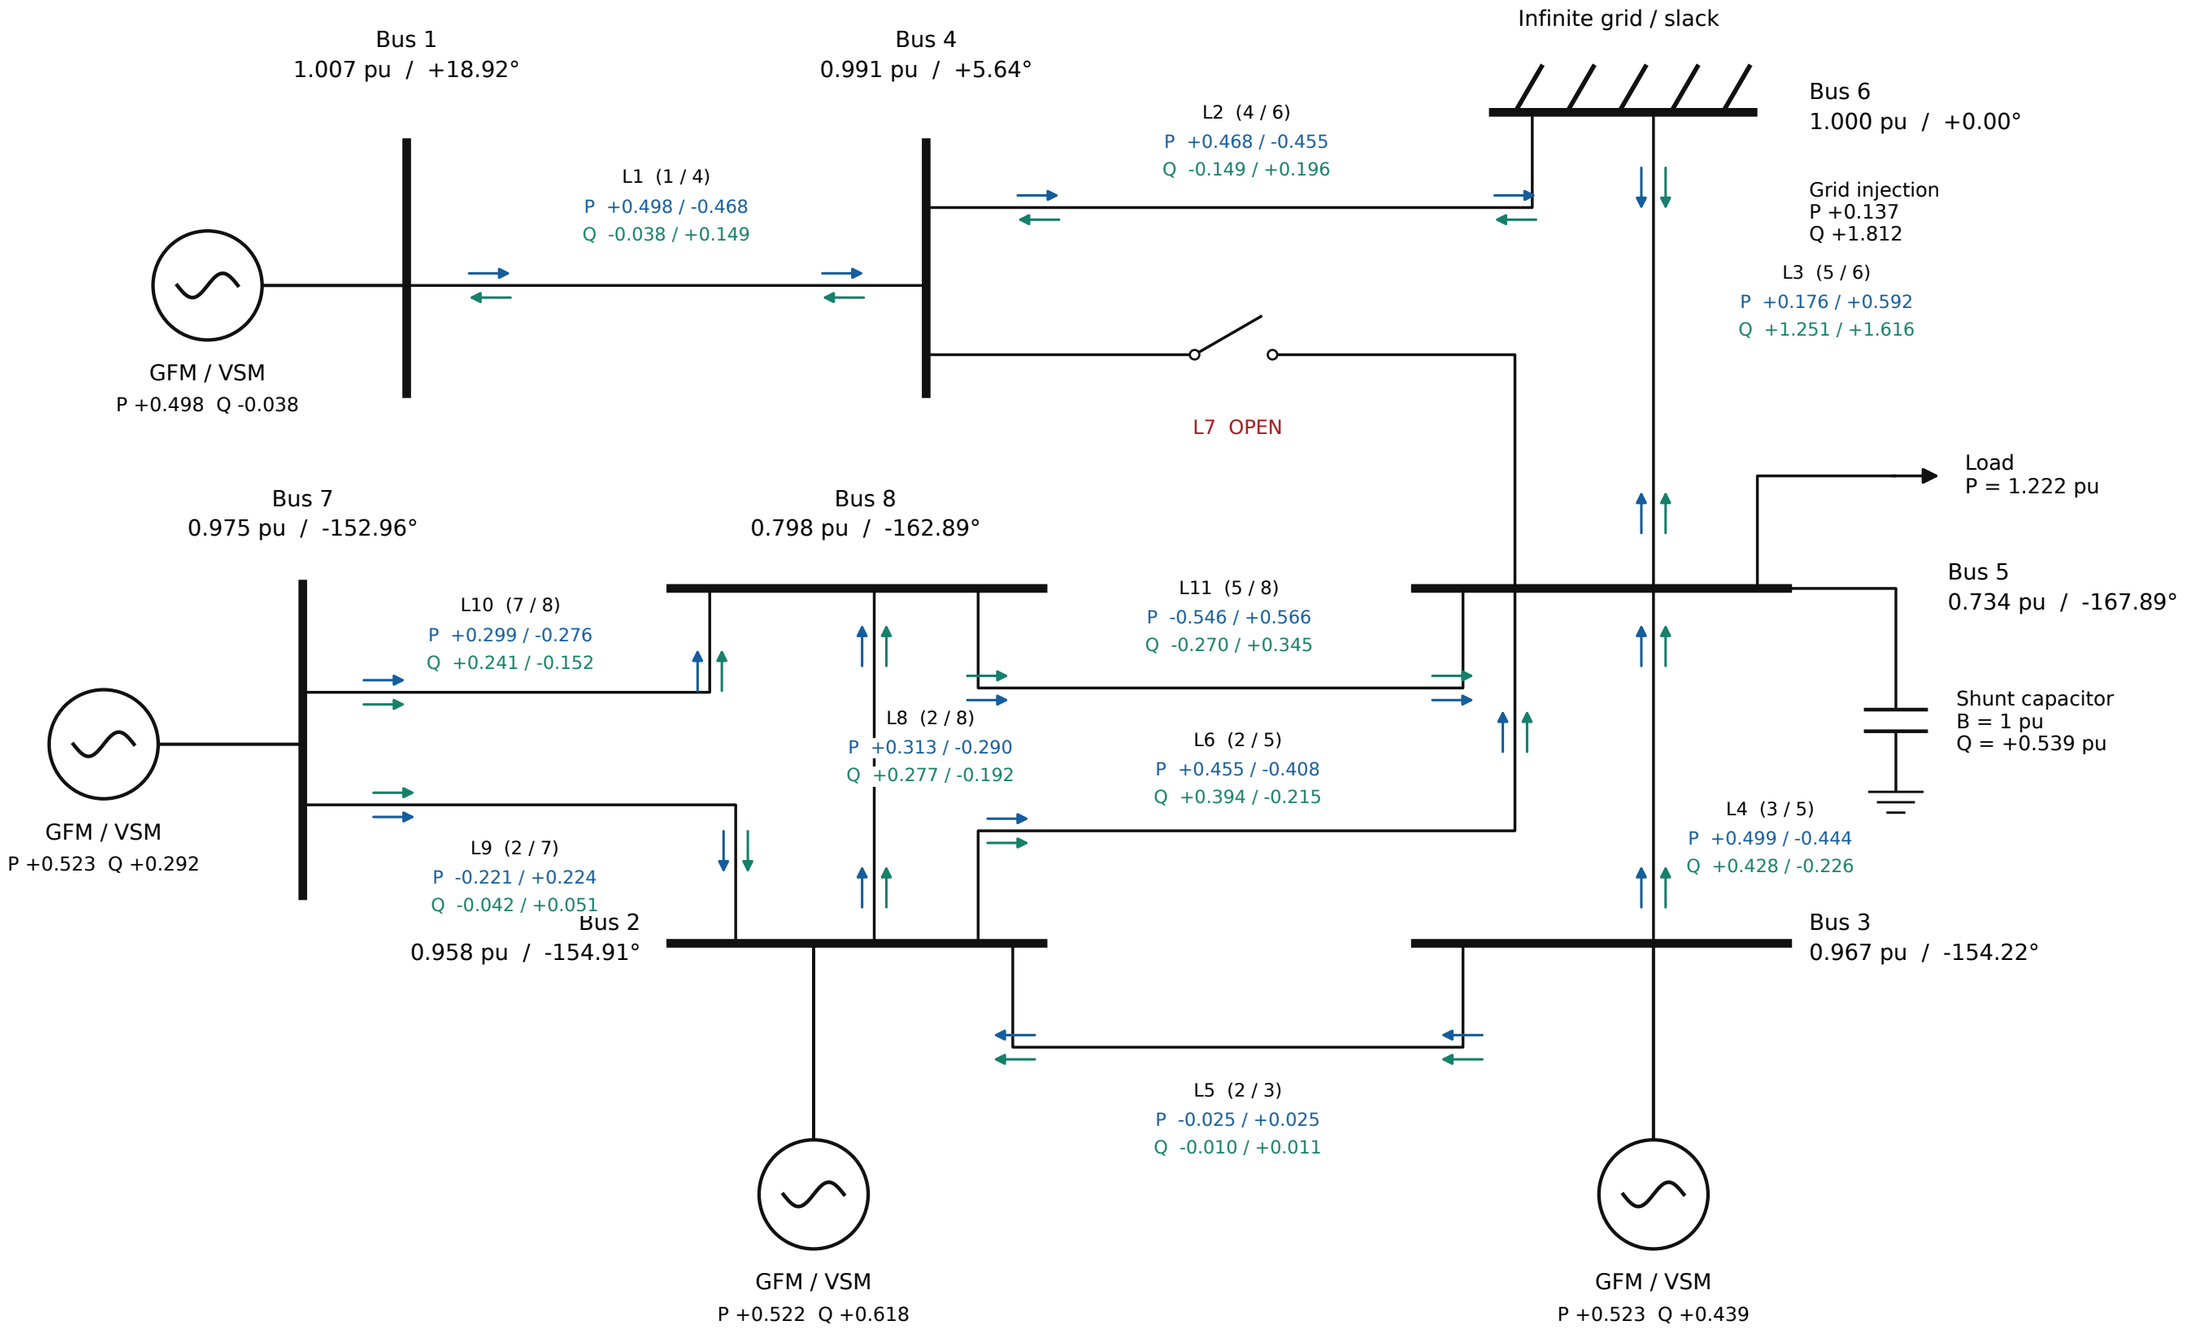

P: blue arrows Q: green arrows Line labels (a / b): signed power from each bus into the line [pu].

Two positive terminal Q values mean reactive absorption along the line. Device P/Q: positive injection into the network.

GFM 2.066 + grid +0.137 = load 1.222 + fault 0.000 + line losses 0.981 pu