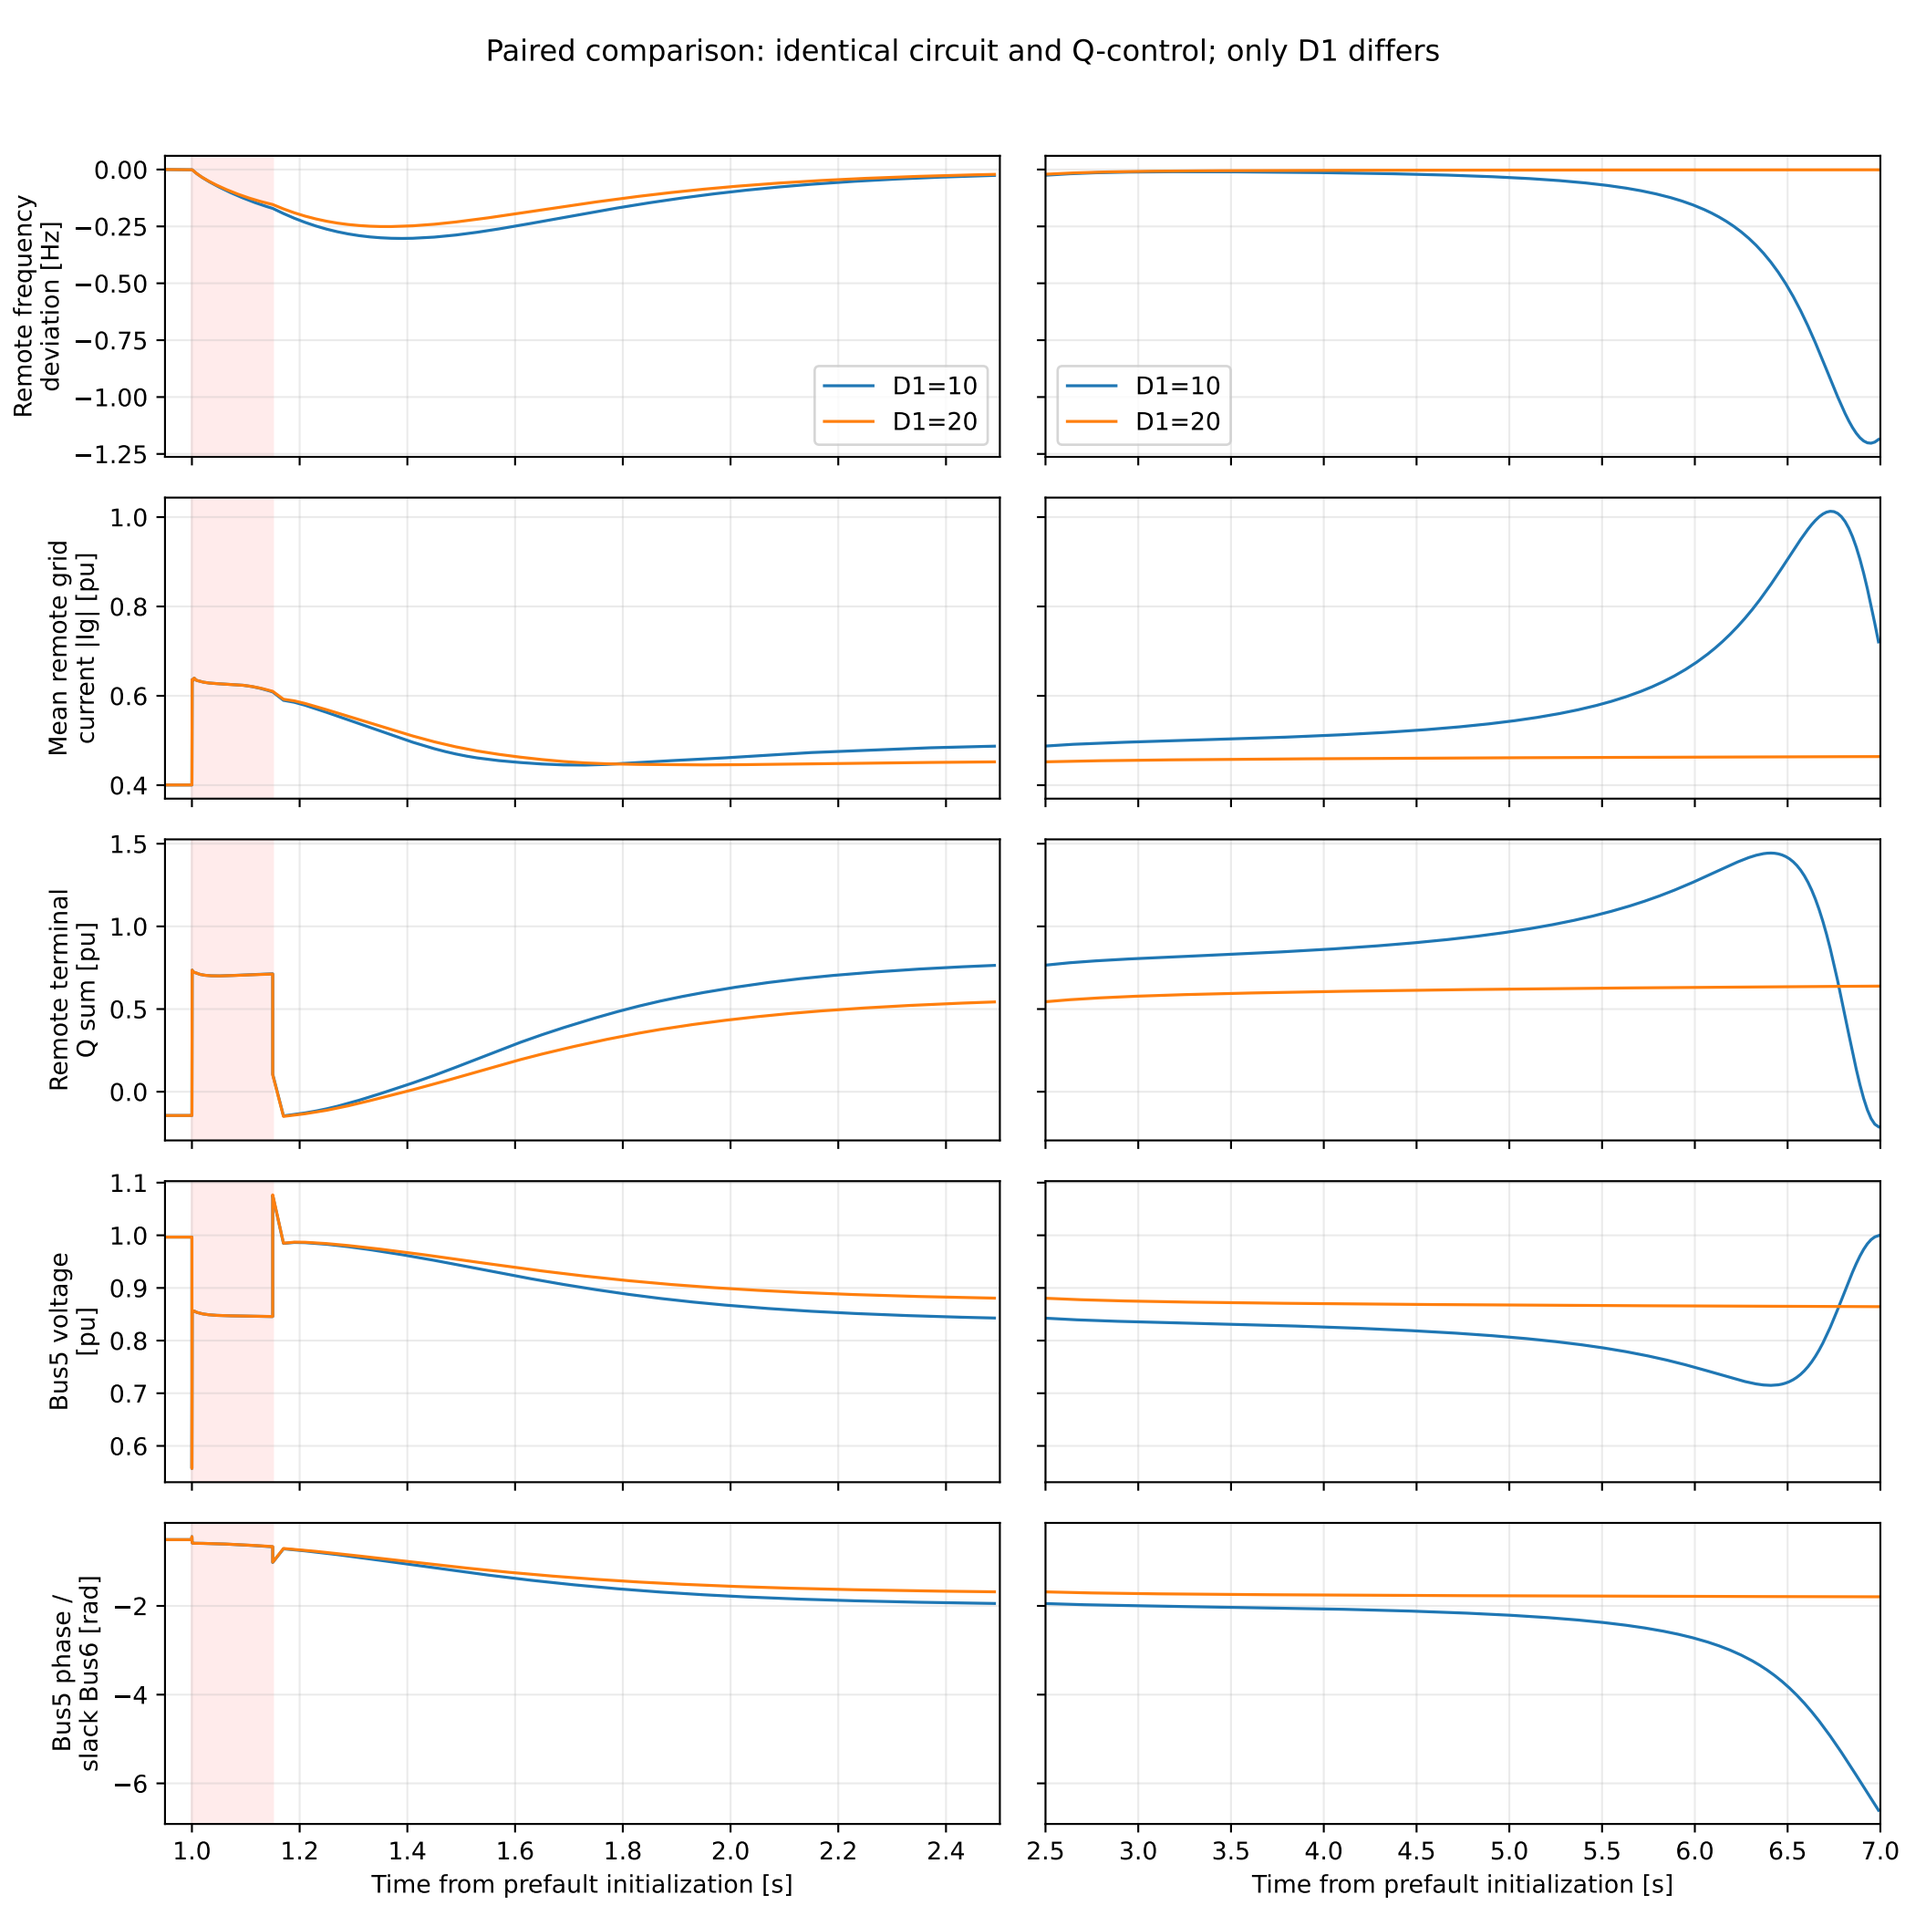
Paired comparison: identical circuit and Q-control; only D1 differs
Remote frequency deviation [Hz]
Mean remote grid current |Ig| [pu]
Remote terminal Q sum [pu]
Bus5 voltage [pu]
Bus5 phase / slack Bus6 [rad]
D1=10
D1=20
Time from prefault initialization [s]
Time from prefault initialization [s]