Post-fault stable equilibrium

Equilibrium | H = 2.5 s, D₁ = 10, D₂ = 100 | Bus6 = 1 pu ∠0°

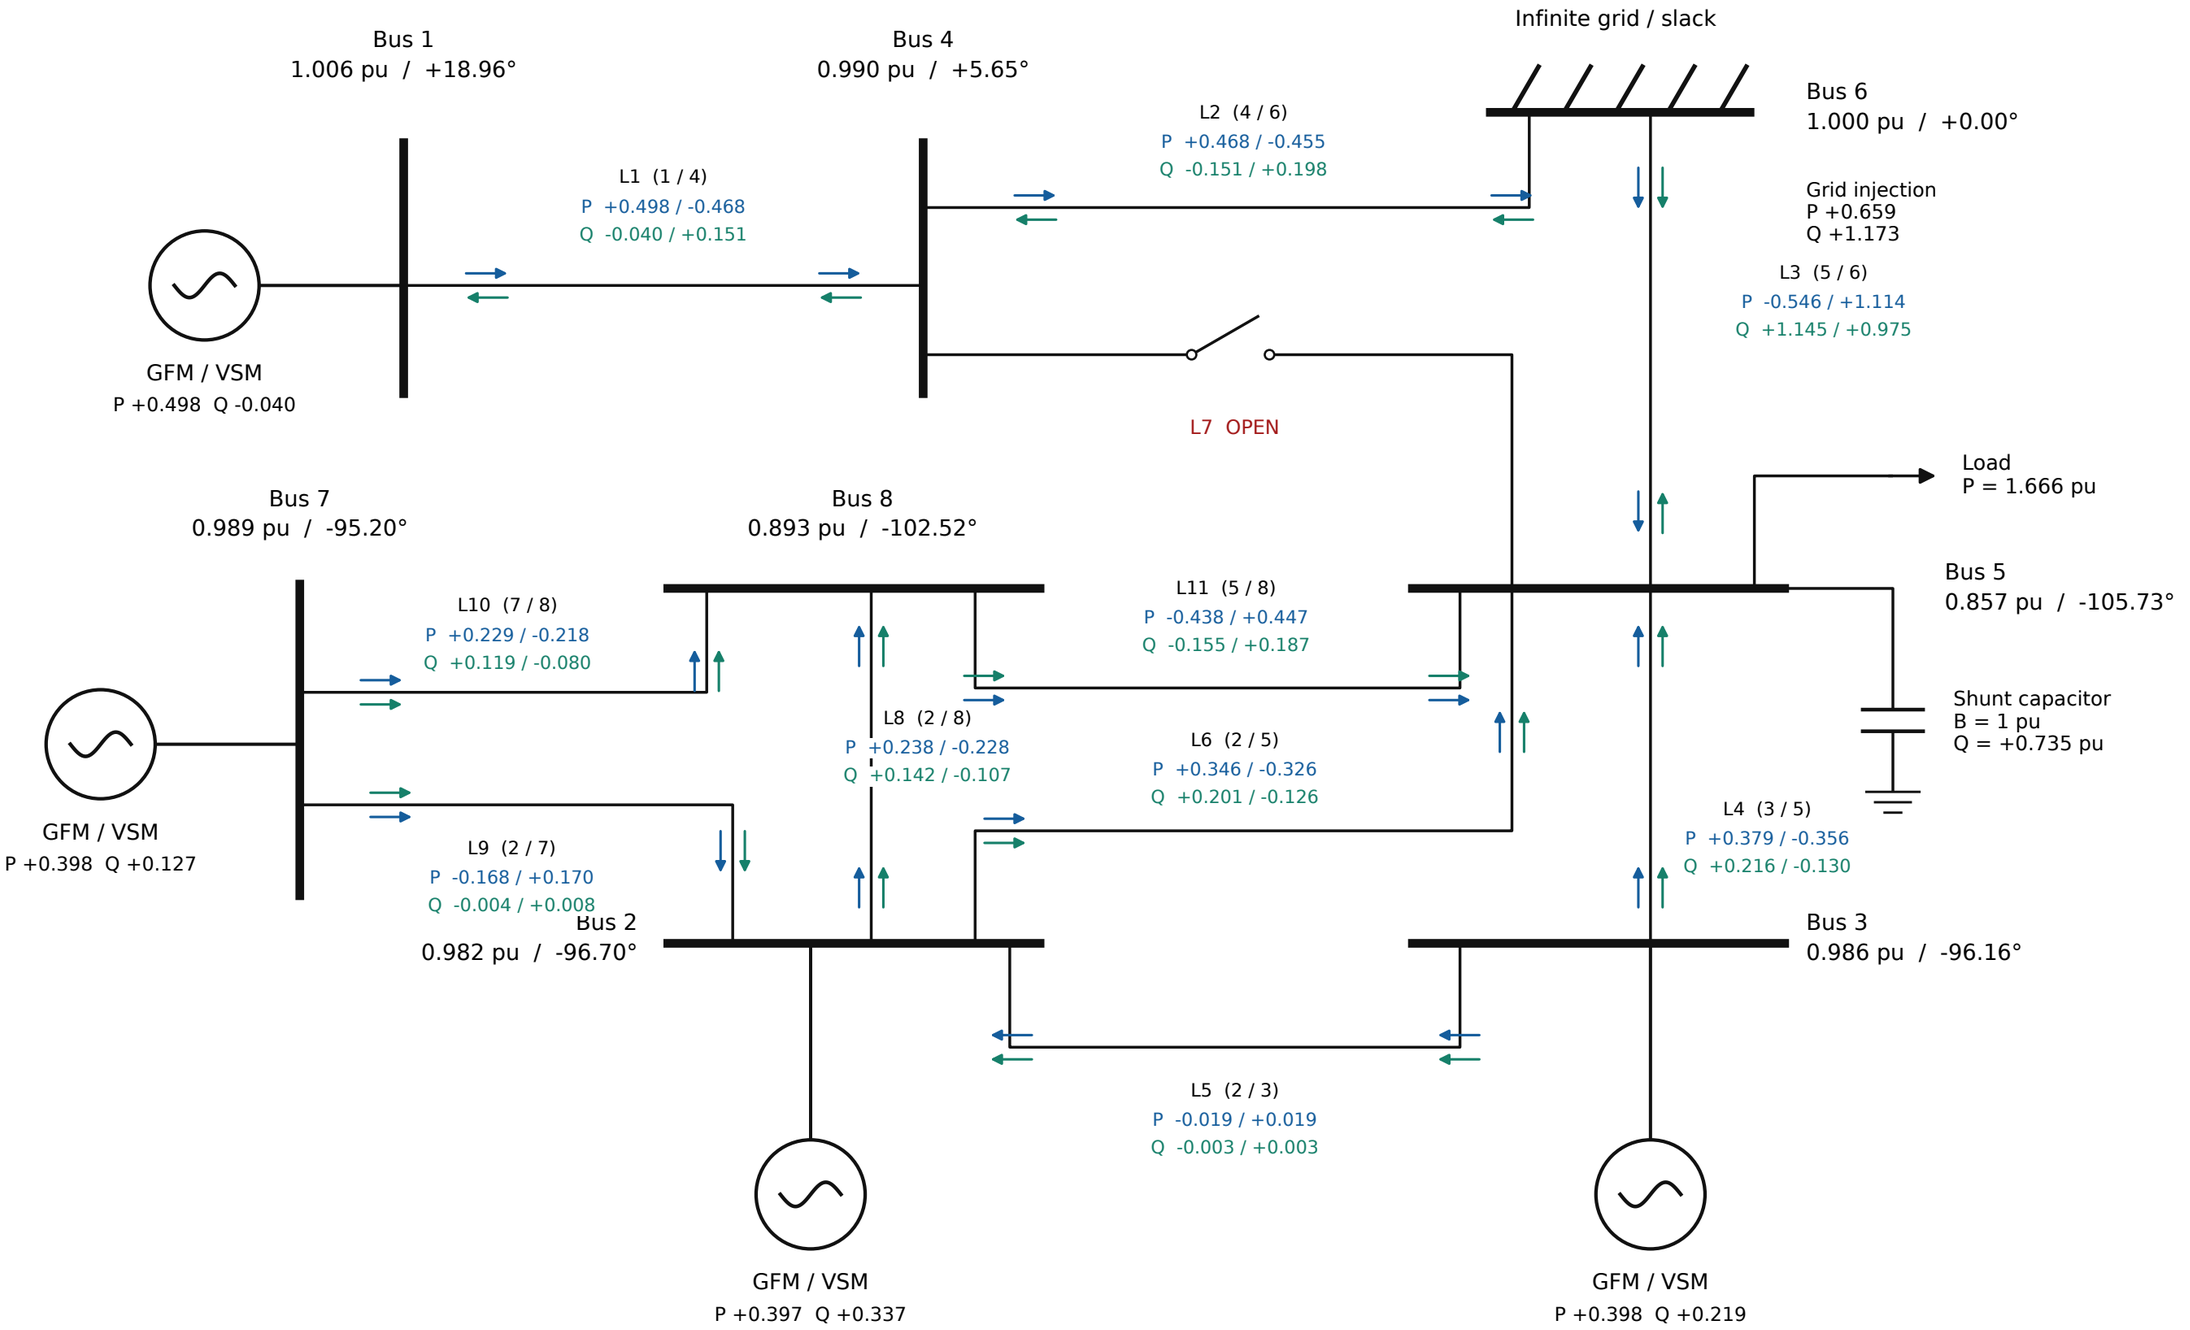

P: blue arrows Q: green arrows Line labels (a / b): signed power from each bus into the line [pu].

Two positive terminal Q values mean reactive absorption along the line. Device P/Q: positive injection into the network.

GFM 1.691 + grid +0.659 = load 1.666 + fault 0.000 + line losses 0.683 pu