Bivariate Fit of inv_UA By cold_x

hot_flow_Lmin=3

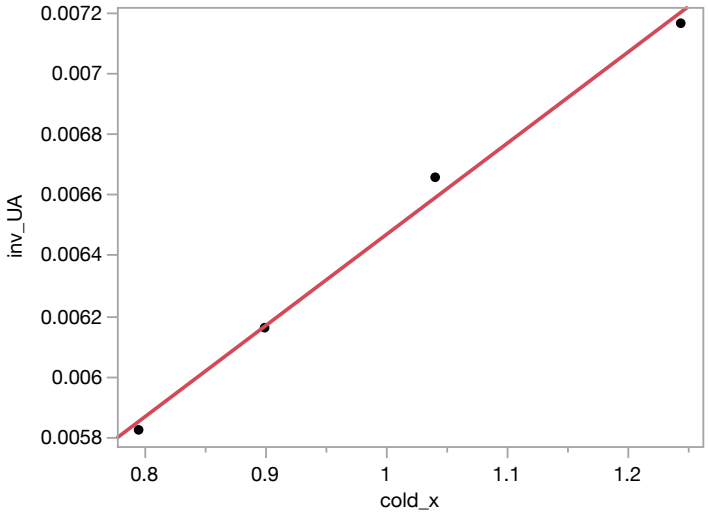

Linear Fit

Linear Fit

inv_UA = 0.0034563 + 0.0030078*cold_x

Summary of Fit

RSquare	0.993581
RSquare Adj	0.990371
Root Mean Square Error	5.756e-5
Mean of Response	0.006451
Observations (or Sum Wgts)	4

Analysis of Variance

Source	DF	Sum of Squares	Mean Square	F Ratio
Model	1	1.02569e-6	1.0257e-6	309.5609
Error	2	6.62677e-9	3.3134e-9	**Prob > F**
C. Total	3	1.03232e-6		0.0032*

Parameter Estimates

Term	Estimate	Std Error	t Ratio	Prob>|t|
Intercept	0.0034563	0.000173	20.03	0.0025*
cold_x	0.0030078	0.000171	17.59	0.0032*

Bivariate Fit of inv_UA By cold_x

hot_flow_Lmin=4

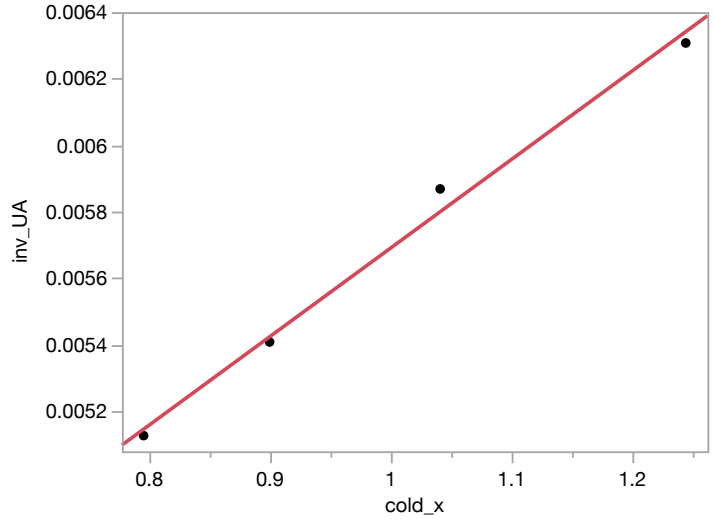

Linear Fit

Linear Fit

inv_UA = 0.0030302 + 0.0026597*cold_x

Summary of Fit

RSquare	0.991991
RSquare Adj	0.987987
Root Mean Square Error	5.69e-5
Mean of Response	0.005678
Observations (or Sum Wgts)	4

Analysis of Variance

Source	DF	Sum of Squares	Mean Square	F Ratio
Model	1	8.01976e-7	8.0198e-7	247.7264
Error	2	6.47469e-9	3.2373e-9	Prob > F
C. Total	3	8.0845e-7		0.0040*

Parameter Estimates

Term	Estimate	Std Error	t Ratio	Prob>|t|
Intercept	0.0030302	0.000171	17.76	0.0032*
cold_x	0.0026597	0.000169	15.74	0.0040*

Bivariate Fit of inv_UA By cold_x

hot_flow_Lmin=5

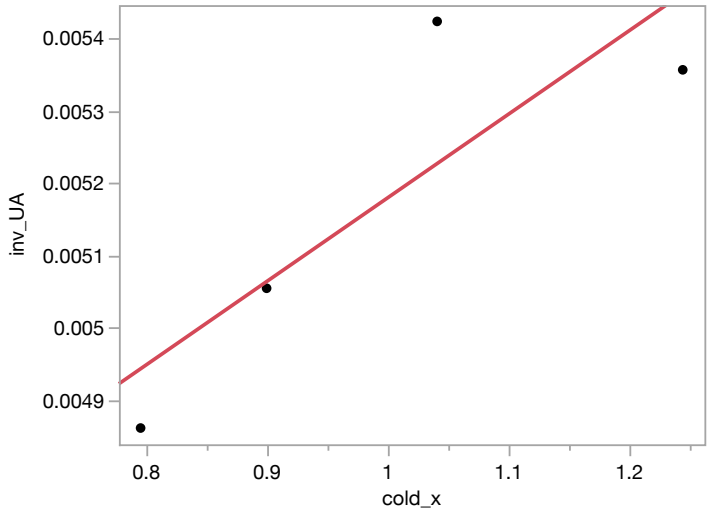

Linear Fit

Linear Fit

inv_UA = 0.0040261 + 0.0011532*cold_x

Summary of Fit

RSquare	0.727704
RSquare Adj	0.591556
Root Mean Square Error	0.000168
Mean of Response	0.005174
Observations (or Sum Wgts)	4

Analysis of Variance

Source	DF	Sum of Squares	Mean Square	F Ratio
Model	1	1.50767e-7	1.5077e-7	5.3449
Error	2	5.64149e-8	2.8207e-8	**Prob > F**
C. Total	3	2.07182e-7		0.1469

Parameter Estimates

Term	Estimate	Std Error	t Ratio	Prob>|t|
Intercept	0.0040261	0.000504	7.99	0.0153*
cold_x	0.0011532	0.000499	2.31	0.1469