


FAISALIYAH TANK FARM (MAIN SCADA BUILDING)



End User:

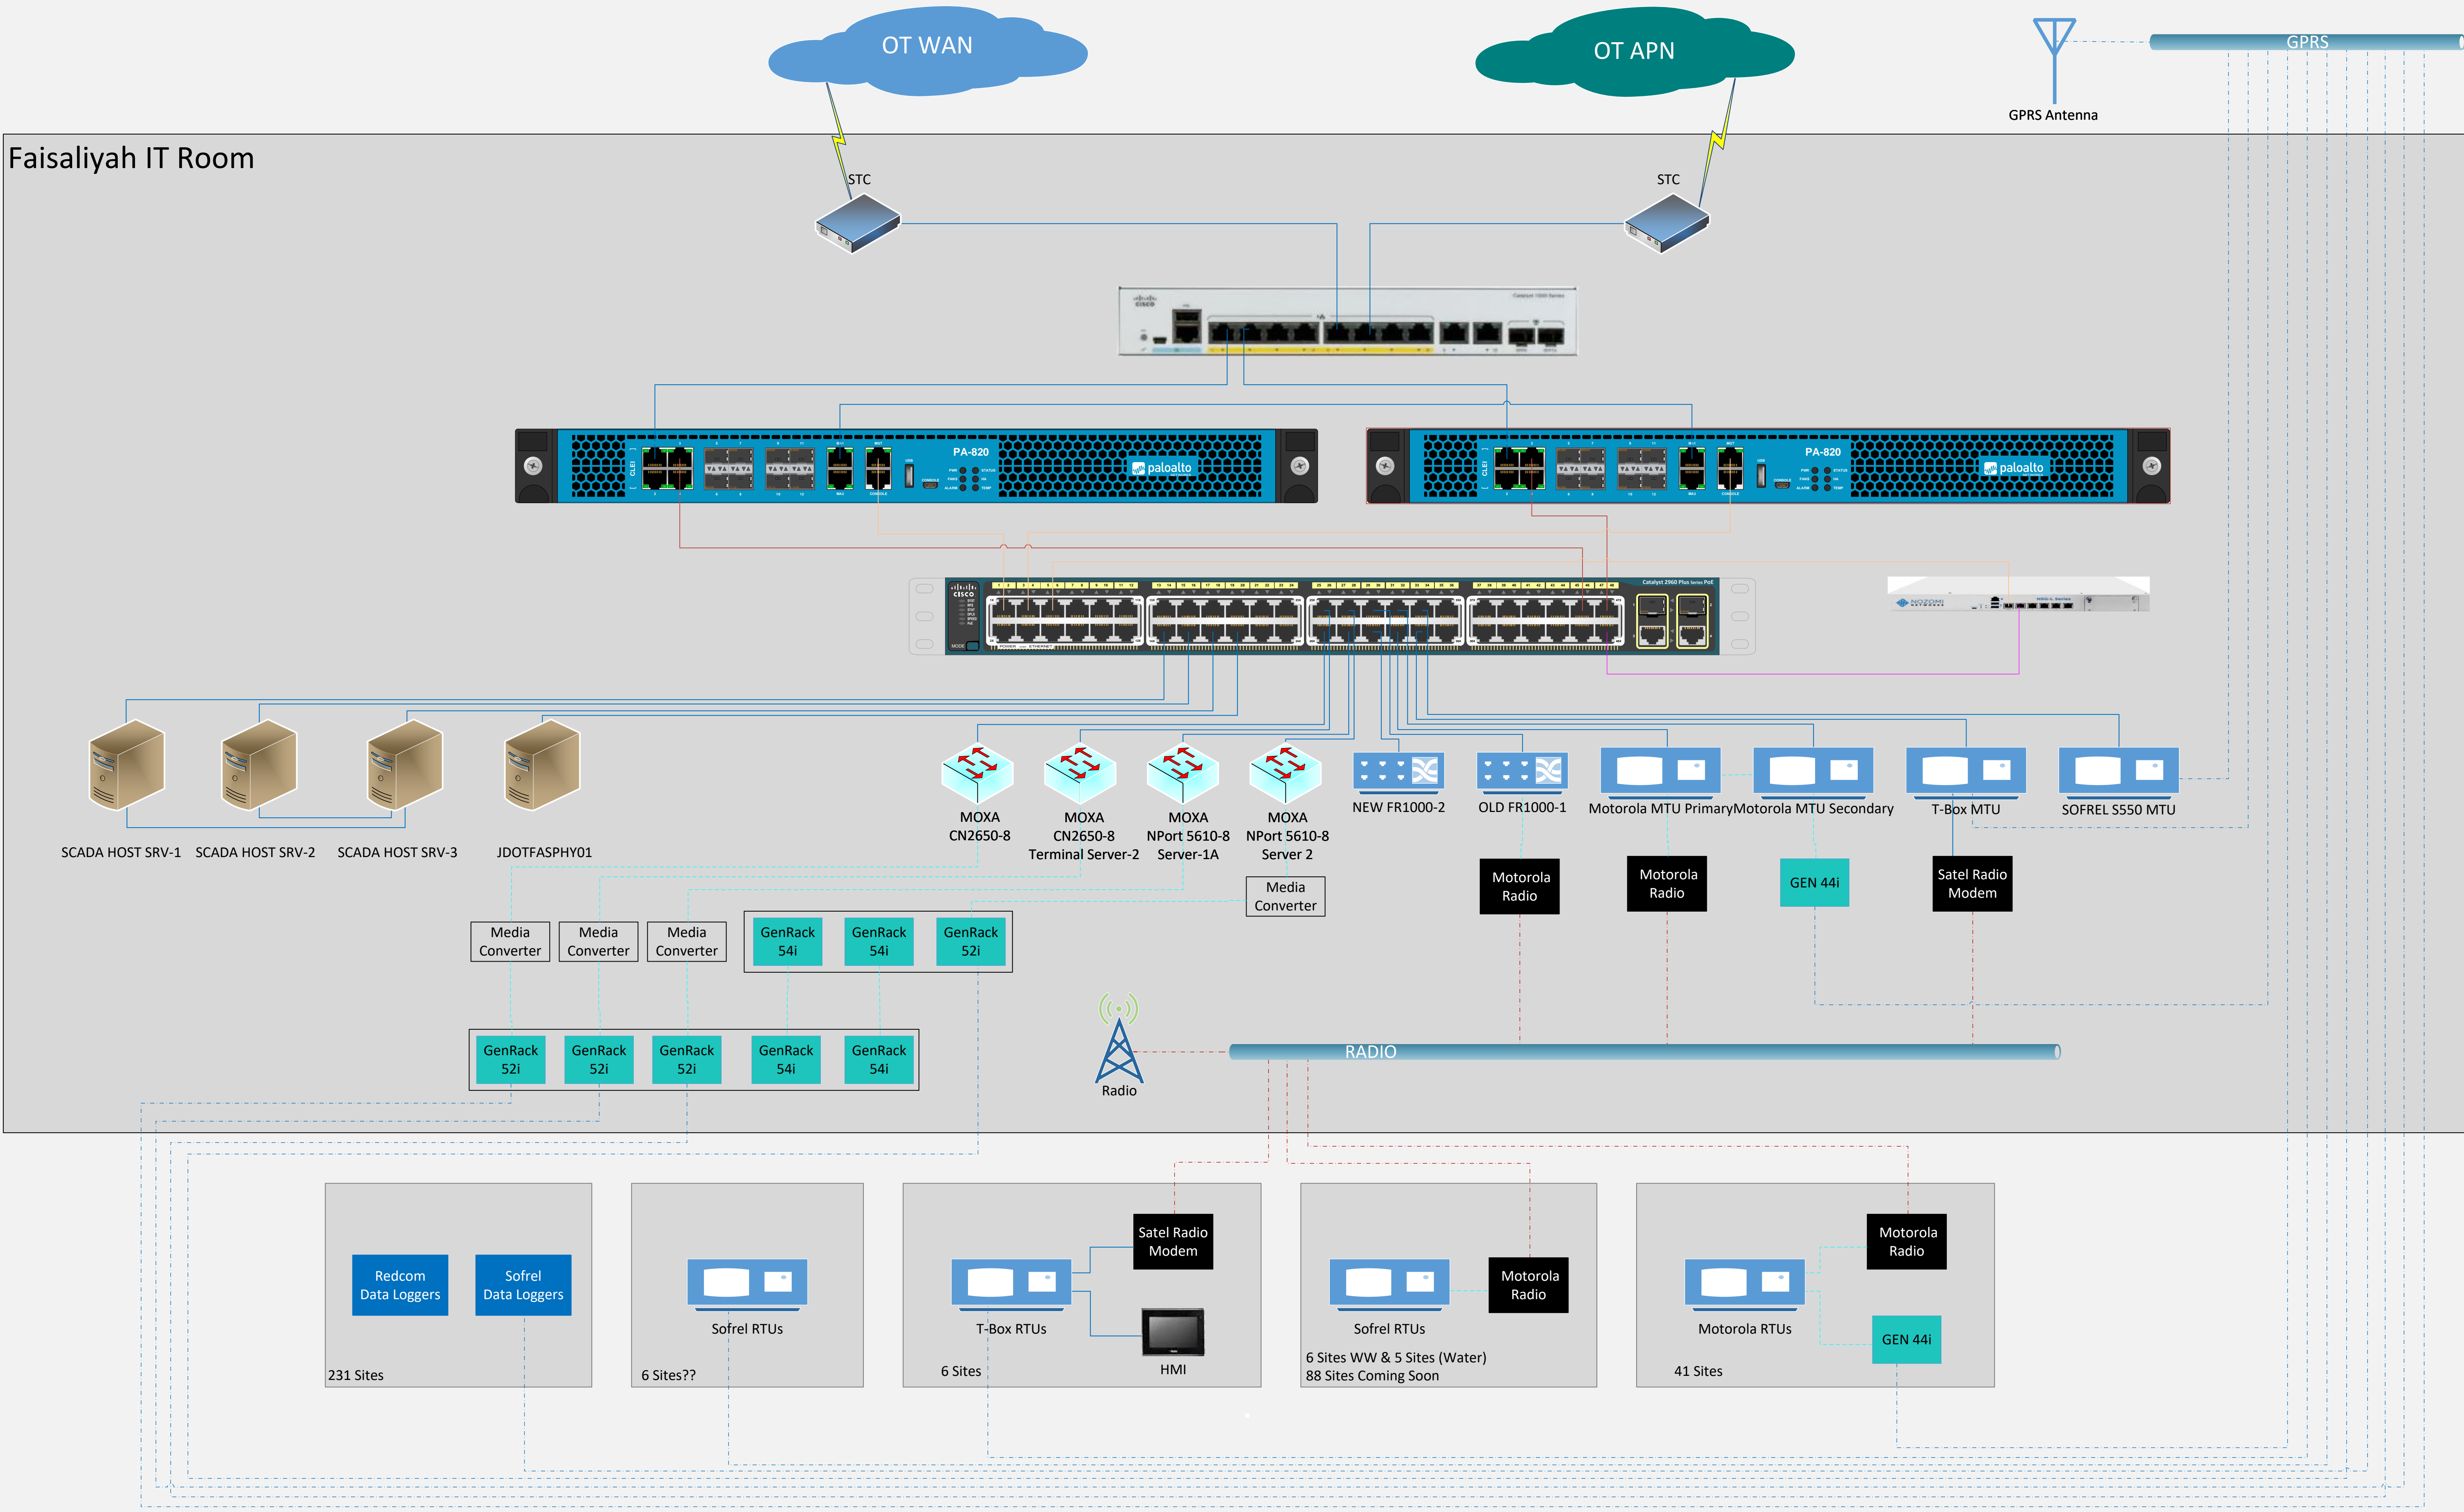


Developed By:



Notes:

1. The equipment shown is for representation only. The exact quantities will be determined during detailed design. The drawing shows existing equipment to show interfaces. Representation of equipment on this drawing does not imply scope of supply.
2. Refer to the document A01001045-HLD for description of design.
3. For all WAN/Cloud connections, telecom company MODEMs and routers have been omitted to reduce clutter.
4. For all LAN connections, the quantities and location of Ethernet switches is not shown to reduce clutter.

Legend:

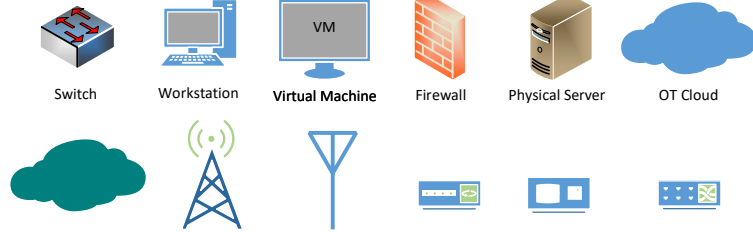

Ethernet	Management Link
APN Cloud Link	Redundant Link
SPAN Port	Redundant Link
CANOPEN Communication	Trunk Link
Fiber Link	Radio Link
Serial Communication	GPRS Link

REV	DATE	DESCRIPTION	PRPD	CHKD	APPD	PROJECT
0	18-Oct-21	Issued For Approval	UK/HMA	SK	MM	SCADA/OT Information Security Implementation
1	30-Nov-21	Issued For Approval	UK/HMA	SK	MM	DOC. # A01001045-JCBU-FAS-NA
2	23-Dec-21	Issued For Approval	UK/HMA	SK	MM	TITLE Faisaliyah Network Architecture
						REV. 2
						SCALE NTS
						SHEET 1 of 1