


AL ARJ SEWAGE TREATMENT PLANT

Main Control Room SCADA



End User:

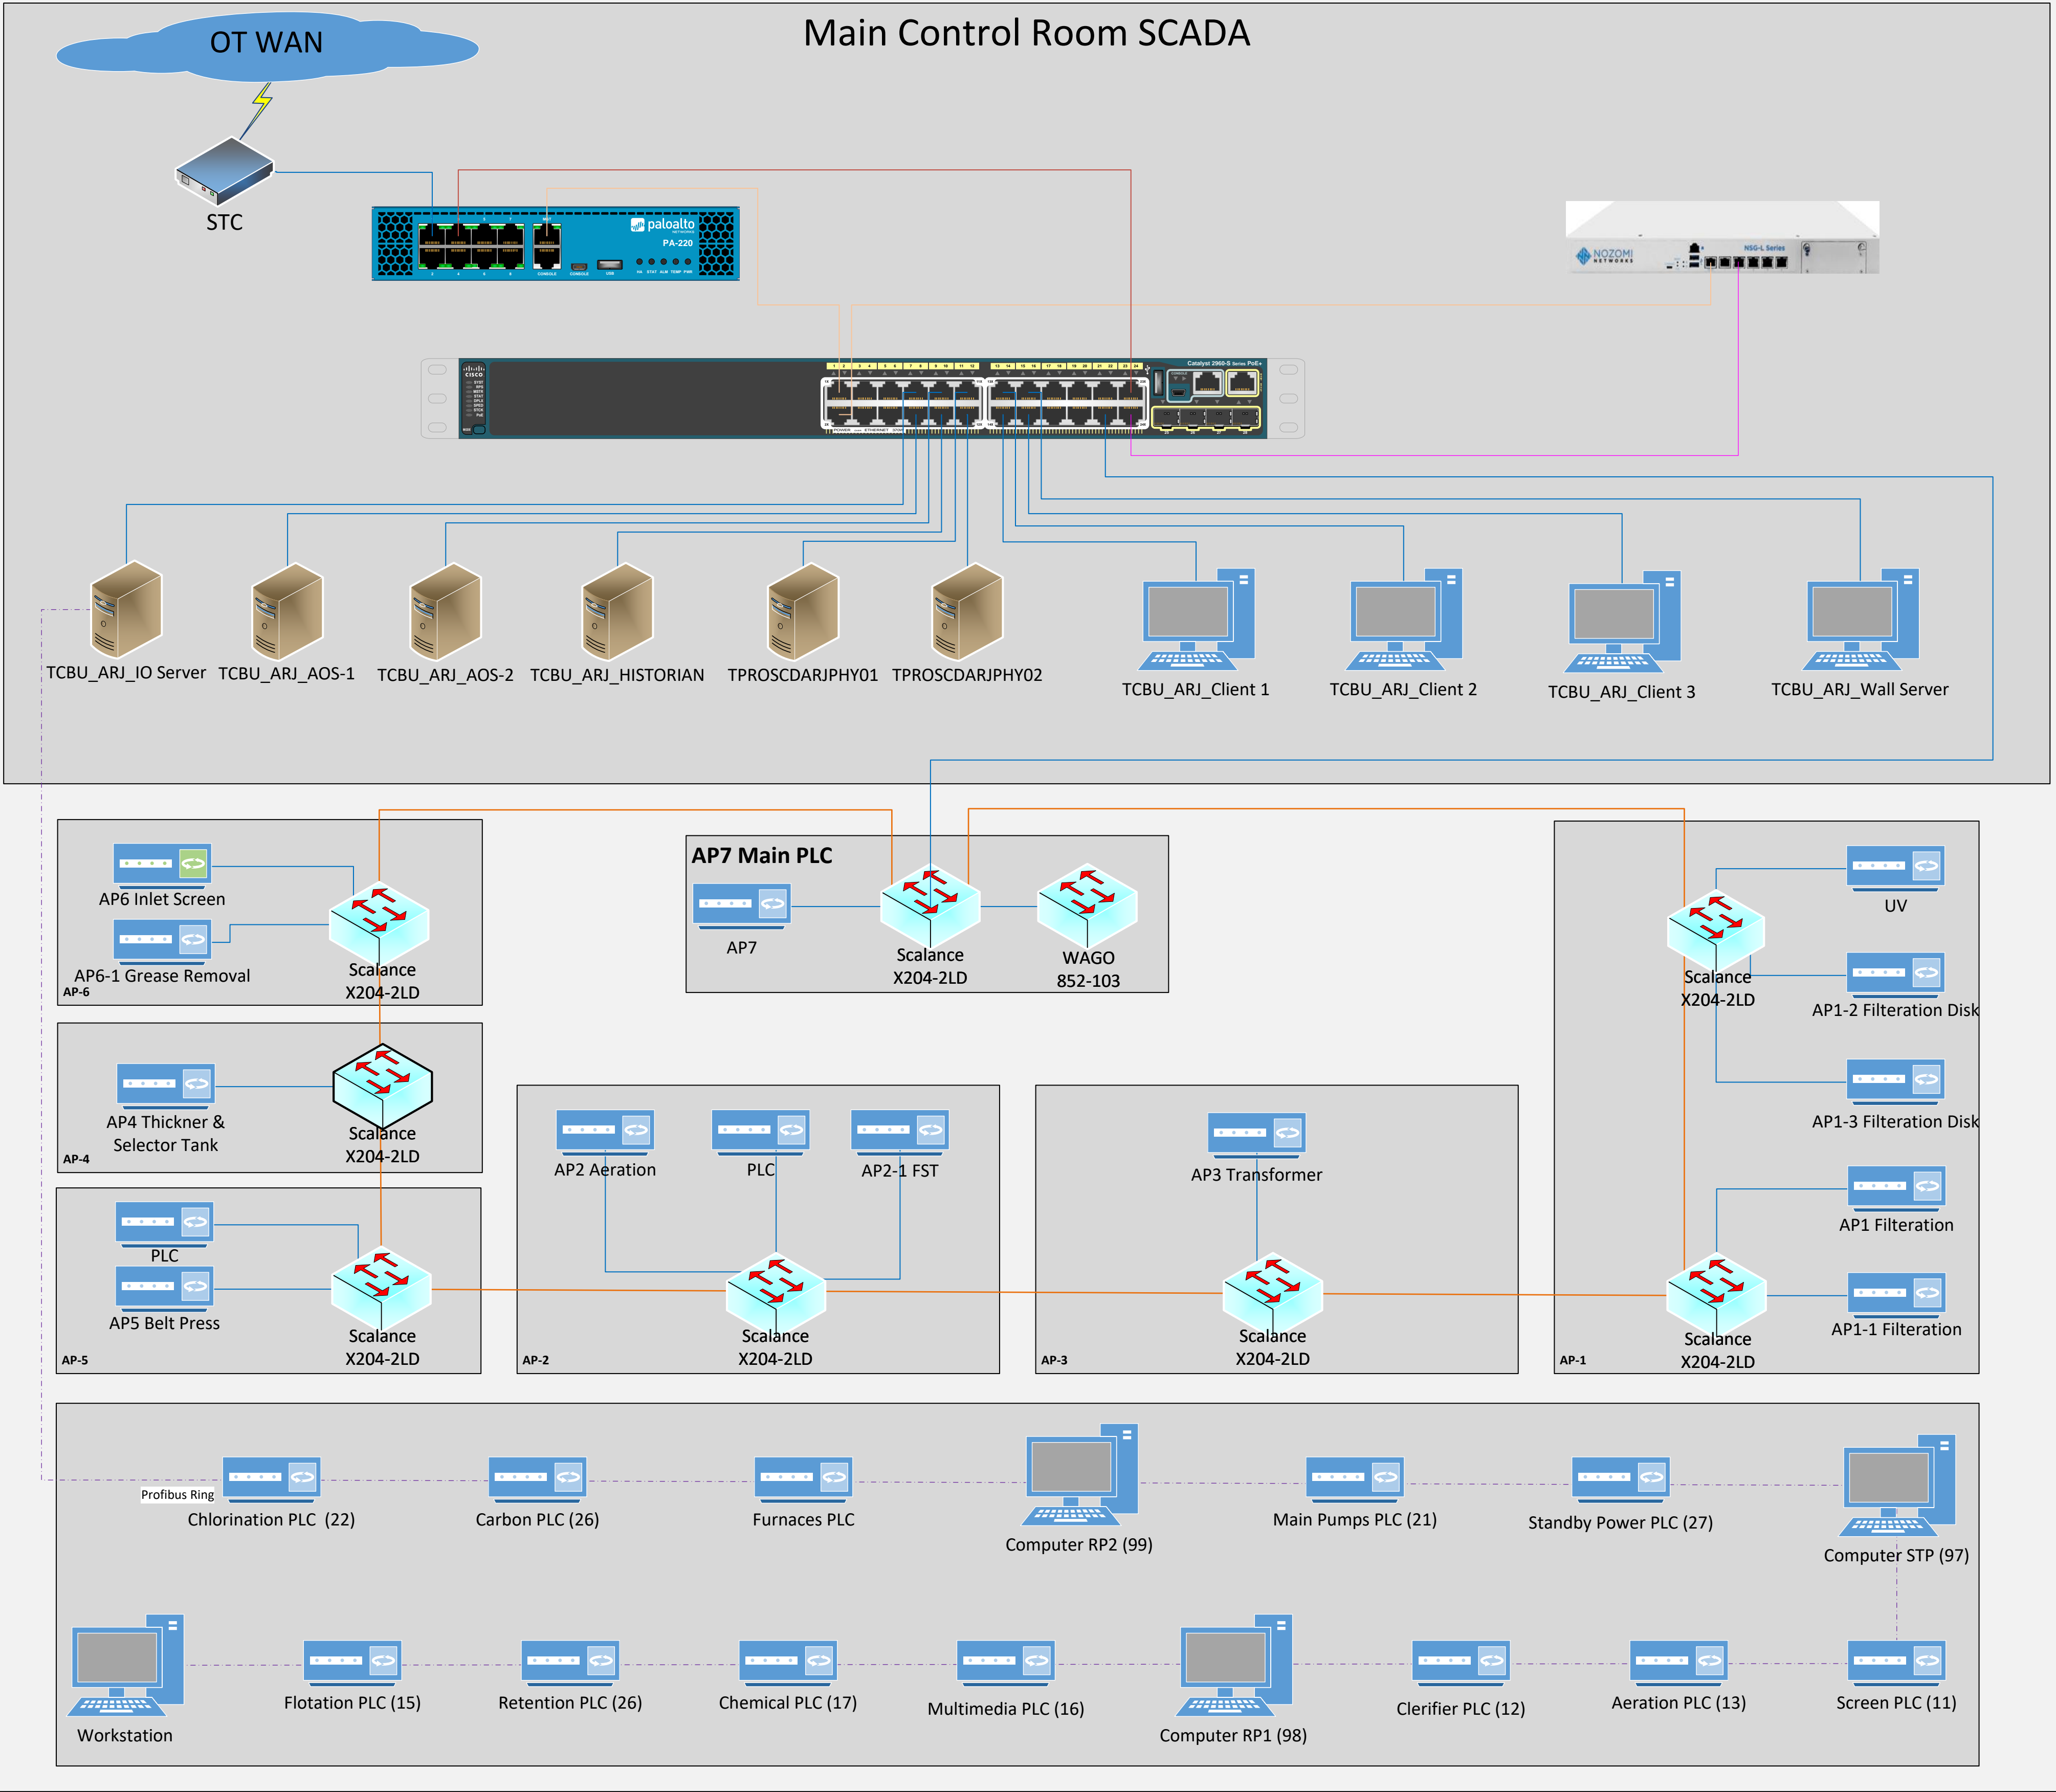


Developed By:



Notes:

1. The equipment shown is for representation only. The exact quantities will be determined during detailed design. The drawing shows proposed equipment to show interfaces. Representation of equipment on this drawing does not imply scope of supply.
2. Refer to the document A01001045-HLD for description of design.
3. For all WAN/Cloud connections, telecom company MODEMs and routers have been omitted to reduce clutter.
4. For all LAN connections, the quantities and location of Ethernet switches is not shown to reduce clutter.

Legend:

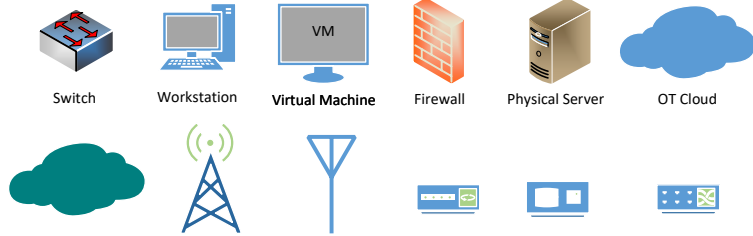

REV	DATE	DESCRIPTION	PRPD	CHKD	APPD
0	18-Oct-21	Issued for Approval	UK/HMA	SK	MM
1	18-Jan-22	Issued for Approval	HMA	SK	MM
2	31-Jan-22	Issued for Approval	HMA	SK	MM

PROJECT	SCADA/OT Information Security Implementation
DOC. #	A01001045-TCBU-ARJ-WWTP-NA
TITLE	Al-Araj WWTP Network Architecture
REV.	2
SCALE	NTS
SHEET	1 of 1