


Full-pairs eQTL restores colocalisation specificity at CR1 / APOE

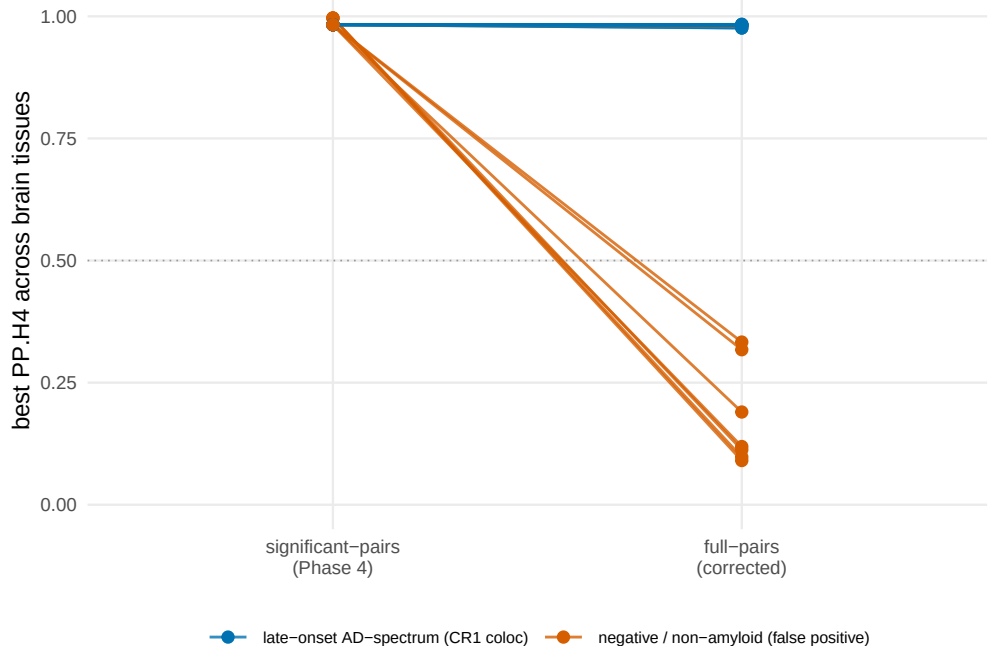

Each line a coloc-tested screening hit; significant-pairs + across-tissue max inflates all to ~0.98